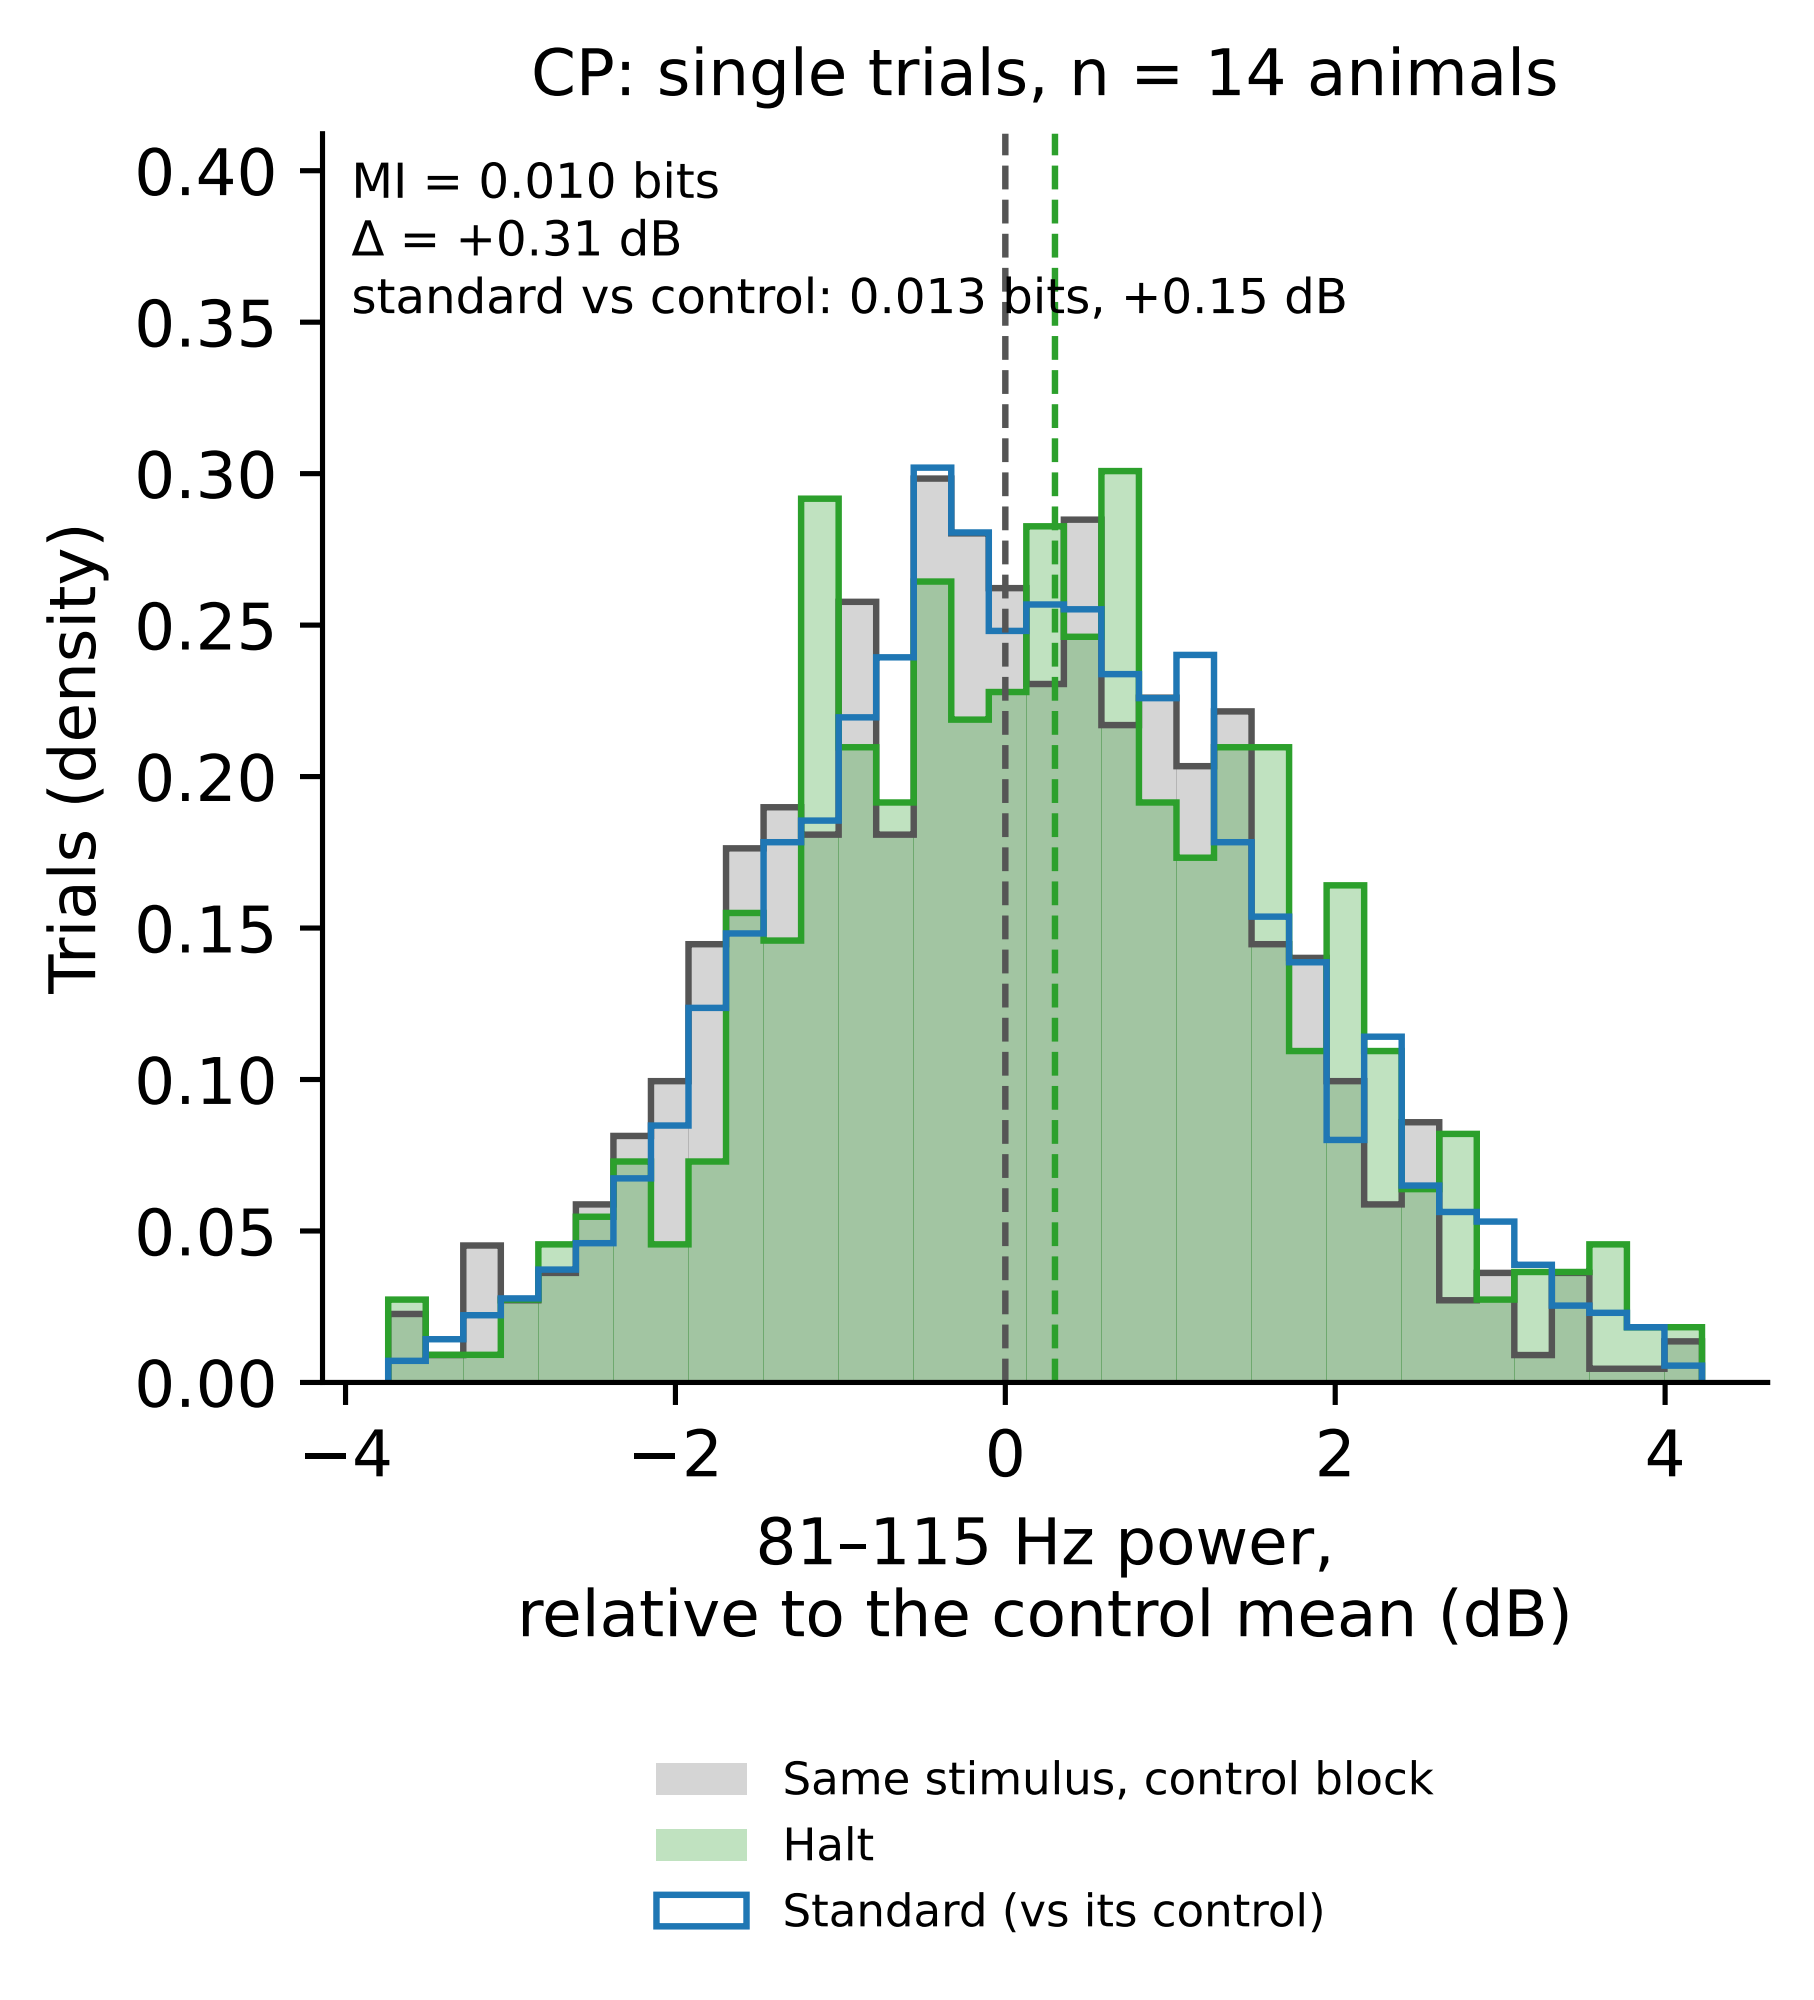
CP: single trials, n = 14 animals
MI = 0.010 bits
Δ = +0.31 dB
standard vs control: 0.013 bits, +0.15 dB
Trials (density)
0.40
0.35
0.30
0.25
0.20
0.15
0.10
0.05
0.00
−4
−2
0
2
4
81–115 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Halt
Standard (vs its control)