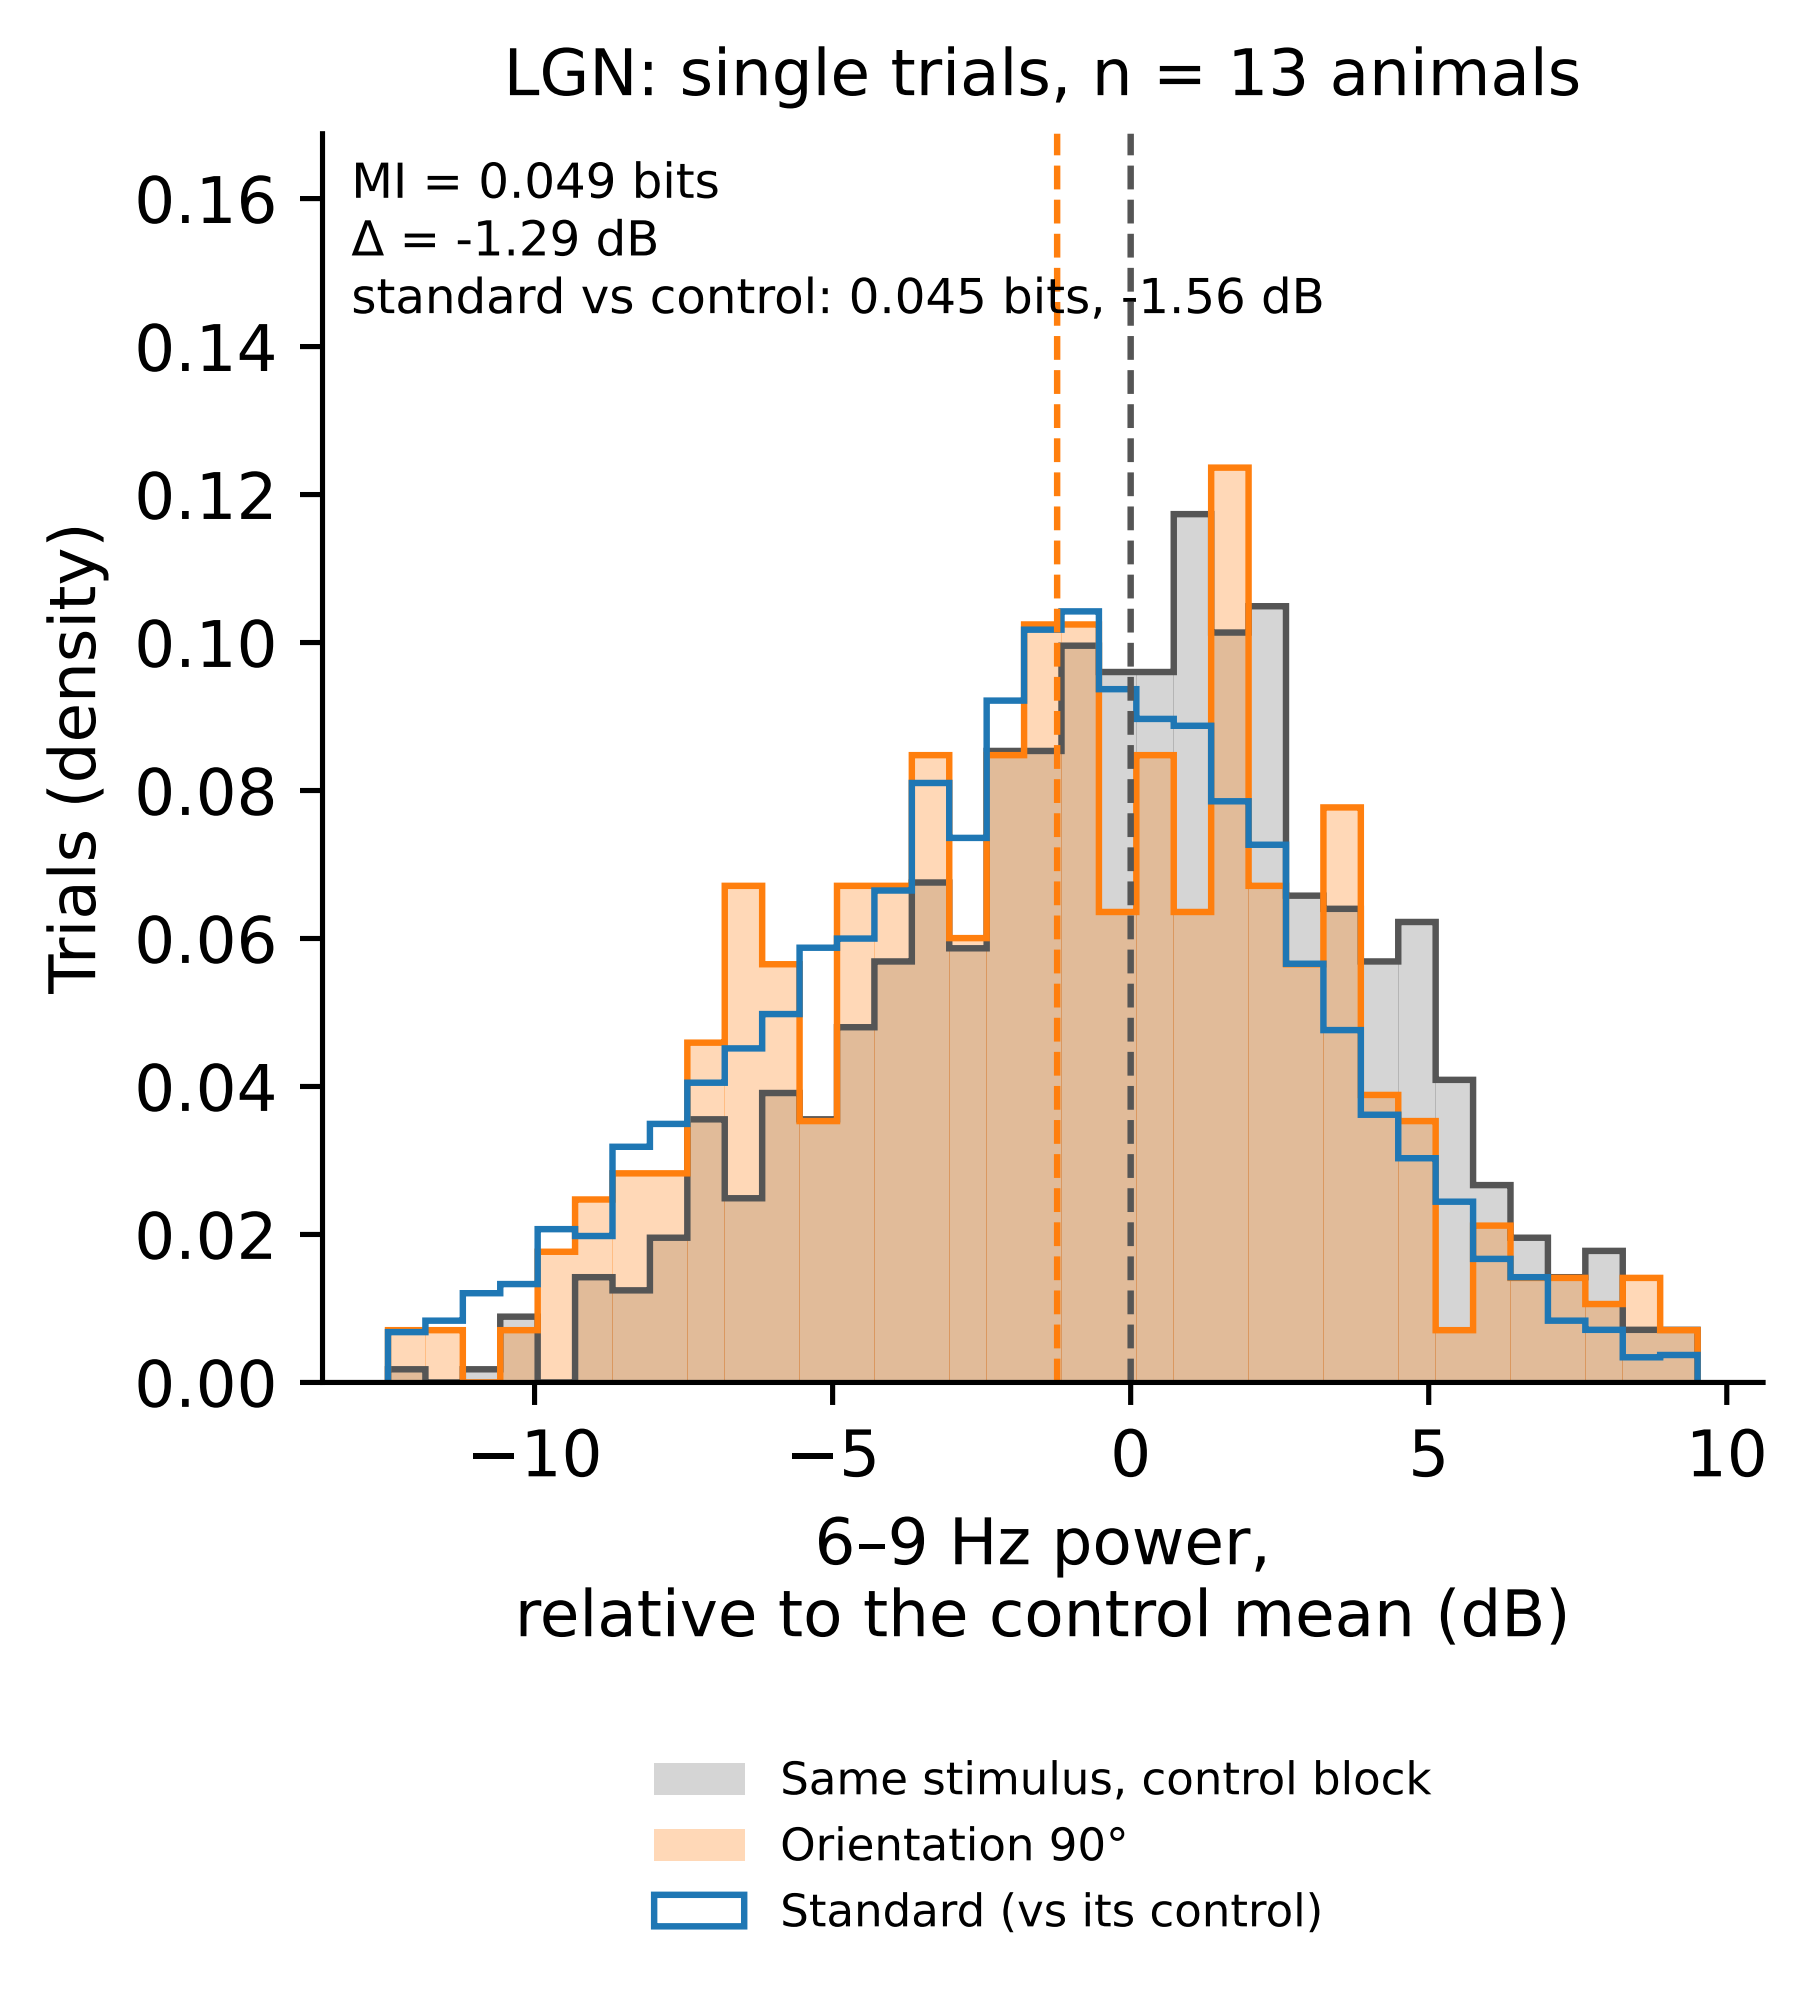
LGN: single trials, n = 13 animals
MI = 0.049 bits
Δ = -1.29 dB
standard vs control: 0.045 bits, -1.56 dB
Trials (density)
0.16
0.14
0.12
0.10
0.08
0.06
0.04
0.02
0.00
−10
−5
0
5
10
6–9 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Orientation 90°
Standard (vs its control)