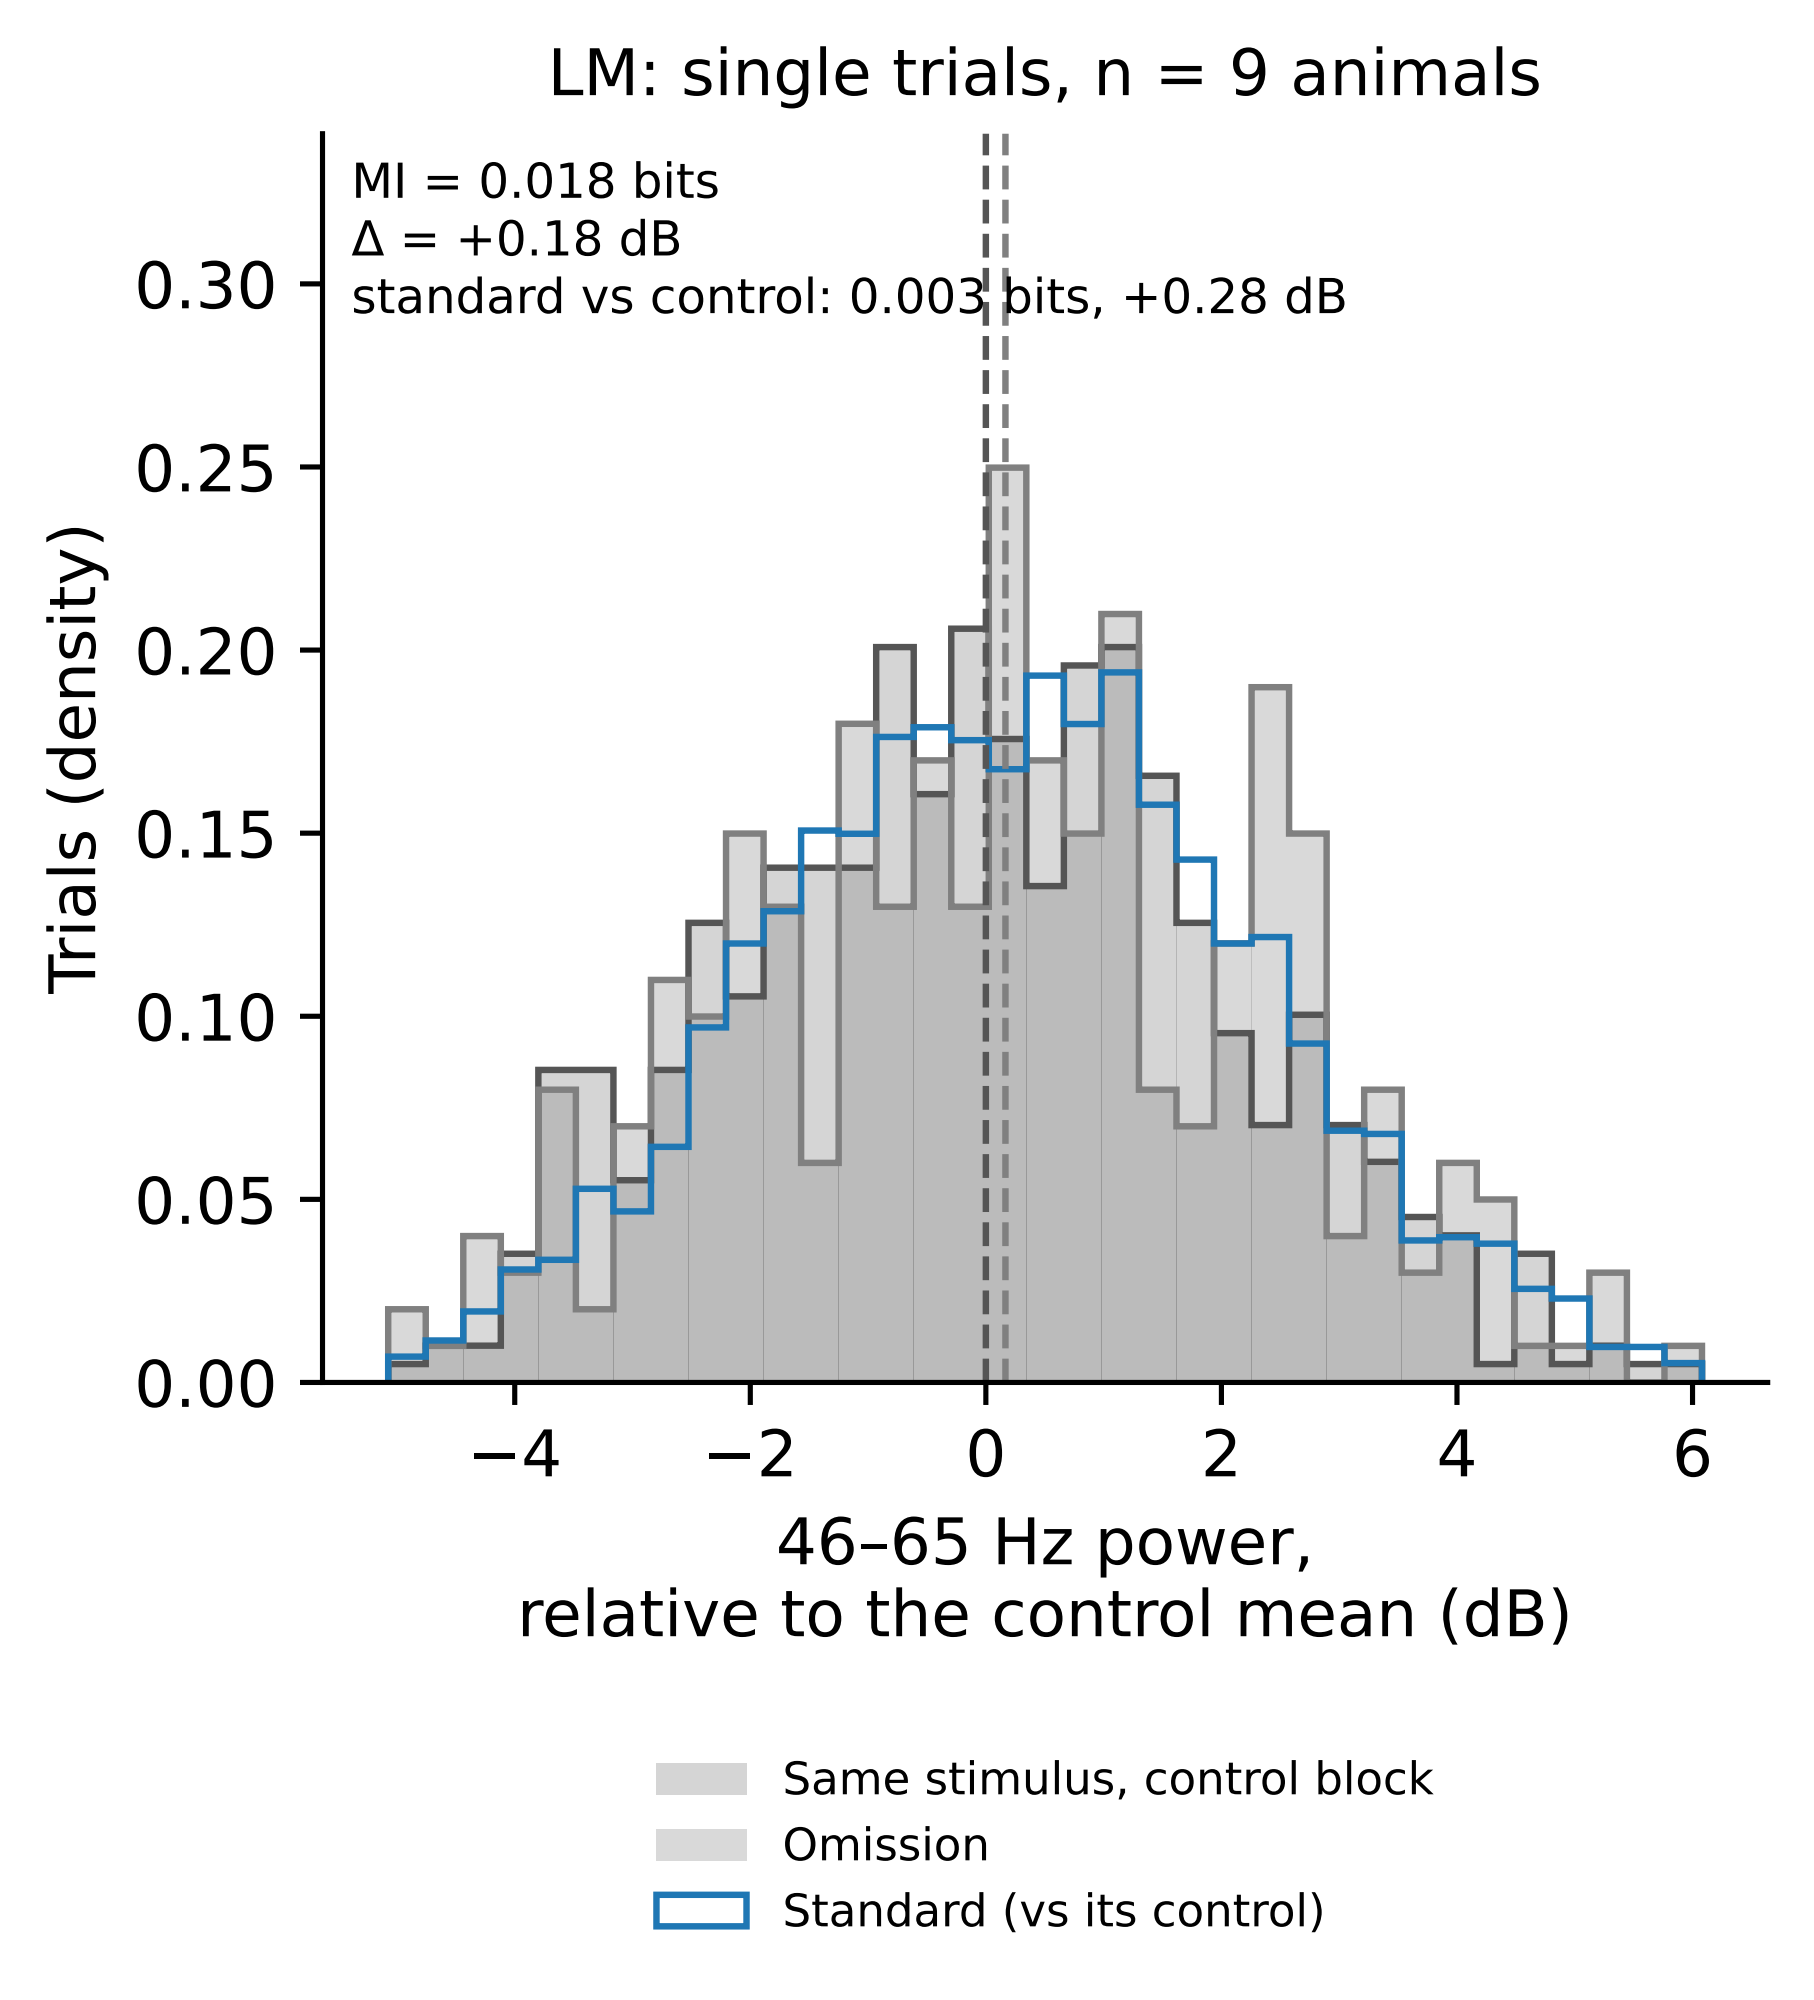
LM: single trials, n = 9 animals
MI = 0.018 bits
Δ = +0.18 dB
standard vs control: 0.003 bits, +0.28 dB
Trials (density)
0.00
0.05
0.10
0.15
0.20
0.25
0.30
−4
−2
0
2
4
6
46–65 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Omission
Standard (vs its control)