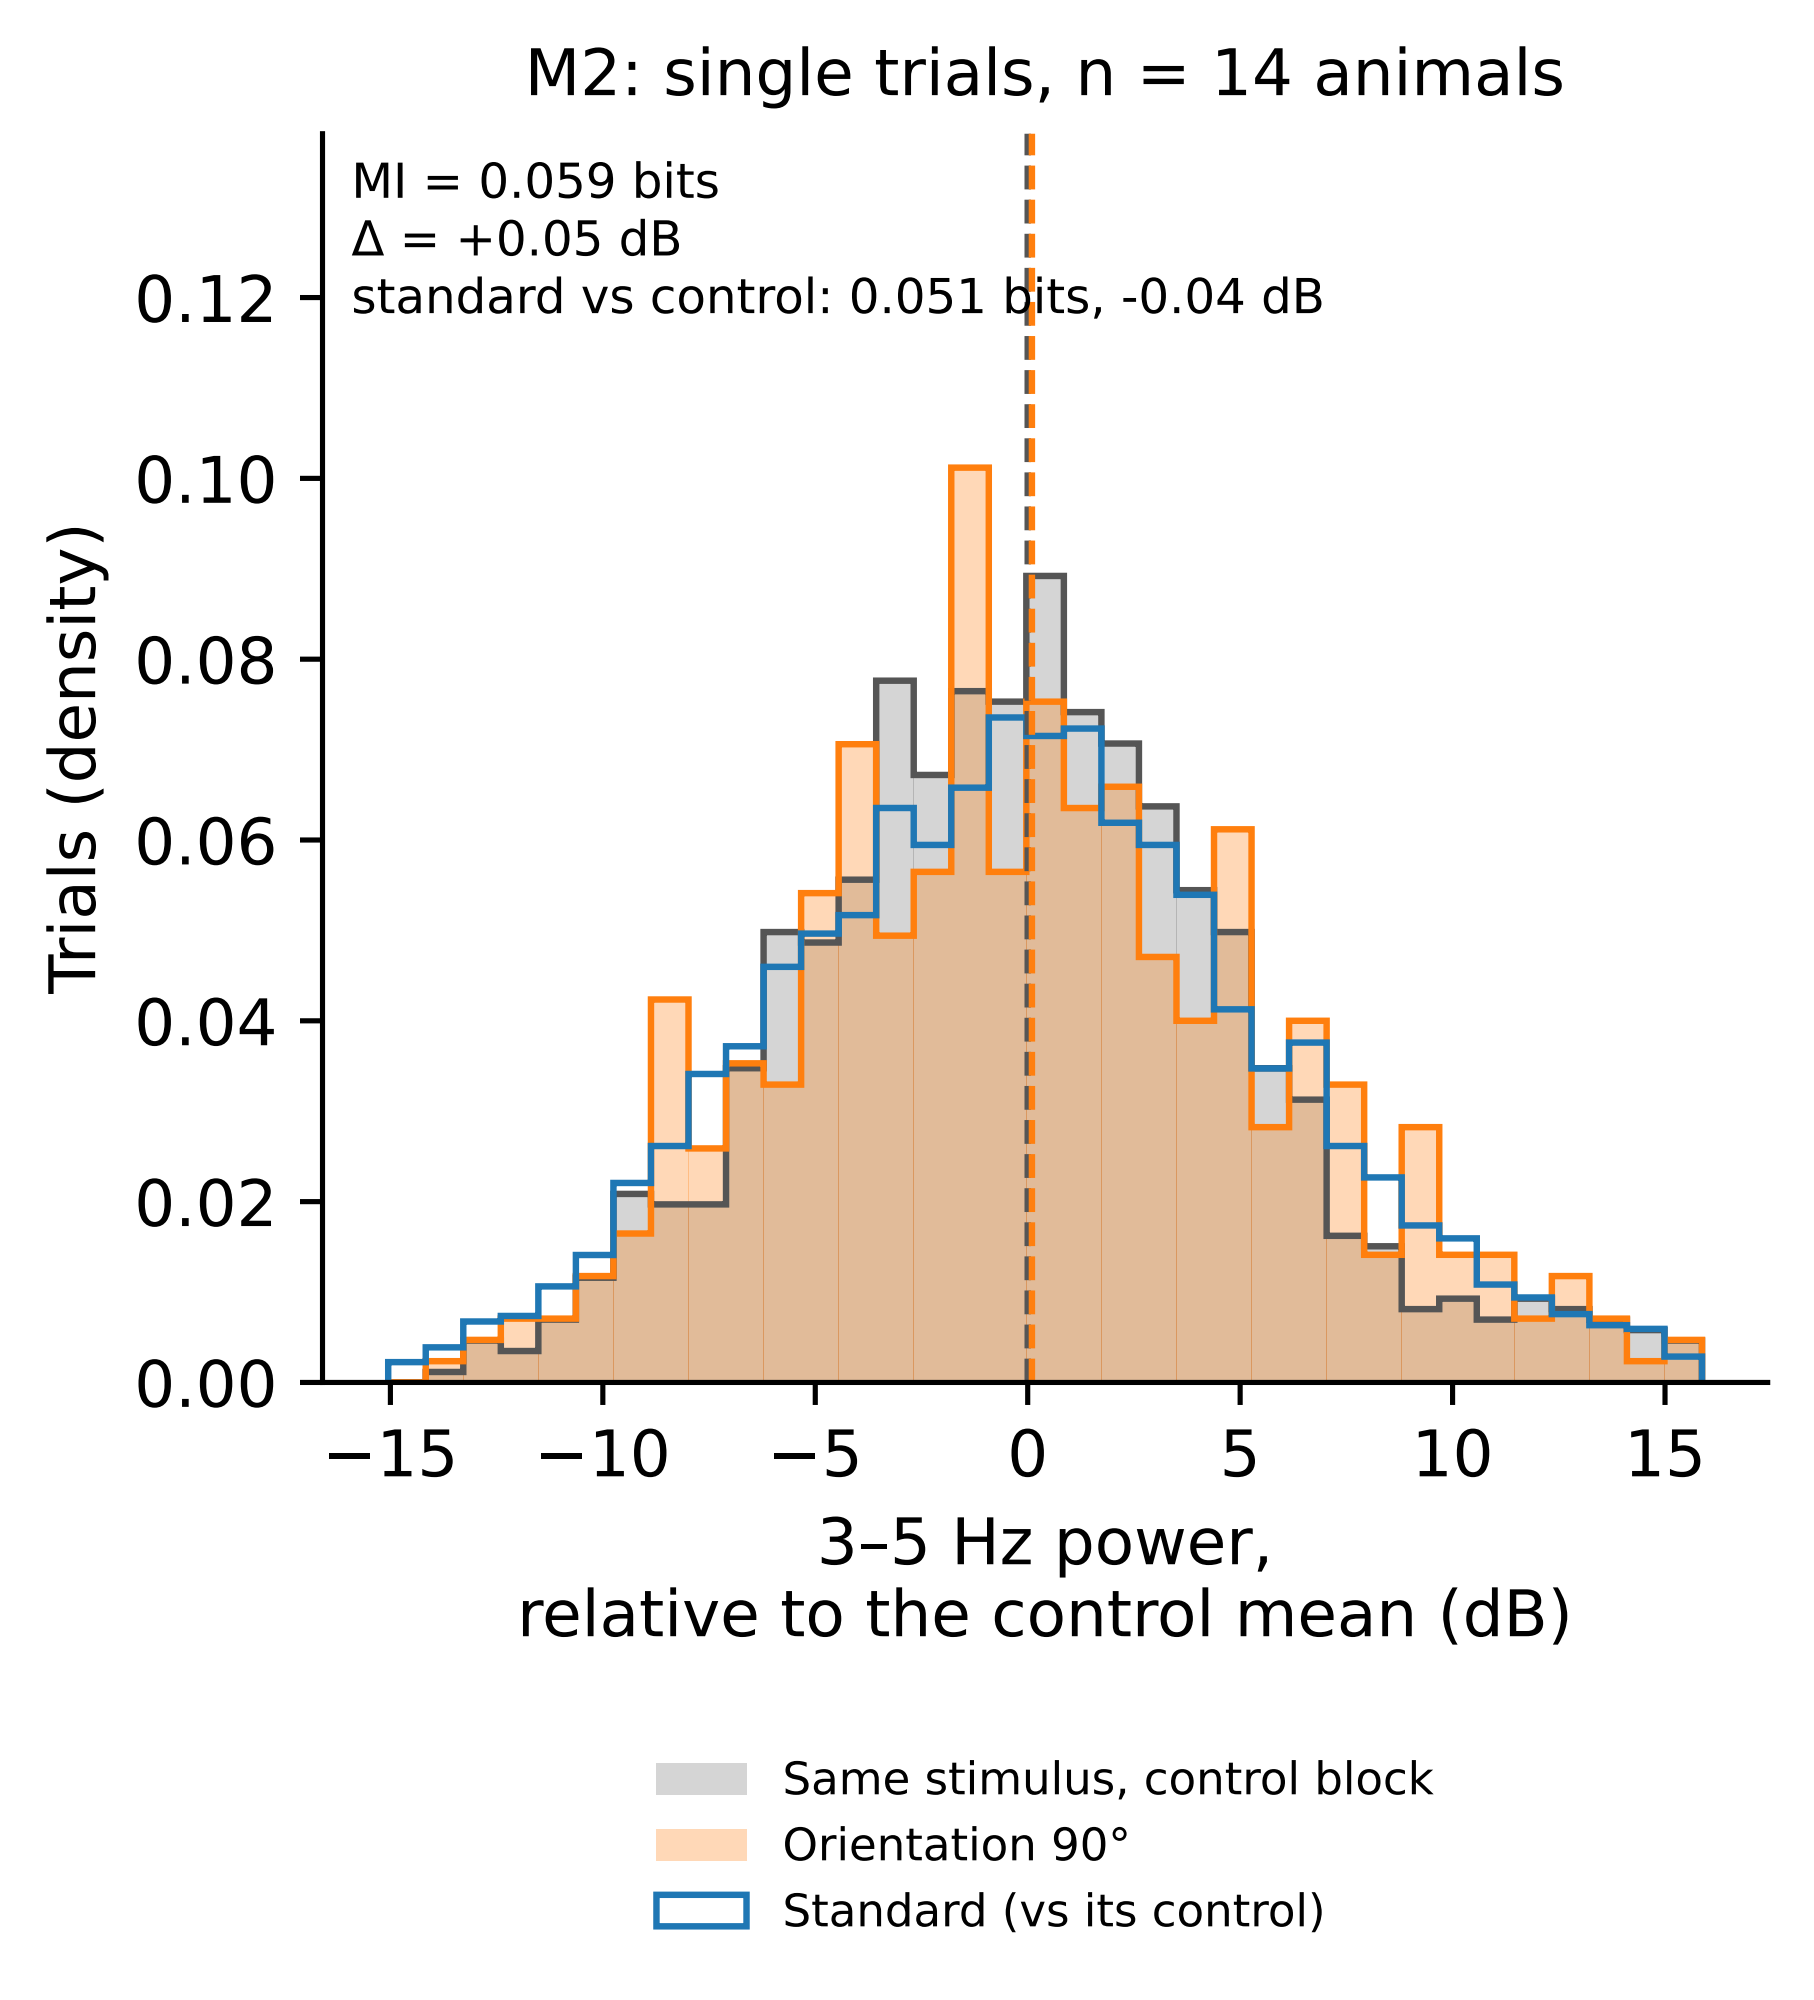
M2: single trials, n = 14 animals
MI = 0.059 bits
Δ = +0.05 dB
standard vs control: 0.051 bits, -0.04 dB
Trials (density)
0.00
0.02
0.04
0.06
0.08
0.10
0.12
−15
−10
−5
0
5
10
15
3–5 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Orientation 90°
Standard (vs its control)