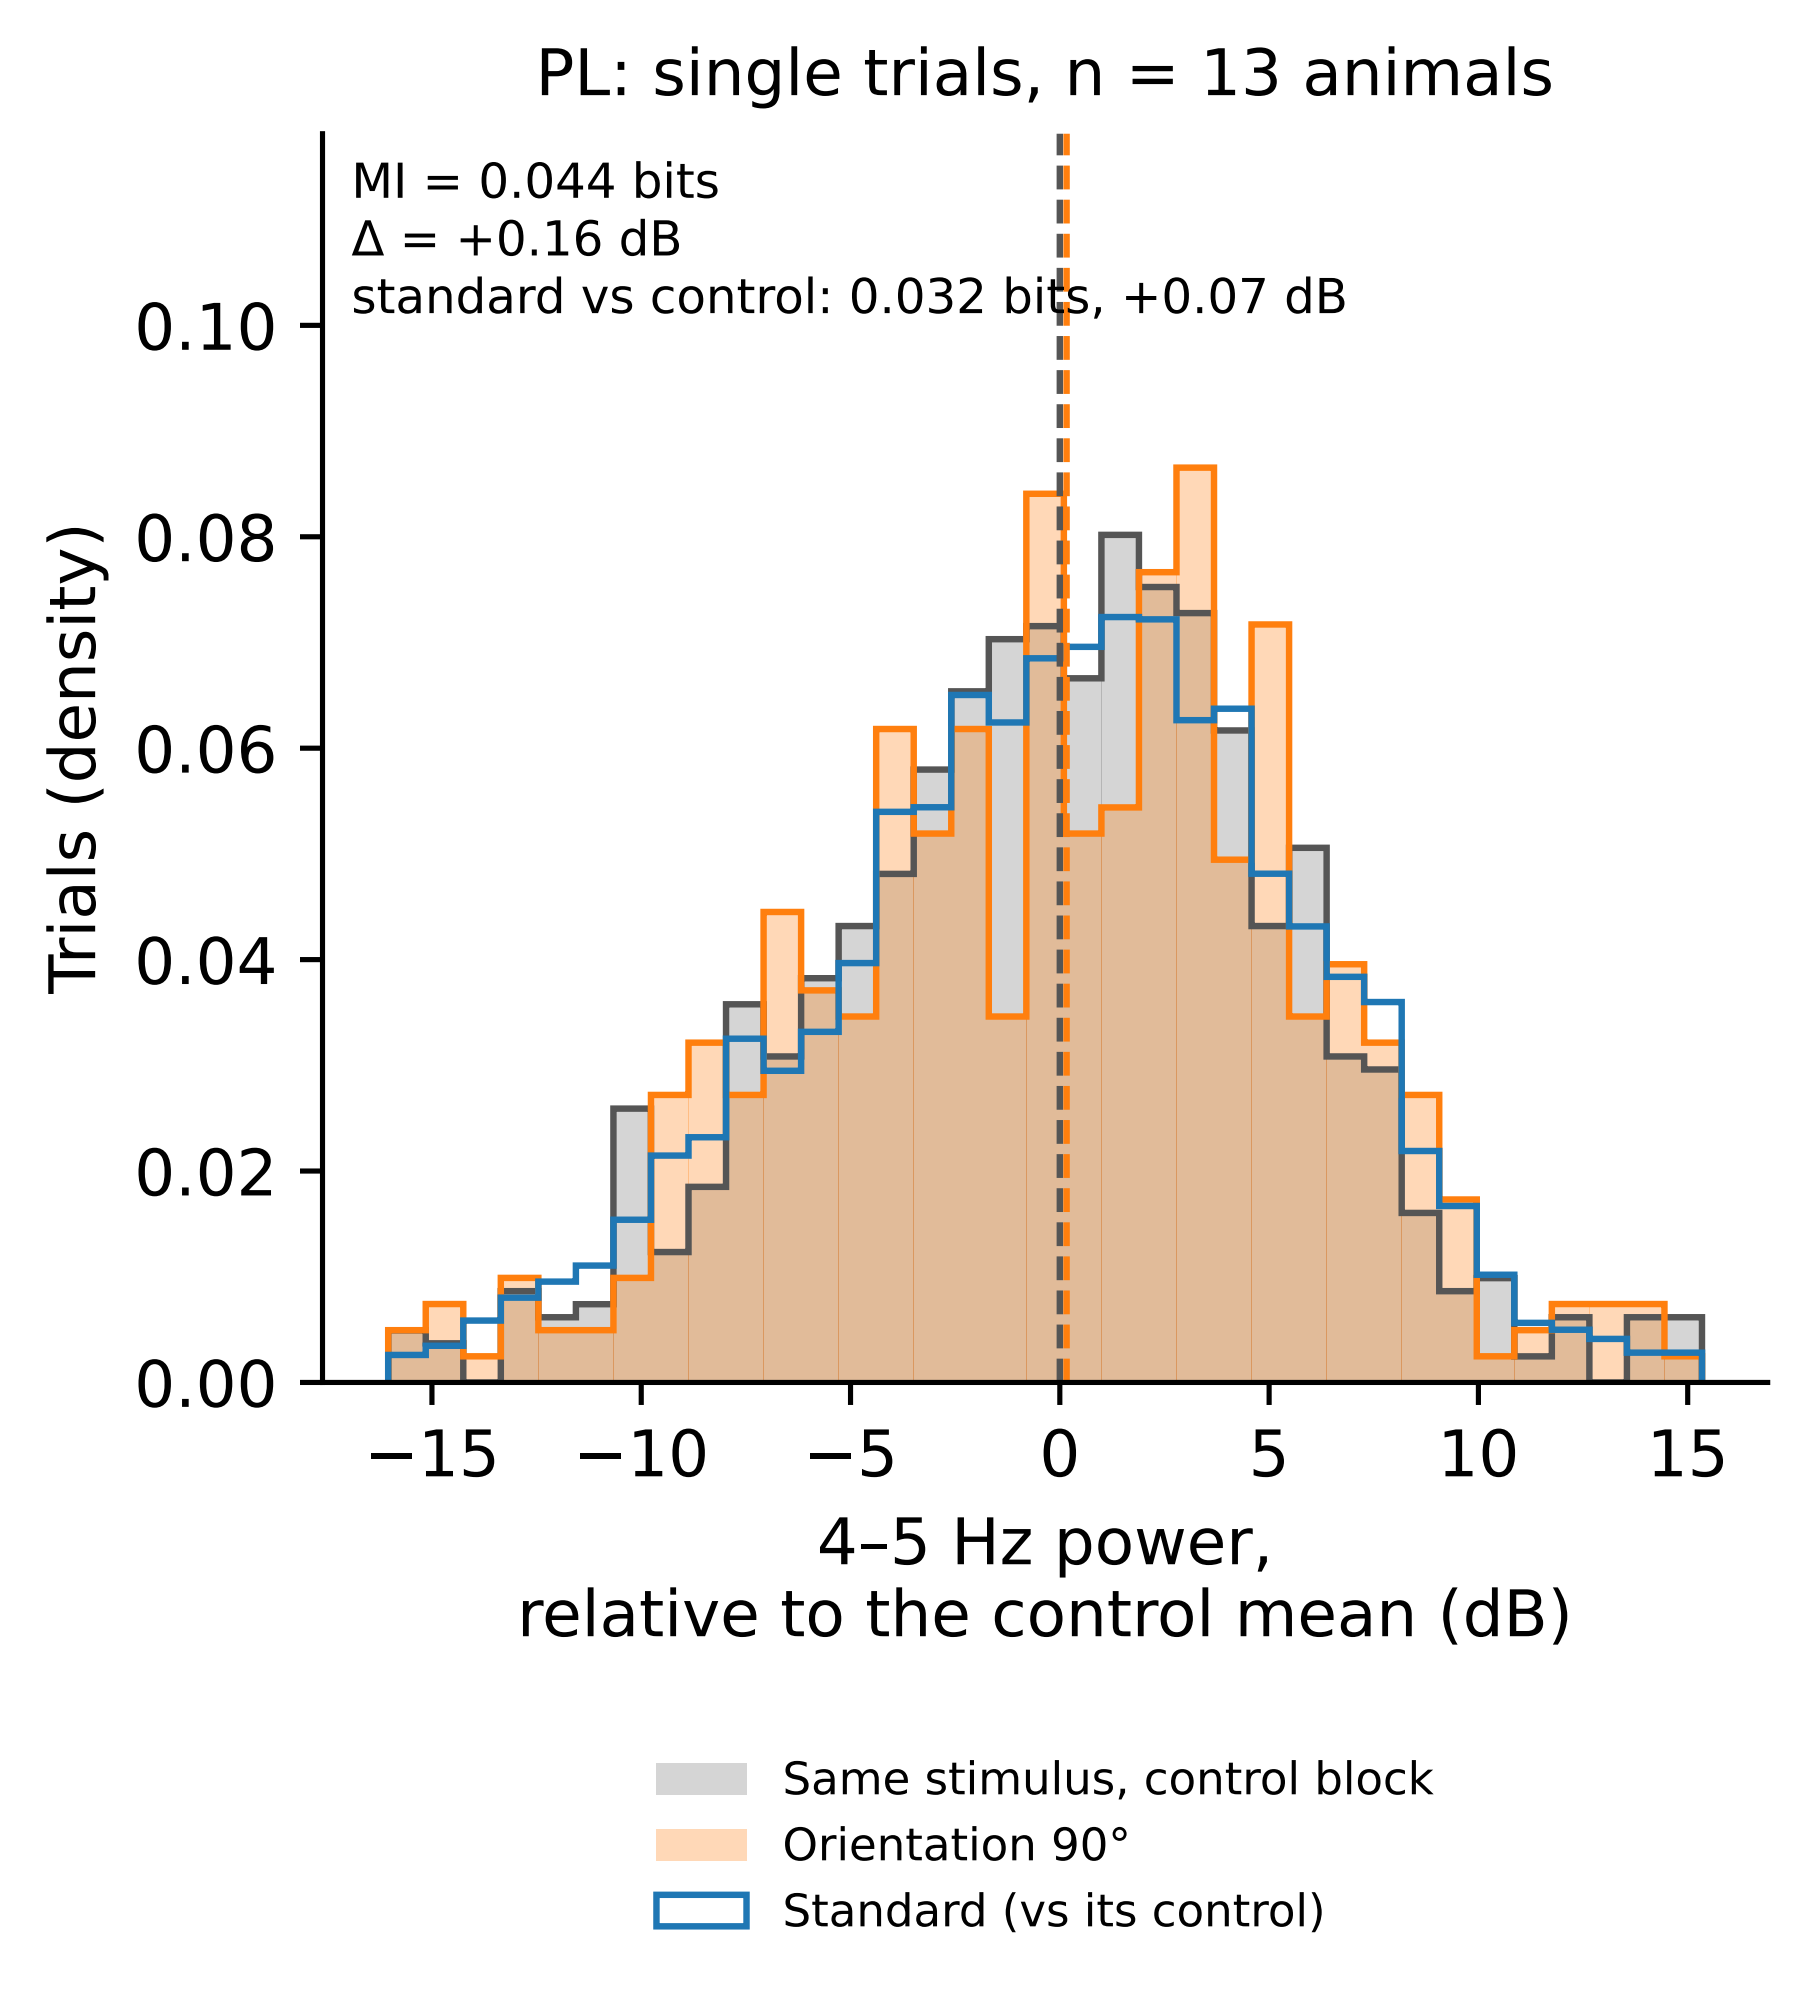
PL: single trials, n = 13 animals
MI = 0.044 bits
Δ = +0.16 dB
standard vs control: 0.032 bits, +0.07 dB
Trials (density)
0.00
0.02
0.04
0.06
0.08
0.10
−15
−10
−5
0
5
10
15
4–5 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Orientation 90°
Standard (vs its control)