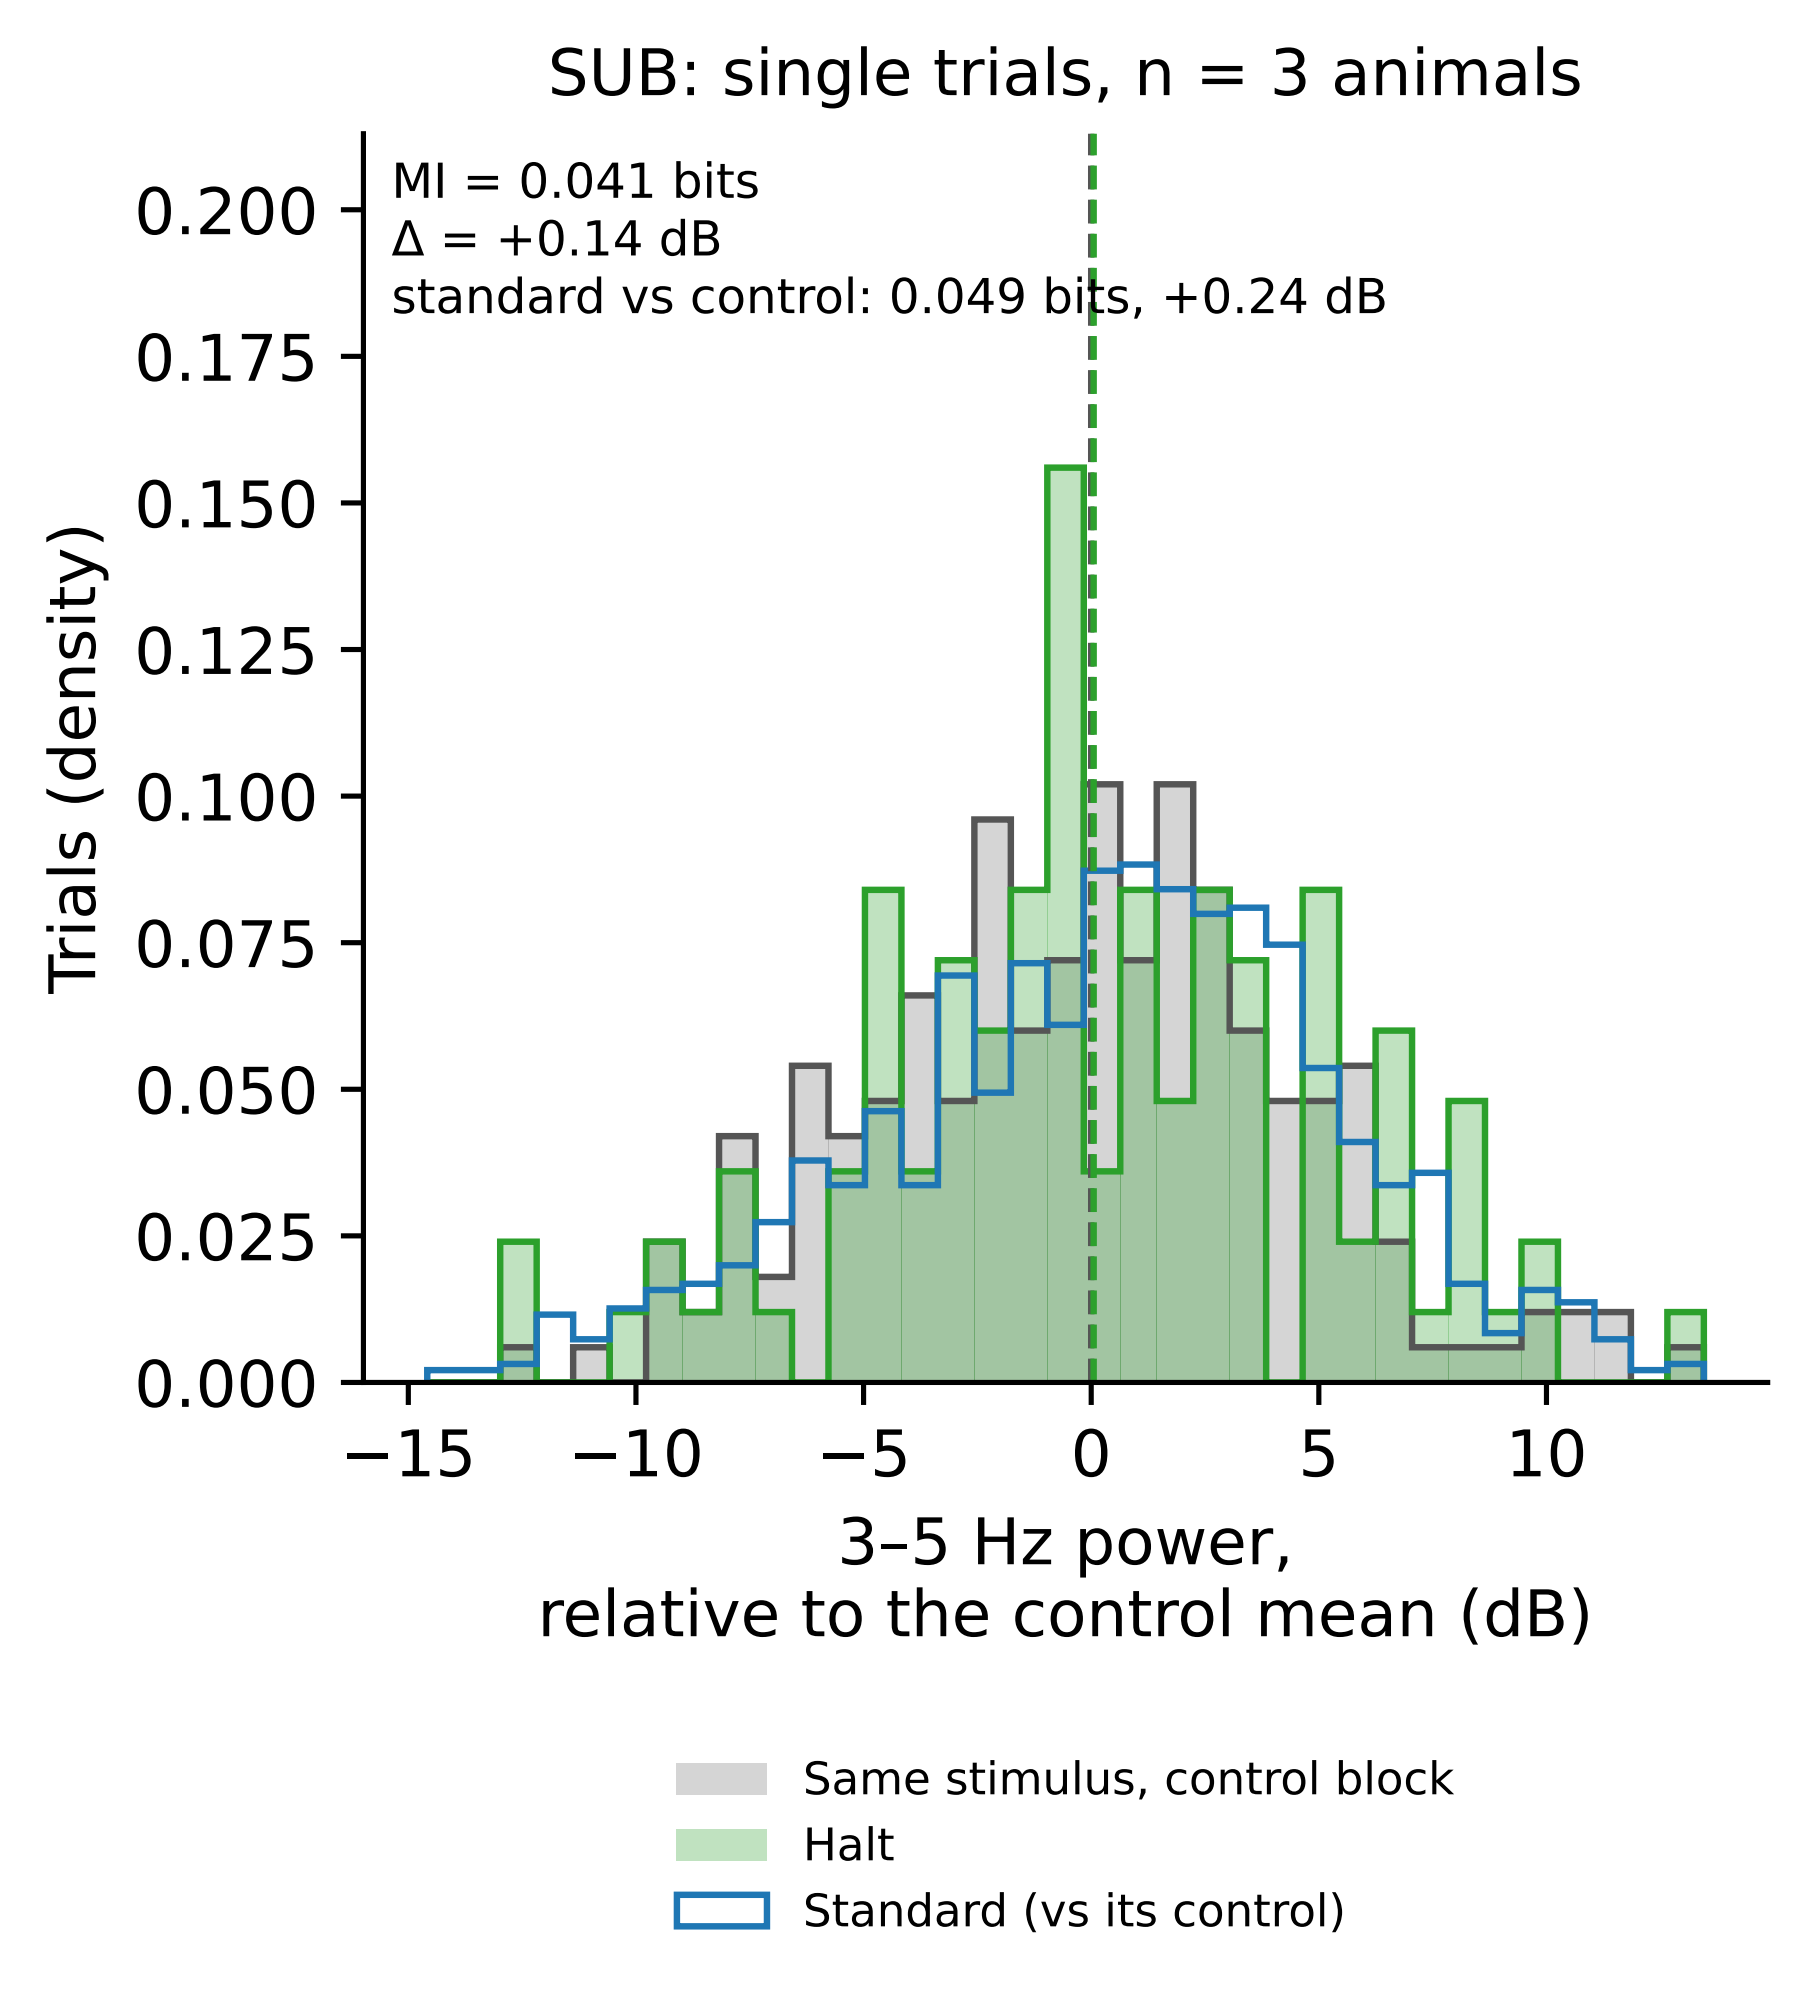
SUB: single trials, n = 3 animals
MI = 0.041 bits
Δ = +0.14 dB
standard vs control: 0.049 bits, +0.24 dB
Trials (density)
0.200
0.175
0.150
0.125
0.100
0.075
0.050
0.025
0.000
−15
−10
−5
0
5
10
3–5 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Halt
Standard (vs its control)