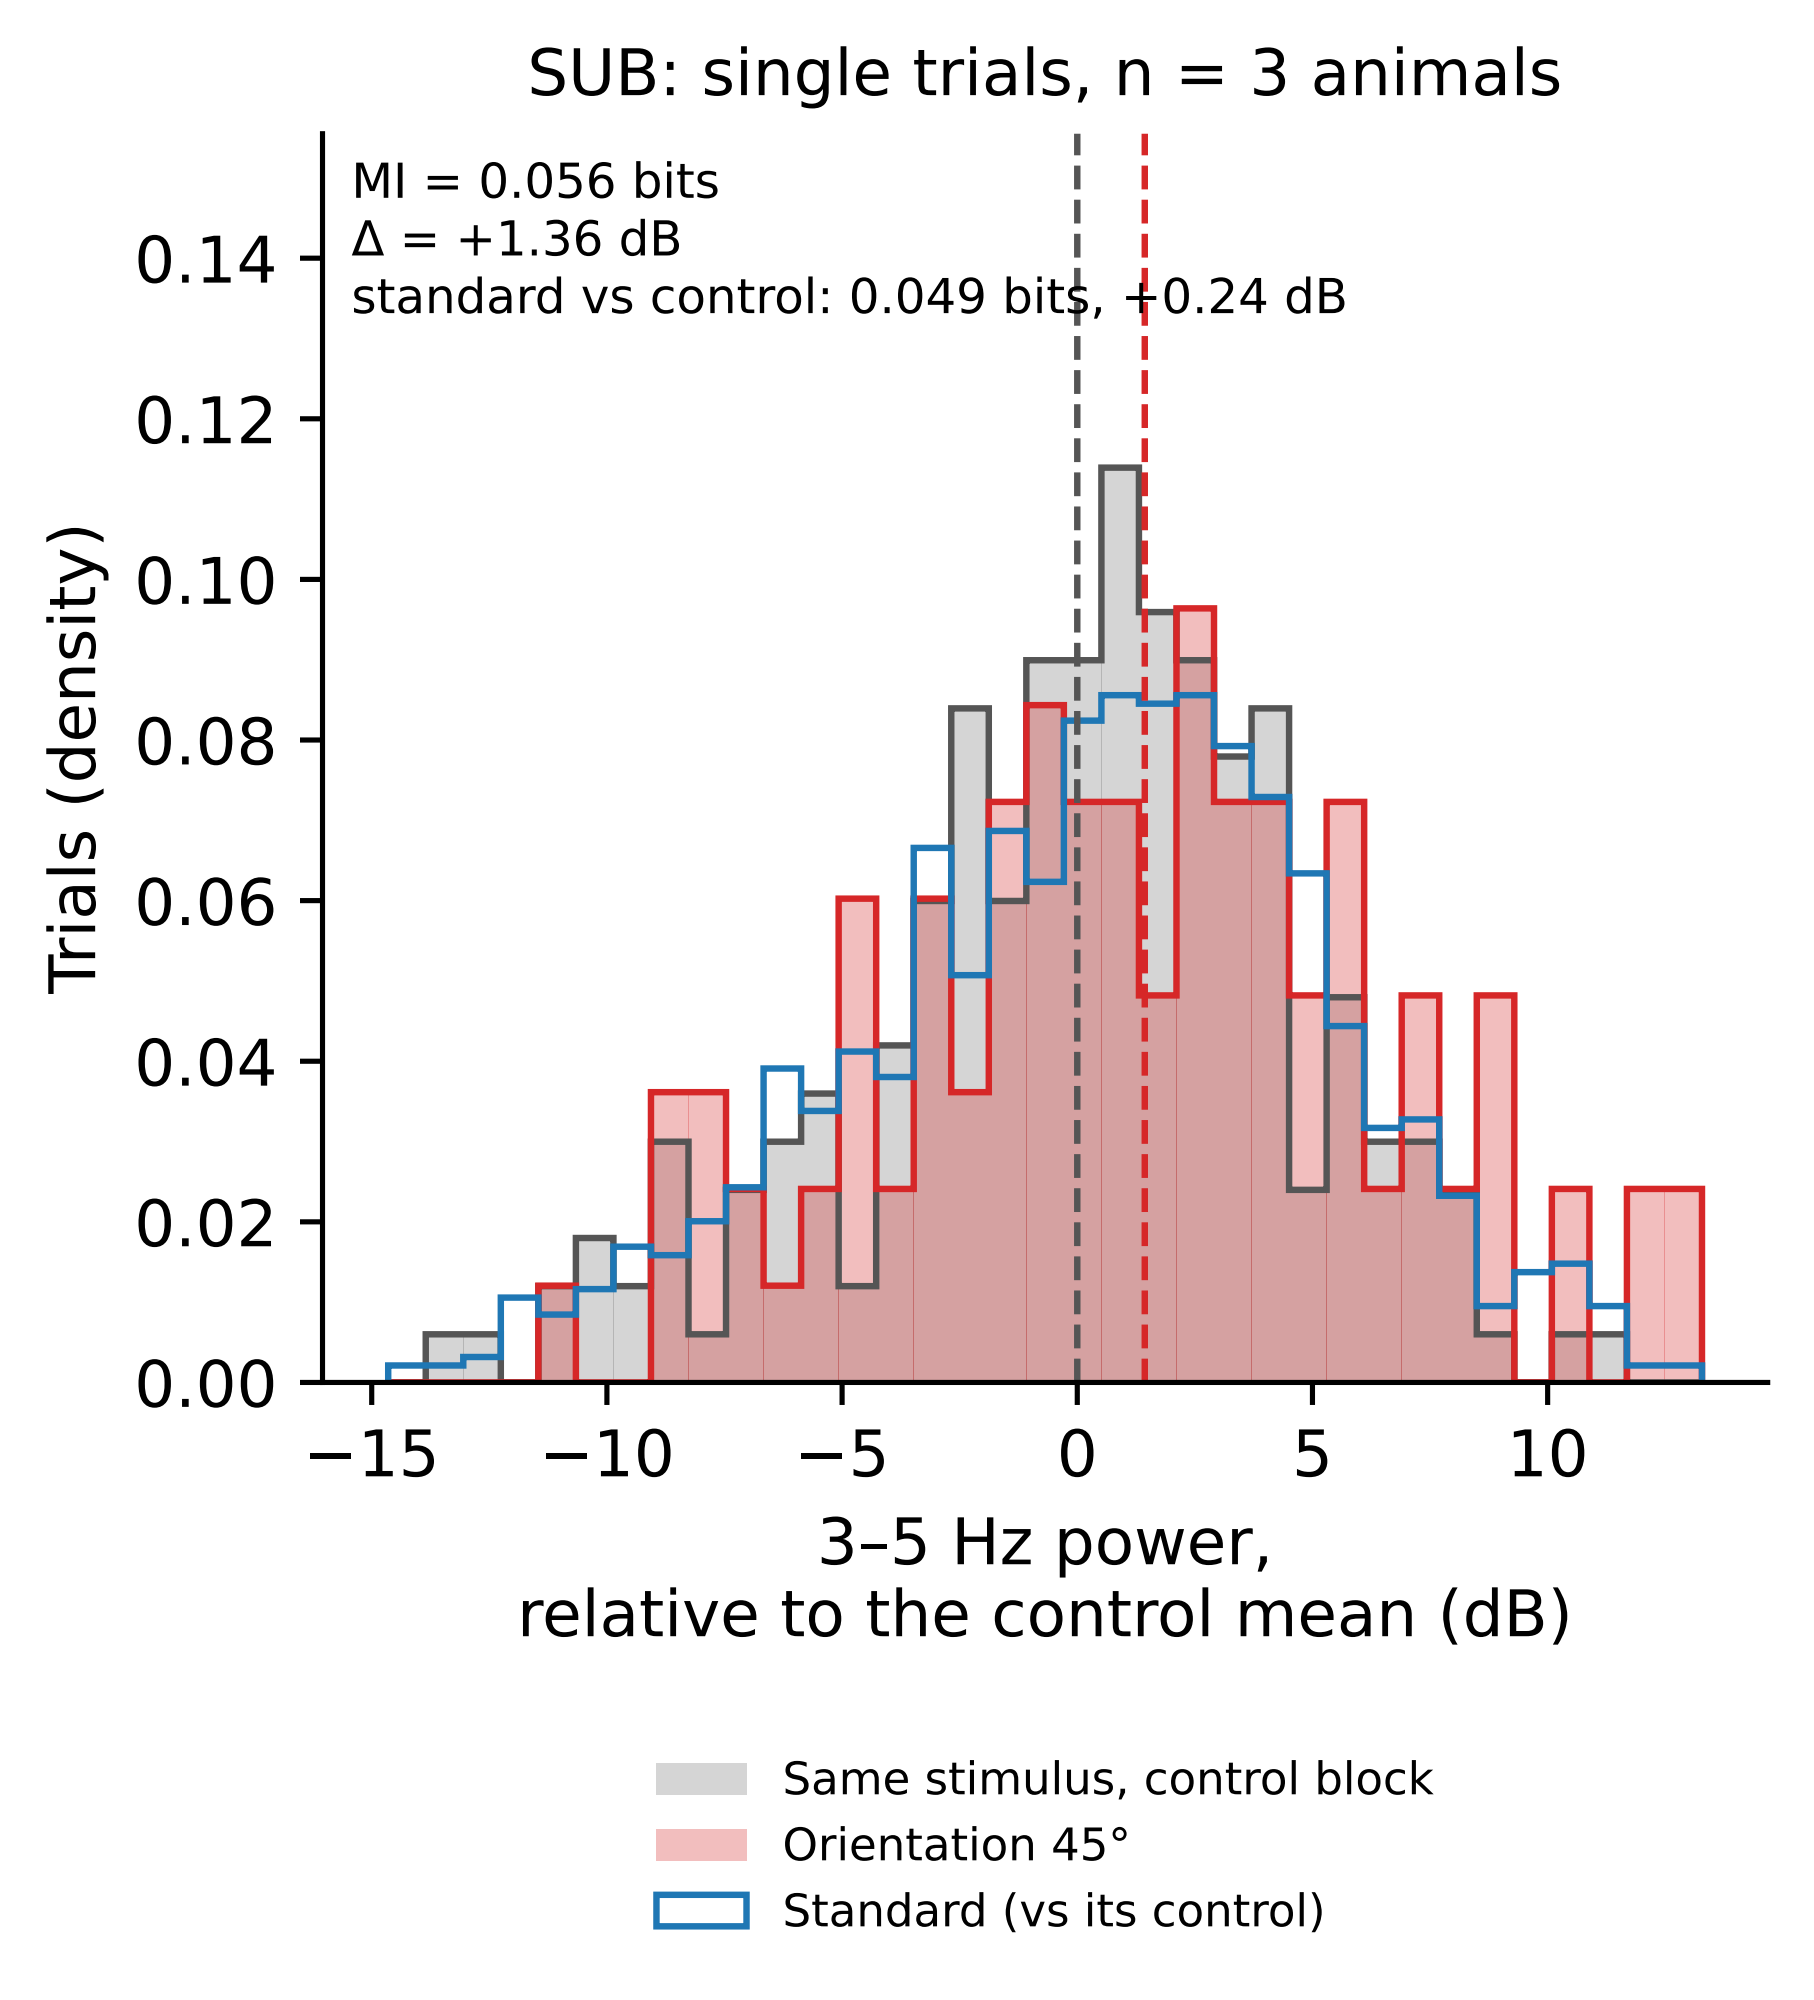
SUB: single trials, n = 3 animals
MI = 0.056 bits
Δ = +1.36 dB
standard vs control: 0.049 bits, +0.24 dB
Trials (density)
0.14
0.12
0.10
0.08
0.06
0.04
0.02
0.00
−15
−10
−5
0
5
10
3–5 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Orientation 45°
Standard (vs its control)