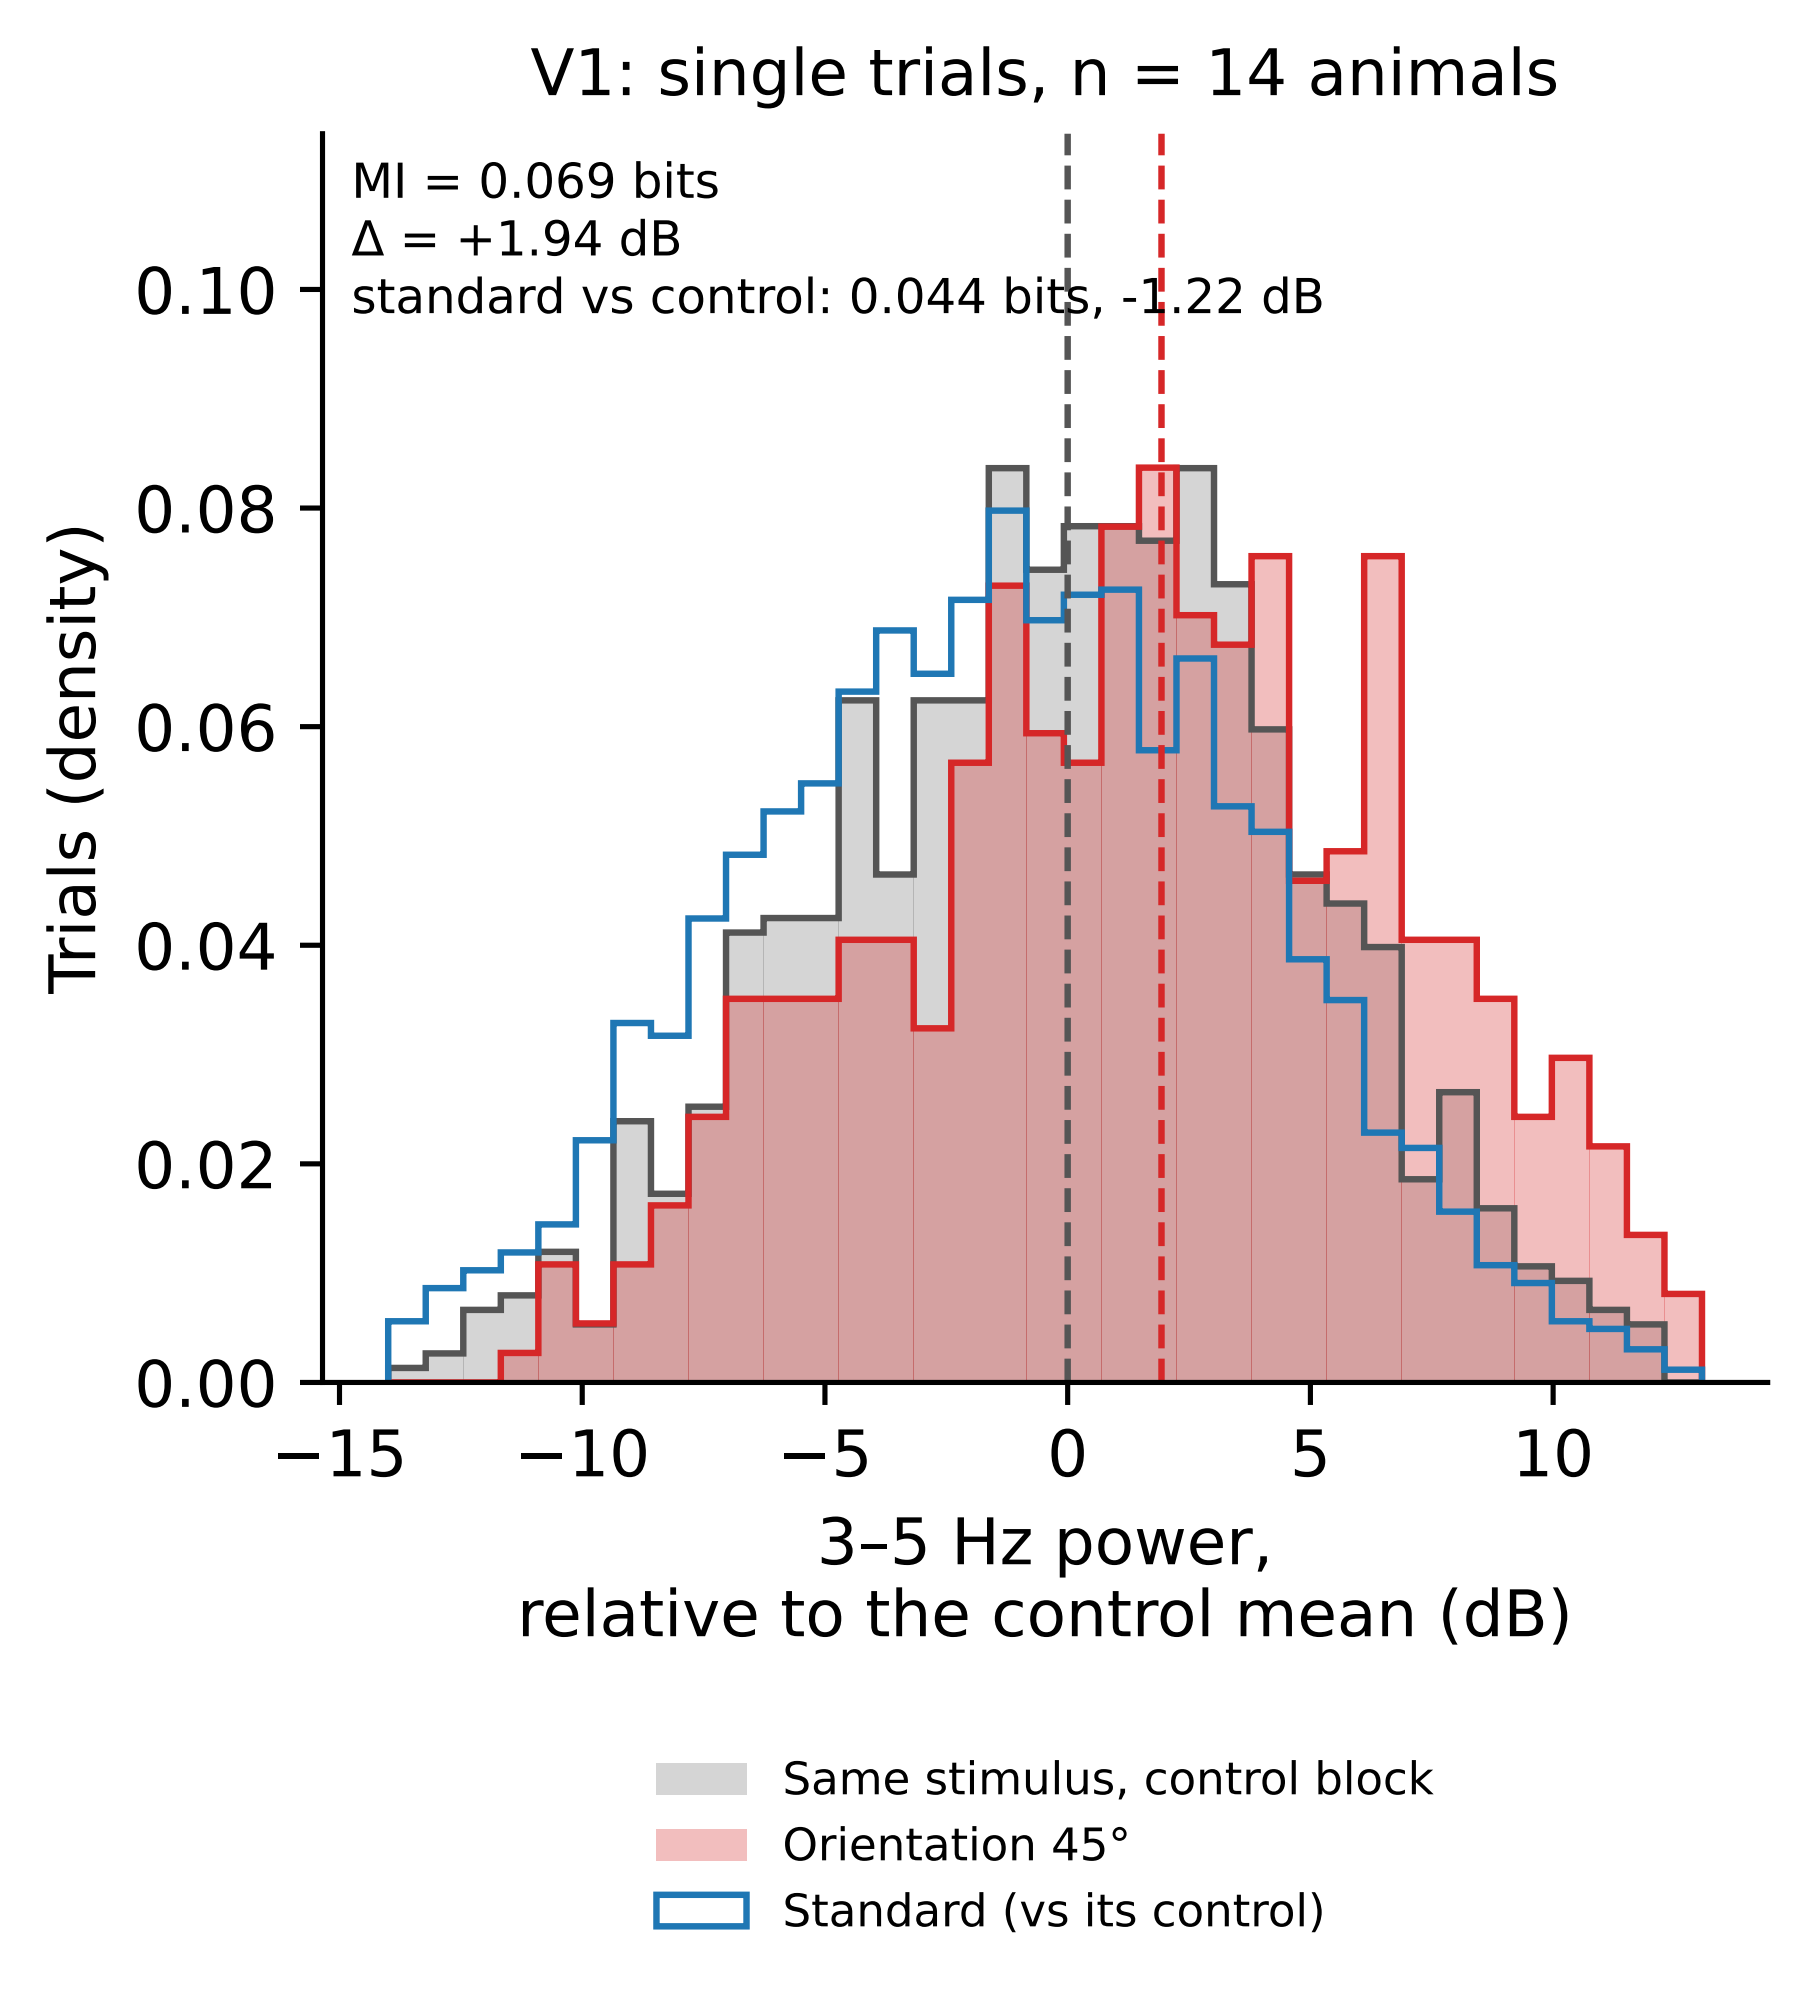
V1: single trials, n = 14 animals
MI = 0.069 bits
Δ = +1.94 dB
standard vs control: 0.044 bits, -1.22 dB
Trials (density)
0.00
0.02
0.04
0.06
0.08
0.10
−15
−10
−5
0
5
10
3–5 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Orientation 45°
Standard (vs its control)