

A longer car, with a deeper front court.

Clear ceilings: ground 3.00 m / upper 2.80 m | Floor-to-floor 3.40 m, provisional | Plans at 1:100 on A3 at 100%



3 bedrooms / 2 full bathrooms

Queen guest room downstairs; king primary and two-double guest room upstairs. Each floor has one shared, hall-accessed bathroom. Neither bedroom upstairs is an en suite.

The proposed fit

SPACE / ITEM	m ²	ft ² / ref.
Ground floor	94.5 m ²	1,017.2 ft ²
Upper, less stair void	77.4 m ²	833.4 ft ²
Combined floors	171.9 m ²	1,850.6 ft ²
Covered terrace, extra	18.0 m ²	193.8 ft ²

Gross areas include walls. Bedroom dimensions on page 6 now deduct the reserved acoustic linings. Metric dimensions govern; feet are rounded references.

Noise-control changes

TV moved to the left exterior wall. D1 closes the stair; D2 encloses the laundry and service passage. Blue-green bands reserve 0.10 m for bedroom acoustic linings. Details and specifications: pages 4-5.

Room arrangement

Ground / social + guest

G1 queen room; G2 front shared bath; G3 laundry; G4 revised kitchen (page 7); G5 living/dining; G6 entry; G7 stair; G8 service passage. Sliding vehicle gate: page 9.

Upper / shared bath

U1 two-double room; U2 open shared bath with a far-end shower, toilet and double vanity; U3 linen; U4 dressing/storage; U5 primary; U6 hall; U7 stair arrival.


Still schematic

Setbacks, boundary-wall permission, floor elevation, structure and services need local review. Front/rear orientation is schematic; no surveyed north is asserted.

Both bathrooms, with clear indoor access.

Enlarged bathroom studies / both at 1:30 on A3 at 100% / meter and feet reference columns below

Ground / bathroom and laundry

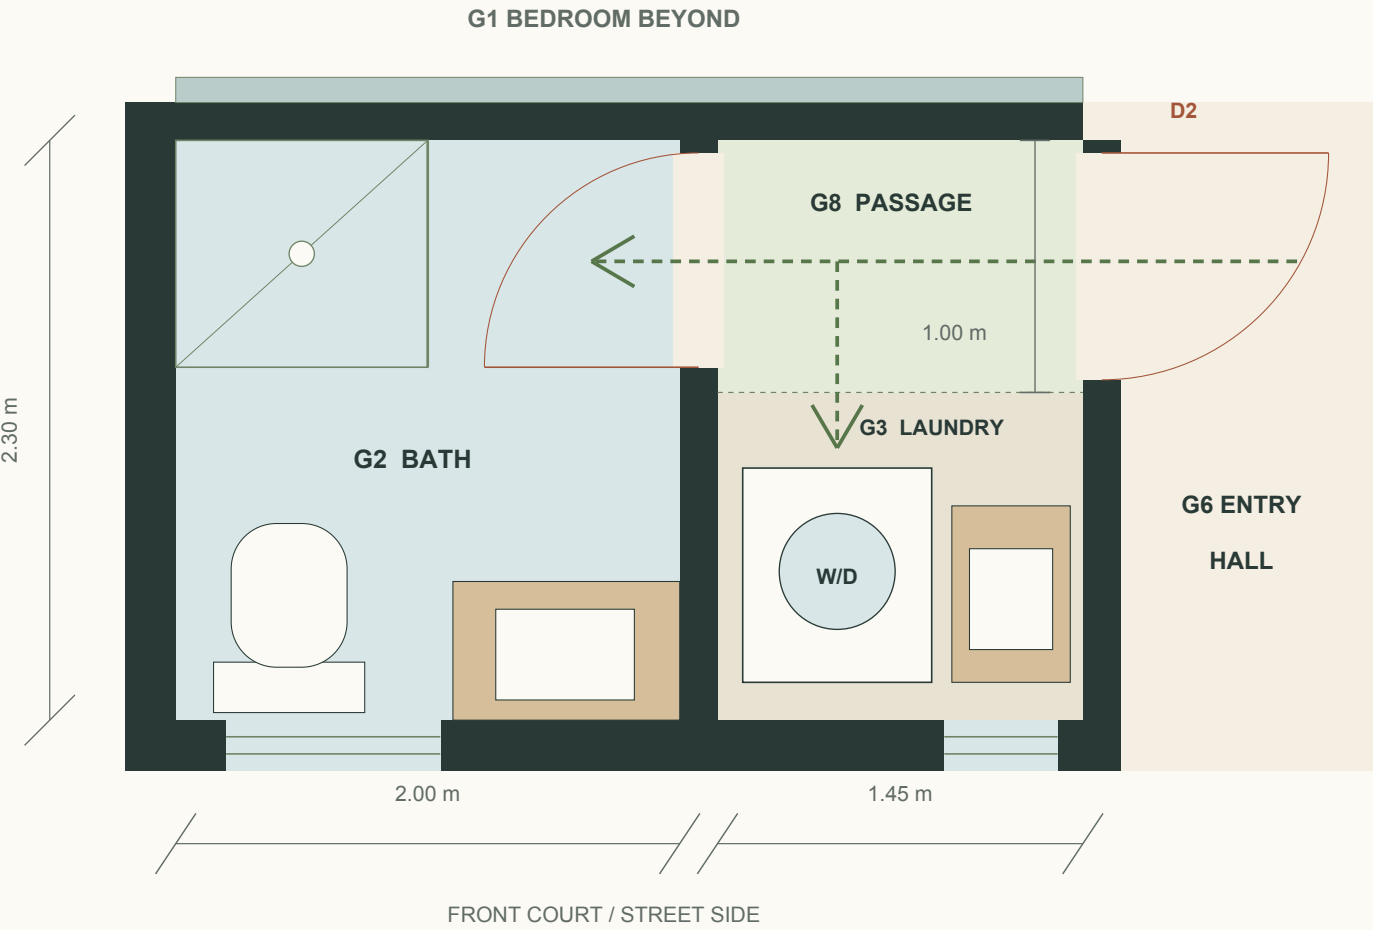


Ground-floor service dimensions

SPACE / ITEM	Meters	Feet / reference
G2 / Bathroom	2.00 x 2.30 m	6.56 x 7.55 ft
G3 / Recessed laundry bay	1.45 x 1.30 m	4.76 x 4.27 ft
G8 / Passage	1.45 x 1.00 m	4.76 x 3.28 ft

D2 opens into G6 and encloses G3 + G8 together. The 1.00 m-deep passage stays free of door swings; its hall doorway is 0.90 m nominal. G2 opens inward. Loading still uses G8 temporarily. Ventilate the enclosure to suit the chosen washer/dryer; see page 5.

Upper / shower at the far end

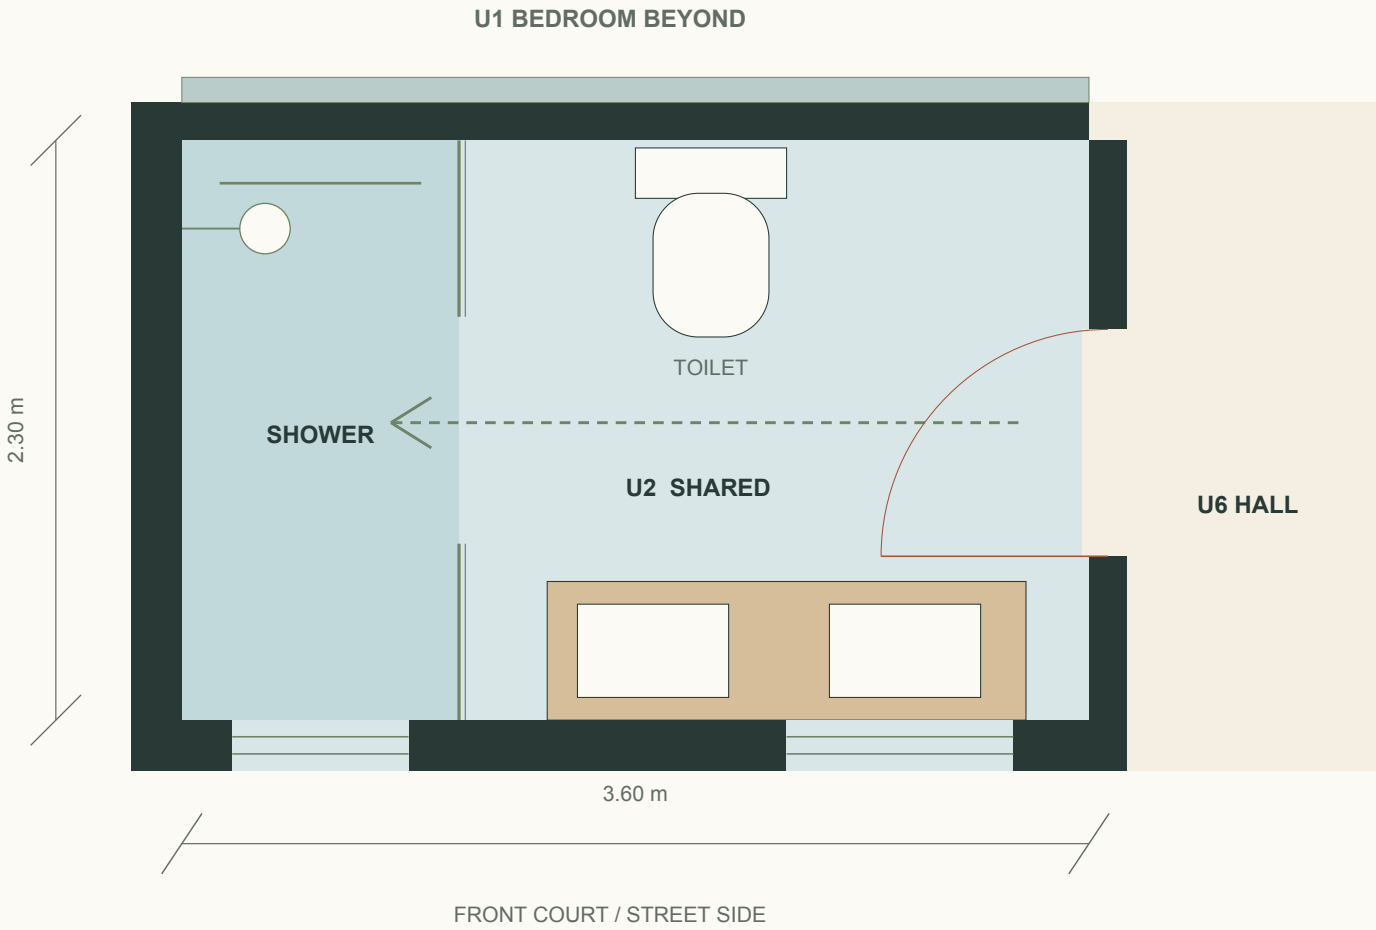

Upper bathroom dimensions


SPACE / ITEM	Meters	Feet / reference
U2 / Open shared bathroom	3.60 x 2.30 m	11.81 x 7.55 ft
Far-end walk-in shower	1.10 x 2.30 m	3.61 x 7.55 ft
Double vanity	1.90 x 0.55 m	6.23 x 1.80 ft
Shower entry / nominal	0.90 m	2.95 ft

The former toilet compartment is removed. The shower is at the far end opposite the hall door, behind a glass screen. The toilet stays in the main bathroom. Final fixture, glazing, drainage and finished clearances need detailed review.

Adopted heights and the revised stair.

Height diagram: vertical dimensions at 1:50 / stair plan at 1:50 / provisional structure and site levels

Finished floors and clear ceilings

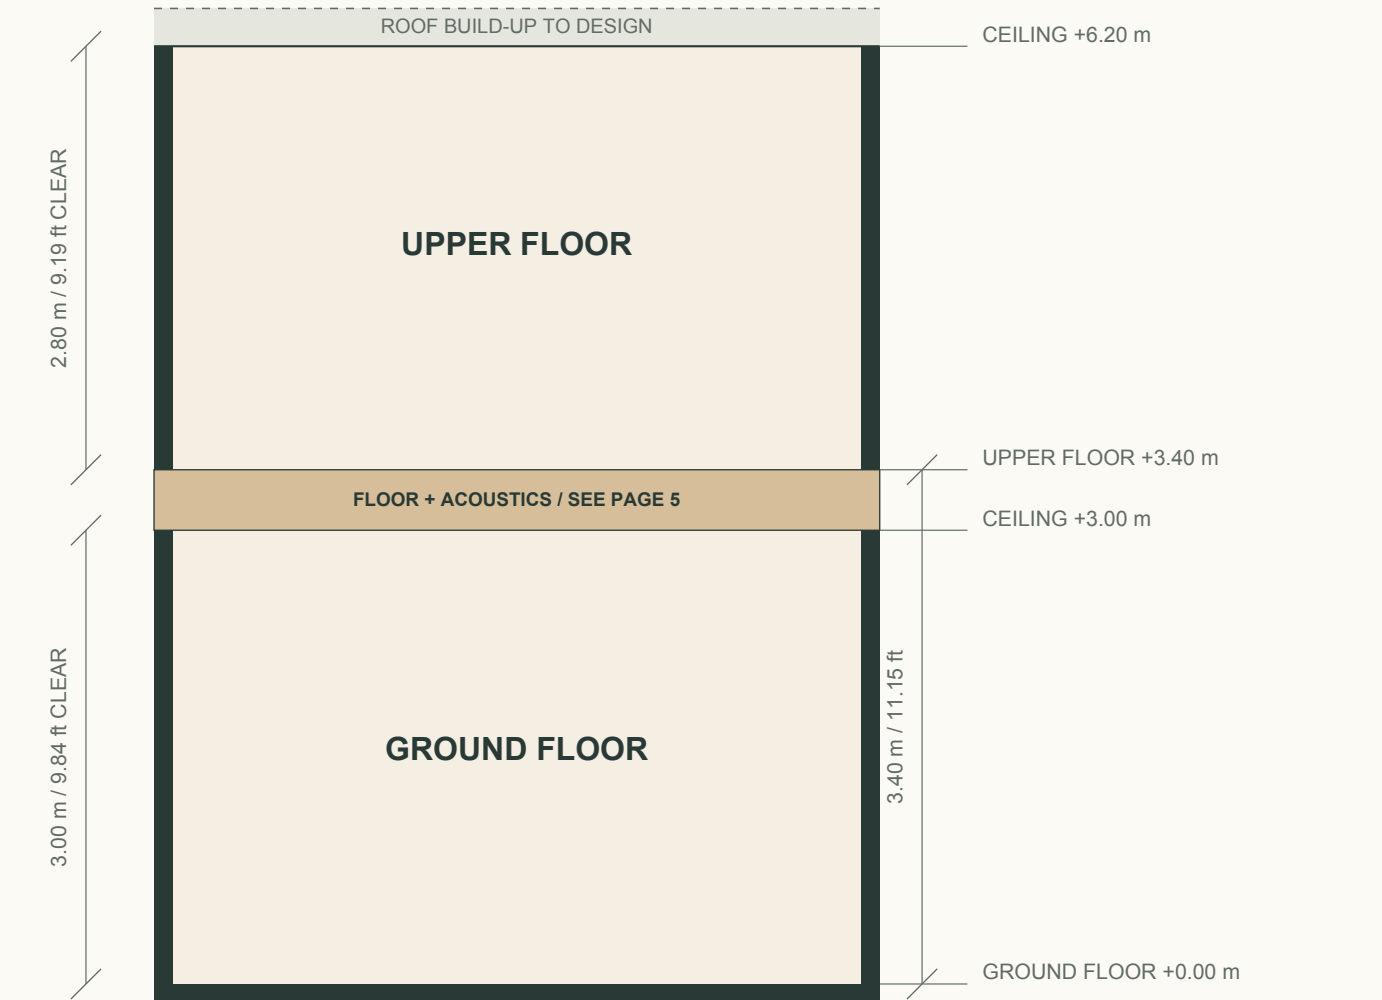


Height references

SPACE / ITEM	Meters	Feet / reference
Ground / clear ceiling	3.00 m	9.84 ft
Upper / clear ceiling	2.80 m	9.19 ft
Ground-to-upper floor	3.40 m	11.15 ft
Floor assembly allowance	0.40 m	1.31 ft
Upper ceiling above datum	6.20 m	20.34 ft

The 0.40 m includes structure, tile, acoustic layers, services and any isolated ceiling. Layer thicknesses are unresolved. Coordinate the stack before fixing floor levels and stairs; roof and site levels remain to be set.

20 risers connect the two floors

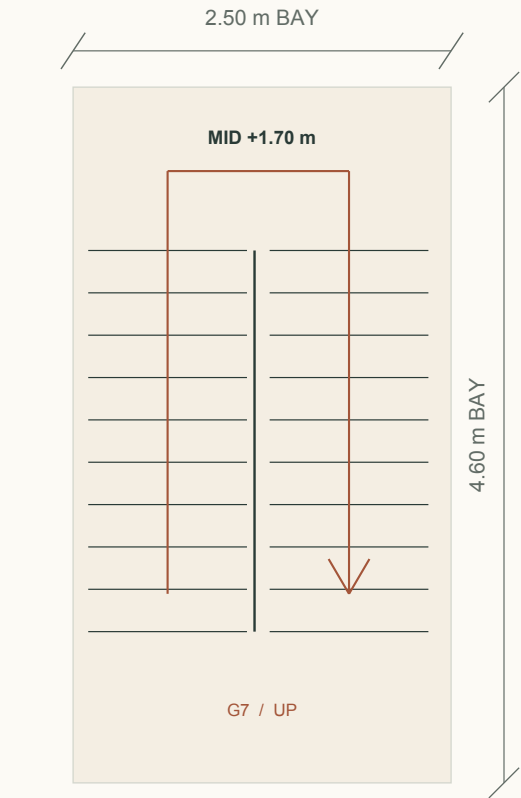

20 x 0.170 m = 3.40 m

Two flights of 10 risers, with nine 280 mm treads per flight. Each run is 2.52 m. The turning landing is at +1.70 m.

D1 closes the stair at ground level

The new door swings into G6, outside the landing. The front entrance moves 0.20 m left to separate the two nominal door sweeps. See the enlarged entrance study on page 4.

Keep the stair opening clear

The opening covers both flights and the turning landing. Final beam positions, services, handrails, guards and clear headroom need coordinated architectural and structural sections.

Stair references


SPACE / ITEM	Meters	Feet / reference
Riser / 20 total	0.170 m	0.56 ft
Tread depth	0.280 m	0.92 ft
Run per flight / 9 treads	2.52 m	8.27 ft
Flight / turning landing	1.05 m	3.44 ft
Front arrival landing	1.00 m	3.28 ft
Reserved stair bay	2.50 x 4.60 m	8.20 x 15.09 ft
Upper stair opening	2.25 x 3.59 m	7.38 x 11.78 ft

Nominal dimensions before detailed finishes and rail design. The stair arithmetic and plan fit are checked; local compliance and final headroom are not certified.

Three layout changes for everyday quiet.

Living detail at 1:50 / entrance detail at 1:40 on A3 at 100% / nominal dimensions before final hardware and finishes

Living / exterior-wall TV and a clear route

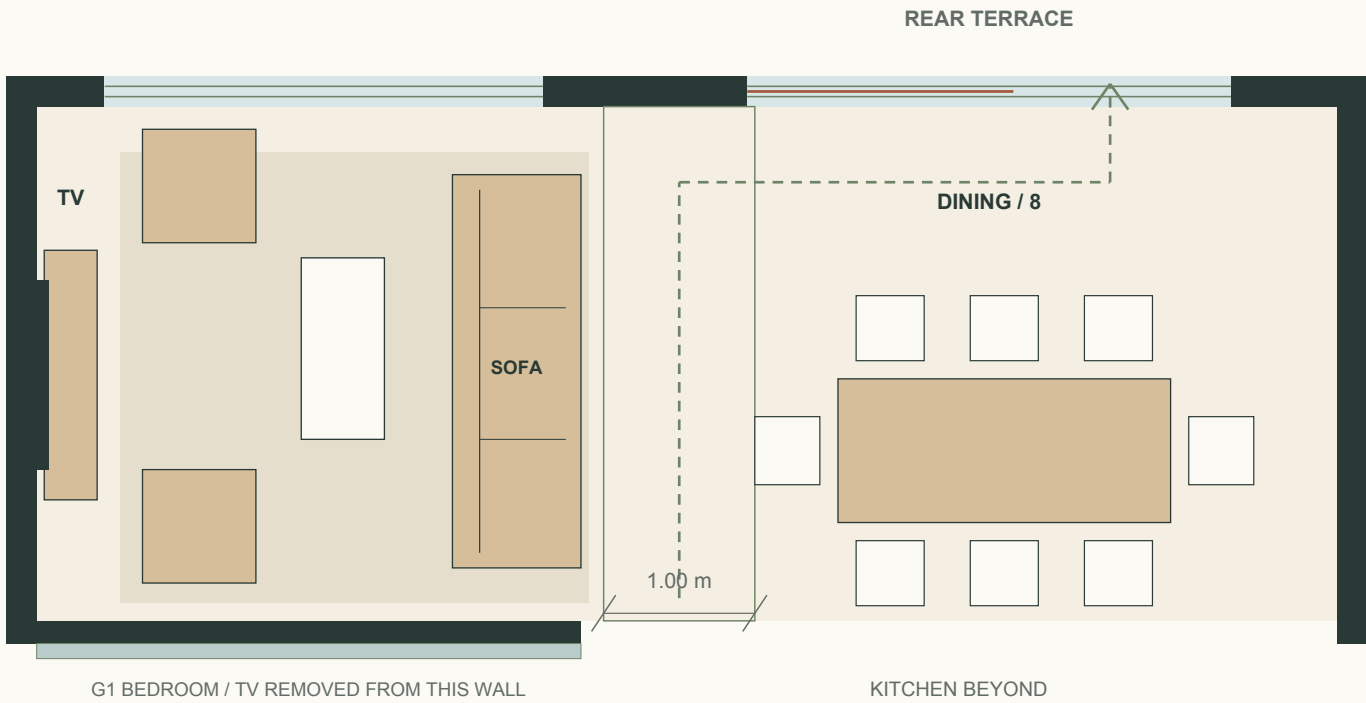


Living / nominal reference dimensions

SPACE / ITEM	Meters	Feet / reference
Three-seat sofa	0.85 x 2.60 m	2.79 x 8.53 ft
Media console	0.35 x 1.65 m	1.15 x 5.41 ft
Route beside seating	1.00 m	3.28 ft
Acoustic lining reserve	0.10 m	0.33 ft

The sofa faces the left exterior wall; two chairs complete the seating group. A nominal 1.00 m route runs between the sofa and dining furniture, then turns toward the rear doors. Check final chair pull-out and door hardware during furnishing selection.

AW1 linings sit inside the bedrooms. Ground G1 loses 0.10 m along each front/rear wall and its hall wall; U1 loses 0.10 m at its bathroom and hall walls; U5 loses 0.10 m at its stair/hall wall. Revised room sizes appear on page 6.

Entrance / doors close outside the landings

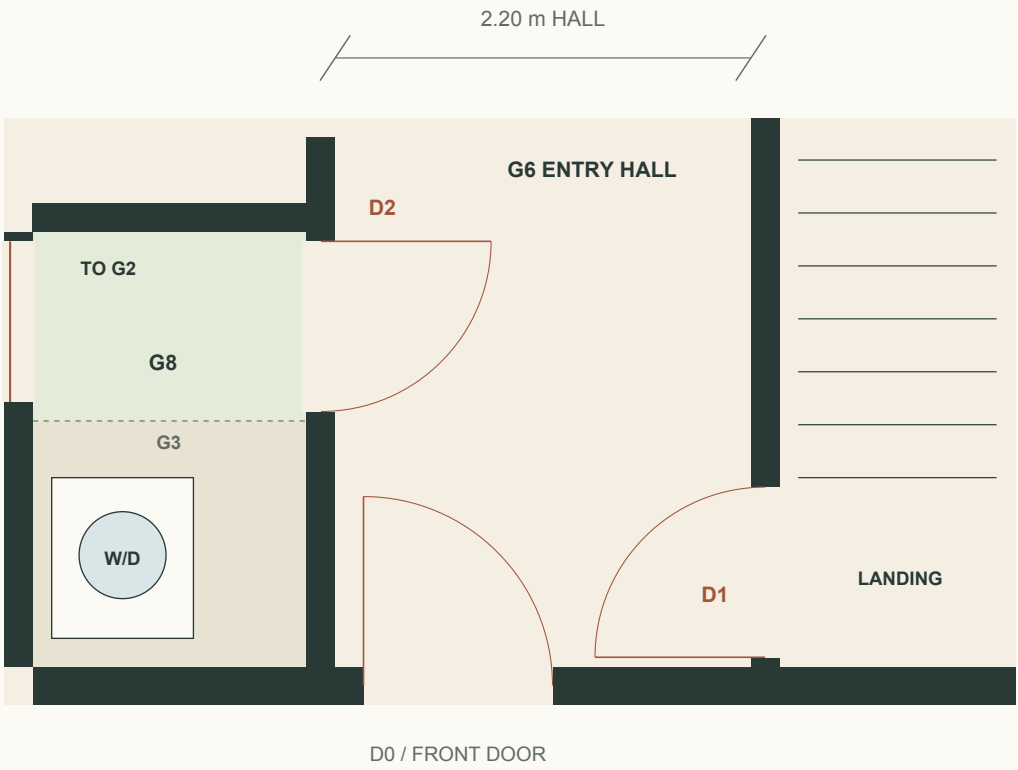

Doors / nominal leaf and passage sizes

SPACE / ITEM	Meters	Feet / reference
D0 / front entrance	1.00 m	3.28 ft
D1 / stair door	0.90 m	2.95 ft
D2 / service door	0.90 m	2.95 ft
G8 / passage depth	1.00 m	3.28 ft
D0 / move left	0.20 m	0.66 ft

D1 swings into G6, outside the stair landing. D2 also swings into G6, leaving G8 free of door sweeps. The nominal D0/D1 sweep envelopes are separated by 0.225 m. Hardware and finished clear openings remain to be detailed.

G3 and G8 form one enclosed laundry/service vestibule. A separate cabinet front would obstruct bathroom access. D2 provides the acoustic closure; G2 retains its own privacy door. Appliance loading temporarily occupies G8.

Construction and acoustic design brief.

Proposed materials and requirements to detail and price / street traffic plus general household noise / no acoustic performance claim yet

Structure, walls and roof

Starting system: an engineered reinforced-concrete structure and foundations, concrete-masonry infill, and concrete upper floor and roof. The engineer must establish wall roles, beam/slab sizes and reinforcement from the site and structural design. Existing wall cores remain schematic.

Finish with warm plaster/stucco, porcelain or ceramic tile and terracotta accents. Design roof insulation, waterproofing, falls and drainage as one coordinated assembly; roof thickness and site levels are still open. [3]

AW1 / bedroom wall assemblies

Reserve 0.10 m on the marked dry bedroom faces for an independent lining: separated framing, mineral-wool cavity absorption and two gypsum layers, subject to a tested assembly fitting the reserve. Carry the separating wall to structure and seal junctions and penetrations. Keep outlets staggered and avoid rigid bridges through the lining. Wet-side backing and waterproofing are separate requirements. [1]

Request complete wall and floor test reports. STC describes airborne separation; IIC describes impact transmission through floor/ceiling assemblies. Do not assign either rating from a material name alone. [2]

AD1 / stair, service and bedroom doors

Use solid-core hinged leaves, robust frames, perimeter seals and compatible drop seals. D1 requires a continuous stair enclosure; D2 closes G3 + G8. Coordinate ventilation paths with the seals. Final leaf/frame ratings and installed clear widths are to be selected. [1]

AV1 / bedroom windows and quiet ventilation

Obtain traffic-noise test data for complete window assemblies, including frames and compression seals. Acoustic laminated glazing is a candidate; its makeup must follow the measured source and solar/thermal requirements. [4] Provide quiet ventilation and cooling with windows closed; detail attenuated air paths rather than relying on door gaps. [1]

AF1 / upper floor, top to bottom

Tile + compatible bedding / wet-area waterproofing where needed
Impact-isolation system + isolated perimeter joints
Engineered concrete floor structure / beams to coordinate
Services + isolated ceiling where required / finished ceiling

SPACE / ITEM	Meters	Feet / reference
Complete floor allowance	0.40 m	1.31 ft

Layer order only, not a thickness detail. Select a tile-compatible impact system with full floor/ceiling test evidence. Keep rigid edge connections from bypassing it. The 0.40 m total must fit all layers and services; if it cannot, revise the floor level and stair before construction documents. [2] [1]

AP1 / laundry, plumbing and equipment

Select the washer/dryer before service design. G3 + G8 needs appliance-specific heat removal, air supply, clearances and exhaust if applicable; do not seal the machines into an unventilated space. Isolate equipment vibration and pipe supports; locate pumps and condensers away from bedroom walls and neighboring windows. Service and vent routes are not yet drawn. [1]

Finishes and street boundary

Rugs, upholstery and selected absorptive surfaces address echo from hard finishes. [2] Front wall/gate treatment is a later pricing item, after site listening or measurement establishes the traffic exposure. No barrier height or noise reduction is assumed here.

Before selecting products

Record traffic during busy and quiet periods, including night. Set room-specific noise goals with the local designer, select matching tested assemblies, and obtain itemized quotations. This brief reserves space and defines scope; it is not an engineered acoustic design.

[1] YourHome / Noise control

[3] YourHome / Insulation

[2] USG / Acoustics 101

[4] Pilkington / Acoustic laminated glazing

Area, circulation and budget checks

Metric dimensions govern. Feet are decimal and rounded for reference. Areas are shown in square meters and square feet.

Where the 200 m² lot goes

SPACE / ITEM	Square meters / m²	Square feet / ft²
Main ground-floor footprint	94.5 m²	1,017.2 ft²
Front parking / entrance	58.0 m²	624.3 ft²
Nominal side passage	10.5 m²	113.0 ft²
Rear outdoor zone	37.0 m²	398.3 ft²
Total lot allocation	200.0 m²	2,152.8 ft²

Approximate internal room sizes

SPACE / ITEM	Meters	Feet / reference
G1 / Ground queen room	3.50 x 3.90 m 13.7 m²	11.48 x 12.80 ft 146.9 ft²
G2 / Ground shared bath / front	2.00 x 2.30 m 4.6 m²	6.56 x 7.55 ft 49.5 ft²
G3 / Recessed laundry bay	1.45 x 1.30 m 1.9 m²	4.76 x 4.27 ft 20.3 ft²
G5 / Living + dining	8.60 x 3.40 m 29.2 m²	28.22 x 11.15 ft 314.7 ft²
G4 / Kitchen / transition	4.85 x 1.80 m 8.7 m²	15.91 x 5.91 ft 94.0 ft²
U1 / Upper two-double room	4.50 x 4.00 m 18.0 m²	14.76 x 13.12 ft 193.8 ft²
U2 / Open upper shared bathroom	3.60 x 2.30 m 8.3 m²	11.81 x 7.55 ft 89.1 ft²
U5 / Primary bedroom	3.85 x 4.25 m 16.4 m²	12.63 x 13.94 ft 176.1 ft²
U4 / Primary dressing / storage	4.60 x 2.40 m 11.0 m²	15.09 x 7.87 ft 118.8 ft²

Bedroom sizes deduct the 0.10 m lining reserves. These are nominal planning dimensions; final assemblies and finish tolerances may change them. Gross floor area includes partitions. Conversions use unrounded metric values.

Privacy and everyday use

Both shared bathrooms include showers. D2 encloses G3 and G8; loading temporarily uses the passage. Bedroom doors receive acoustic seals. Eight guests assumes sharing both double beds; living seating shown is a three-seat sofa and two chairs.

MXN 4 million working target

Construction + site works, residual allowance	2,600,000
Design, studies and permits, provisional	300,000
Furniture, appliances and linens, provisional	500,000
Contingency / 15%	600,000
Total, excluding land	4,000,000

Unpriced working allocation. Obtain separate quotations for acoustic linings, sealed doors/windows, floor isolation and ventilation. These upgrades are not proven to fit the target. Reprice structure, heights and bathrooms alongside them.


Furniture and stair references

SPACE / ITEM	Meters	Feet / reference
Lot / frontage x depth	10.00 x 20.00 m	32.81 x 65.62 ft
Queen mattress	1.52 x 2.03 m	4.99 x 6.66 ft
King mattress	2.00 x 2.00 m	6.56 x 6.56 ft
Each double mattress	1.35 x 1.90 m	4.43 x 6.23 ft
Dining table / eight seats	2.20 x 0.95 m	7.22 x 3.12 ft
Reserved stair zone	2.50 x 4.60 m	8.20 x 15.09 ft
Provisional floor-to-floor	3.40 m	11.15 ft
Riser / 20 total, 10 per flight	0.170 m	0.56 ft
Tread depth	0.280 m	0.92 ft
Run per flight / 9 treads	2.52 m	8.27 ft
Flight / turning landing	1.05 m	3.44 ft
Front arrival landing	1.00 m	3.28 ft

Stair arithmetic fits the reserved zone. Headroom, guards, finished clear widths, structure and local compliance need professional review. Furniture and cabinetry remain subject to selection and clearance checks.

The fridge belongs in the kitchen.

Approved 80 cm appliance allowance / enlarged plan at approximately 1:28 / meter and feet reference columns

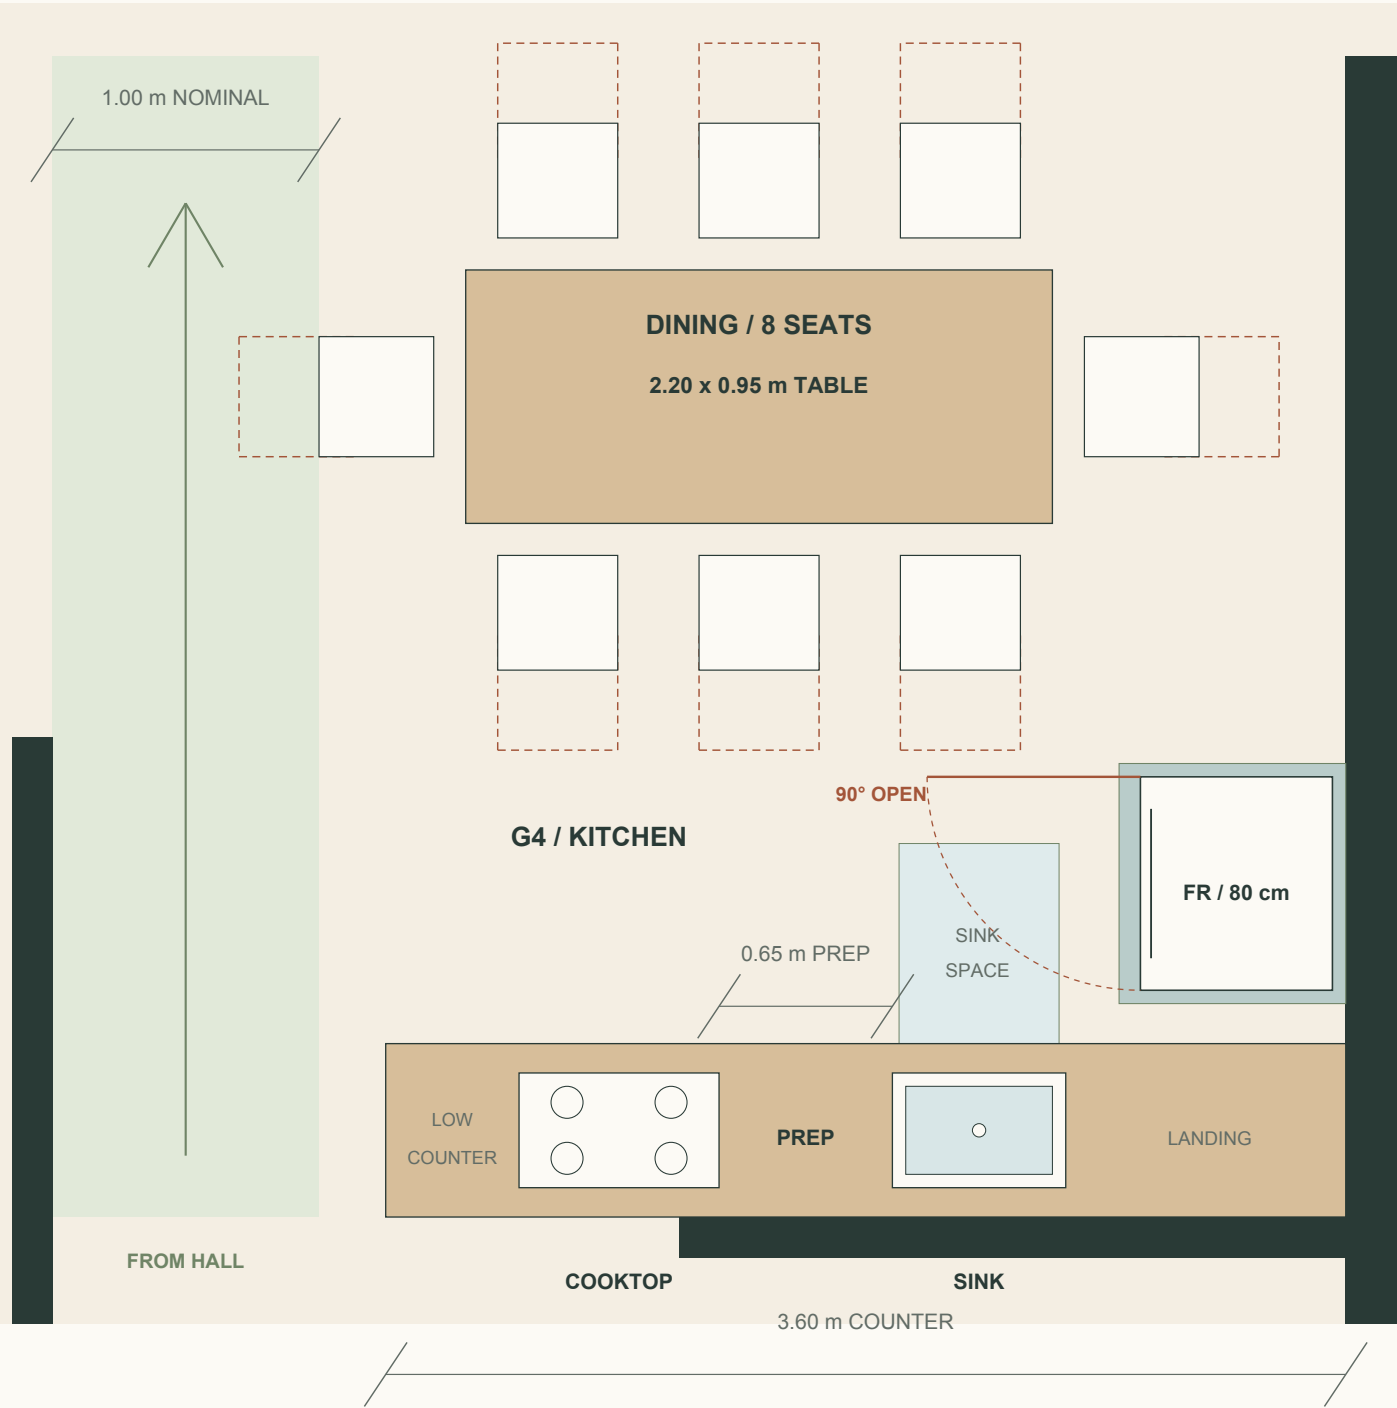

Solid chairs: drawn positions. Dashed chairs: 0.30 m pull-out test.
Blue: sink standing test. Terracotta arc: nominal fridge door movement.

The fridge faces left from the right exterior wall. Its dining-side hinge keeps the illustrated 90-degree leaf clear of the long counter.
The former hallway-facing fridge position becomes low counter; the short sink return is removed.

Kitchen dimensions

SPACE / ITEM	Meters	Feet / reference
Fridge / selected width allowance	0.80 m	2.62 ft
Fridge bay / width x projection	0.90 x 0.85 m	2.95 x 2.79 ft
Long counter / length x depth	3.60 x 0.65 m	11.81 x 2.13 ft
Cooktop / footprint	0.75 x 0.43 m	2.46 x 1.41 ft
Sink / footprint	0.65 x 0.43 m	2.13 x 1.41 ft
Clear prep / cooktop to sink	0.65 m	2.13 ft
Through route / drawn chairs	1.00 m	3.28 ft
Chair pull-out / test movement	0.30 m	0.98 ft
Pulled hall chair / remaining route	0.70 m	2.30 ft
Open leaf to pulled kitchen chair	0.10 m	0.33 ft

Clearance check / what the plan proves

Fixed fit: the counter, fridge bay and appliance footprints fit G4 and leave the nominal hall-to-living route. The sink standing test clears the fridge body. The 90-degree door clears the cabinets and both drawn and tested pulled-out chairs.

Everyday use: pulling the hall-side dining chair out 0.30 m temporarily reduces the nominal route to 0.70 m (2.30 ft). A kitchen-side chair in its tested position is only 0.10 m (0.33 ft) from the open fridge leaf. The door sweep shares part of the sink work area; these are not independent workstations during opening.

Before cabinetry: select the actual refrigerator and verify depth including handles, ventilation, hinge clearance and the opening angle needed for drawers. The 0.90 x 0.85 m bay and 90-degree swing are planning assumptions. Recheck wider opening and actual chair use before fabrication.

Sink supply, waste and cooktop services move with the appliances; coordinate their routes with the stair wall, structure and acoustic details.

The same warm architectural character

5.80 m front court / 4.80 m planning car / 3.70 m rear zone with the same 3.00 m terrace

STREET / FRONT COURT



REAR / COVERED TERRACE



House and terrace move back 0.30 m. The 4.80 m car retains a 0.55 m boundary gap and 0.45 m nose gap; closed-gate clearance is approximately 0.25 m before hardware. Rear: 3.70 m total depth, including the 3.00 m terrace. Views are illustrative; dimensioned plans govern.

FRONT COURT / PARKING CLEARANCES

SPACE / ITEM	Meters	Feet / reference
Street boundary to house	5.80 m	19.03 ft
Car length / planning allowance	4.80 m	15.75 ft
Vehicle gate / clear opening	3.60 m	11.81 ft
Boundary / house bumper gaps	0.55 / 0.45 m	1.80 / 1.48 ft

FOOTPRINTS / REAR TERRACE


SPACE / ITEM	Meters	Feet / reference
Ground floor envelope	9.00 x 10.50 m	29.53 x 34.45 ft
Upper floor envelope	9.00 x 9.50 m	29.53 x 31.17 ft
Rear zone / beyond canopy	3.70 / 0.70 m	12.14 / 2.30 ft
Covered terrace	6.00 x 3.00 m	19.69 x 9.84 ft

Stair windows: separate inward-opening units with solid wall/floor between. Sill/head heights, sash clearance, safe cleaning reach, privacy, shading and glazing performance need detailing. Gate operation: page 9. Gate slats do not establish acoustic performance.

One sliding gate. A clear route to the street.

Single leaf covers the vehicle entrance when closed / slides right behind the fixed fence / plan views at approximately 1:60

CLOSED / ONE COMPLETE VEHICLE GATE

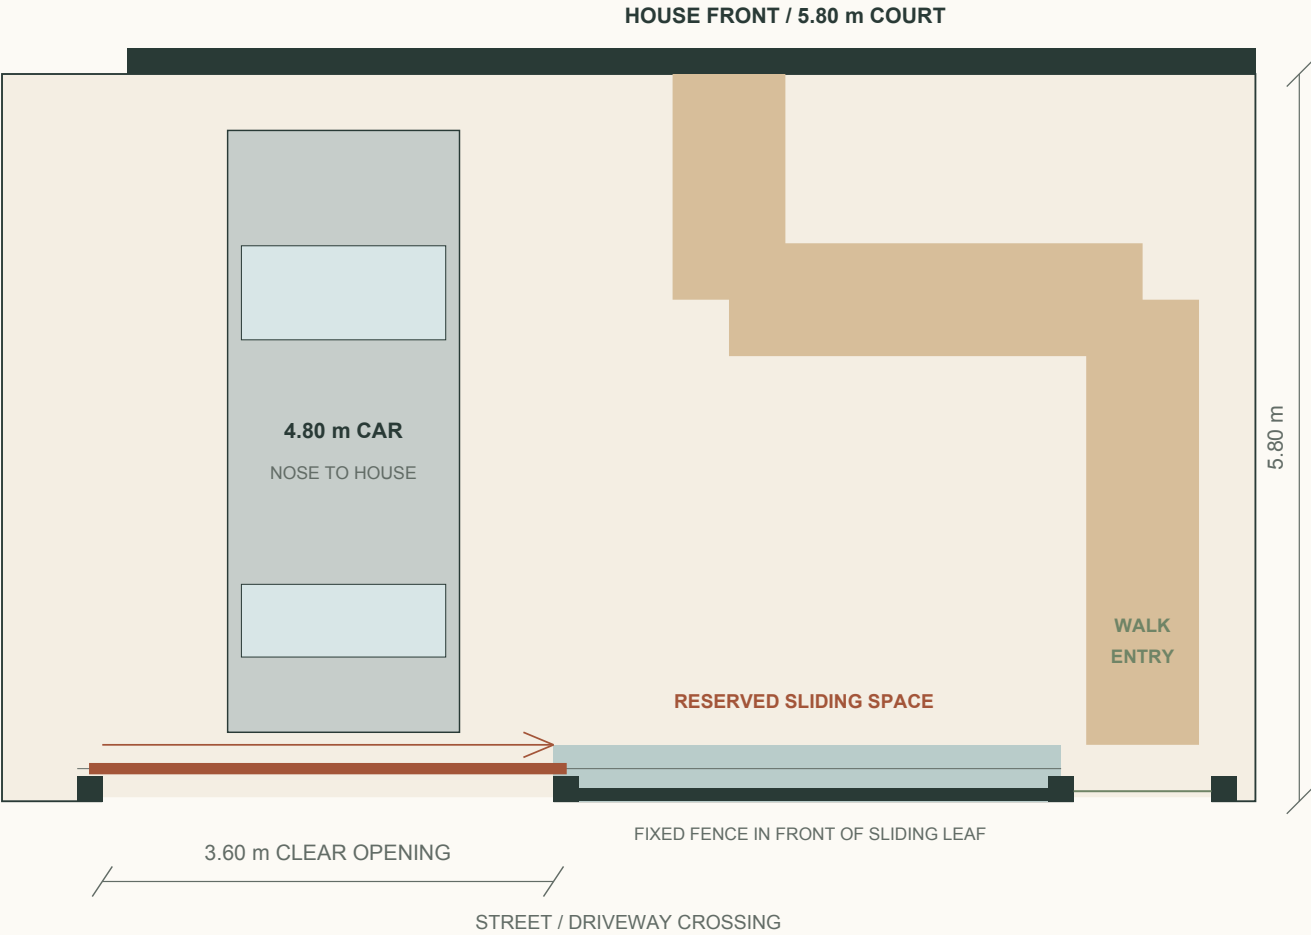


Gate dimensions / planning allowances

SPACE / ITEM	Meters	Feet / reference
Vehicle opening / between posts	3.60 m	11.81 ft
Moving leaf / total length	3.80 m	12.47 ft
Leaf travel / closed to open	3.80 m	12.47 ft
Reserved runback / length x depth	4.05 x 0.45 m	13.29 x 1.48 ft
Separate pedestrian opening	1.10 m	3.61 ft

Terracotta: moving leaf. Dark green: fixed posts and fence. Pale blue: reserved sliding space. Green: clear vehicle corridor when open.

OPEN / CAR REVERSES STRAIGHT OUT

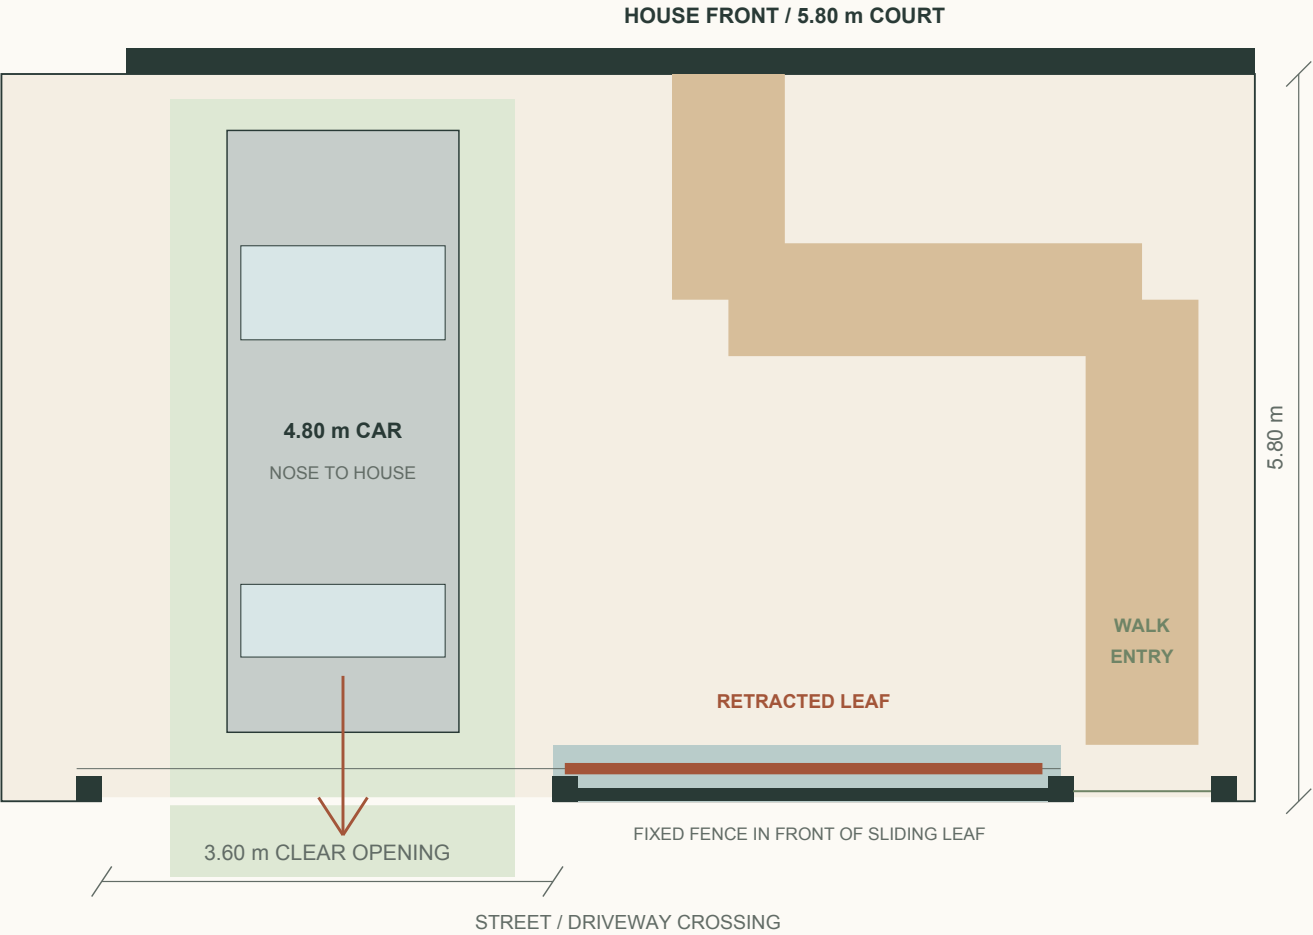

How the gate works

A single leaf covers the entire vehicle opening when closed. It slides right on a parallel track behind the fixed center fence. All posts sit outside the clear opening, and the open leaf is beyond the car route. The pedestrian gate remains separate at the far right.

Reserve the complete sliding space for the gate and its hardware. Keep planting, storage and the pedestrian route outside it. The court is 5.80 m deep for a 4.80 m car. Rear bumper: 0.55 m from the boundary, approximately 0.25 m from the closed leaf before hardware. Nose: 0.45 m from the house. The 3.60 m opening is retained.

Final gate frame, guides, track, stops and any automation require fabrication details. Coordinate a flush driveway crossing, drainage and the curb transition with actual street levels. This plan checks straight passage through the gate; street turning and the selected vehicle remain to be checked on site.