

A windows, with B clay roofs.


Clear ceilings: ground 3.00 m / upper 2.80 m | Floor-to-floor 3.40 m, provisional | Plans at 1:100 on A3 at 100%



Both bathrooms, with clear indoor access.

Enlarged bathroom studies / both at 1:30 on A3 at 100% / meter and feet reference columns below

Ground / bathroom and laundry

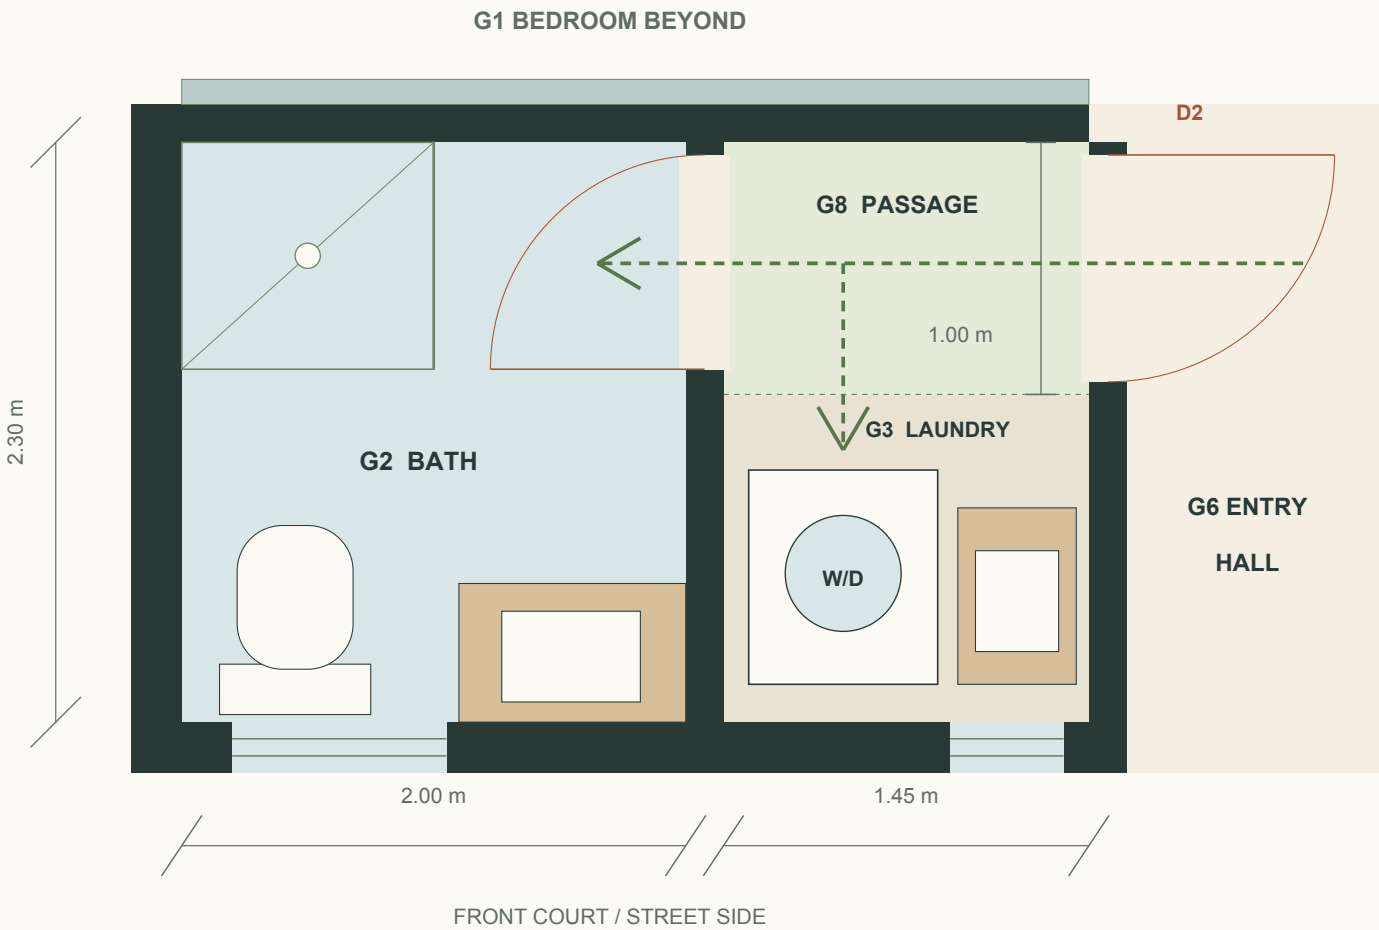


Ground-floor service dimensions

SPACE / ITEM	Meters	Feet / reference
G2 / Bathroom	2.00 x 2.30 m	6.56 x 7.55 ft
G3 / Recessed laundry bay	1.45 x 1.30 m	4.76 x 4.27 ft
G8 / Passage	1.45 x 1.00 m	4.76 x 3.28 ft

D2 opens into G6 and encloses G3 + G8 together. The 1.00 m-deep passage stays free of door swings; its hall doorway is 0.90 m nominal. G2 opens inward. Loading still uses G8 temporarily. Ventilate the enclosure to suit the chosen washer/dryer; see page 5.

Upper / shower at the far end

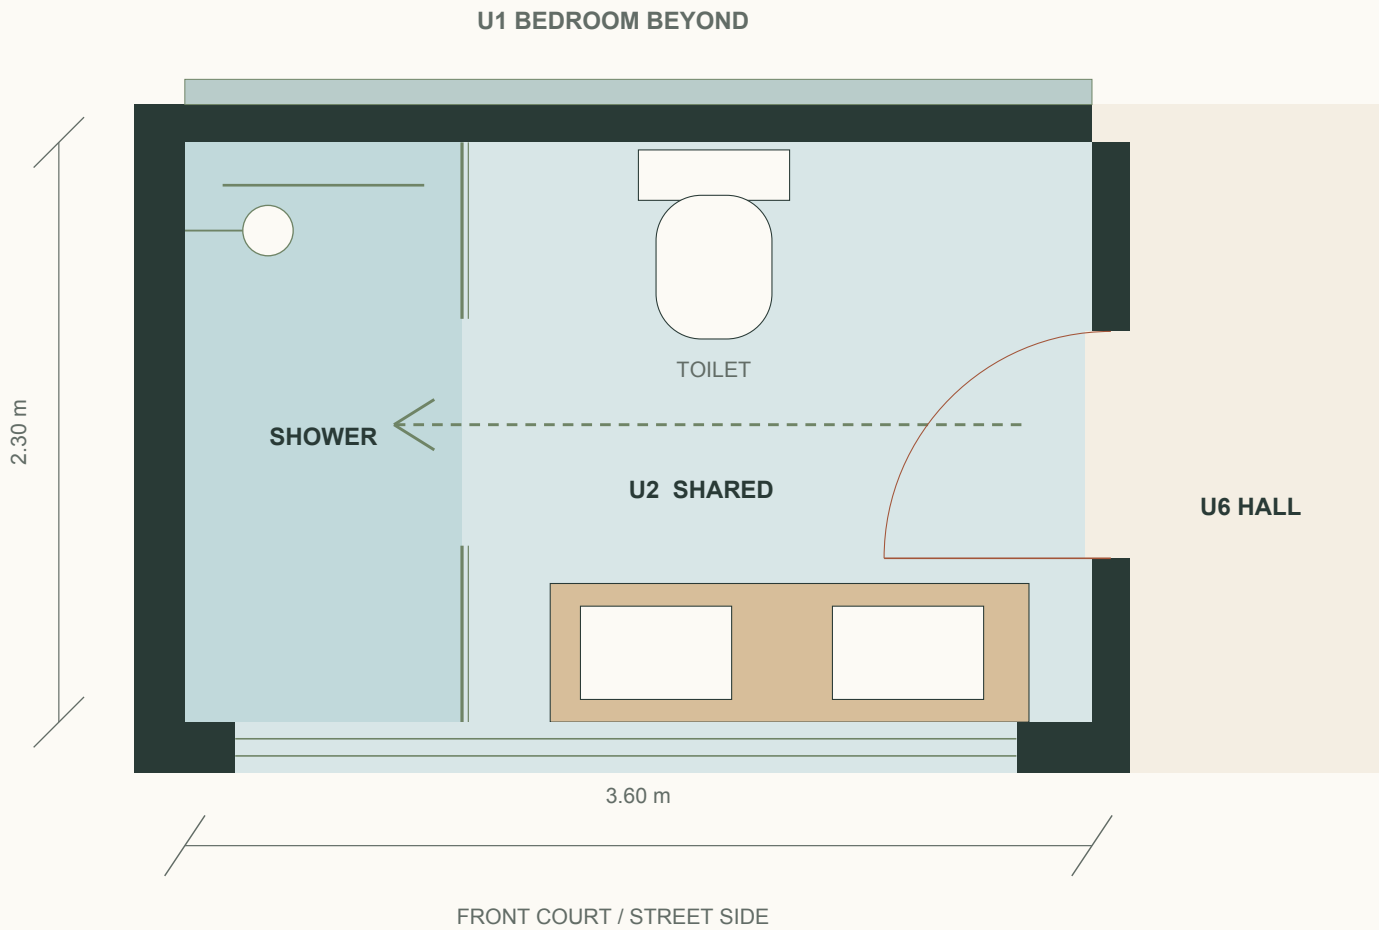

Upper bathroom dimensions


SPACE / ITEM	Meters	Feet / reference
U2 / Open shared bathroom	3.60 x 2.30 m	11.81 x 7.55 ft
Far-end walk-in shower	1.10 x 2.30 m	3.61 x 7.55 ft
Double vanity	1.90 x 0.55 m	6.23 x 1.80 ft
Shower entry / nominal	0.90 m	2.95 ft

The shower remains at the far end, with no separate toilet compartment. A single high obscure-glass opening replaces the two front windows. Its sill is 1.75 m above this floor; coordinate mirrors, shower-screen junction and high-level operation. See page 10.

Adopted heights and the revised stair.

Height diagram: vertical dimensions at 1:50 / stair plan at 1:50 / provisional structure and site levels

Finished floors and clear ceilings

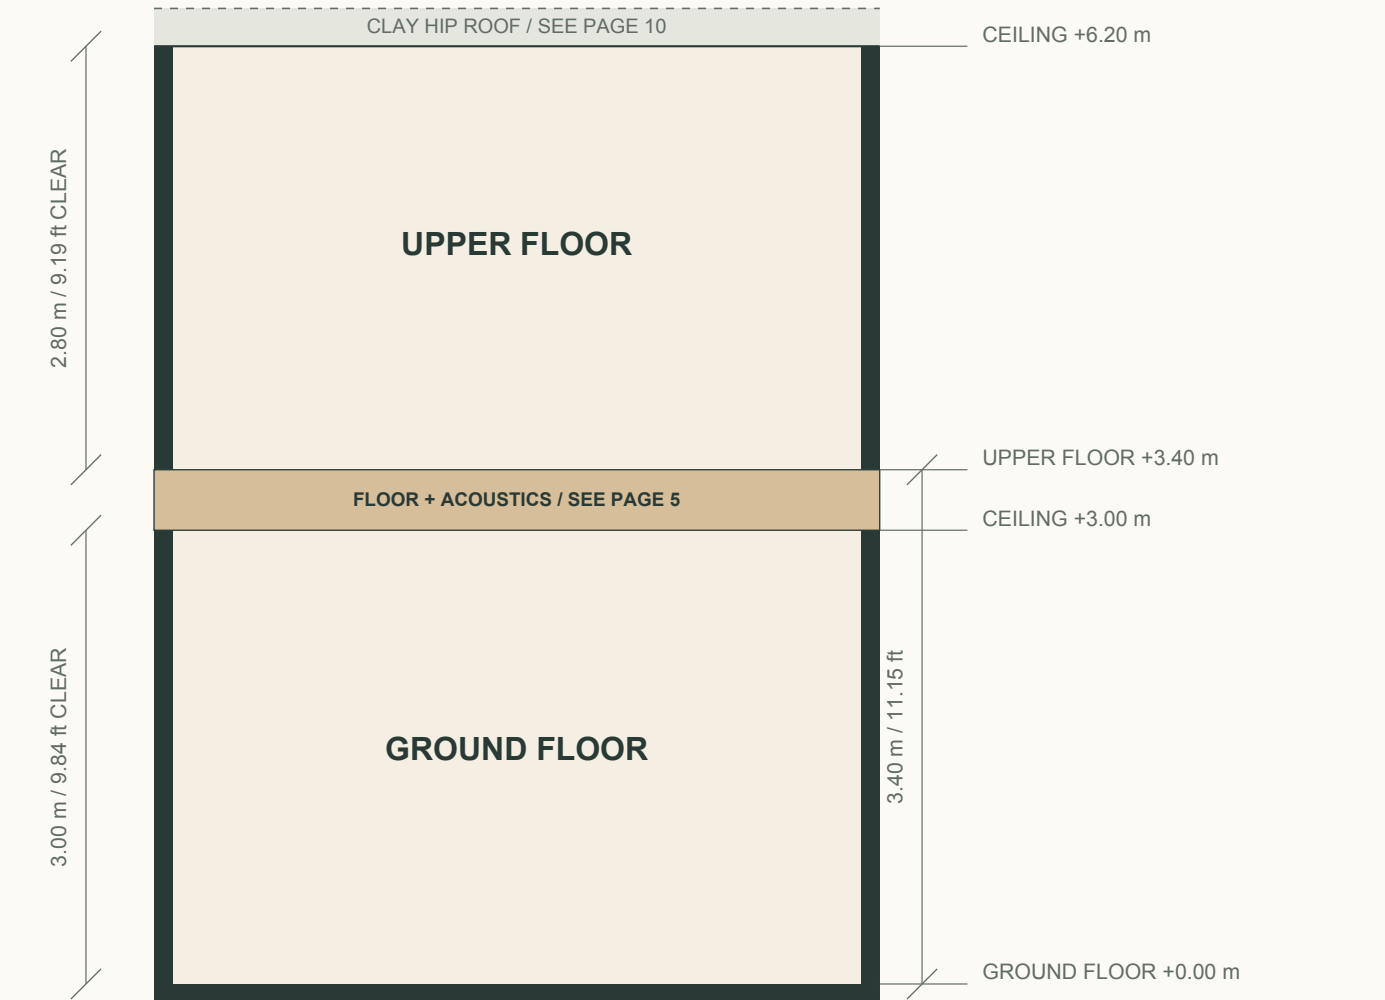


Height references

SPACE / ITEM	Meters	Feet / reference
Ground / clear ceiling	3.00 m	9.84 ft
Upper / clear ceiling	2.80 m	9.19 ft
Ground-to-upper floor	3.40 m	11.15 ft
Floor assembly allowance	0.40 m	1.31 ft
Upper ceiling above datum	6.20 m	20.34 ft

The 0.40 m covers structure, finishes, acoustics, services and any isolated ceiling; layer thicknesses remain unresolved. Coordinate this stack with the stairs. Selected roof levels: page 10. Actual site levels remain unassigned.

20 risers connect the two floors

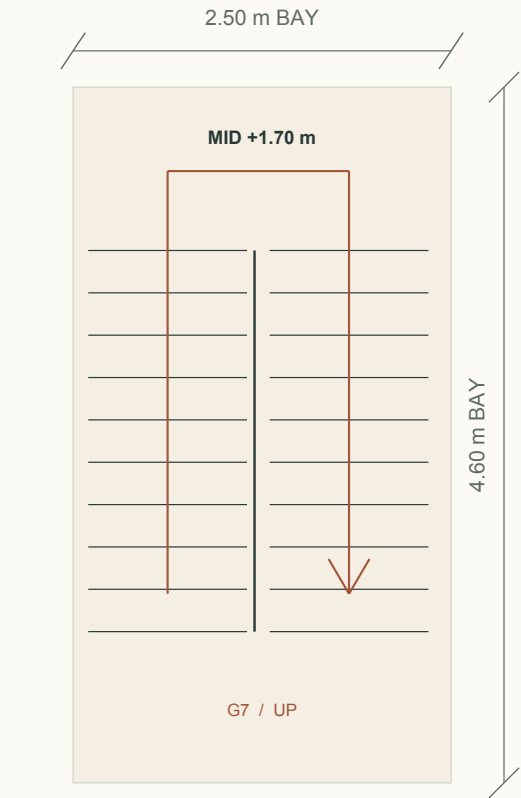

20 x 0.170 m = 3.40 m

Two flights of 10 risers, with nine 280 mm treads per flight. Each run is 2.52 m. The turning landing is at +1.70 m.

D1 closes the stair at ground level

The new door swings into G6, outside the landing. The front entrance moves 0.20 m left to separate the two nominal door sweeps. See the enlarged entrance study on page 4.

Keep the stair opening clear

The opening covers both flights and the turning landing. Final beam positions, services, handrails, guards and clear headroom need coordinated architectural and structural sections.

Stair references


SPACE / ITEM	Meters	Feet / reference
Riser / 20 total	0.170 m	0.56 ft
Tread depth	0.280 m	0.92 ft
Run per flight / 9 treads	2.52 m	8.27 ft
Flight / turning landing	1.05 m	3.44 ft
Front arrival landing	1.00 m	3.28 ft
Reserved stair bay	2.50 x 4.60 m	8.20 x 15.09 ft
Upper stair opening	2.25 x 3.59 m	7.38 x 11.78 ft

Nominal dimensions before detailed finishes and rail design. The stair arithmetic and plan fit are checked; local compliance and final headroom are not certified.

Three layout changes for everyday quiet.

Living detail at 1:50 / entrance detail at 1:40 on A3 at 100% / nominal dimensions before final hardware and finishes

Living / exterior-wall TV and a clear route

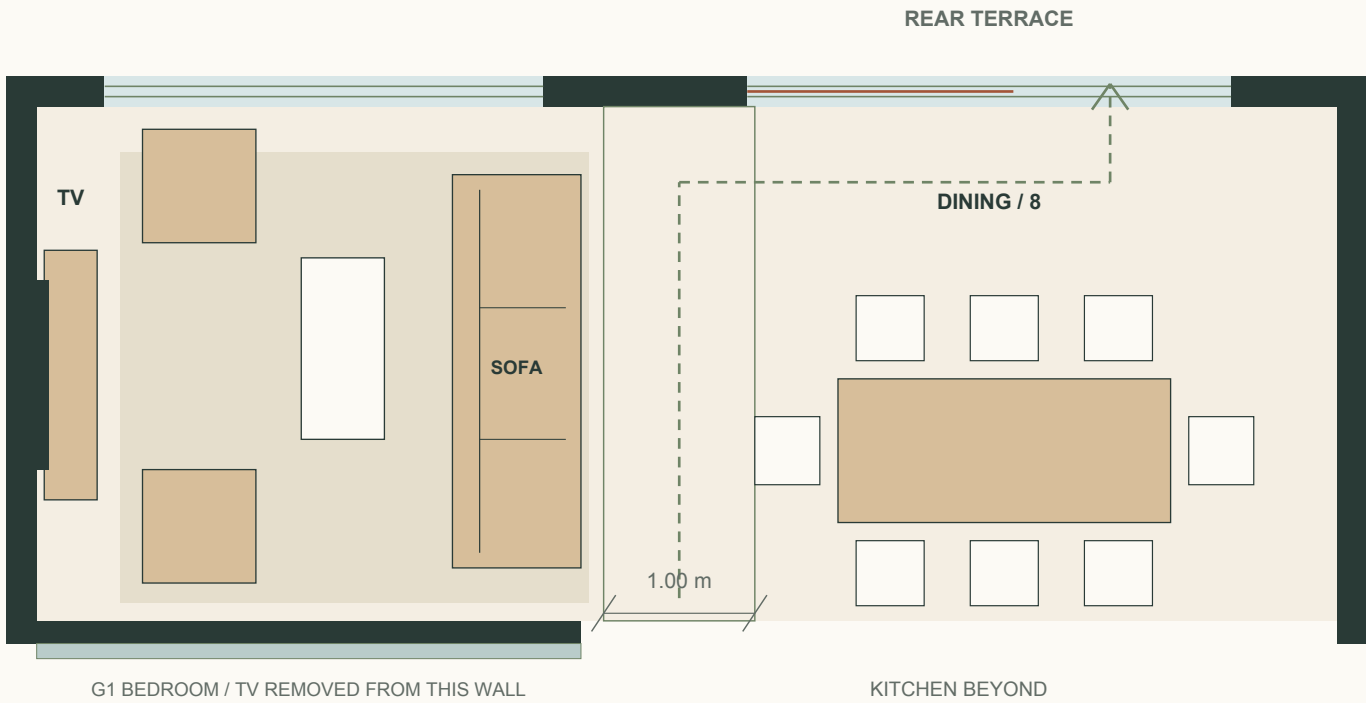


Living / nominal reference dimensions

SPACE / ITEM	Meters	Feet / reference
Three-seat sofa	0.85 x 2.60 m	2.79 x 8.53 ft
Media console	0.35 x 1.65 m	1.15 x 5.41 ft
Route beside seating	1.00 m	3.28 ft
Acoustic lining reserve	0.10 m	0.33 ft

The sofa faces the left exterior wall; two chairs complete the seating group. A nominal 1.00 m route runs between the sofa and dining furniture, then turns toward the rear doors. Check final chair pull-out and door hardware during furnishing selection.

AW1 linings sit inside the bedrooms. Ground G1 loses 0.10 m along each front/rear wall and its hall wall; U1 loses 0.10 m at its bathroom and hall walls; U5 loses 0.10 m at its stair/hall wall. Revised room sizes appear on page 6.

Entrance / doors close outside the landings

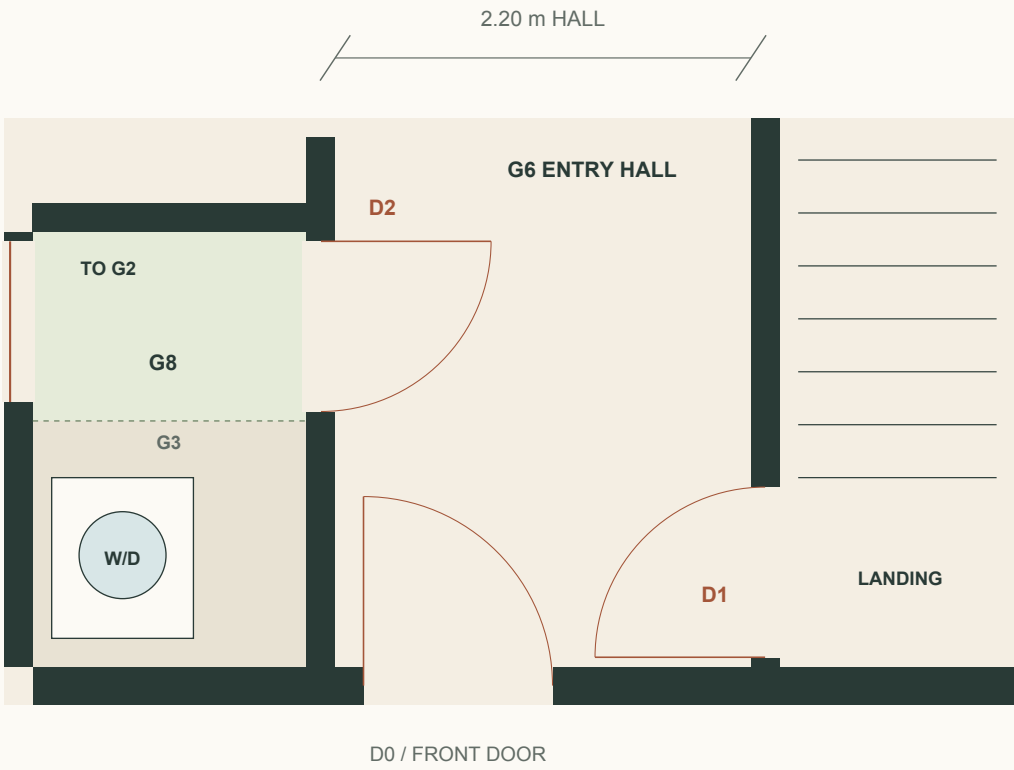

Doors / nominal leaf and passage sizes

SPACE / ITEM	Meters	Feet / reference
D0 / front entrance	1.00 m	3.28 ft
D1 / stair door	0.90 m	2.95 ft
D2 / service door	0.90 m	2.95 ft
G8 / passage depth	1.00 m	3.28 ft
D0 / move left	0.20 m	0.66 ft

D1 swings into G6, outside the stair landing. D2 also swings into G6, leaving G8 free of door sweeps. The nominal D0/D1 sweep envelopes are separated by 0.225 m. Hardware and finished clear openings remain to be detailed.

G3 and G8 form one enclosed laundry/service vestibule. A separate cabinet front would obstruct bathroom access. D2 provides the acoustic closure; G2 retains its own privacy door. Appliance loading temporarily occupies G8.

Construction and acoustic design brief.

Proposed materials and requirements to detail and price / street traffic plus general household noise / no acoustic performance claim yet

Structure, walls and roof

Starting system: engineered reinforced-concrete structure and foundations, concrete-masonry infill and concrete upper floor. The selected clay hip roof and tiled terrace roof need engineered supports, fixings and load paths; their structural system is not selected. Wall cores remain schematic.

Finish with ivory plaster, bronze frames, timber accents and clay roof tiles. Coordinate tile suitability at the proposed 30% slope, insulation, underlay, flashings, drainage and the exposed rear setback. Roof build-up and site levels remain open. [\[3\]](#)

AW1 / bedroom wall assemblies

Reserve 0.10 m on the marked dry bedroom faces for an independent lining: separated framing, mineral-wool cavity absorption and two gypsum layers, subject to a tested assembly fitting the reserve. Carry the separating wall to structure and seal junctions and penetrations. Keep outlets staggered and avoid rigid bridges through the lining. Wet-side backing and waterproofing are separate requirements. [\[1\]](#)

Request complete wall and floor test reports. STC describes airborne separation; IIC describes impact transmission through floor/ceiling assemblies. Do not assign either rating from a material name alone. [\[2\]](#)

AD1 / stair, service and bedroom doors

Use solid-core hinged leaves, robust frames, perimeter seals and compatible drop seals. D1 requires a continuous stair enclosure; D2 closes G3 + G8. Coordinate ventilation paths with the seals. Final leaf/frame ratings and installed clear widths are to be selected. [\[1\]](#)

AV1 / bedroom windows and quiet ventilation

Obtain traffic-noise test data for complete window assemblies, including frames and compression seals. Acoustic laminated glazing is a candidate; its makeup must follow the measured source and solar/thermal requirements. [\[4\]](#) Provide quiet ventilation and cooling with windows closed; detail attenuated air paths rather than relying on door gaps. [\[1\]](#)

AF1 / upper floor, top to bottom

Tile + compatible bedding / wet-area waterproofing where needed
Impact-isolation system + isolated perimeter joints
Engineered concrete floor structure / beams to coordinate
Services + isolated ceiling where required / finished ceiling

SPACE / ITEM	Meters	Feet / reference
Complete floor allowance	0.40 m	1.31 ft

Layer order only, not a thickness detail. Select a tile-compatible impact system with full floor/ceiling test evidence. Keep rigid edge connections from bypassing it. The 0.40 m total must fit all layers and services; if it cannot, revise the floor level and stair before construction documents. [\[2\]](#) [\[1\]](#)

AP1 / laundry, plumbing and equipment

Select the washer/dryer before service design. G3 + G8 needs appliance-specific heat removal, air supply, clearances and exhaust if applicable; do not seal the machines into an unventilated space. Isolate equipment vibration and pipe supports; locate pumps and condensers away from bedroom walls and neighboring windows. Service and vent routes are not yet drawn. [\[1\]](#)

Finishes and street boundary

Rugs, upholstery and selected absorptive surfaces address echo from hard finishes. [\[2\]](#) Front wall/gate treatment is a later pricing item, after site listening or measurement establishes the traffic exposure. No barrier height or noise reduction is assumed here.

Before selecting products

Record traffic during busy and quiet periods, including night. Set room-specific noise goals with the local designer, select matching tested assemblies, and obtain itemized quotations. This brief reserves space and defines scope; it is not an engineered acoustic design.

[\[1\]](#) YourHome / Noise control

[\[3\]](#) YourHome / Insulation

[\[2\]](#) USG / Acoustics 101

[\[4\]](#) Pilkington / Acoustic laminated glazing

Area, circulation and budget checks

Metric dimensions govern. Feet are decimal and rounded for reference. Areas are shown in square meters and square feet.

Where the 200 m² lot goes

SPACE / ITEM	Square meters / m²	Square feet / ft²
Main ground-floor footprint	94.5 m²	1,017.2 ft²
Front parking / entrance	58.0 m²	624.3 ft²
Nominal side passage	10.5 m²	113.0 ft²
Rear outdoor zone	37.0 m²	398.3 ft²
Total lot allocation	200.0 m²	2,152.8 ft²

Approximate internal room sizes

SPACE / ITEM	Meters	Feet / reference
G1 / Ground queen room	3.50 x 3.90 m 13.7 m²	11.48 x 12.80 ft 146.9 ft²
G2 / Ground shared bath / front	2.00 x 2.30 m 4.6 m²	6.56 x 7.55 ft 49.5 ft²
G3 / Recessed laundry bay	1.45 x 1.30 m 1.9 m²	4.76 x 4.27 ft 20.3 ft²
G5 / Living + dining	8.60 x 3.40 m 29.2 m²	28.22 x 11.15 ft 314.7 ft²
G4 / Kitchen / transition	4.85 x 1.80 m 8.7 m²	15.91 x 5.91 ft 94.0 ft²
U1 / Upper two-double room	4.50 x 4.00 m 18.0 m²	14.76 x 13.12 ft 193.8 ft²
U2 / Open upper shared bathroom	3.60 x 2.30 m 8.3 m²	11.81 x 7.55 ft 89.1 ft²
U5 / Primary bedroom	3.85 x 4.25 m 16.4 m²	12.63 x 13.94 ft 176.1 ft²
U4 / Primary dressing / storage	4.60 x 2.40 m 11.0 m²	15.09 x 7.87 ft 118.8 ft²

Bedroom sizes deduct the 0.10 m lining reserves. These are nominal planning dimensions; final assemblies and finish tolerances may change them. Gross floor area includes partitions. Conversions use unrounded metric values.

Privacy and everyday use

Both shared bathrooms include showers. D2 encloses G3 and G8; loading temporarily uses the passage. Bedroom doors receive acoustic seals. Eight guests assumes sharing both double beds; living seating shown is a three-seat sofa and two chairs.

MXN 4 million working target

Construction + site works, residual allowance	2,600,000
Design, studies and permits, provisional	300,000
Furniture, appliances and linens, provisional	500,000
Contingency / 15%	600,000
Total, excluding land	4,000,000

Unpriced working allocation. Obtain separate quotations for acoustic linings, sealed doors/windows, floor isolation and ventilation. Price the clay hip roof, tiled canopy and wider bathroom lintel as added scope. No roof or acoustic upgrades are proven to fit this target.


Furniture and stair references

SPACE / ITEM	Meters	Feet / reference
Lot / frontage x depth	10.00 x 20.00 m	32.81 x 65.62 ft
Queen mattress	1.52 x 2.03 m	4.99 x 6.66 ft
King mattress	2.00 x 2.00 m	6.56 x 6.56 ft
Each double mattress	1.35 x 1.90 m	4.43 x 6.23 ft
Dining table / eight seats	2.20 x 0.95 m	7.22 x 3.12 ft
Reserved stair zone	2.50 x 4.60 m	8.20 x 15.09 ft
Provisional floor-to-floor	3.40 m	11.15 ft
Riser / 20 total, 10 per flight	0.170 m	0.56 ft
Tread depth	0.280 m	0.92 ft
Run per flight / 9 treads	2.52 m	8.27 ft
Flight / turning landing	1.05 m	3.44 ft
Front arrival landing	1.00 m	3.28 ft

Stair arithmetic fits the reserved zone. Headroom, guards, finished clear widths, structure and local compliance need professional review. Furniture and cabinetry remain subject to selection and clearance checks.

The fridge belongs in the kitchen.

Approved 80 cm appliance allowance / enlarged plan at approximately 1:28 / meter and feet reference columns

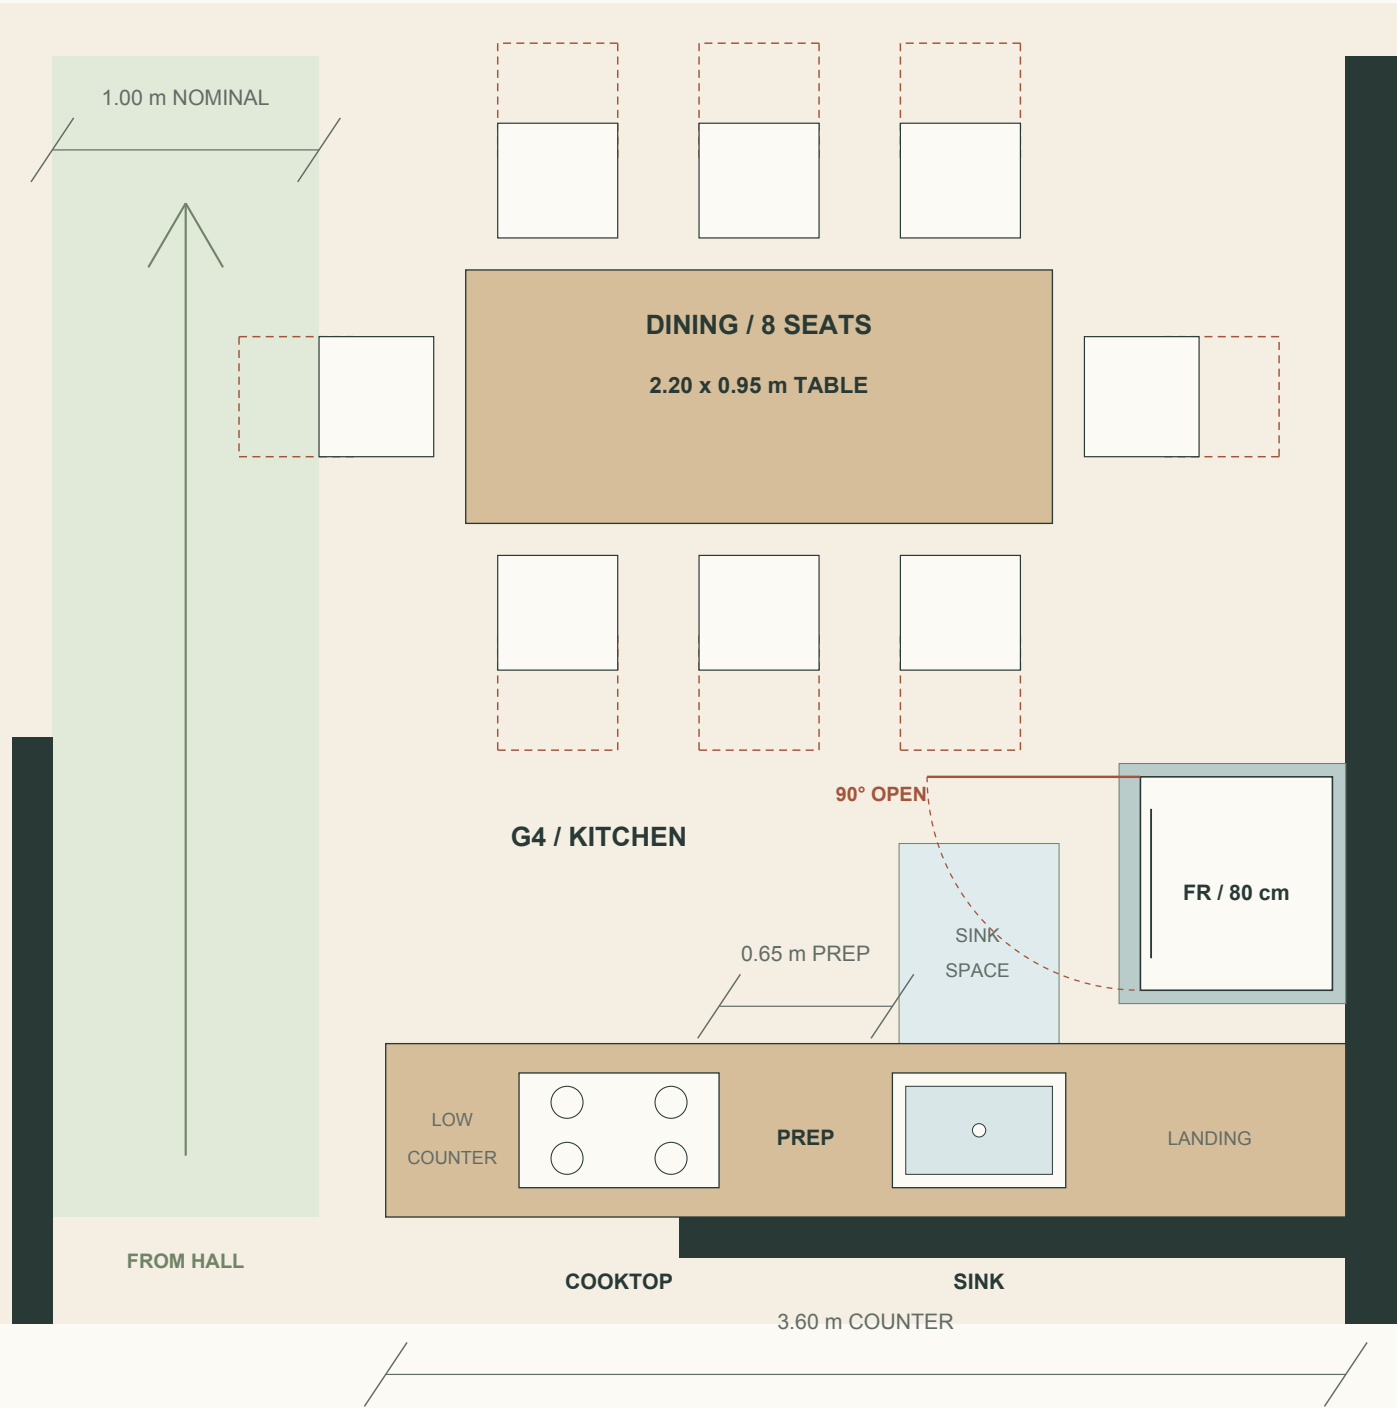

Solid chairs: drawn positions. Dashed chairs: 0.30 m pull-out test.
Blue: sink standing test. Terracotta arc: nominal fridge door movement.

The fridge faces left from the right exterior wall. Its dining-side hinge keeps the illustrated 90-degree leaf clear of the long counter.
The former hallway-facing fridge position becomes low counter; the short sink return is removed.

Kitchen dimensions

SPACE / ITEM	Meters	Feet / reference
Fridge / selected width allowance	0.80 m	2.62 ft
Fridge bay / width x projection	0.90 x 0.85 m	2.95 x 2.79 ft
Long counter / length x depth	3.60 x 0.65 m	11.81 x 2.13 ft
Cooktop / footprint	0.75 x 0.43 m	2.46 x 1.41 ft
Sink / footprint	0.65 x 0.43 m	2.13 x 1.41 ft
Clear prep / cooktop to sink	0.65 m	2.13 ft
Through route / drawn chairs	1.00 m	3.28 ft
Chair pull-out / test movement	0.30 m	0.98 ft
Pulled hall chair / remaining route	0.70 m	2.30 ft
Open leaf to pulled kitchen chair	0.10 m	0.33 ft

Clearance check / what the plan proves

Fixed fit: the counter, fridge bay and appliance footprints fit G4 and leave the nominal hall-to-living route. The sink standing test clears the fridge body. The 90-degree door clears the cabinets and both drawn and tested pulled-out chairs.

Everyday use: pulling the hall-side dining chair out 0.30 m temporarily reduces the nominal route to 0.70 m (2.30 ft). A kitchen-side chair in its tested position is only 0.10 m (0.33 ft) from the open fridge leaf. The door sweep shares part of the sink work area; these are not independent workstations during opening.

Before cabinetry: select the actual refrigerator and verify depth including handles, ventilation, hinge clearance and the opening angle needed for drawers. The 0.90 x 0.85 m bay and 90-degree swing are planning assumptions. Recheck wider opening and actual chair use before fabrication.

Sink supply, waste and cooktop services move with the appliances; coordinate their routes with the stair wall, structure and acoustic details.

A windows, B roofs: the selected exterior

5.80 m front court / 4.80 m planning car / 3.70 m rear zone with the same 3.00 m terrace

STREET / FRONT COURT



REAR / COVERED TERRACE



A supplies the high bathroom ribbon, two wider stair windows, ivory plaster and slim entry shade. B supplies the clay hip roof and tiled terrace canopy. The latest 5.80 m court, 4.80 m car and 0.70 m rear strip remain. Views are illustrative; measured geometry on page 10 governs.

FRONT COURT / PARKING CLEARANCES

SPACE / ITEM	Meters	Feet / reference
Street boundary to house	5.80 m	19.03 ft
Car length / planning allowance	4.80 m	15.75 ft
Vehicle gate / clear opening	3.60 m	11.81 ft
Boundary / house bumper gaps	0.55 / 0.45 m	1.80 / 1.48 ft

FOOTPRINTS / REAR TERRACE


SPACE / ITEM	Meters	Feet / reference
Ground floor envelope	9.00 x 10.50 m	29.53 x 34.45 ft
Upper floor envelope	9.00 x 9.50 m	29.53 x 31.17 ft
Rear zone / beyond canopy	3.70 / 0.70 m	12.14 / 2.30 ft
Covered terrace	6.00 x 3.00 m	19.69 x 9.84 ft

The original three-version study remains in design/style-study-01. This hybrid is the current direction. Roof and window schedules: page 10; gate operation: page 9. Roof support, drainage, glazing, safe window operation and cost remain unverified.

One sliding gate. A clear route to the street.

Single leaf covers the vehicle entrance when closed / slides right behind the fixed fence / plan views at approximately 1:60

CLOSED / ONE COMPLETE VEHICLE GATE

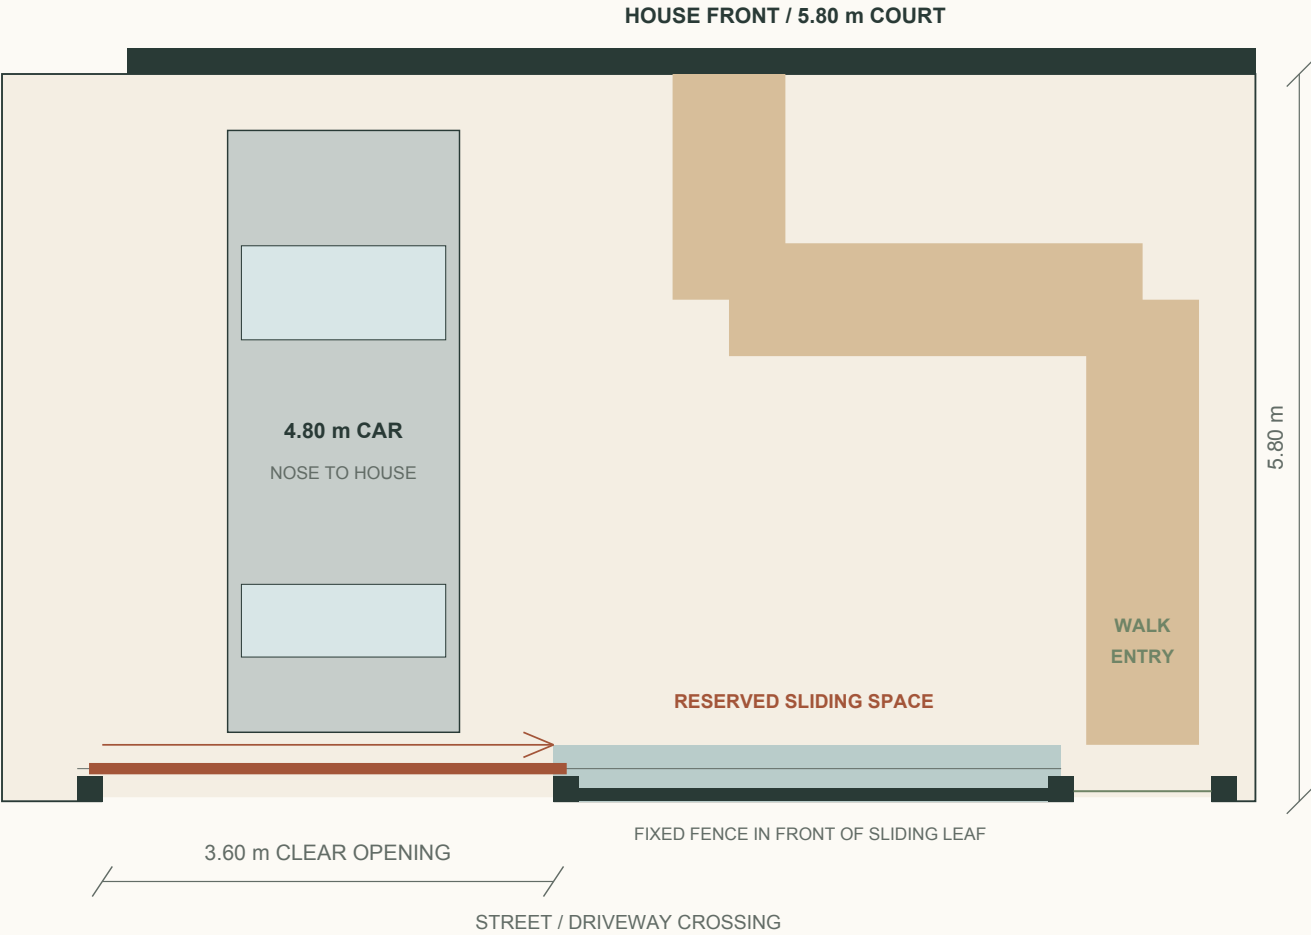


Gate dimensions / planning allowances

SPACE / ITEM	Meters	Feet / reference
Vehicle opening / between posts	3.60 m	11.81 ft
Moving leaf / total length	3.80 m	12.47 ft
Leaf travel / closed to open	3.80 m	12.47 ft
Reserved runback / length x depth	4.05 x 0.45 m	13.29 x 1.48 ft
Separate pedestrian opening	1.10 m	3.61 ft

Terracotta: moving leaf. Dark green: fixed posts and fence. Pale blue: reserved sliding space. Green: clear vehicle corridor when open.

OPEN / CAR REVERSES STRAIGHT OUT

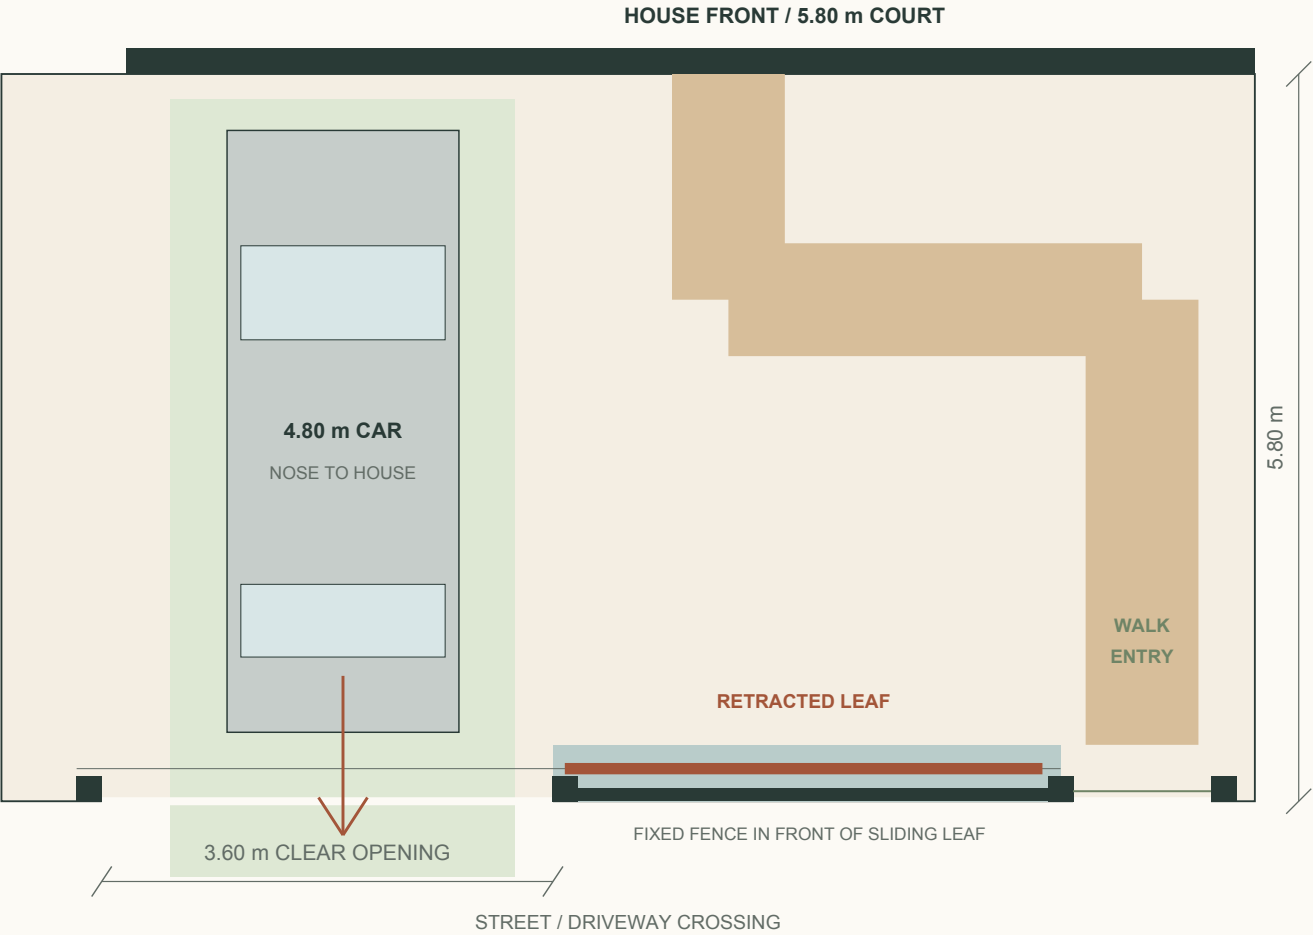

How the gate works

A single leaf covers the entire vehicle opening when closed. It slides right on a parallel track behind the fixed center fence. All posts sit outside the clear opening, and the open leaf is beyond the car route. The pedestrian gate remains separate at the far right.


Reserve the complete sliding space for the gate and its hardware. Keep planting, storage and the pedestrian route outside it. The court is 5.80 m deep for a 4.80 m car. Rear bumper: 0.55 m from the boundary, approximately 0.25 m from the closed leaf before hardware. Nose: 0.45 m from the house. The 3.60 m opening is retained.

Final gate frame, guides, track, stops and any automation require fabrication details. Coordinate a flush driveway crossing, drainage and the curb transition with actual street levels. This plan checks straight passage through the gate; street turning and the selected vehicle remain to be checked on site.


Selected windows and clay-roof geometry.

A opening layout and ivory/bronze palette + B main and terrace roofs / Concept 11 site retained / relative levels from ground finished floor


FRONT ELEVATION / OPENINGS IN THEIR ROOMS

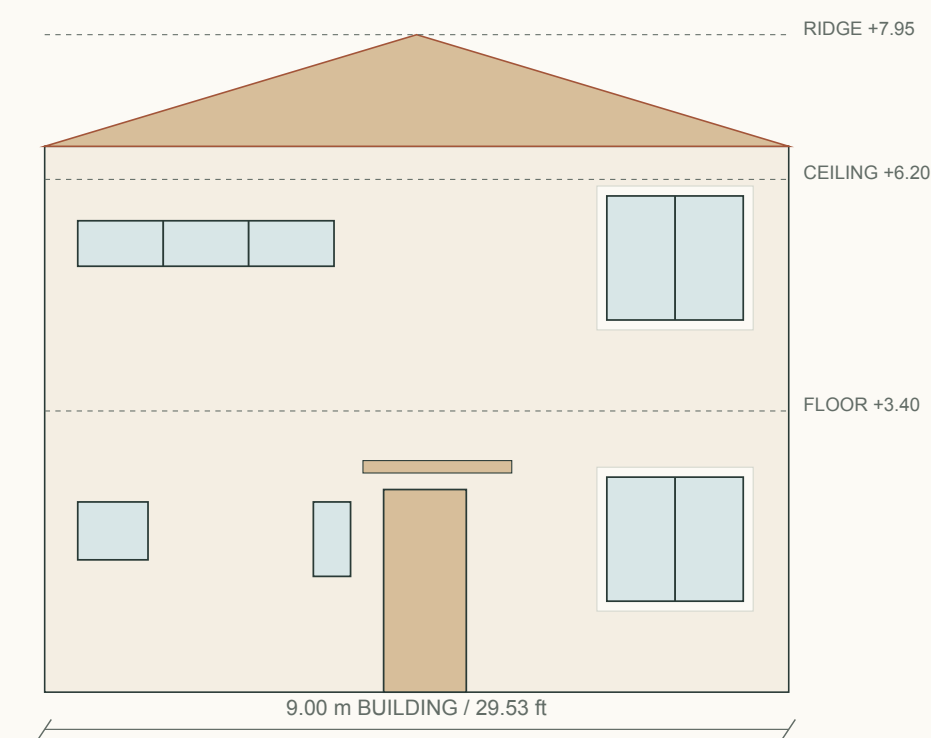

ROOFS WITHIN LOT

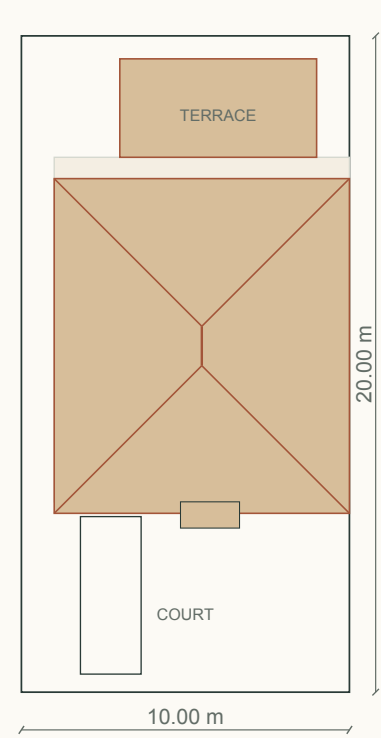

SIDE PROFILE / ROOF HEIGHT ADDED SEPARATELY

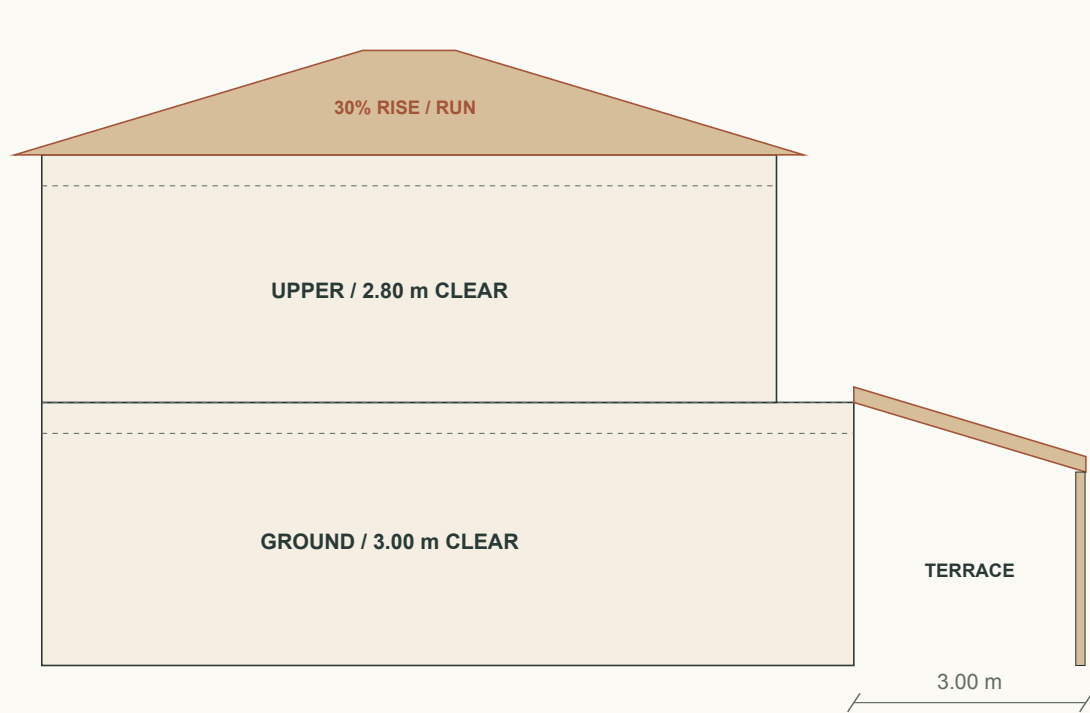

A / front opening and entrance schedule

SPACE / ITEM	Meters	Feet / reference
Upper bathroom / W x H	3.10 x 0.55 m	10.17 x 1.80 ft
Bathroom sill / head above datum	5.15 / 5.70 m	16.90 / 18.70 ft
Bathroom sill above upper floor	1.75 m	5.74 ft
Each stair opening / W x H	1.65 x 1.50 m	5.41 x 4.92 ft
Stair sills / ground, upper	1.10 / 4.50 m	3.61 / 14.76 ft
Stair heads / ground, upper	2.60 / 6.00 m	8.53 / 19.69 ft
Stair reveal / projection	0.20 m	0.66 ft
Entry canopy / width x projection	1.80 x 0.80 m	5.91 x 2.62 ft
Entry canopy / clear soffit	2.65 m	8.69 ft

Bathroom: three obscure-glass modules within one opening. The opening stays in U2 above the shower/vanity zone; coordinate the lintel, mirrors, glass-screen junction and operating hardware. Stair: retain two separate inward-opening units and a solid floor band; guards, sash clearance and safe cleaning reach need detailing.

B / roofs translated to the current site

SPACE / ITEM	Meters	Feet / reference
Main roof / eave level	6.60 m	21.65 ft
Main roof / highest ridge	7.95 m	26.08 ft
Ridge above upper ceiling	1.75 m	5.74 ft
Main roof footprint / W x D	9.00 x 10.20 m	29.53 x 33.46 ft
Front / rear eave projection	0.35 m	1.15 ft
Side eave projection	0.00 m	0.00 ft
Terrace roof / low, high top	2.70 / 3.60 m	8.86 / 11.81 ft
Terrace / outer clear soffit	2.50 m	8.20 ft
Terrace roof / W x D	6.00 x 3.00 m	19.69 x 9.84 ft

Both tile roofs use 30% rise/run provisionally. Structure, tile-system pitch compatibility, fixing, underlay, drainage and the exposed 1.00 m rear setback junction remain to be designed and priced. Roof edges and gutters must remain within the lot. The MXN 4 million allocation is unverified.