

2

Total No.of Floors

14

Total No.of Sensors

Date Hierarchy

Select all

2023

Qtr 1

January

February

March

Qtr 2

Qtr 3

Qtr 4

Floor

Select all

H-3F

H-4F

Current Outdoor Stats

19/02/2023 18:00:00

9.50

Temperature (C)

77.40

Humidity (%)

0.80

Windspeed

Last 30 mins status window

Floor	Sensor Id	Temperature (C)	Humidity (%)	CO2 levels (ppm)
H-3F	ENKZYW001792	22.23	30.00	431.43
H-3F	ENKZYW001804	21.68	33.00	434.00
H-3F	ENKZYW001819	21.85	33.00	436.83
H-3F	ENKZYW001837	22.00	32.00	434.17
H-3F	ENKZYW001848	21.70	32.00	431.25
H-3F	ENKZYW001856	21.70	32.00	434.00
H-3F	ENKZYW001882	20.50	35.00	428.75
H-4F	ENKZYW001883	20.07	35.00	433.50
H-4F	ENKZYW001884	19.85	36.00	435.17
H-4F	ENKZYW001888	21.10	34.00	434.33
H-4F	ENKZYW001900	22.40	31.00	432.83

Average Temperature (C) by Date and Floor

Floor

H-3F

H-4F

Indoor: Summary Statistic

565.38 ppm

Avg. CO2

1378.00 ppm

Max CO2

411.00 ppm

Min CO2

31.27%

Avg. Humidity

62.00%

Max. Humidity

20.00%

Min Humidity

23.52°C

Avg Temperature

27.20°C

Max Temperature

13.00°C

Min Temperature

Outdoor: Summary Statistic

0.81

Avg. Windspeed

8.10

Max Windspeed

0.00

Min Windspeed

82.62%

Avg. Humidity

93.00%

Max Humidity

50.00%

Min Humidity

5.76°C

Avg Temperature

13.80°C

Max Temperature

-2.70°C

Min Temperature

Sensor Location on Floor sized by CO2 variation in last 1hr

Floor

H-3F

H-4F

Indoor Facilities Management Dashboard

Foster + Partners

Floor

H-3F

H-4F

Sensor

Select all

H-3F

ENKZYW001792

ENKZYW001804





ENKZYW001819

ENKZYW001837

ENKZYW001848

ENKZYW001856

ENKZYW001882

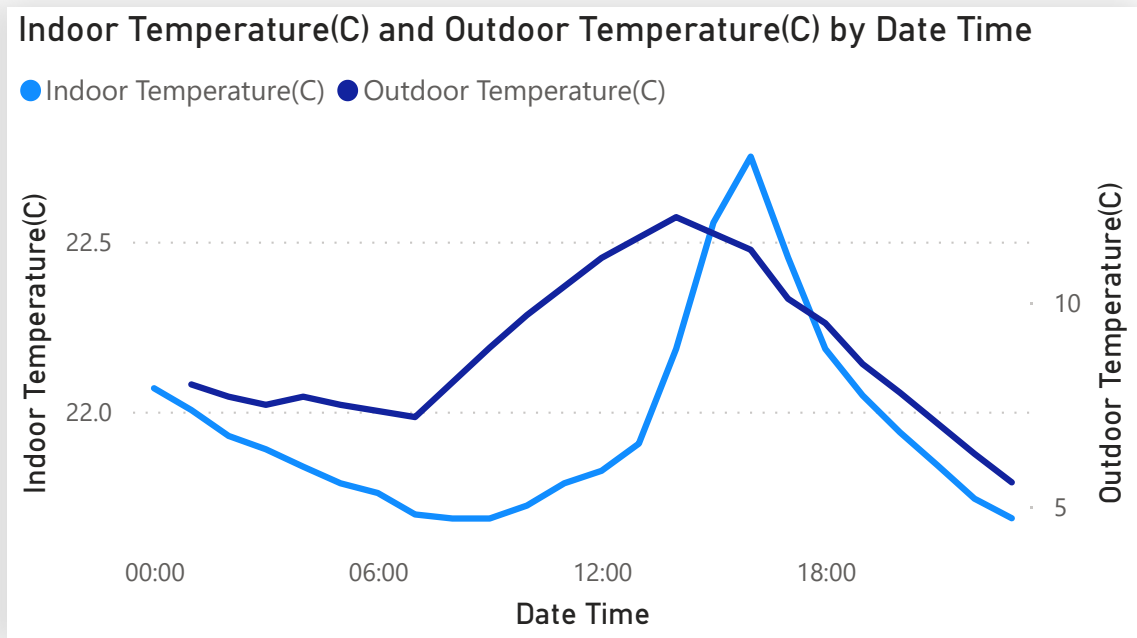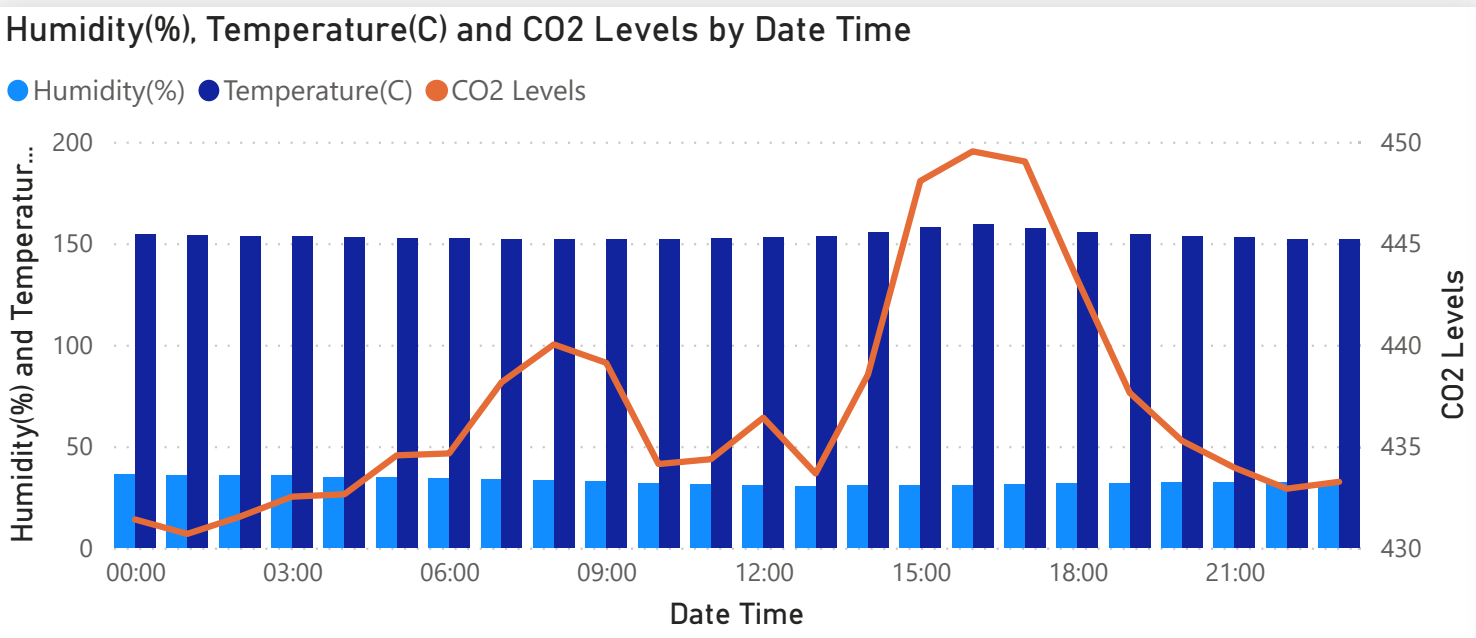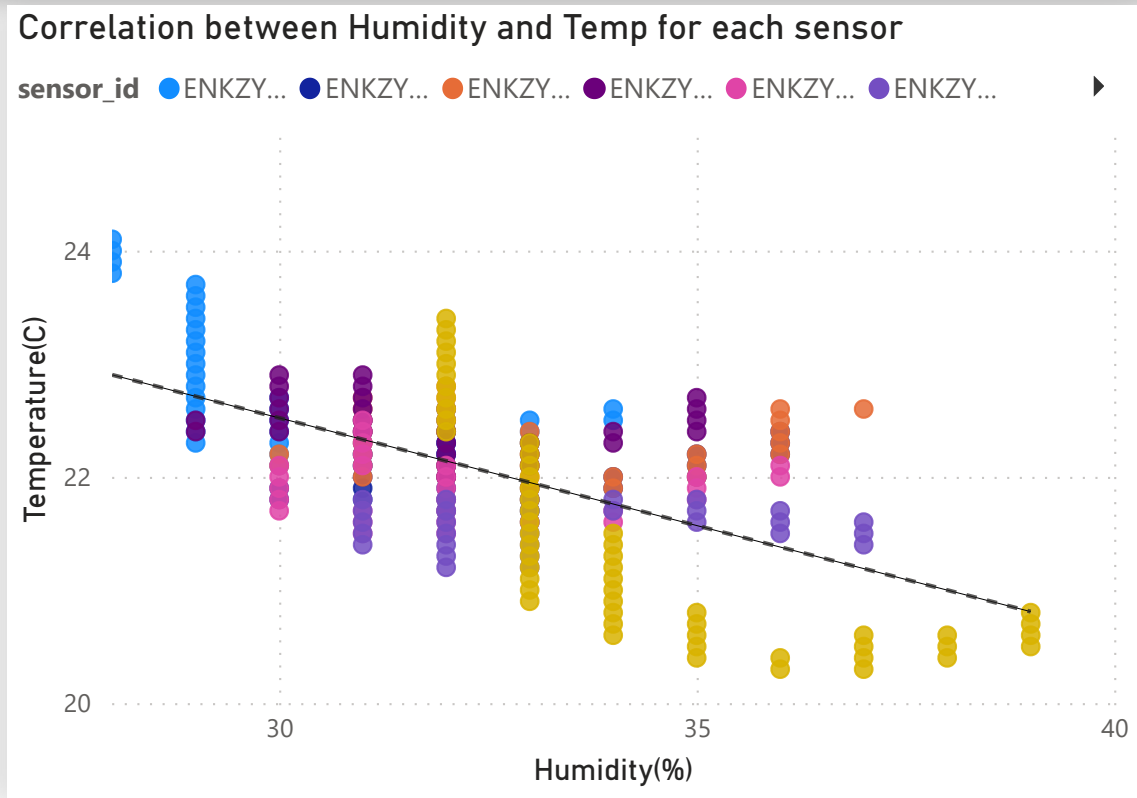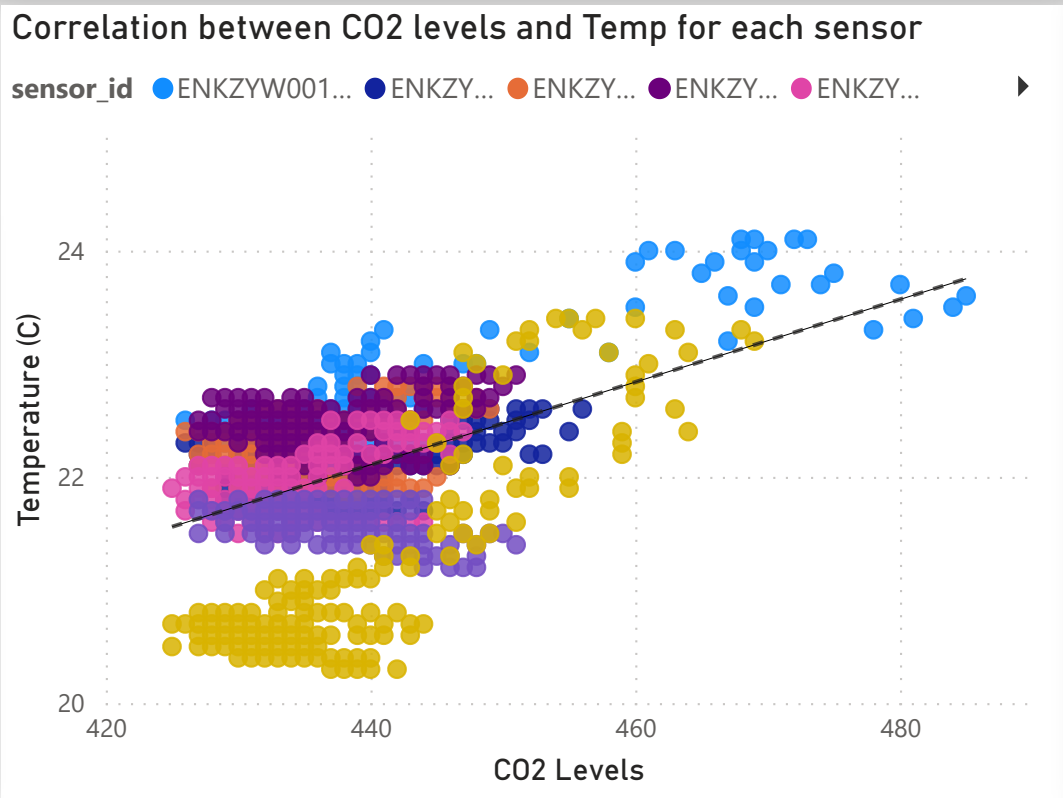

19 February 2023

Date


Floor

H-3F

H-4F


Humidity_ratio by Sensor Location

Humidity Ratio 0.57 0.60

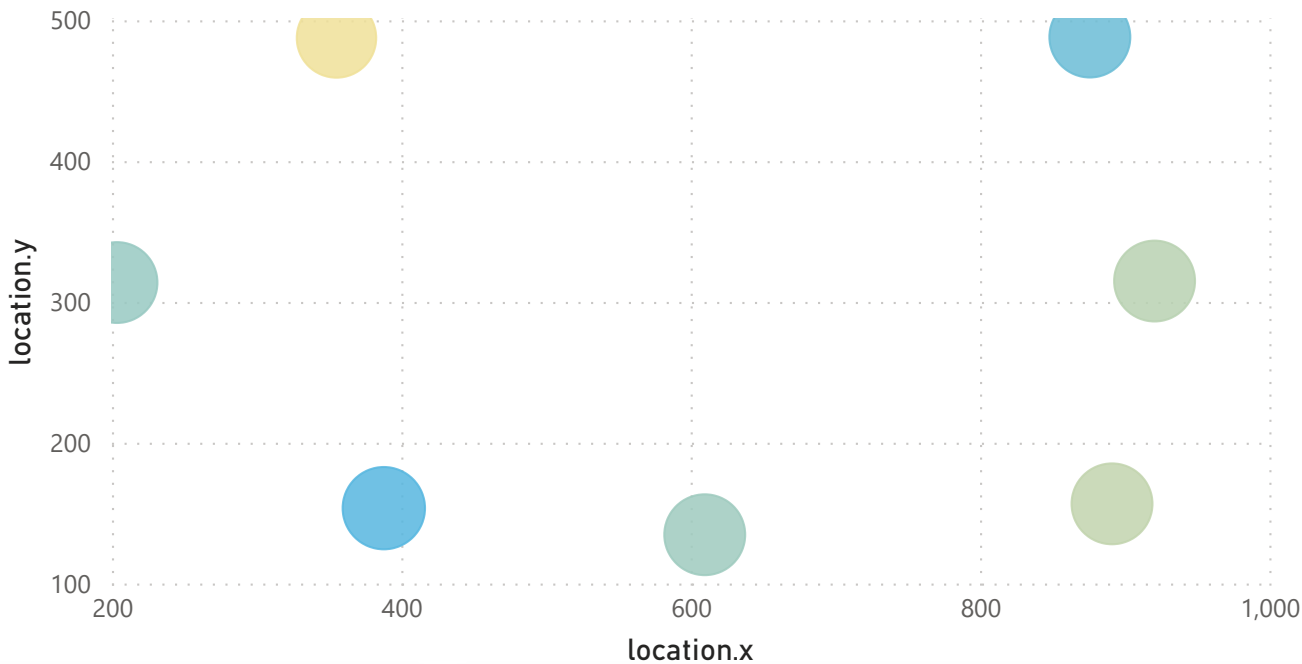

CO2 Levels by Sensor Location

Average CO2 Levels 432.39 435.91

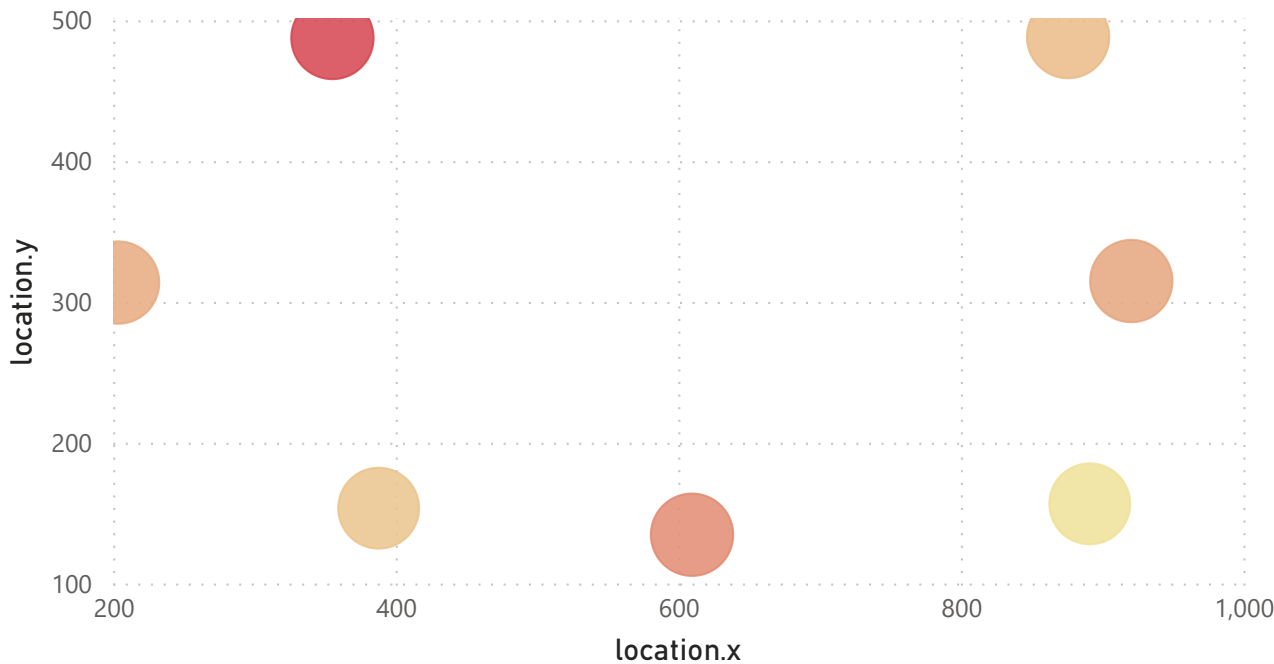

Sensor ID

- Select all
- ENKZYW001792

ENKZYW001804

ENKZYW001819

ENKZYW001837

ENKZYW001848

ENKZYW001856

ENKZYW001882

Date	Time	Sensor ID	CO2 Levels(ppm)	Temperature (C)	Humidity (%)	Humidity Ratio
14 February 2023	12:00:00 PM	ENKZYW001856	1,331.75	24.07	32.00	0.65
23 January 2023	11:00:00 AM	ENKZYW001882	1,280.67	21.82	25.56	0.45
23 January 2023	01:00:00 PM	ENKZYW001837	1,259.18	22.61	25.73	0.48
23 January 2023	12:00:00 PM	ENKZYW001882	1,238.67	22.09	26.00	0.47
14 February 2023	11:00:00 AM	ENKZYW001856	1,238.27	23.30	31.09	0.60