








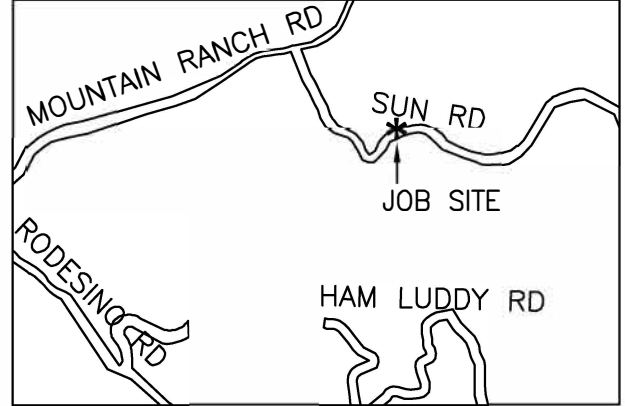
# LEGEND

-  REMOVE JOINT POLE
-  INSTALL JOINT POLE
-  EXISTING JOINT ANCHOR
-  REMOVE TX
-  INSTALL TX
-  REMOVE RISER
-  INSTALL RISER

1

COORDINATE #  
319949563140  
LOADING DISTRICT  
SUMMER INTERIOR  
TX SIZE — 15KVA  
KVA 1Ø — 11.5  
KVA 3Ø — N/A  
% L.F. — 23%

## VICINITY MAP



## RISER QUAD

4" PG



SAP ID # 101273114

45'/50' — CL 3

SET 8.0' DEEP

SAME HOLE SET


REMOVE 15 KVA TX

INST 15 KVA TX

(2) EXISTING JO ANC GOOD 20M — 20.0' LD

1-7/16" PRI DG ATTACH @ 40.58

1-7/16" PRI DG ATTACH @ 37.67

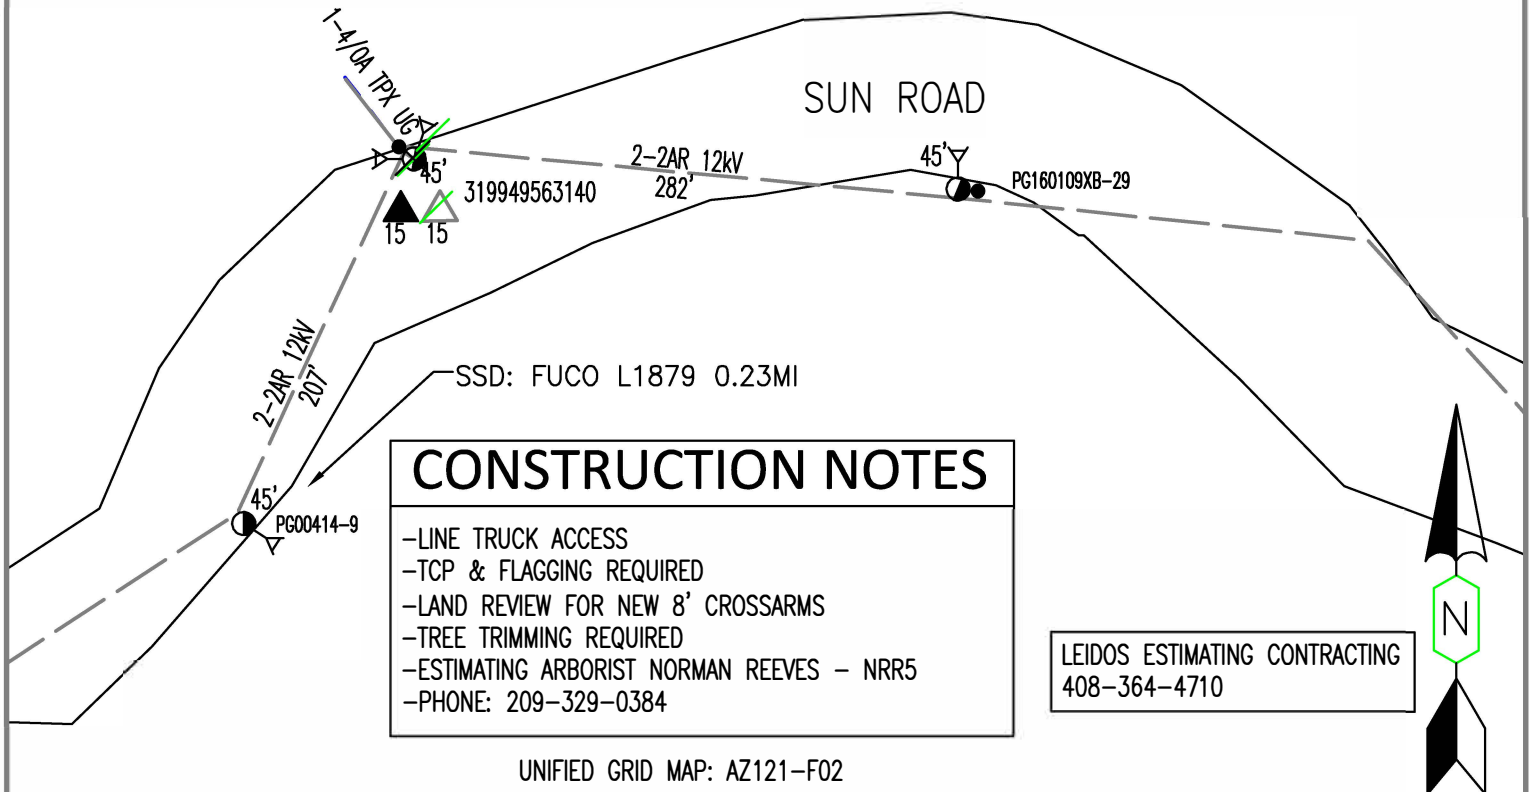

## CONSTRUCTION NOTES

- LINE TRUCK ACCESS
- TCP & FLAGGING REQUIRED
- LAND REVIEW FOR NEW 8' CROSSARMS
- TREE TRIMMING REQUIRED
- ESTIMATING ARBORIST NORMAN REEVES — NRR5
- PHONE: 209-329-0384

LEIDOS ESTIMATING CONTRACTING  
408-364-4710

UNIFIED GRID MAP: AZ121-F02

PRIMARY VOLTAGE: 12 kV VOLTAGE AREA: 2  
LATITUDE: 38.23402 LONGITUDE: -120.518361  
SOURCE SIDE DEVICE: FUCO L1879  
SUB & CIRCUIT: CALAVERAS CEMENT 1101

DSGN SAG: HVY RAPTOR ZONE: YES  
LOADING AREA: HVY ARRESTER DIST: 1  
CORROSION AREA: NON INSULATION DIST: D

EXEMPT EQUIP.INST.: YES FIRE AREA: SRA-TIER 2

CONSTRUCTION SKETCH  
07D POLE REPLACEMENTS  
9363 SUN RD, MOUNTAIN RANCH



NO ENVIRONMENTAL  
ISSUES

NEAR LOC: N/A



PLNR: N/A N/A

JPA#: PG225283XB

SCALE: NTS

NOTIF: 117820328

DATE: 6/27/2023

PM: 35378297

SHEET: 1 OF 1 REV. 0