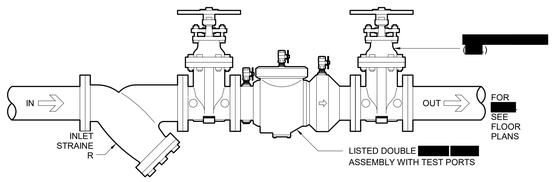

NOTES:

1. UNLESS OTHERWISE NOTED MOUNTING HEIGHT SHALL BE BETWEEN 42" ABOVE THE FINISHED FLOOR AND 12" CLEAR AROUND ALL SIDES

DOUBLE

SCALE: NOT TO SCALE

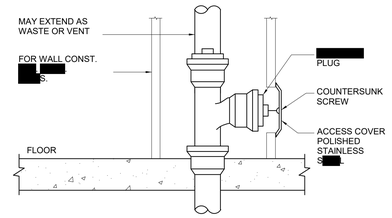

5 WALL DETAIL

SCALE: NOT TO SCALE

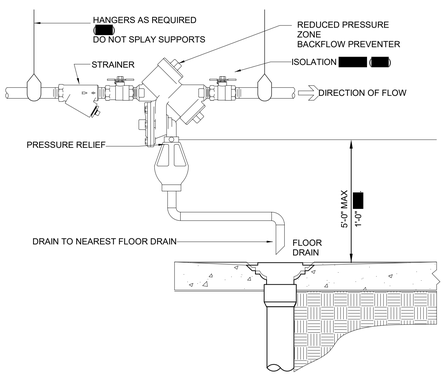

2 (UNDER 2 INCH DIAMETER) INSTALLATION DETAIL

SCALE: NOT TO SCALE

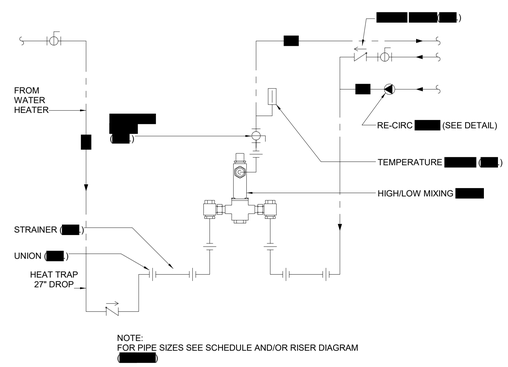

NOTE:
FOR PIPE SIZES SEE SCHEDULE AND/OR RISER DIAGRAM

6 THERMOSTATIC MIXING PIPING DETAIL

SCALE: NOT TO SCALE

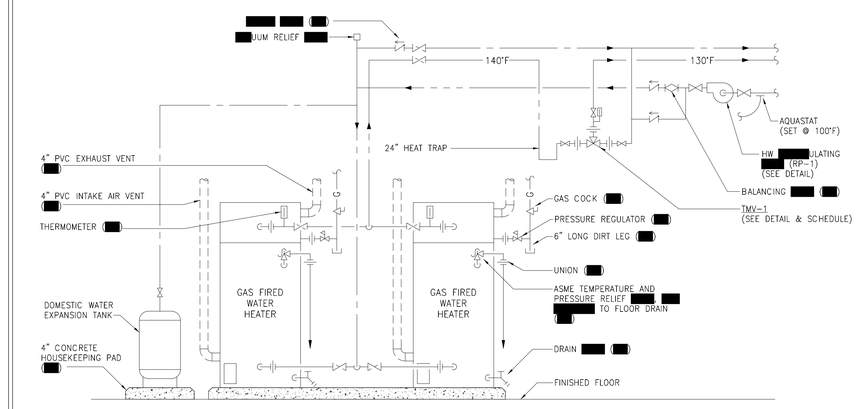

NOTES:

1. INSTALL PER MANUFACTURER'S RECOMMENDATIONS.
2. ALL S, -PURPOSE S TO BE INSTALLED IN THE HORIZONTAL POSITION ONLY.
3. IN-LINE RE-CIRC. S SHALL BE INSTALLED AT 66"
4. MAINTAIN CLEARANCES TO COMBUSTIBLES AS REQUIRED BY WATER HEATER MANUFACTURER.
5. ALL S MUST BE BALANCED TO SCHEDULED FLOW RATES.
6. VENT AND COMBUSTION AIR TER ATIONS MUST BE SEPARATED PER NFPA-54 AND MANUFACTURER'S RECOMMENDATIONS.
7. MANIFOLD WATER HEATERS PER MANUFACTURER'S RECOMMENDATIONS TO MAINTAIN A HYDRAULICALLY BALANCED SYSTEM.

8 DUPLEX GAS FIRED WATER HEATER DETAIL

SCALE: NOT TO SCALE

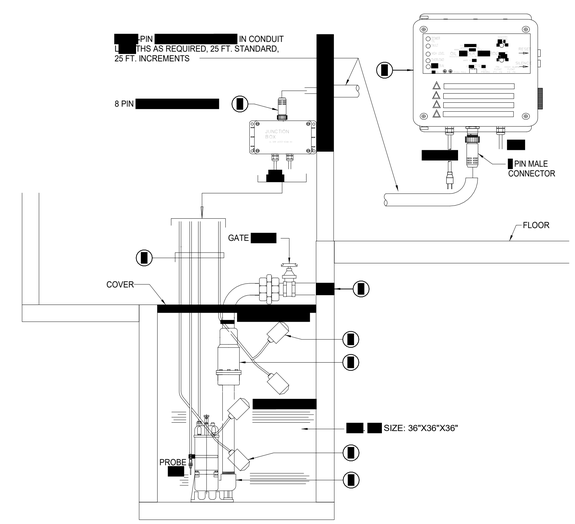

KEYED NOTES:

1. SE-100 1 HP, 460 3600 RPM, 2" DISCHARGE CONNECTION
2. STANCOR
3. STANCOR OIL DER 460V, 1 ROL SYSTEM WITH BUILT IN AUDIBLE AND VISUAL ALARM WHEN DOES NOT RUN DUE TO OIL IN OR HIGH LIQUID ALARM. PROVIDE SILENCING BUTTON FOR AUDIBLE ALARM BUILT INTO PANEL. PANEL SHALL HAVE ADDITIONAL ACT FOR A REMOTE ALARM LOCATION. JUNCTION BOX WILL BE PROVIDED WITH PIN IN L THS AS REQUIRED, 25 FT. IS STANDARD, OPTIONAL 25 FT. INCREMENTS ARE REQUIRED. LIGHTS FOR OIL SPILL, POWER, HIGH LIQUID LEVEL, RUN
4. JUNCTION BOX WILL BE PROVIDED WITH PIN CONNECTOR AND IN L THS AS REQUIRED, 25 FT. IS STANDARD, OPTIONAL 25 FT. INCREMENTS AVAILABLE
5. ALL BURIED PRESSURE DISCHARGE PIPING SHALL BE PROTECTED WITH TAPECOAT CT CORROSION PROTECTION TAPE
6. OIL DER CABLE. HIGH LIQUID ALARM CABLE & ON FLOAT CABLE.
7. HIGH LIQUID ALARM FLOAT WITH CLAMP DEVICE TO MOUNT TO DISCHARGE PIPING.
8. ON FLOAT.

9 ELEVATOR SUMP DETAIL

SCALE: NOT TO SCALE

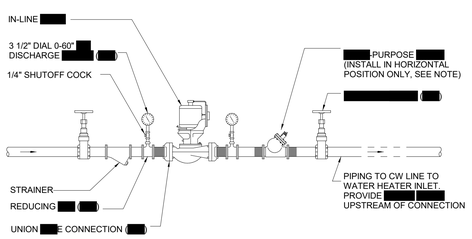

NOTES:

1. RACTOR SHALL INSTALL AQUASTAT IN RETURN LINE FOR
2. WHERE RE-CIRC. PIPING ON DISCHARGE IS LESS THAN 1-1/2", RACTOR SHALL INSTALL SEPARATE AND BALANCE IN LIEU OF PURPOSE

3 IN-LINE ULATING DETAIL

SCALE: NOT TO SCALE

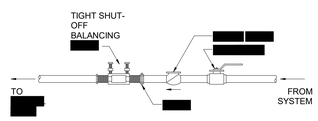

NOTES:

1. INSURE PROPER ACCESS IS PROVIDED TO AND THAT CAN BE METERED. DO NOT ORIENT TAPS DOWNWARD.
2. PROVIDE ACCESS PANEL IN HARD CEILING LOCATIONS.
3. PROVIDE HANDLE WHERE LIMITED ACCESS.

7 HOT WATER CIRCULATION BALANCING DETAIL

SCALE: NOT TO SCALE

PARTS LIST		
SYM	QTY	PART
1	2	EBARA MODEL 3U OR GOULDS MODEL SH
2	1	CAP 304SS, 4"
		TIGERFLOW 871W, 2-1/2"
		TIGERFLOW L-ZH-L, 2-1/2"
		PANEL STAND, PS
6	2	VFD (NOT SHOWN)
7	1	ROLLER, TIGERFLOW MARK V, INTERNAL DRIVES

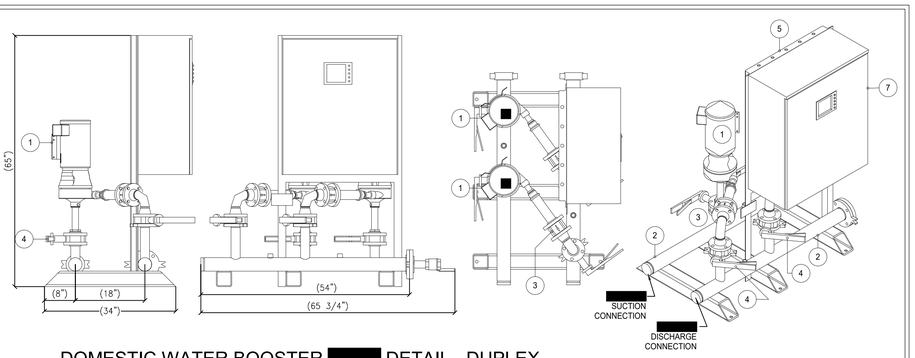

4 DOMESTIC WATER BOOSTER DETAIL - DUPLEX

SCALE: NOT TO SCALE

REVISION	DESCRIPTION	BY	DATE

TEXT

FOR OFFICIAL USE ONLY

NIST – MEDIUM OFFICE

PLUMBING DETAILS

P302

SH. NO. ___ OF ___ P302

APPROVED BY	DATE	SPONSOR	DATE	MAINTENANCE OFF.	DATE	SHED – NIST FIRE MARSHAL/AHJ	FACILITIES R. OFF.	DATE	VAY	DATE	AA	DRAWN BY	DATE	08/15/2022	Project Number	PROJECT/ W.O. #