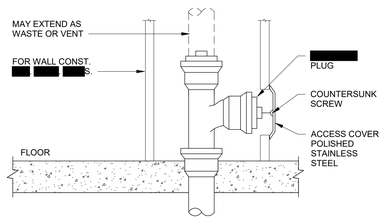

6 WALL [redacted]

SCALE: NOT TO SCALE

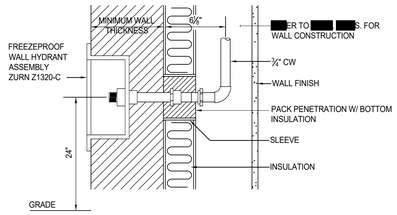

4 FREEZEPROOF WALL HYDRANT

SCALE: NOT TO SCALE



[redacted]

SCALE: NOT TO SCALE

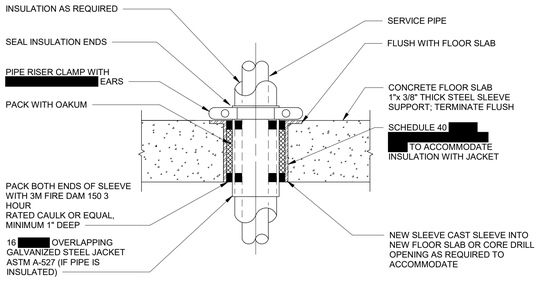

7 PIPE THRU FLOOR PENETRATION

SCALE: NOT TO SCALE

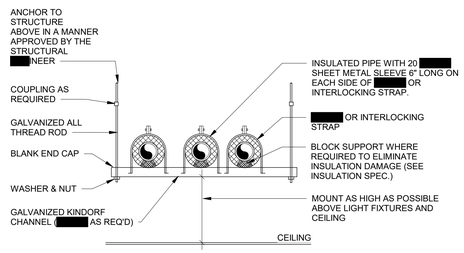

NOTE:
1. ALL PIPING SUPPORT SYSTEM COMPONENTS SHALL HAVE A NON-CORROSIVE METAL FINISH, GALV-KROM OR EQUAL
2. COORDINATE CROSS PIPING WITH MECHANICAL PIPING ROUTED IN CORRIDORS & SPRINKLER PIPING MAINS CROSSING IN CORRIDORS.

5 TRAPEZE PIPING SUPPORT

SCALE: NOT TO SCALE

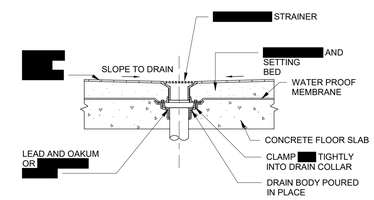

2 [redacted]

SCALE: NOT TO SCALE

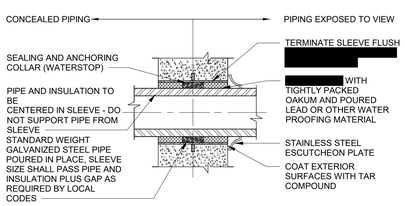

8 SLEEVE THRU EXTERIOR WALL

SCALE: NOT TO SCALE

NOTES:
1. SET DISCHARGE TEMPERATURES OF THE WATER HEATERS AT 140°F.
2. WATER HEATER COMBUSTION AIR AND VENT PIPES SHALL BE SCHEDULE 40 [redacted] TERMINATE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. PROVIDE TERMINATION KITS BY THE MANUFACTURER. FLASH THE ROOF PENETRATION. PROVIDE FIRE STOPPING AT PENETRATION OF ALL FIRE RATED ASSEMBLIES.
3. [redacted] A SHOP DRAWING OF THE PROPOSED ROUTING AND L[redacted]THS OF VENT AND COMBUSTION AIR FOR THE HIGH EFFICIENCY WATER HEATERS. FINAL PIPE SIZING SHALL BE BASED ON THE TOTAL DEVELOPED L[redacted]TH OF PIPES.
4. AFTER THE INSTALLATION OF THE WATER HEATERS, PIPING AND COMPLETION OF THE PROJECT, CONTRACTOR SHALL BALANCE THE HOT WATER FLOW THROUGH THE WATER HEATERS AND ENSURE EQUAL FLOW THROUGH ALL WATER HEATERS. SUBMIT THE TEST AND BALANCE REPORT FOR REVIEW BY THE OWNER'S REPRESENTATIVE.
5. UTILIZE PIPE MANIFOLDS FOR EQUAL FLOW OF WATER THROUGH WATER HEATERS OR PROVIDE BALANCING VALVES WITH [redacted] AT EACH WATER HEATER.

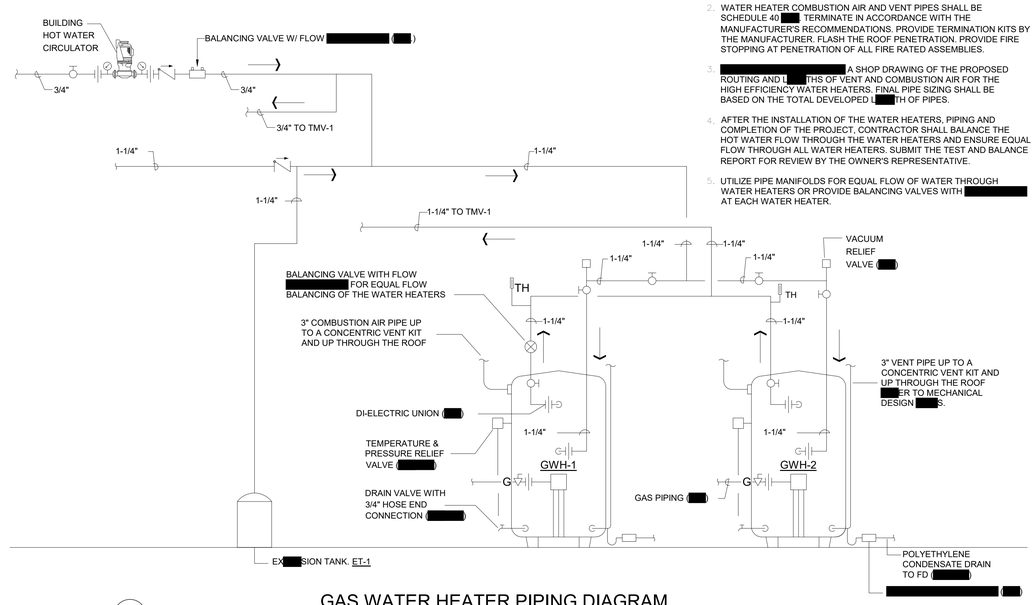

3 GAS WATER HEATER PIPING DIAGRAM

SCALE: NOT TO SCALE

REVISION	DESCRIPTION	BY	DATE

[redacted]TECT

[redacted]

NIST

FOR OFFICIAL USE ONLY

[redacted]

NIST - STAND ALONE RETAIL

PLUMBING DETAILS

P301

SH. NO. ___ OF ___ [redacted]. P301

APPROVED BY	DATE	SPONSOR	DATE	MAINTENANCE [redacted] OFF. [redacted]	[redacted]	[redacted]	DATE	SHED - NIST FIRE MARSHAL/AHJ [redacted]	FACILITIES [redacted]R. OFF.	DATE	VAY [redacted]	DATE	AA DRAWN BY	DATE	08/15/2022 Project Number PROJECT/ W.O. #