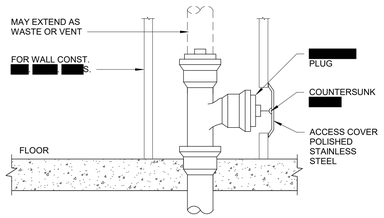

7 WALL [redacted]

SCALE: NOT TO SCALE

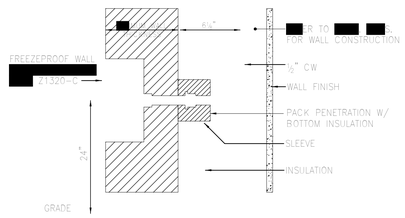

4 **FREEZEPROOF WALL HYDRANT DETAIL**

SCALE: NOT TO SCALE



[redacted]

SCALE: NOT TO SCALE

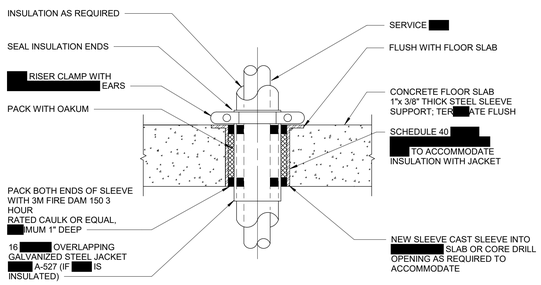

8 [redacted] THRU FLOOR PENETRATION

SCALE: NOT TO SCALE

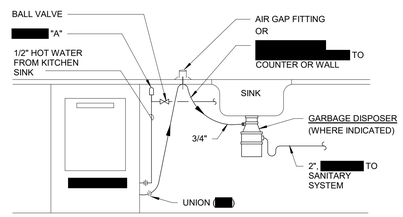

5 RESIDENTIAL DISHWASHER PIPING

SCALE: NOT TO SCALE

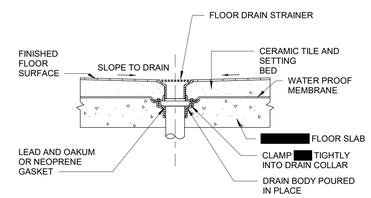

2 FLOOR DRAIN

SCALE: NOT TO SCALE

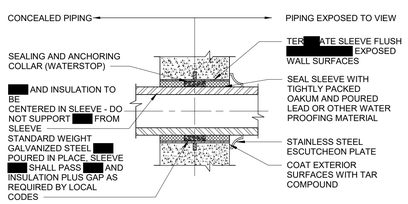

9 SLEEVE THRU EXTERIOR WALL

SCALE: NOT TO SCALE

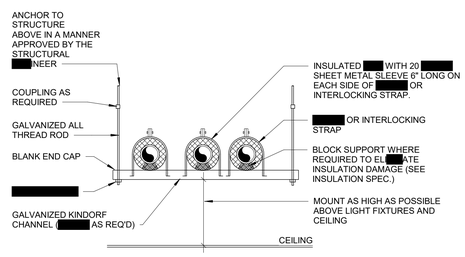

NOTE:
1. ALL PIPING SUPPORT SYSTEM COMPONENTS SHALL HAVE A NON-CORROSIVE METAL FINISH, GALV-KROM OR EQUAL
2. COORDINATE CROSS PIPING WITH MECHANICAL PIPING ROUTED IN CORRIDORS & [redacted] IN CORRIDORS.

6 TRAPEZE PIPING SUPPORT

SCALE: NOT TO SCALE

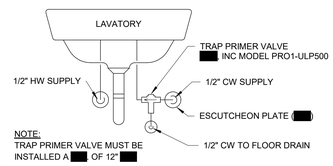

NOTE:
TRAP PRIMER VALVE MUST BE INSTALLED A [redacted] OF 12" [redacted]

3 BELOW LAVATORY TRAP PRIMER

SCALE: NOT TO SCALE

[redacted]	DESCRIPTION	BY	DATE

[redacted]TECT

MEP. [redacted]

NIST

FOR OFFICIAL USE ONLY

[redacted]

NIST – SINGLE FAMILY DETACHED HOME MULTI STORY

PLUMBING DETAILS

P301

SH. NO. ___ OF ___ [redacted]. P301

APPROVED BY	DATE	SPONSOR	DATE	MAINTENANCE [redacted] OFF.	DATE	[redacted]	[redacted]	[redacted]	DATE	SHED – NIST FIRE MARSHAL/AHJ	[redacted]	FACILITIES [redacted]R. OFF.	DATE	VAY PROJECT LEADER	DATE	AA DRAWN BY	DATE	08/15/2022 PROJECT/ W.O. #	Project Number