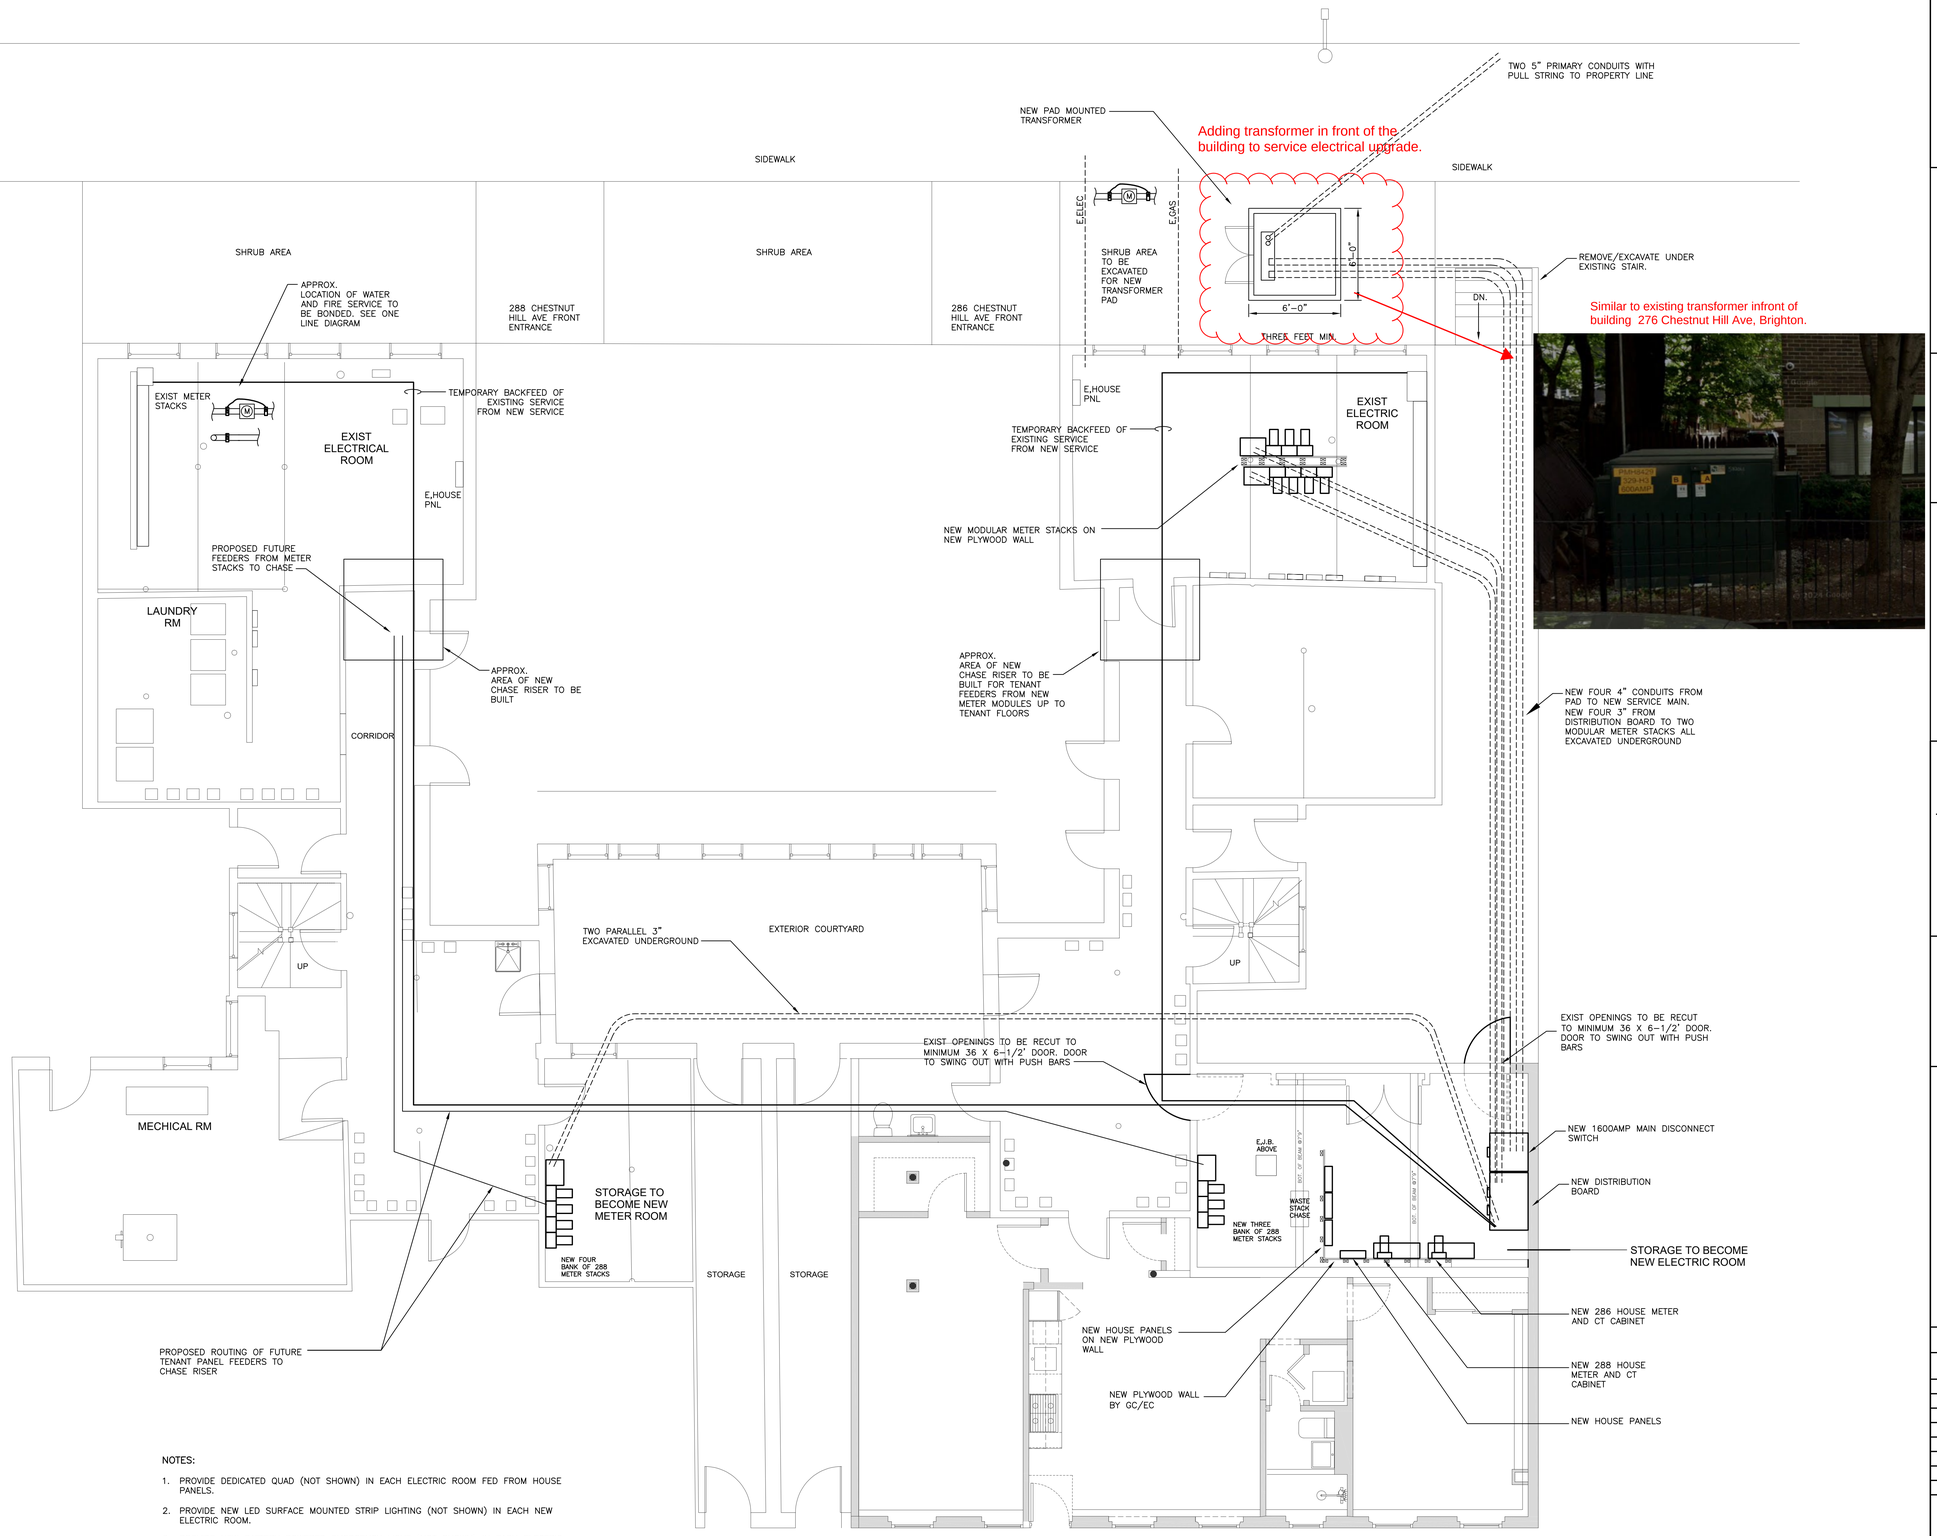

NOTES:

1. PROVIDE DEDICATED QUAD (NOT SHOWN) IN EACH ELECTRIC ROOM FED FROM HOUSE PANELS.
2. PROVIDE NEW LED SURFACE MOUNTED STRIP LIGHTING (NOT SHOWN) IN EACH NEW ELECTRIC ROOM.
3. PROVIDE NEW BATTERY POWERED EMERGENCY LIGHT (NOT SHOWN) IN EACH ELECTRIC ROOM.
4. PROVIDE NEW SMOKE DETECTOR (NOT SHOWN) IN EACH ELECTRIC ROOM.

286-288 Chestnut Hill Avenue

Boston, MA

Commercial Construction Consulting. Inc.
313 Congress Street
Boston, MA 02210
617.330.9390
617.330.9383 fax
[redacted]
Consulting Engineers/Construction Managers

Existing Conditions Surveys Inc.
398 Columbus Avenue #334
Boston, [redacted]
T 617.247.9161
F 617.249.0746
E [redacted]
www.existingconditions.com

Revision Schedule

Revision Number	Revision Description	Revision Date

ELECTRICAL BASEMENT PLAN

Date: 06/27/2022
Scale: 1/4" = 1'-0"
[redacted] By: SB
Checked By: BW
[redacted]

Properties/286-288 Chestnut Hill Ave Brighton\DESIGN FOLDERS\06 Electrical Plans\[redacted] ELECTRICAL BASEMENT POWER PLAN.dwg [redacted] April 18, 2024 - 9:21am Sean Blair