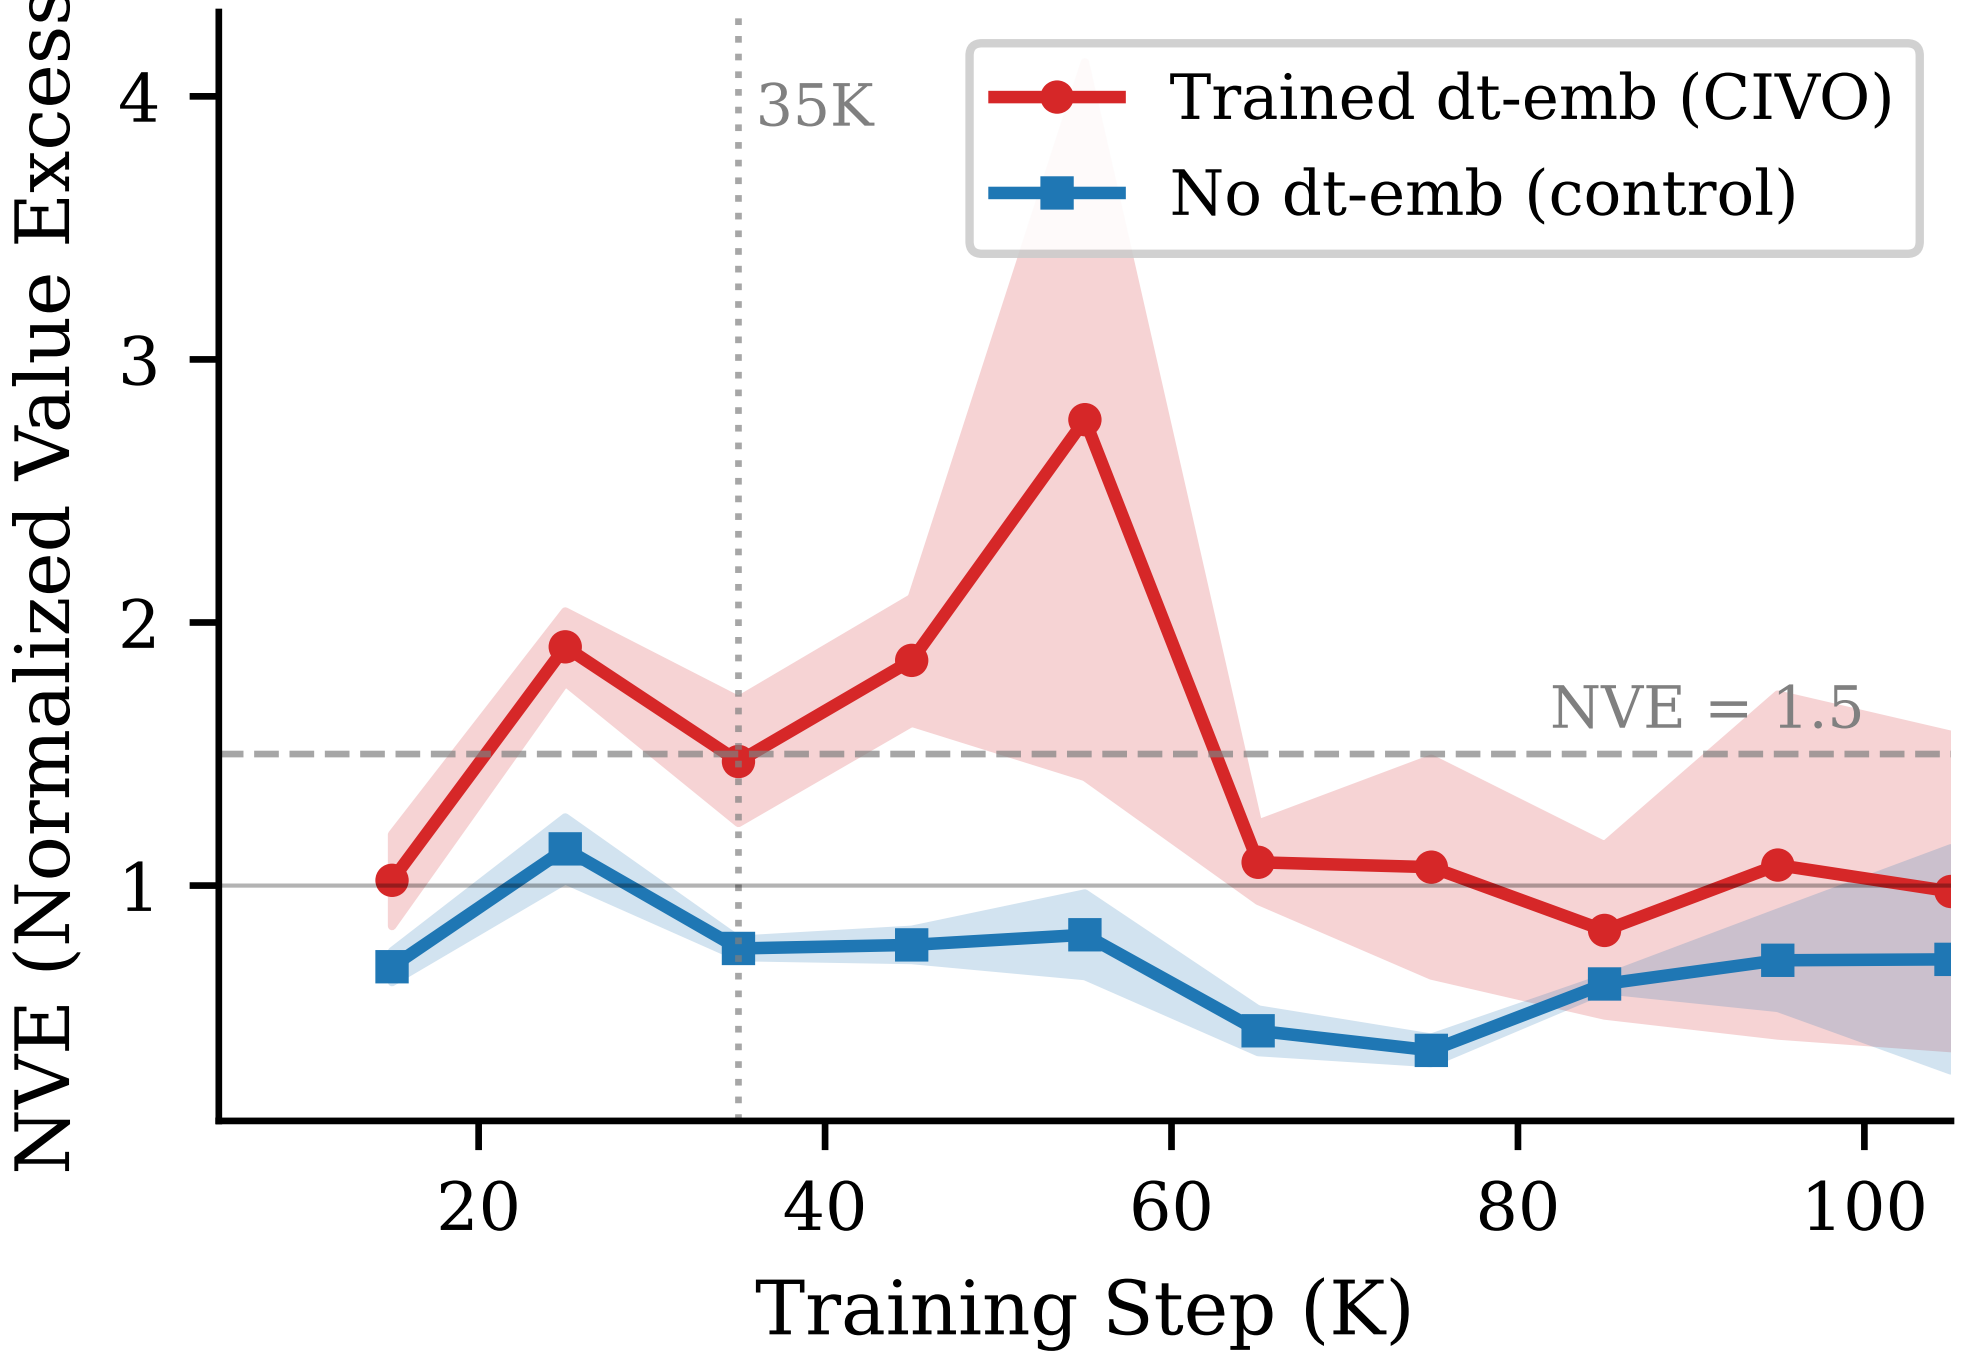
Trained dt-emb (CIVO)
No dt-emb (control)
35K
NVE = 1.5
NVE (Normalized Value Excess)
Training Step (K)
1
2
3
4
20
40
60
80
100