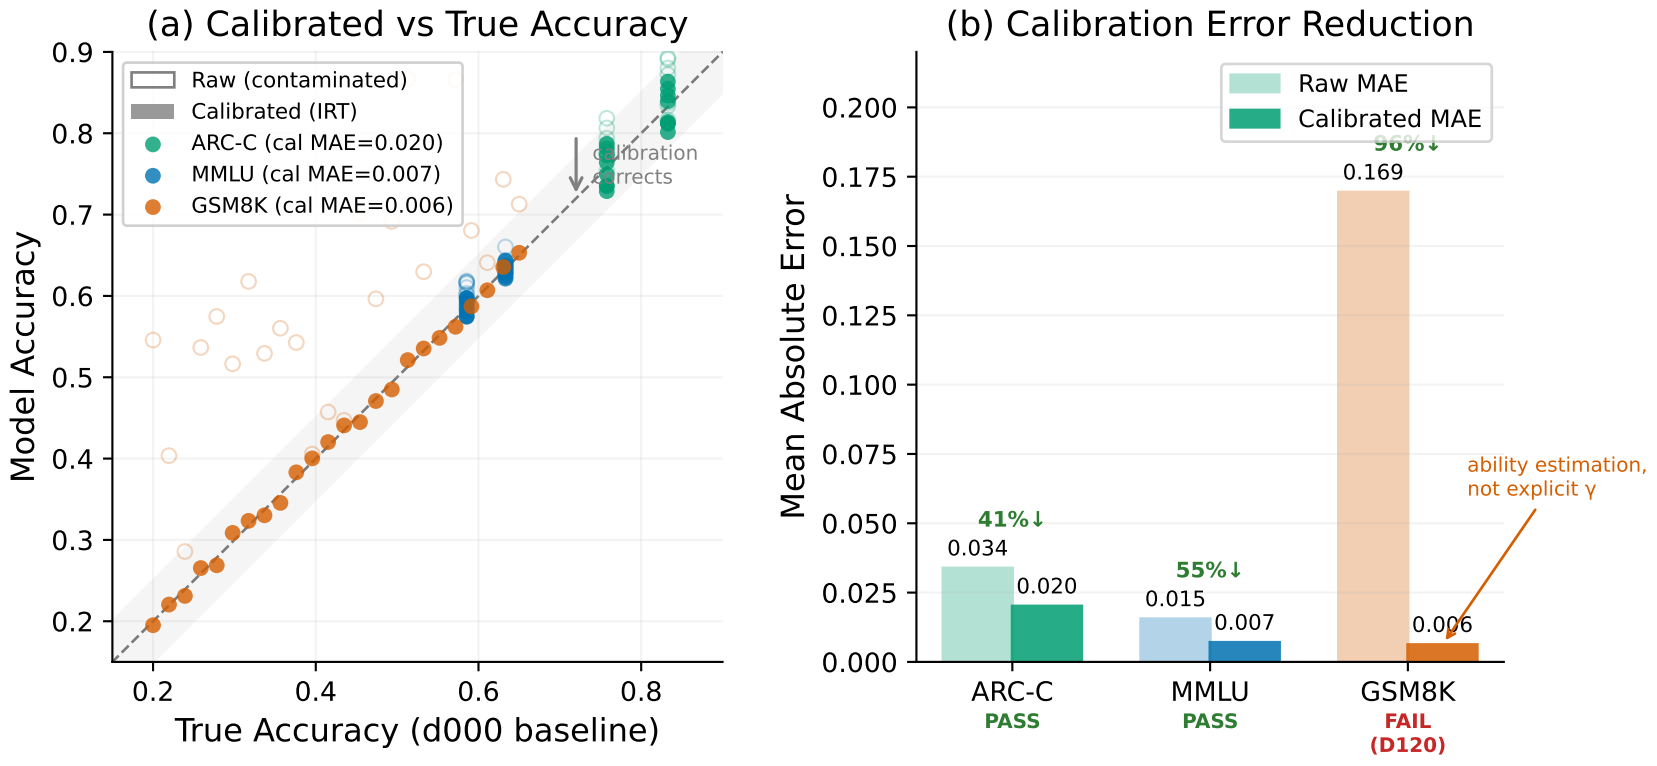
(a) Calibrated vs True Accuracy
Raw (contaminated)
Calibrated (IRT)
ARC-C (cal MAE=0.020)
MMLU (cal MAE=0.007)
GSM8K (cal MAE=0.006)
calibration corrects
Model Accuracy
True Accuracy (d000 baseline)
0.2
0.3
0.4
0.5
0.6
0.7
0.8
0.9
(b) Calibration Error Reduction
Raw MAE
Calibrated MAE
Mean Absolute Error
0.000
0.025
0.050
0.075
0.100
0.125
0.150
0.175
0.200
41%↓
0.034
0.020
55%↓
0.015
0.007
98%↓
0.169
0.006
ability estimation,
not explicit γ
ARC-C
PASS
MMLU
PASS
GSM8K
FAIL
(D120)