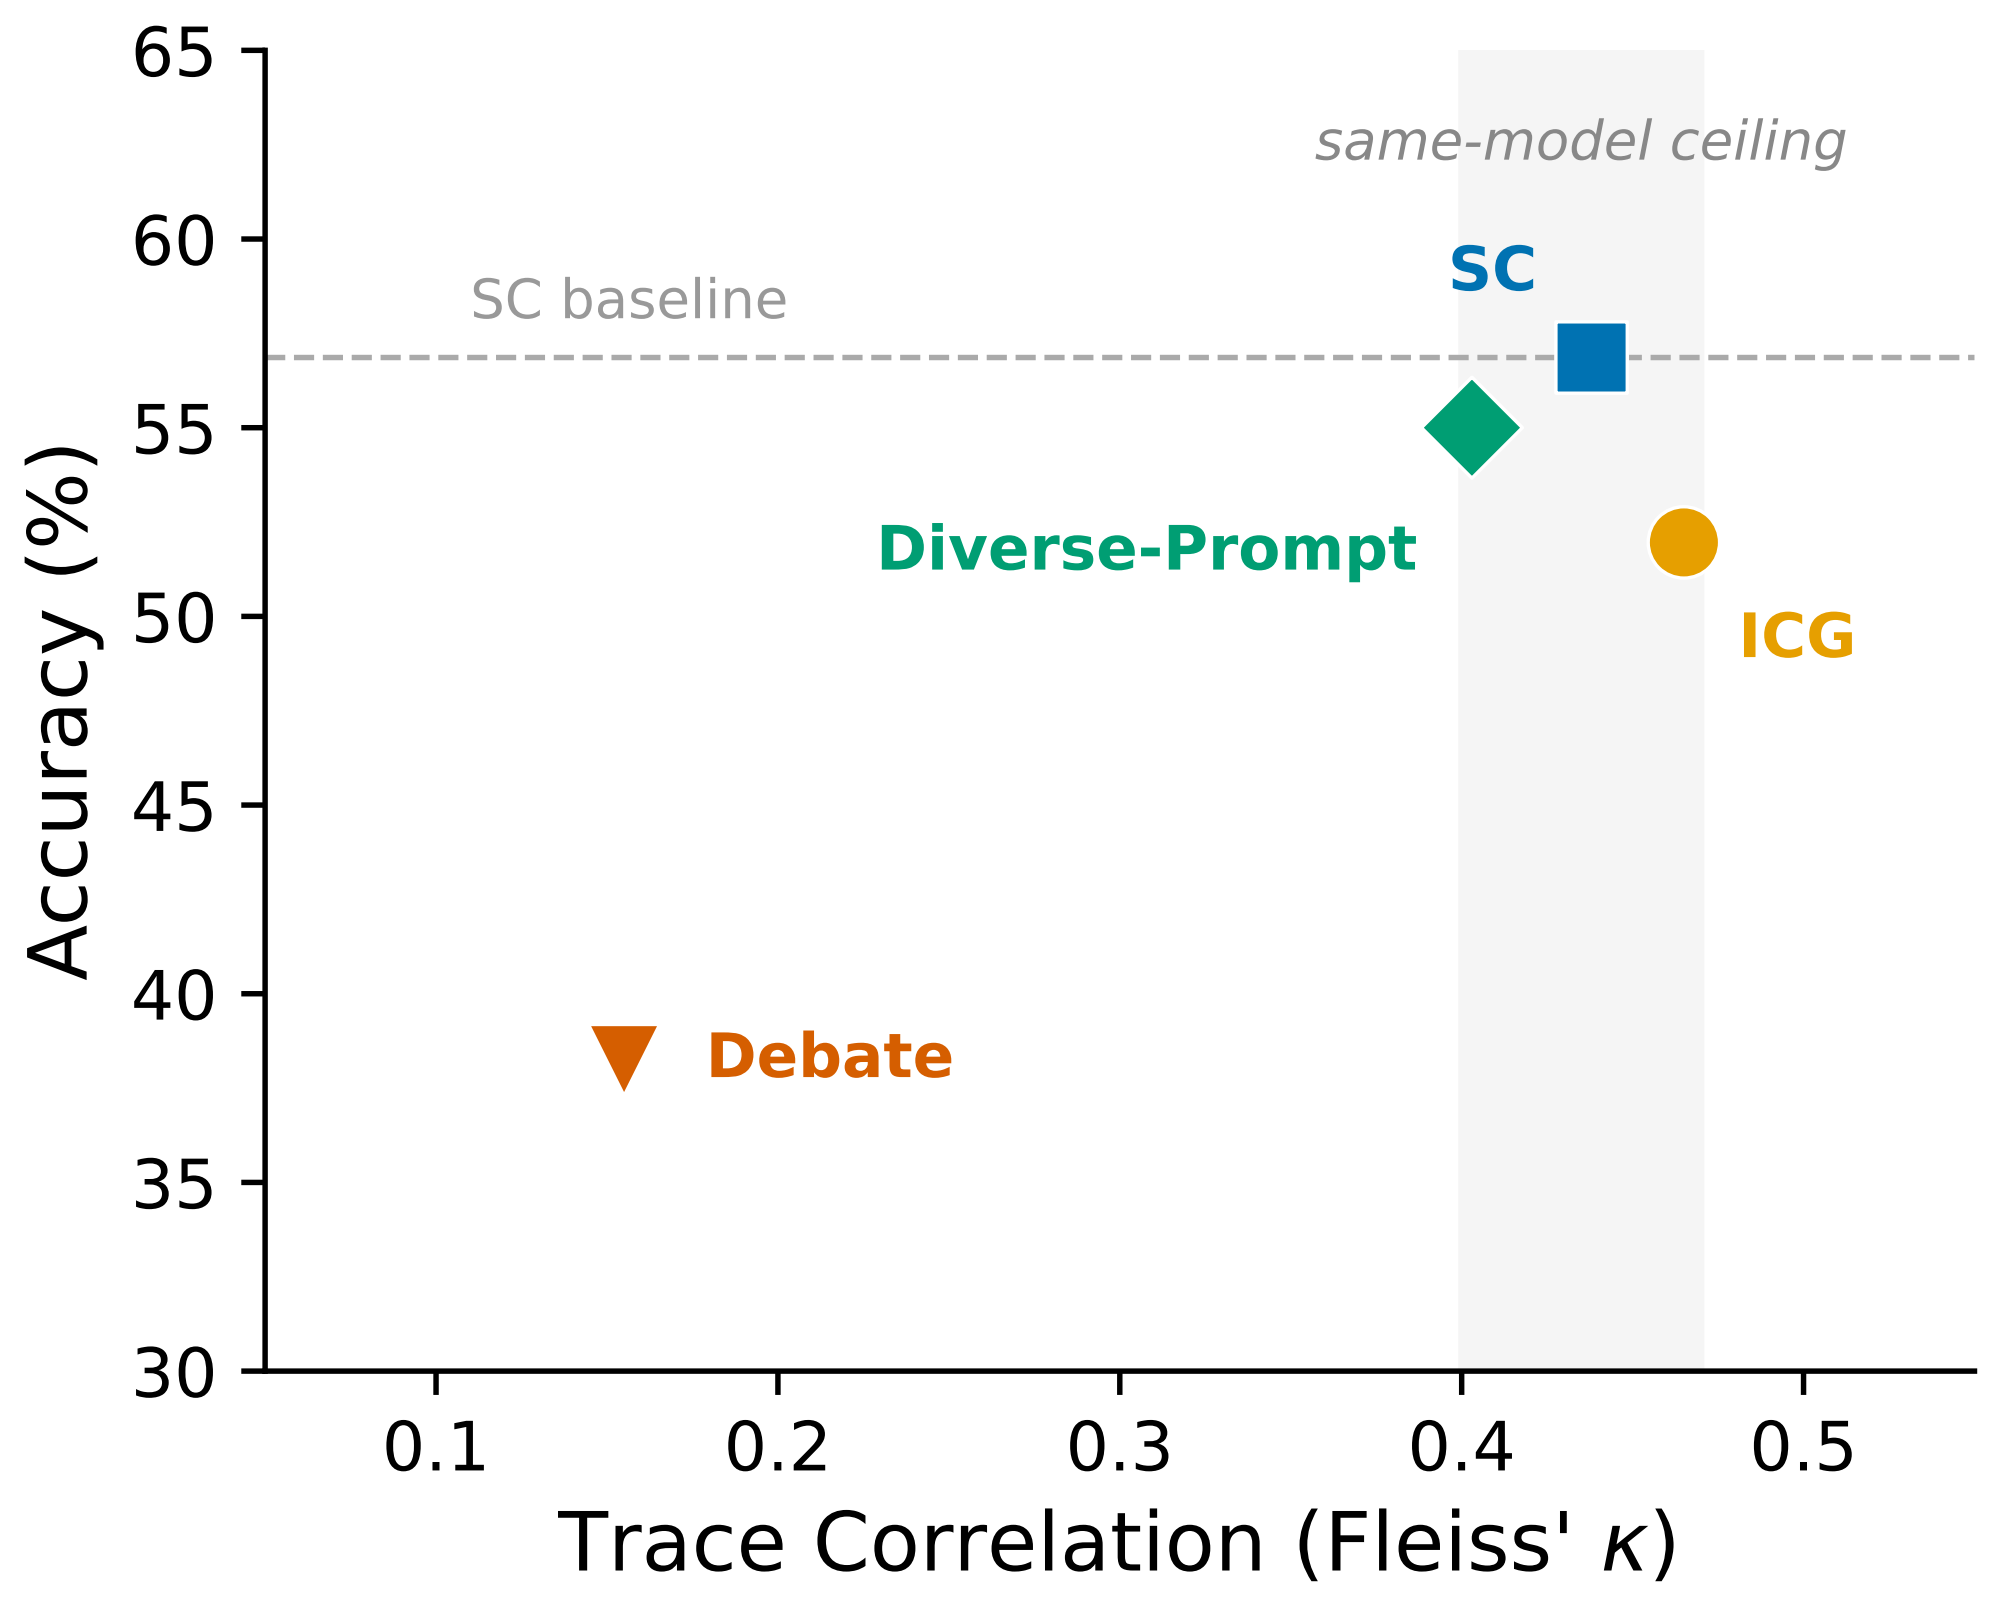
65
60
55
50
45
40
35
30
Accuracy (%)
same-model ceiling
SC baseline
SC
Diverse-Prompt
ICG
Debate
0.1
0.2
0.3
0.4
0.5
Trace Correlation (Fleiss' κ)