Protocol 1 / Cardiac timing and behavioral steepness

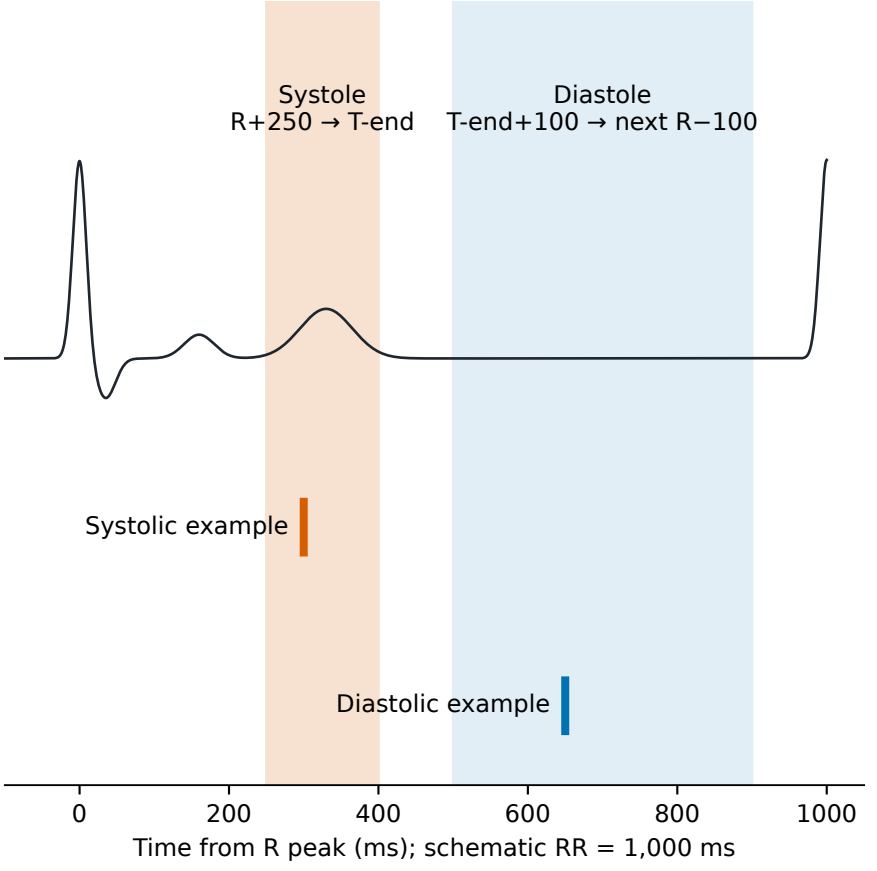

Individual T-wave end determines timing.
Fixed values above illustrate T-end=400 ms only.

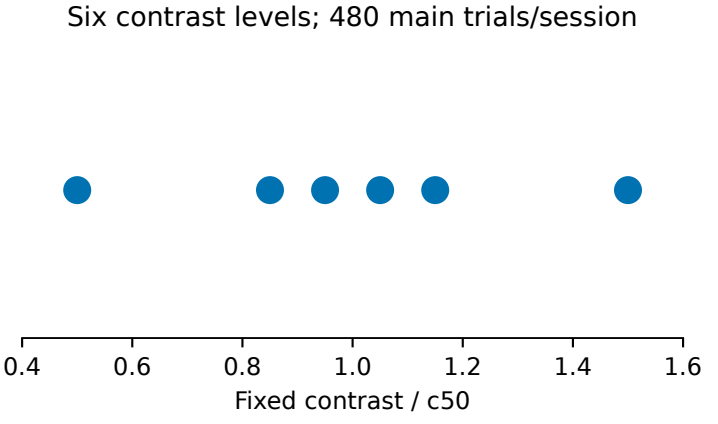

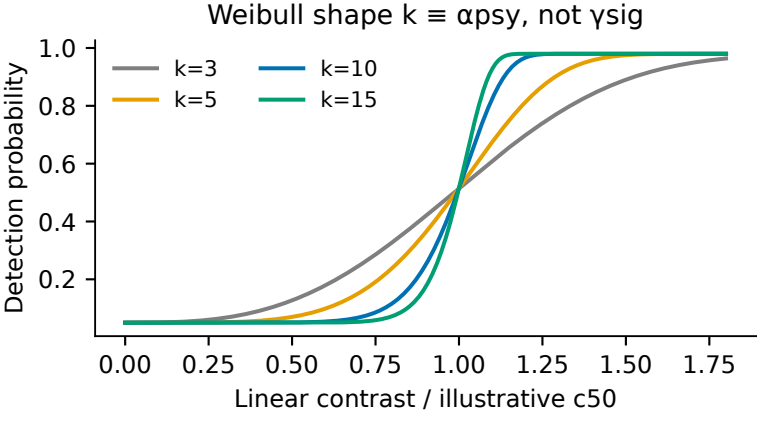

Protocol 1, specification 1.1.0. No observed outcomes. Curves illustrate shape only; Pred 1.E also requires interval and comparator evidence. QUEST count unresolved.