Protocol 2 / Separate calibration, simulation and human tests

1 · Independent calibration

Published CP-3a data: N≥60
Freeze parameter and observation manifest

2 · Simulation

7 architectures × 1,000 seeds per condition
500 trials/environment; seed-level inference

3 · Human model comparison

Independent IGT test cohort: N=80
ΔBIC≥10 against each alternative; CV evidence

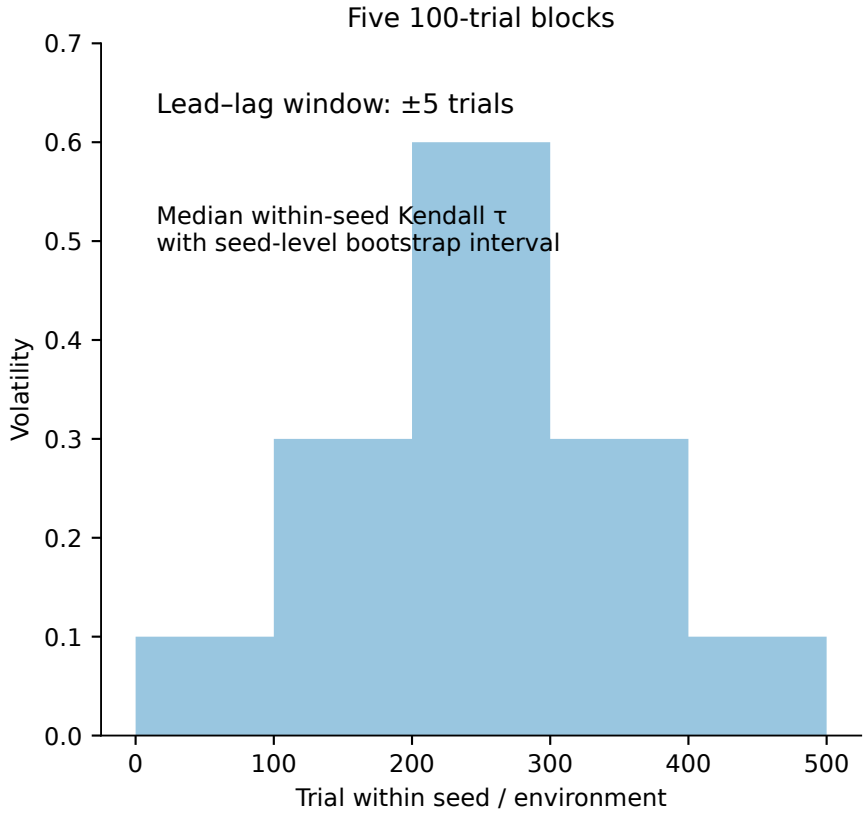

Protocol 2, specification 1.1.0. No observed outcomes. Exploratory 2.F / 2.G carry no independent empirical confirmation.