


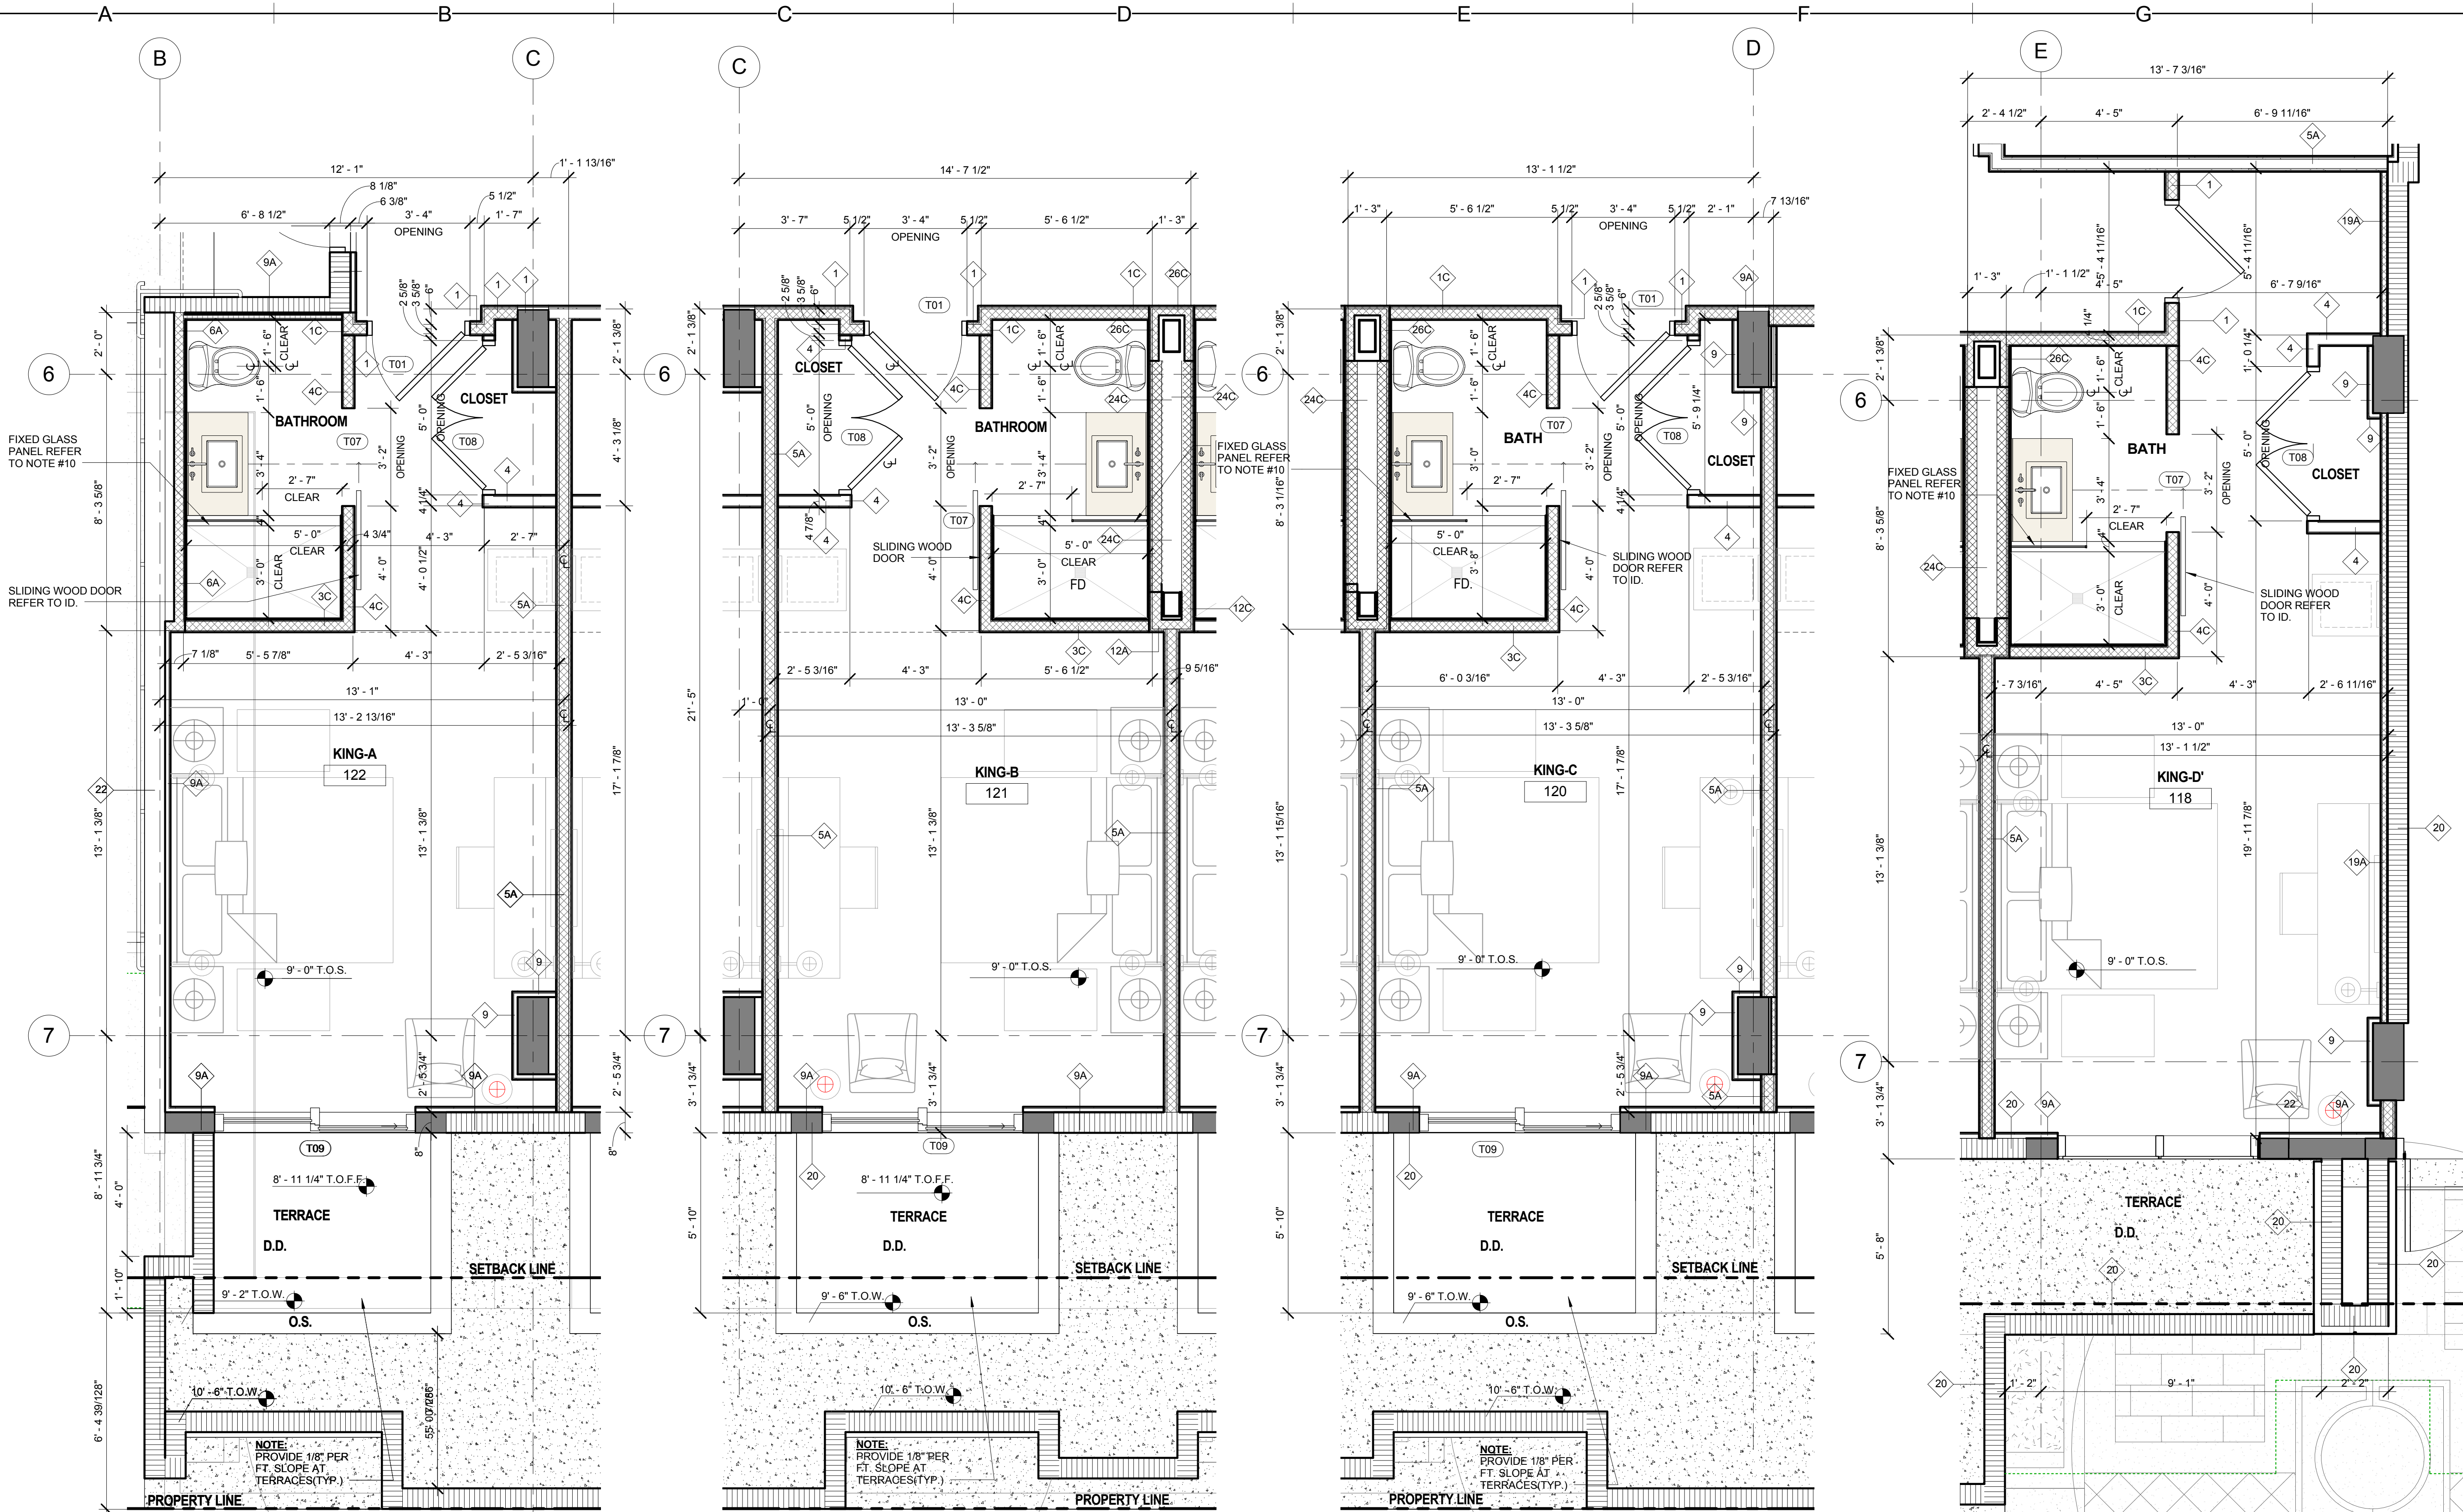

1 KING-A
A5.00
KING UNITS ROOM #: 122
REFER TO 1/8" SCALE PLAN SHEET A4.02 -A4.05 FOR
BALCONY AND SLIDING GLASS DOOR LAYOUT.)

2 KING-B
A5.00
KING UNITS ROOM #: 119,121 (SHOWN.)
REFER TO 1/8" SCALE PLAN SHEET A4.02 -A4.05 FOR
BALCONY AND SLIDING GLASS DOOR LAYOUT.)

3 KING-C
A5.00
KING UNITS ROOM #: 120
REFER TO 1/8" SCALE PLAN SHEET A4.02 -A4.05 FOR
BALCONY AND SLIDING GLASS DOOR LAYOUT.)


5 KING-D'
A5.00
KING UNITS ROOM #: 118
REFER TO 1/8" SCALE PLAN SHEET A4.02 -A4.05 FOR
BALCONY AND SLIDING GLASS DOOR LAYOUT.)

HOTEL UNIT GENERAL NOTES

- ALL DIMENSIONS TO STUD,CENTER OR FURRING FACE, (ACTUAL DIMENSIONS) CONTRACTOR TO CONFIRM WITH THE ARCHITECT ANY DISCREPANCY.
- FOR WALL TYPE DETAILS REFER TO A12.00 SHEET SERIES.
- PARTITION FRAMING TO BE 20 GA. 3-5/8" METAL STUDS (MIN.) AT 16" O.C. AT ALL HUNG ITEMS AND WALLS TO RECEIVE TILE.
- CONTRACTOR TO COORDINATE SHEETS WITH MECHANICAL, PLUMBING, AND ELECTRICAL CONTRACTORS.
- ALL SLOPES TO DRAINS SHALL BE 1/8" FT. (MIN.); 2% MAX. AT ALL AREAS OTHER THAN SHOWERS.
- ALL SHOWER WALLS TO HAVE 5/8" GLASS MAT FACED GYPSUM TILE BACKER BOARD MOUNTED ON THE STUD OR FURRING CHANNELS.
- INSTALL SELF-BONDING SOUND CONTROL MEMBRANE TO ALL CONCRETE FLOORS BELOW TILE OR WOOD, INCLUDING FLOORS OTHER THAN SHOWERS. PROFLEX 90 MSC" AS MANUFACTURED BY PROFLEX PRODUCTS, INC., OR ACCEPTABLE EQUIVALENT.
- ALL UNITS SHALL MAINTAIN AN ACCESSIBLE ROUTE WITH MINIMUM WIDTH OF 36".
- REFER TO INTERIOR DESIGN DRAWINGS FOR REFLECTED CEILING PLANS, FURNITURE LAYOUTS, MILLWORK DETAILS, HARDWARE-FIXTURE SELECTIONS & FINISHES.
- ALL SHOWER GLASS DOORS & GLASS PANELS ADJACENT TO DOORS MUST BE SAFETY GLAZING IN COMPLIANCE W/ FBC 2406.4 & TB 2406.2(1) AND 2406.2 (2) AS PER FBC SECTION 2406.4 PROVIDE SAFETY GLAZING TESTED IN ACCORDANCE WITH CPSC 16 CFR 1201. GLAZING IN DOORS AND ENCLOSURES FOR HOT TUBS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHTUBS AND SHOWERS WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE A STANDING SURFACE. GLAZING 9 SF OR LESS SHALL BE CATEGORY CLASS I. GLAZING 9 SF OR MORE SHALL BE CATEGORY CLASS II. GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE NEAREST EXPOSED EDGE OF THE GLAZING IS WITHIN A 24-INCH ARC OF EITHER VERTICAL EDGE OF THE DOOR IN A CLOSED POSITION AND WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE THE WALKING SURFACE. GLAZING 9 SF OR LESS SHALL BE CATEGORY CLASS B GLAZING 9 SF OR MORE SHALL BE CATEGORY CLASS A
- INSTALL "VULKEM 350 / 350 NF R" (2ND COAT SANDED) BY TREMCO, OR ACCEPTED EQUIVALENT FLUID APPLIED WATERPROOFING AT ALL TOILET ROOMS UNDER SOUND CONTROL MEMBRANE (OTHER THAN SHOWERS).
- SOUND TRANSMISSION PER FBC 1207:
 - AIR-BORNE SOUND. WALLS, PARTITIONS AND FLOOR/CEILING ASSEMBLIES SEPARATING DWELLING UNITS FROM EACH OTHER OF FROM PUBLIC OR SERVICE AREAS SHALL HAVE A SOUND TRANSMISSION CLASS (STC) OF NOT LESS THAN 50 (45 IF FIELD TESTED) FOR AIR-BORNE NOISE WHEN TESTED IN ACCORDANCE WITH ASTM E 90. PENETRATIONS OR OPENINGS IN CONSTRUCTION ASSEMBLIES FOR PIPING, ELECTRICAL DEVICES, RECESSED CABINETS, BATHTUBS, SOFFITS, OR HEATING, VENTILATING OR EXHAUST DUCTS SHALL BE SEALED, LINED, INSULATED OR OTHERWISE TREATED TO MAINTAIN THE REQ. RATINGS. THIS REQUIREMENTS SHALL NOT APPLY TO DWELLING UNITS ENTRANCE DOORS; HOWEVER, SUCH DOORS SHALL BE TIGHT FITTING TO THE FRAME AND SILL.
 - STRUCTURE-BORNE SOUND. FLOOR/CEILING ASSEMBLIES BETWEEN A DWELLING UNIT AND A PUBLIC OR SERVICE AREA WITHIN THE STRUCTURES SHALL HAVE AN IMPACT INSULATION CLASS (IIC) RATING OF NOT LESS THAN 50 (45 IF FIELD TESTED) WHEN TESTED IN ACCORDANCE WITH ASTM E 492.
- ALL UNIT BARN DOORS TO BE SIZED (FIELD VERIFY) TO ALIGN WITH CENTER LINE OF BATHROOM VANITY.

#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/15/15
3	CMB Bldg. Dept. Comments	03/25/15
5	Revisions	06-12-15
6	Revision 6	08-14-15

C:\Users\mhiciano\Documents\12064-ANGLERS_HOTEL_mhiciano.rvt
4/20/2016 4:28:59 PM

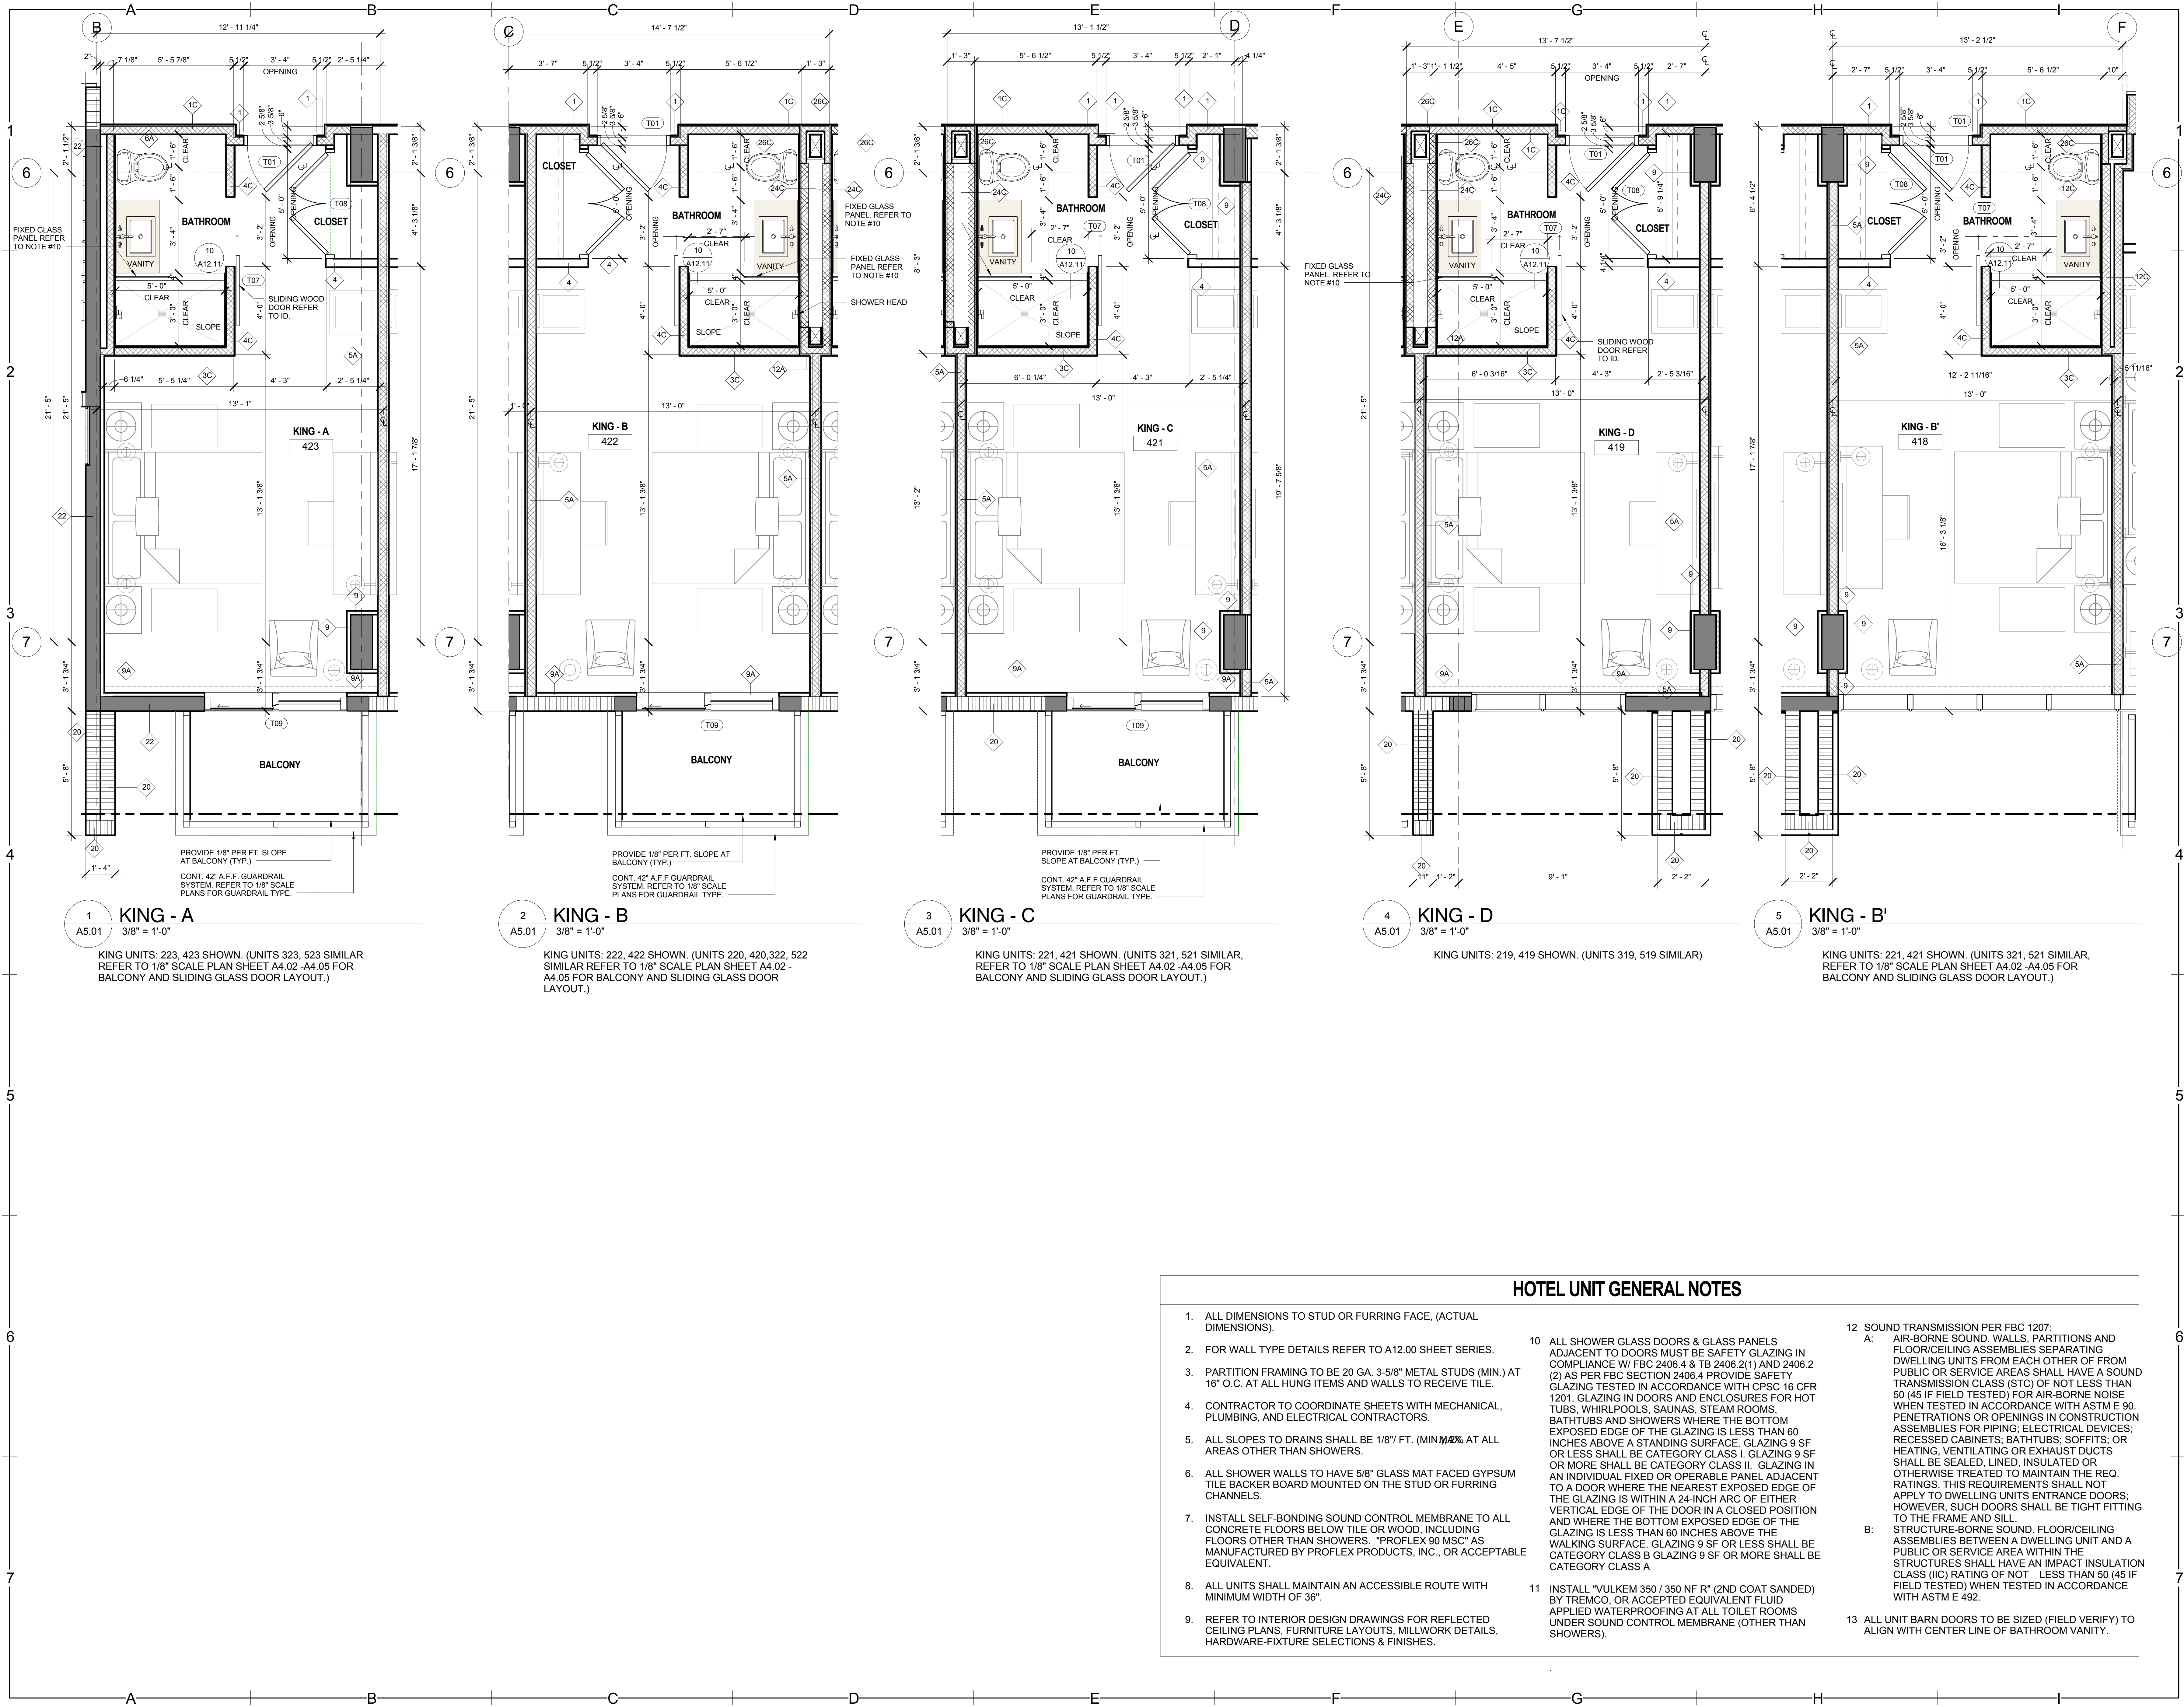


HOTEL UNIT GENERAL NOTES

- ALL DIMENSIONS TO STUD OR FURRING FACE, (ACTUAL DIMENSIONS).
- FOR WALL TYPE DETAILS REFER TO A12.00 SHEET SERIES.
- PARTITION FRAMING TO BE 20 GA. 3-5/8" METAL STUDS (MIN.) AT 16" O.C. AT ALL HUNG ITEMS AND WALLS TO RECEIVE TILE.
- CONTRACTOR TO COORDINATE SHEETS WITH MECHANICAL, PLUMBING, AND ELECTRICAL CONTRACTORS.
- ALL SLOPES TO DRAINS SHALL BE 1/8"/FT. (MIN) ~~1/20"~~ AT ALL AREAS OTHER THAN SHOWERS.
- ALL SHOWER WALLS TO HAVE 5/8" GLASS MAT FACED GYPSUM TILE BACKER BOARD MOUNTED ON THE STUD OR FURRING CHANNELS.
- INSTALL SELF-BONDING SOUND CONTROL MEMBRANE TO ALL CONCRETE FLOORS BELOW TILE OR WOOD, INCLUDING FLOORS OTHER THAN SHOWERS. "PROFLEX 90 MSC" AS MANUFACTURED BY PROFLEX PRODUCTS, INC., OR ACCEPTABLE EQUIVALENT.
- ALL UNITS SHALL MAINTAIN AN ACCESSIBLE ROUTE WITH MINIMUM WIDTH OF 36".
- REFER TO INTERIOR DESIGN DRAWINGS FOR REFLECTED CEILING PLANS, FURNITURE LAYOUTS, MILLWORK DETAILS, HARDWARE-FIXTURE SELECTIONS & FINISHES.
- ALL SHOWER GLASS DOORS & GLASS PANELS ADJACENT TO DOORS MUST BE SAFETY GLAZING IN COMPLIANCE W/ FBC 2406.4 & TB 2406.2(1) AND 2406.2 (2) AS PER FBC SECTION 2406.4 PROVIDE SAFETY GLAZING TESTED IN ACCORDANCE WITH CPSC 16 CFR 1201. GLAZING IN DOORS AND ENCLOSURES FOR HOT TUBS, WHIRLPOLDS, SAUNAS, STEAM ROOMS, BATHTUBS AND SHOWERS WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE A STANDING SURFACE. GLAZING 9 SF OR LESS SHALL BE CATEGORY CLASS I. GLAZING 9 SF OR MORE SHALL BE CATEGORY CLASS II. GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE NEAREST EXPOSED EDGE OF THE GLAZING IS WITHIN A 24-INCH ARC OF EITHER VERTICAL EDGE OF THE DOOR IN A CLOSED POSITION AND WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE THE WALKING SURFACE. GLAZING 9 SF OR LESS SHALL BE CATEGORY CLASS B GLAZING 9 SF OR MORE SHALL BE CATEGORY CLASS A
- INSTALL "VULKEM 350 / 350 NF R" (2ND COAT SANDED) BY TREMCO, OR ACCEPTED EQUIVALENT FLUID APPLIED WATERPROOFING AT ALL TOILET ROOMS UNDER SOUND CONTROL MEMBRANE (OTHER THAN SHOWERS).
- SOUND TRANSMISSION PER FBC 1207:
A: AIR-BORNE SOUND. WALLS, PARTITIONS AND FLOOR/CEILING ASSEMBLIES SEPARATING DWELLING UNITS FROM EACH OTHER OF FROM PUBLIC OR SERVICE AREAS SHALL HAVE A SOUND TRANSMISSION CLASS (STC) OF NOT LESS THAN 50 (45 IF FIELD TESTED) FOR AIR-BORNE NOISE WHEN TESTED IN ACCORDANCE WITH ASTM E 90. PENETRATIONS OR OPENINGS IN CONSTRUCTION ASSEMBLIES FOR PIPING; ELECTRICAL DEVICES; RECESSED CABINETS; BATHTUBS; SOFFITS; OR HEATING, VENTILATING OR EXHAUST DUCTS SHALL BE SEALED, LINED, INSULATED OR OTHERWISE TREATED TO MAINTAIN THE REQ. RATINGS. THIS REQUIREMENTS SHALL NOT APPLY TO DWELLING UNITS ENTRANCE DOORS; HOWEVER, SUCH DOORS SHALL BE TIGHT FITTING TO THE FRAME AND SILL.
B: STRUCTURE-BORNE SOUND. FLOOR/CEILING ASSEMBLIES BETWEEN A DWELLING UNIT AND A PUBLIC OR SERVICE AREA WITHIN THE STRUCTURES SHALL HAVE AN IMPACT INSULATION CLASS (IIC) RATING OF NOT LESS THAN 50 (45 IF FIELD TESTED) WHEN TESTED IN ACCORDANCE WITH ASTM E 492.
- ALL UNIT BARN DOORS TO BE SIZED (FIELD VERIFY) TO ALIGN WITH CENTER LINE OF BATHROOM VANITY.

REVISIONS		
#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/15/15
3	CMB Bldg. Dept. Comments	03/25/15
5	Revisions	06-12-15
6	Revision 6	08-14-15

C:\Users\mhinciano\Documents\12064-ANGLERS_HOTEL_mhinciano.rvt
4/20/2016 4:29:05 PM

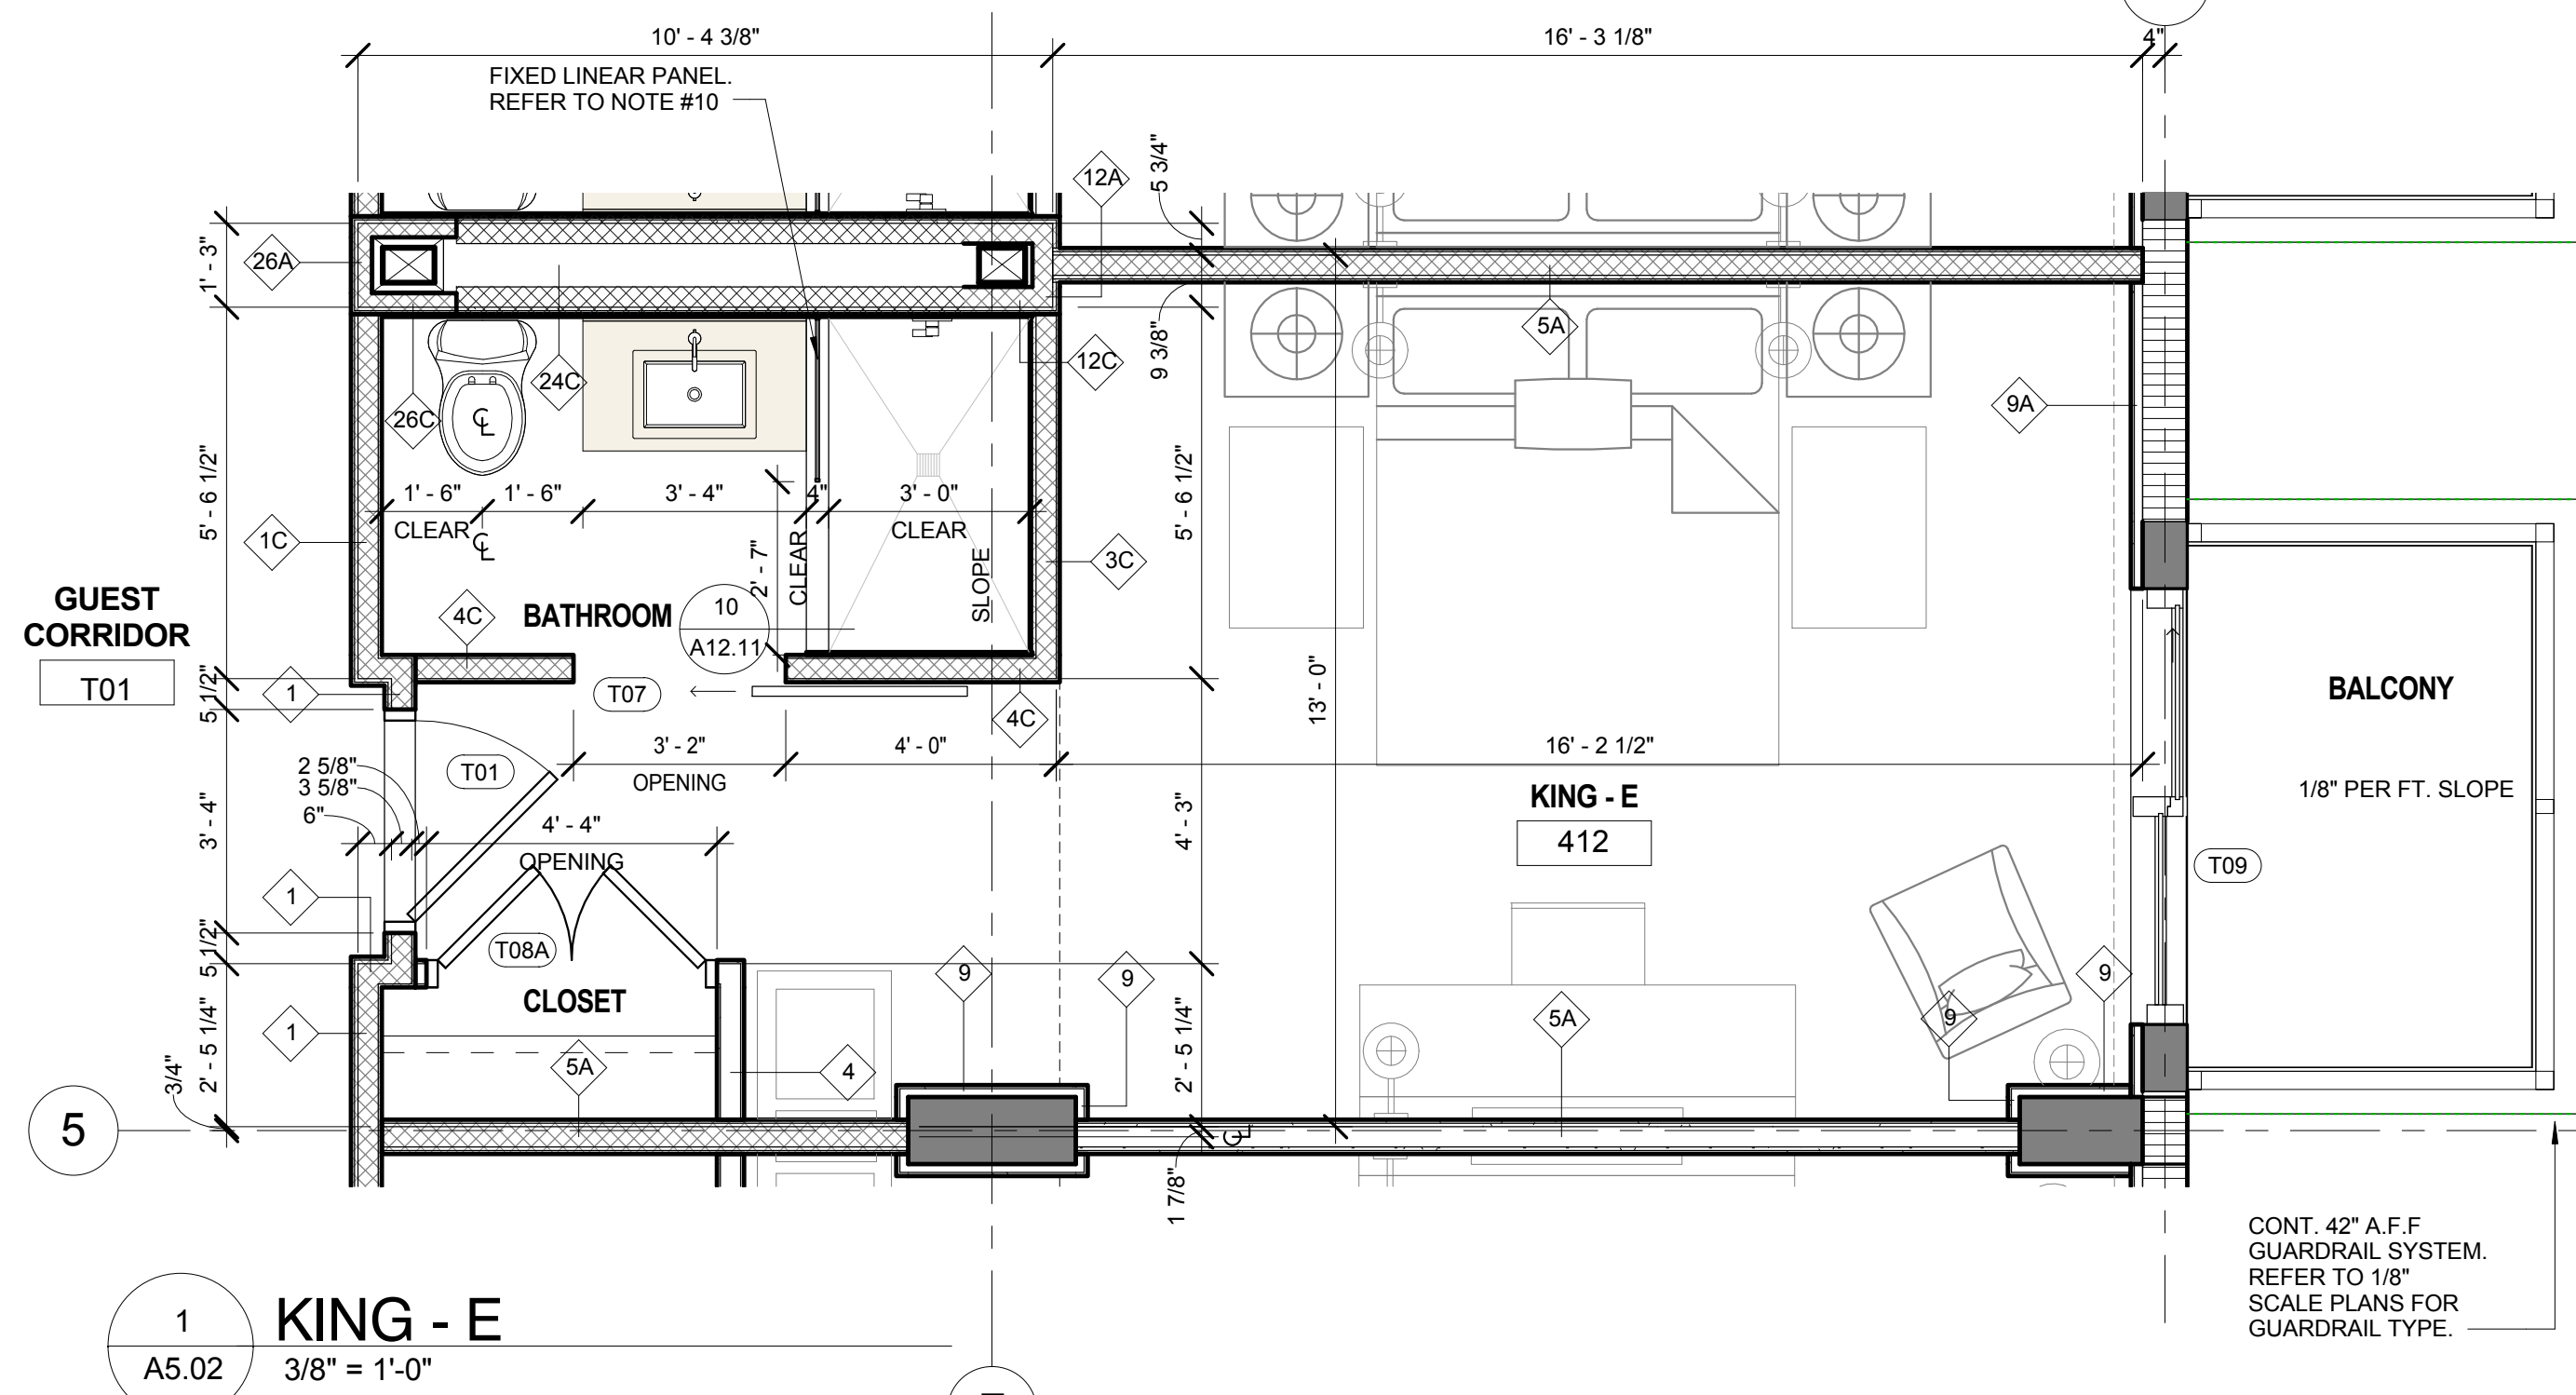


KING - E

A5.02 3/8" = 1'-0"

KING UNITS: 212, 304, 312, 404, 412, 504, 512

(REFER TO 1/8" SCALE PLANS FOR BALCONY / GLASS SLIDING DOOR LAYOUT).

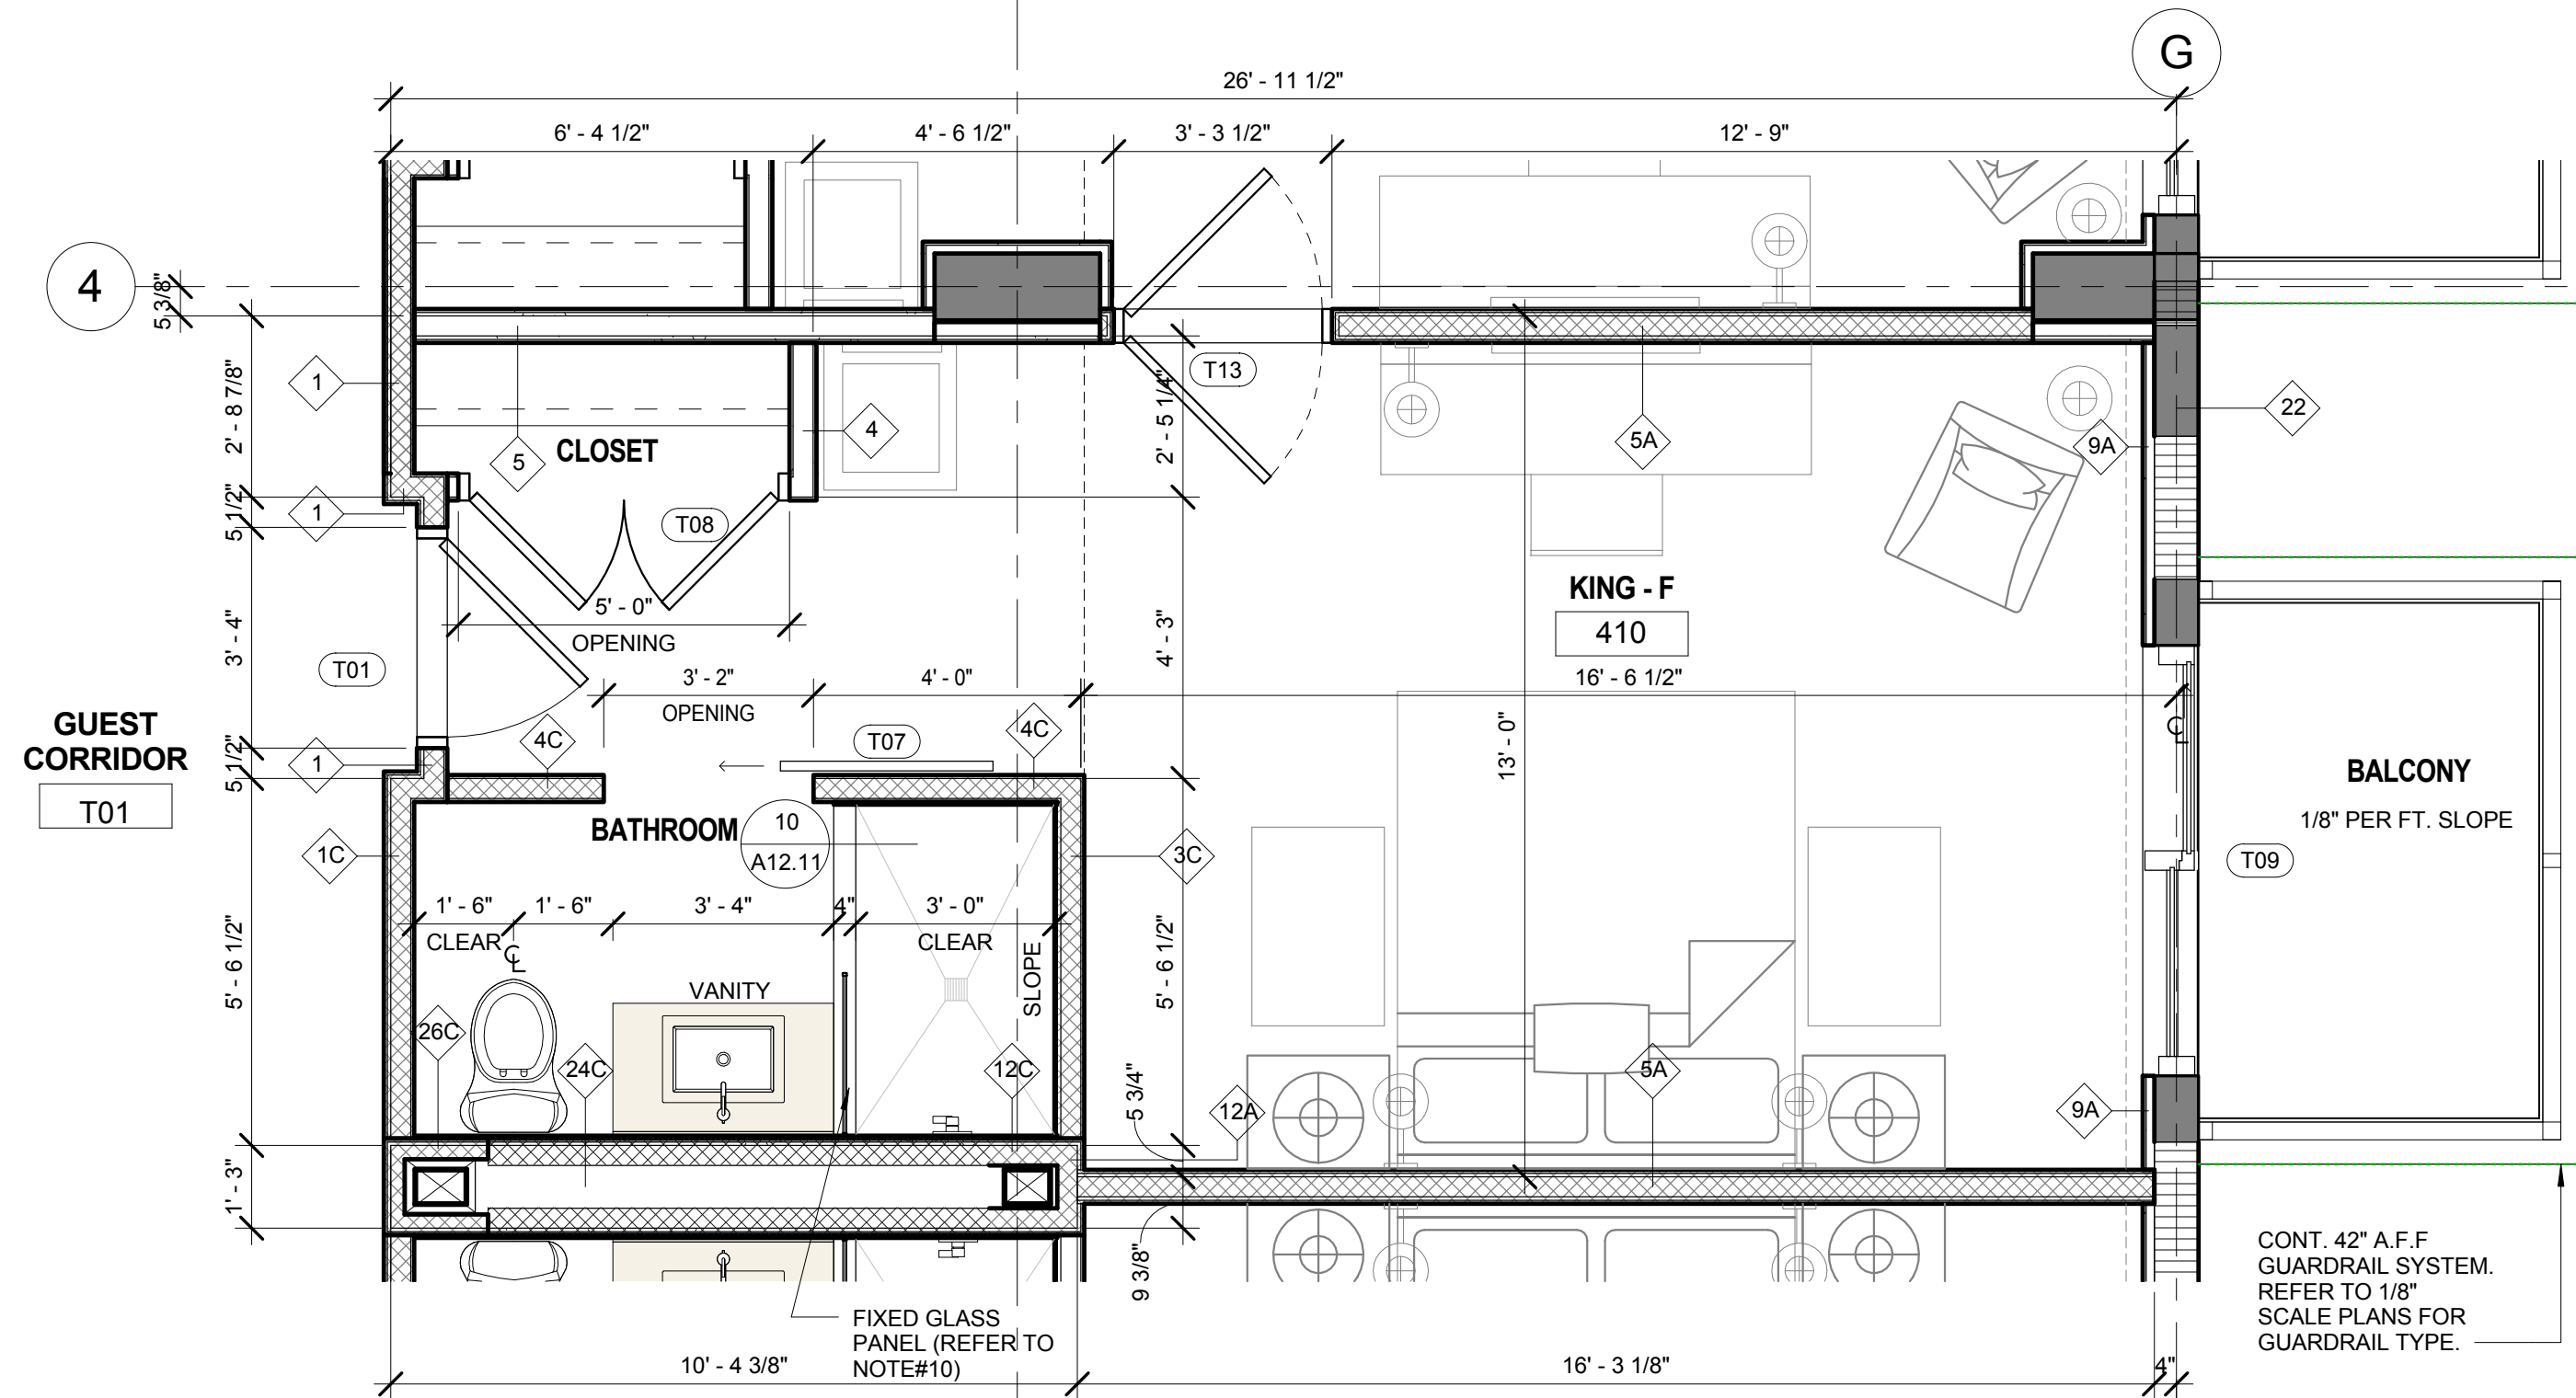


KING - F

A5.02 3/8" = 1'-0"

KING UNITS: 210, 306, 310, 406, 410, 506, 510

(REFER TO 1/8" SCALE PLANS FOR BALCONY / GLASS SLIDING DOOR LAYOUT).

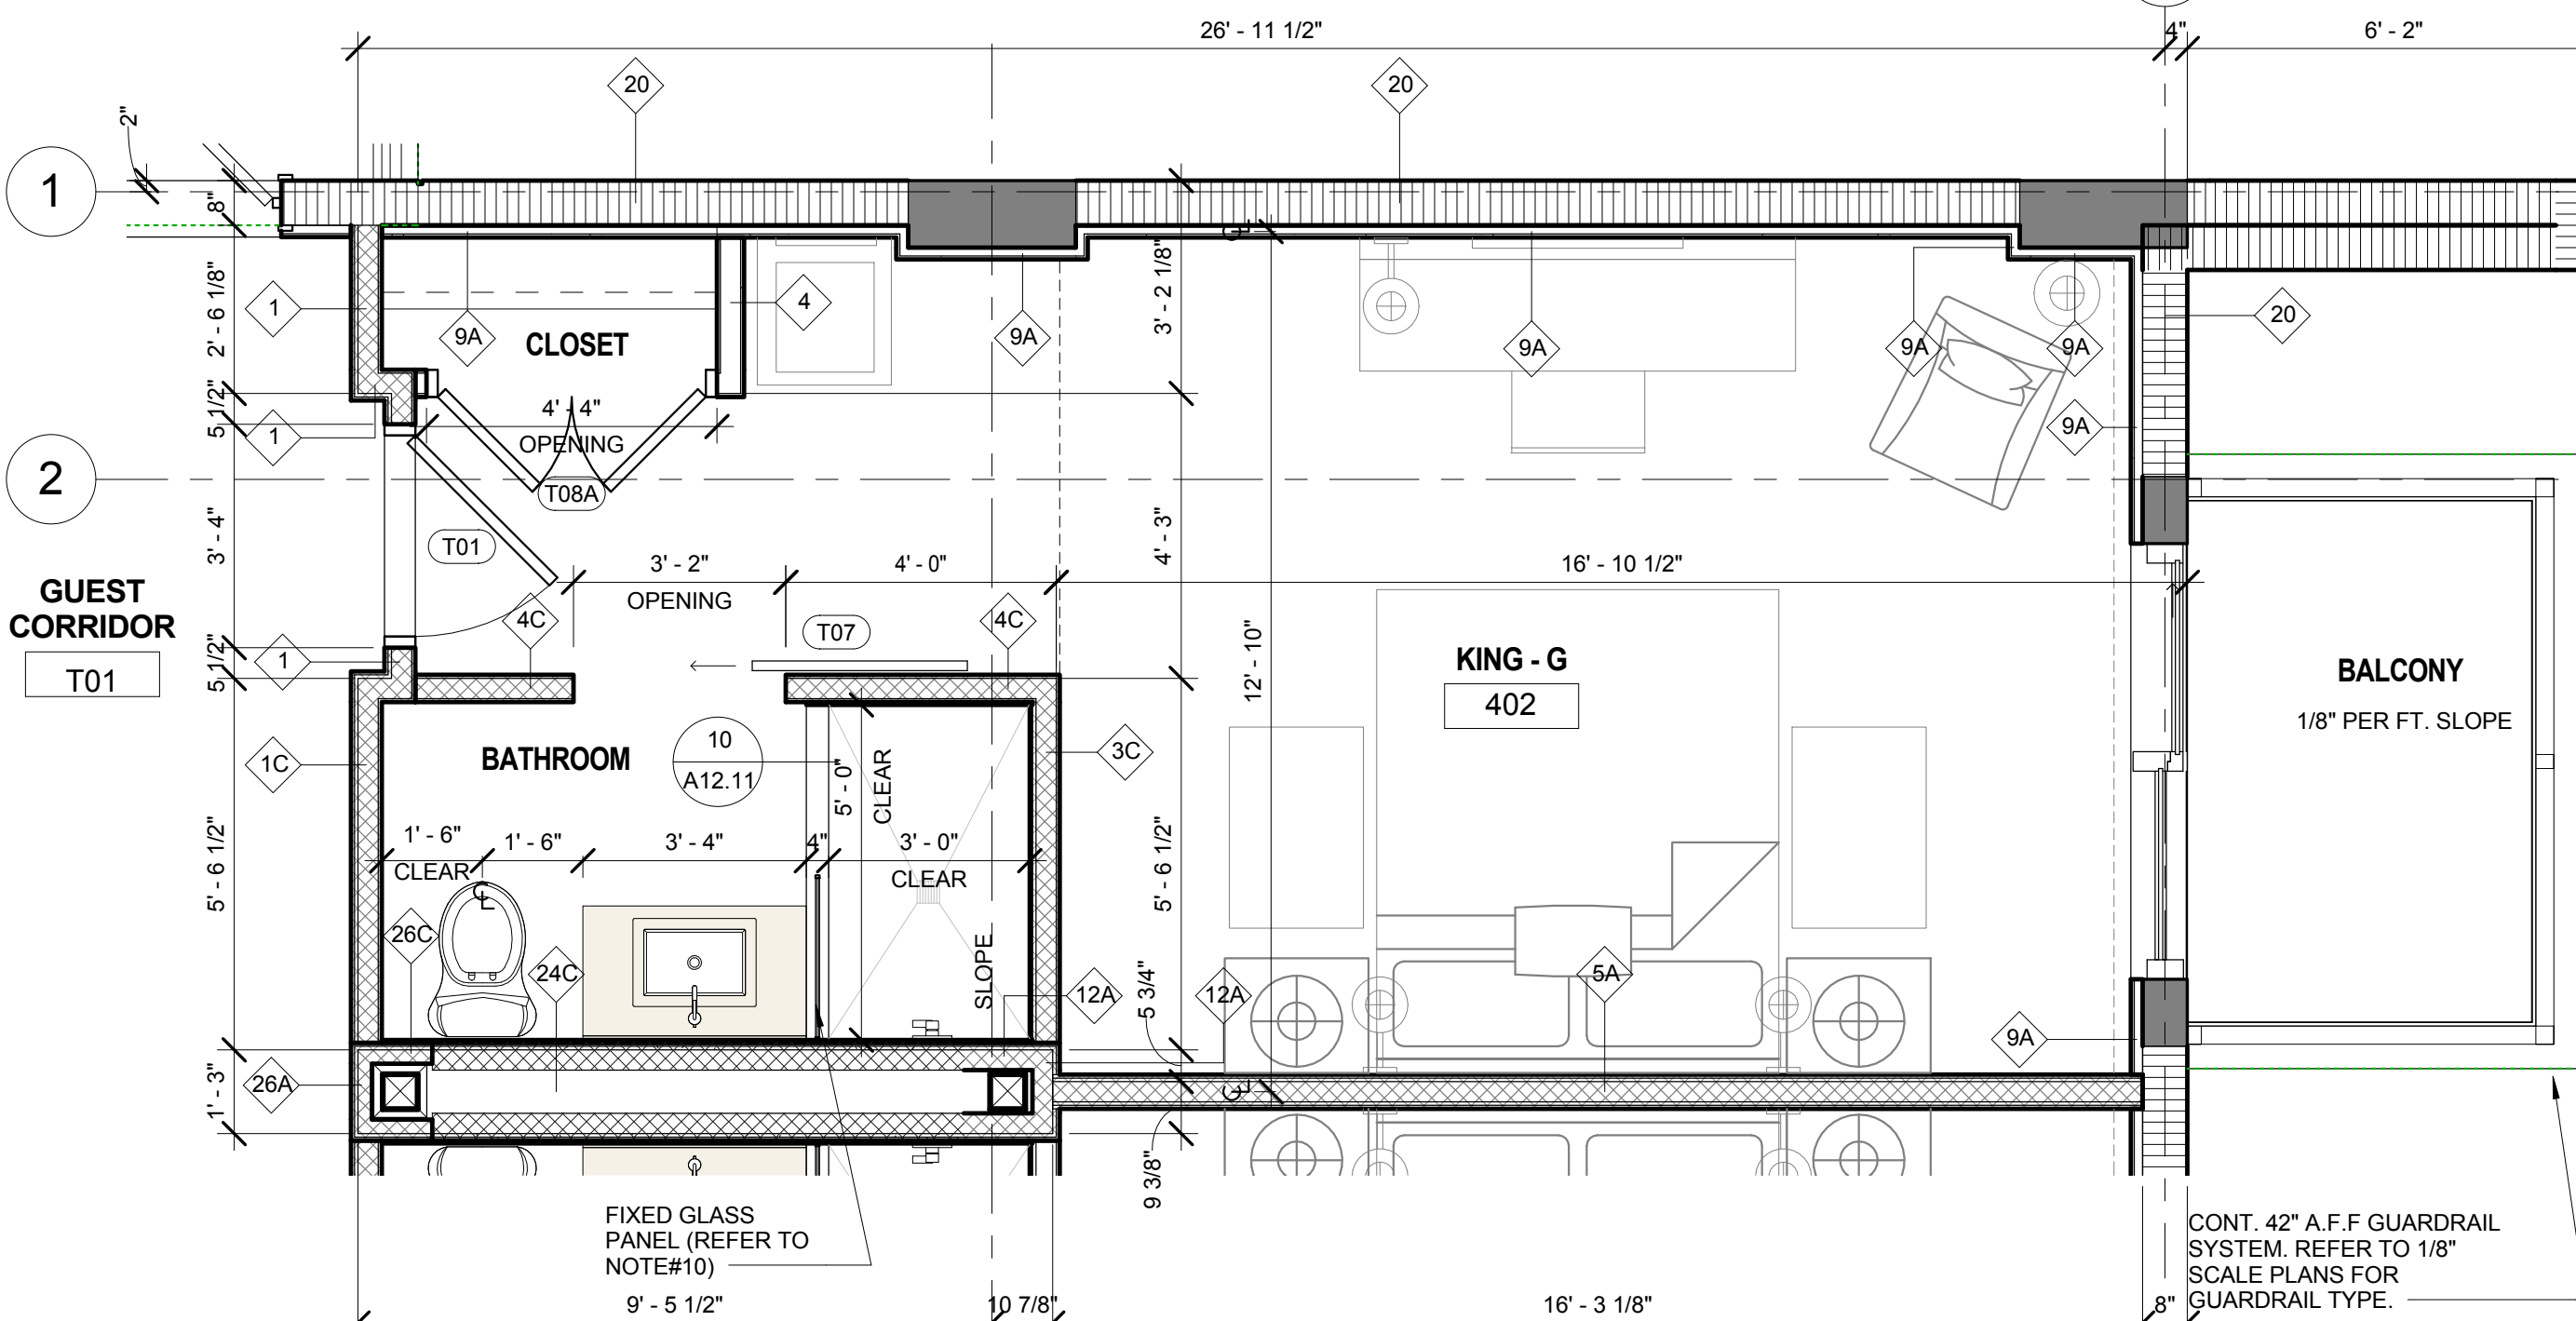


KING - G

A5.02 3/8" = 1'-0"

KING UNITS: 206, 302, 402, 502

(REFER TO 1/8" SCALE PLANS FOR BALCONY / GLASS SLIDING DOOR LAYOUT).

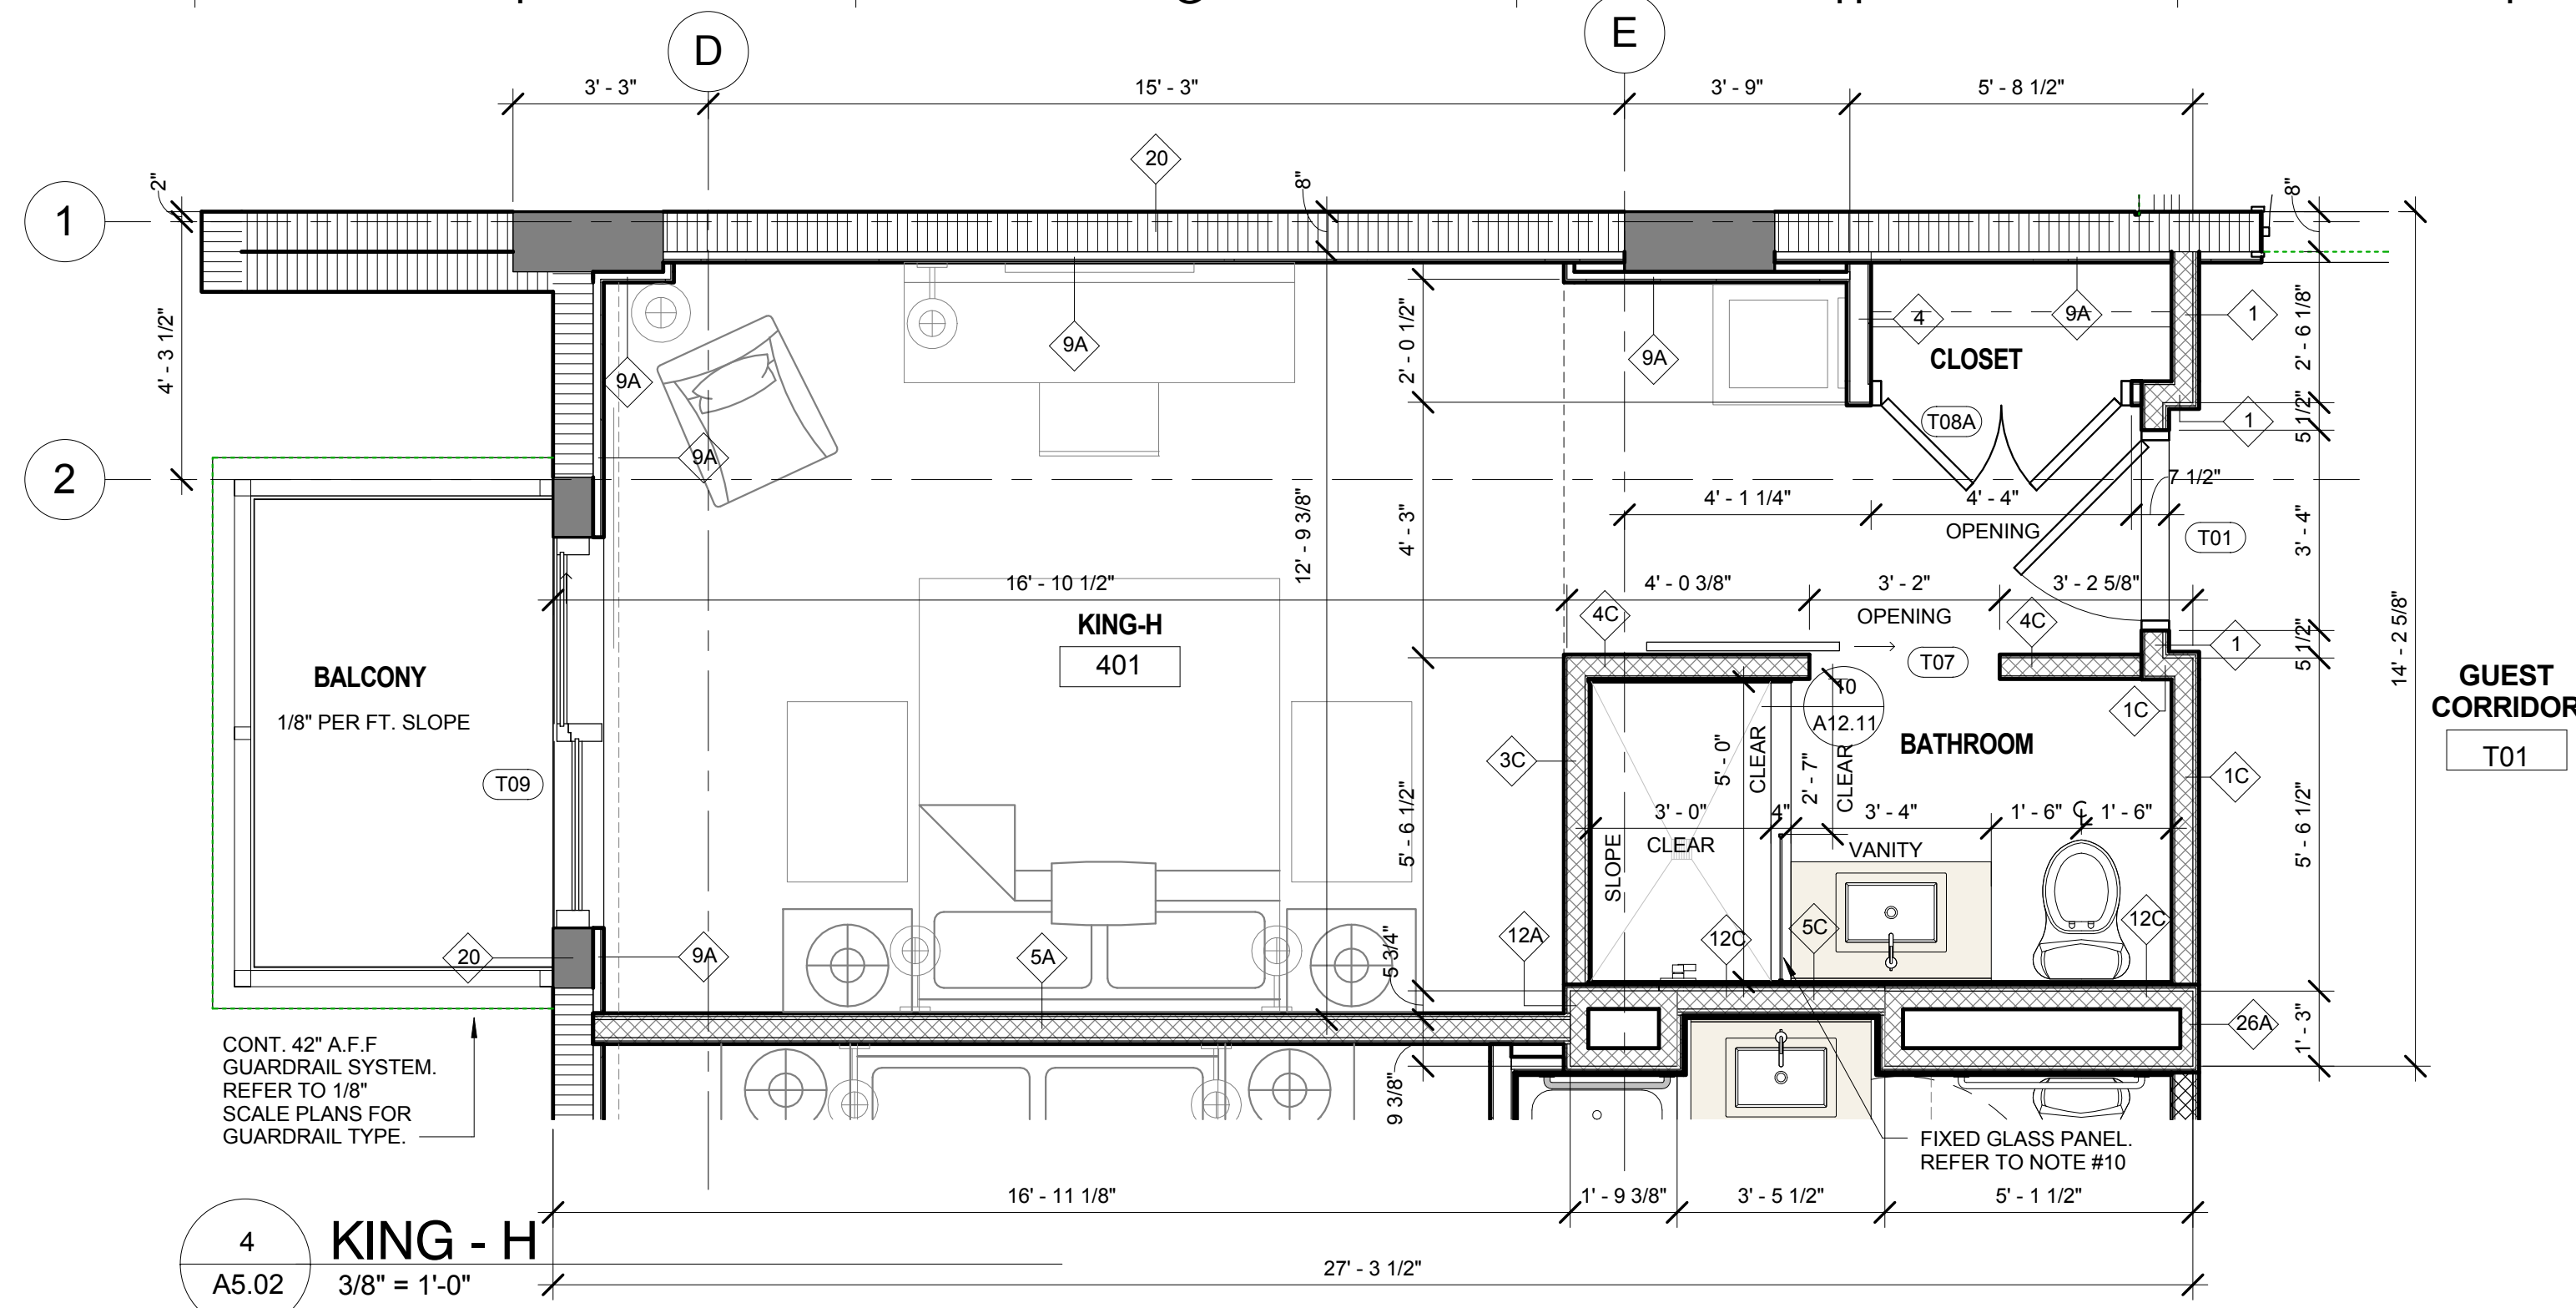


KING - H

A5.02 3/8" = 1'-0"

KING UNITS: 301, 401, 501

(REFER TO 1/8" SCALE PLANS FOR BALCONY / GLASS SLIDING DOOR LAYOUT).

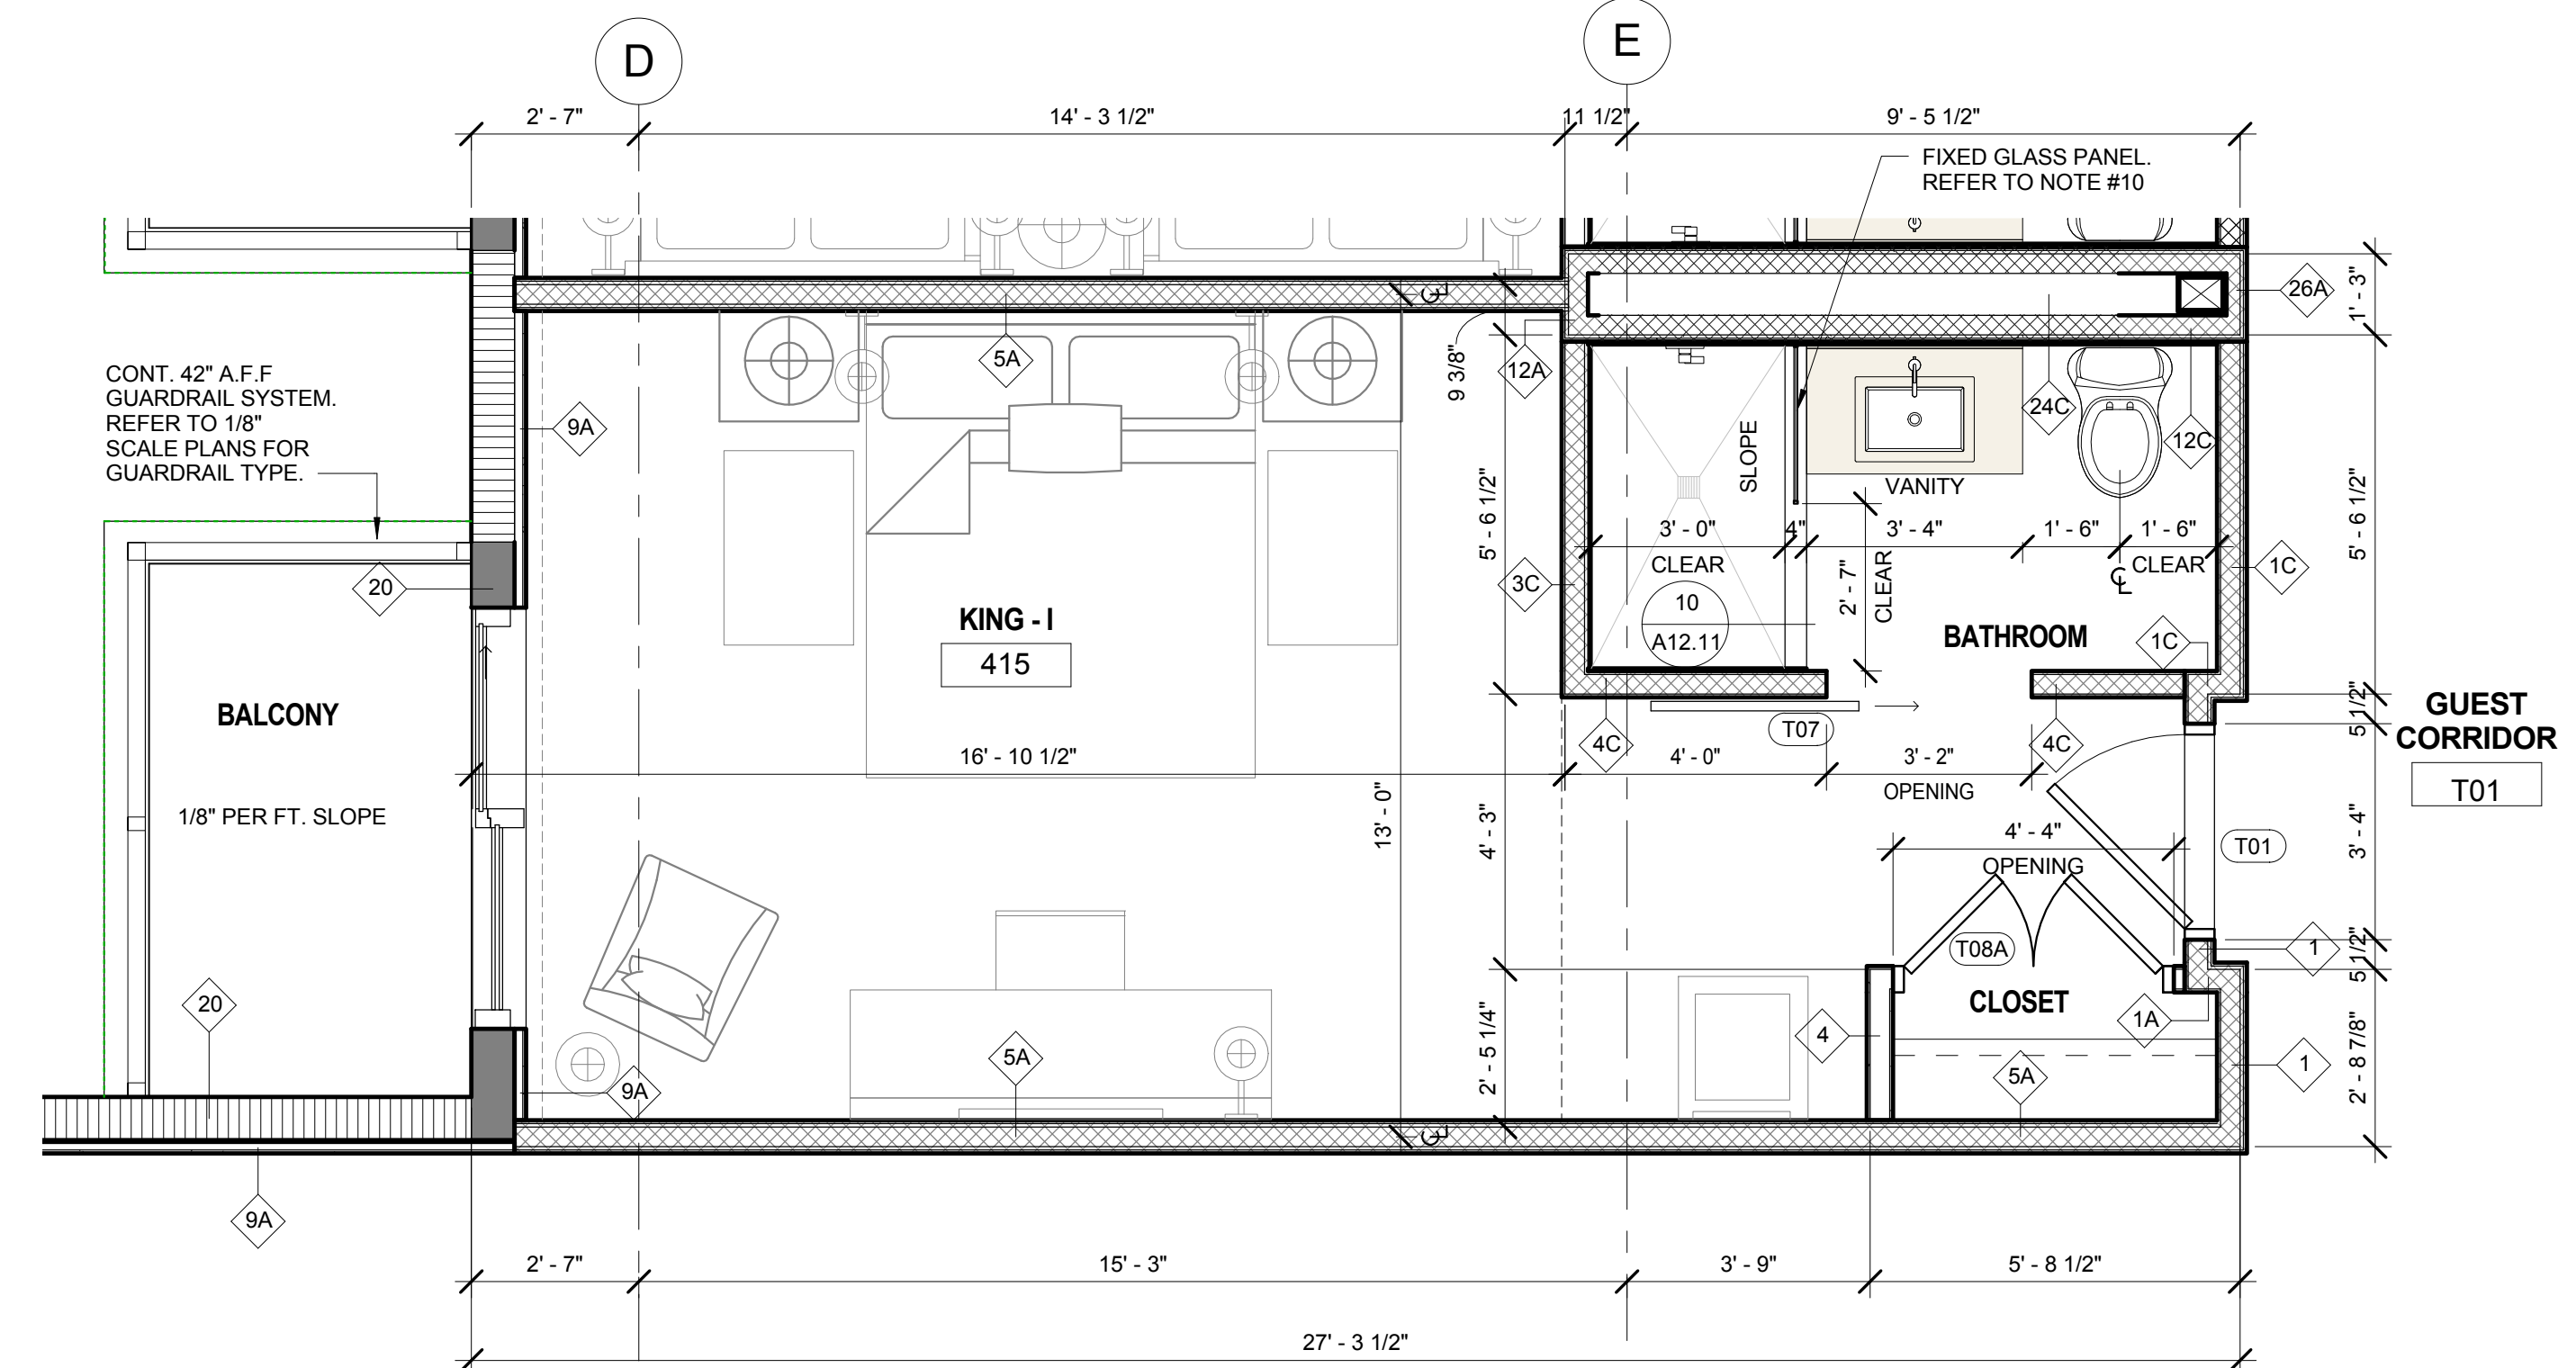

KING - I

A5.02 3/8" = 1'-0"

KING UNITS: 215, 315, 415, 515

(REFER TO 1/8" SCALE PLANS FOR BALCONY / GLASS SLIDING DOOR LAYOUT).



**REVISED GRIDS, STRUCTURE AND DIMENSIONS
- TYPICAL ALL GUESTROOMS**

HOTEL UNIT GENERAL NOTES

- ALL DIMENSIONS TO STUD OR FURRING FACE, (ACTUAL DIMENSIONS).
- FOR WALL TYPE DETAILS REFER TO A12.00 SHEET SERIES.
- PARTITION FRAMING TO BE 20 GA. 3-5/8" METAL STUDS (MIN.) AT 16" O.C. AT ALL HUNG ITEMS AND WALLS TO RECEIVE TILE.
- CONTRACTOR TO COORDINATE SHEETS WITH MECHANICAL, PLUMBING, AND ELECTRICAL CONTRACTORS.
- ALL SLOPES TO DRAINS SHALL BE 1/8" / FT. (MIN) 1/4" AT ALL AREAS OTHER THAN SHOWERS.
- ALL SHOWER WALLS TO HAVE 5/8" GLASS MAT FACED GYPSUM TILE BACKER BOARD MOUNTED ON THE STUD OR FURRING CHANNELS.
- INSTALL SELF-BONDING SOUND CONTROL MEMBRANE TO ALL CONCRETE FLOORS BELOW TILE OR WOOD, INCLUDING FLOORS OTHER THAN SHOWERS. *PROFLEX 90 MSC* AS MANUFACTURED BY PROFLEX PRODUCTS, INC., OR ACCEPTABLE EQUIVALENT.
- ALL UNITS SHALL MAINTAIN AN ACCESSIBLE ROUTE WITH MINIMUM WIDTH OF 36".
- REFER TO INTERIOR DESIGN DRAWINGS FOR REFLECTED CEILING PLANS, FURNITURE LAYOUTS, MILLWORK DETAILS, HARDWARE-FIXTURE SELECTIONS & FINISHES.
- ALL SHOWER GLASS DOORS & GLASS PANELS ADJACENT TO DOORS MUST BE SAFETY GLAZING IN COMPLIANCE W/ FBC 2406.4 & TB 2406.2(1) AND 2406.2 (2) AS PER FBC SECTION 2406.4 PROVIDE SAFETY GLAZING TESTED IN ACCORDANCE WITH CPSC 16 CFR 1201. GLAZING IN DOORS AND ENCLOSURES FOR HOT TUBS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHTUBS AND SHOWERS WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE A STANDING SURFACE. GLAZING 9 SF OR LESS SHALL BE CATEGORY CLASS I. GLAZING 9 SF OR MORE SHALL BE CATEGORY CLASS II. GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE NEAREST EXPOSED EDGE OF THE GLAZING IS WITHIN A 24-INCH ARC OF EITHER VERTICAL EDGE OF THE DOOR IN A CLOSED POSITION AND WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE THE WALKING SURFACE. GLAZING 9 SF OR LESS SHALL BE CATEGORY CLASS B GLAZING 9 SF OR MORE SHALL BE CATEGORY CLASS A
- INSTALL "VULKEM 350 / 350 NF R" (2ND COAT SANDED) BY TREMCO, OR ACCEPTED EQUIVALENT FLUID APPLIED WATERPROOFING AT ALL TOILET ROOMS UNDER SOUND CONTROL MEMBRANE (OTHER THAN SHOWERS).
- SOUND TRANSMISSION PER FBC 1207:
A: AIR-BORNE SOUND. WALLS, PARTITIONS AND FLOOR/CEILING ASSEMBLIES SEPARATING DWELLING UNITS FROM EACH OTHER OF FROM PUBLIC OR SERVICE AREAS SHALL HAVE A SOUND TRANSMISSION CLASS (STC) OF NOT LESS THAN 50 (45 IF FIELD TESTED) FOR AIR-BORNE NOISE WHEN TESTED IN ACCORDANCE WITH ASTM E 90. PENETRATIONS OR OPENINGS IN CONSTRUCTION ASSEMBLIES FOR PIPING, ELECTRICAL DEVICES, RECESSED CABINETS, BATHTUBS, SOFFITS, OR HEATING, VENTILATING OR EXHAUST DUCTS SHALL BE SEALED, LINED, INSULATED OR OTHERWISE TREATED TO MAINTAIN THE REQ. RATINGS. THIS REQUIREMENTS SHALL NOT APPLY TO DWELLING UNITS ENTRANCE DOORS; HOWEVER, SUCH DOORS SHALL BE TIGHT FITTING TO THE FRAME AND SILL.
B: STRUCTURE-BORNE SOUND. FLOOR/CEILING ASSEMBLIES BETWEEN A DWELLING UNIT AND A PUBLIC OR SERVICE AREA WITHIN THE STRUCTURES SHALL HAVE AN IMPACT INSULATION CLASS (IIC) RATING OF NOT LESS THAN 50 (45 IF FIELD TESTED) WHEN TESTED IN ACCORDANCE WITH ASTM E 492.
- ALL UNIT BARN DOORS TO BE SIZED (FIELD VERIFY) TO ALIGN WITH CENTER LINE OF BATHROOM VANITY.

REVISIONS		
#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/15/15
3	CMB Bldg. Dept. Comments	03/25/15
5	Revisions	06-12-15
6	Revision 6	08-14-15

C:\Users\mhiciano\Documents\12064-ANGLERS_HOTEL_mhiciano.rvt
4/20/2016 4:29:10 PM

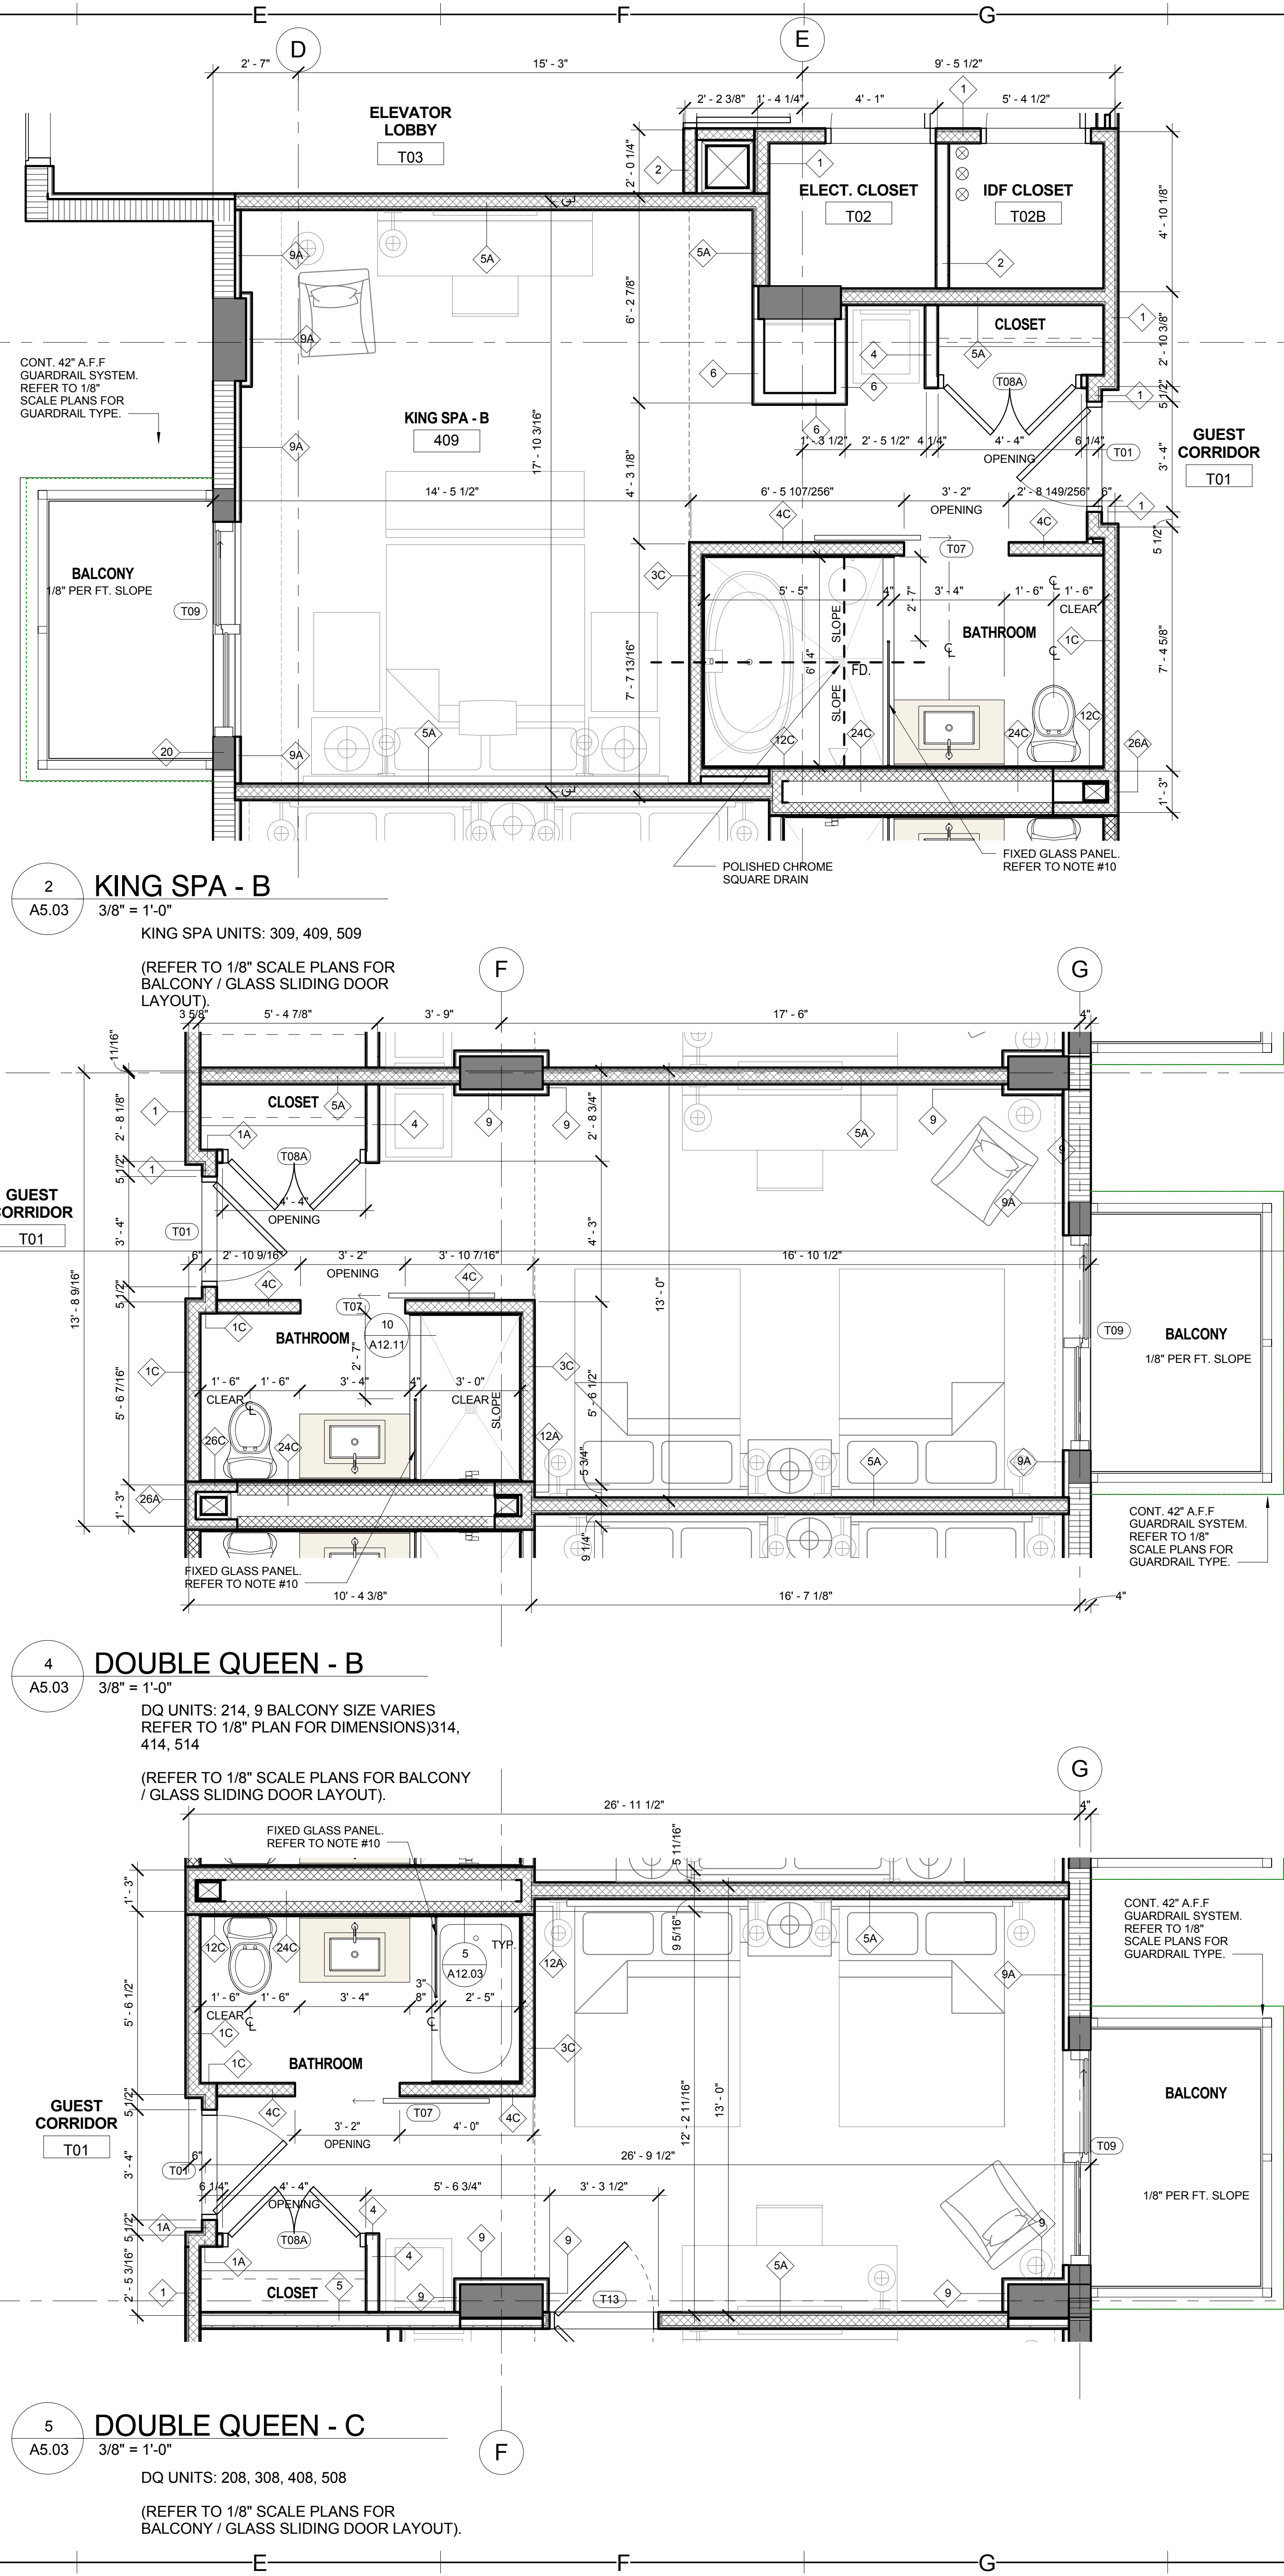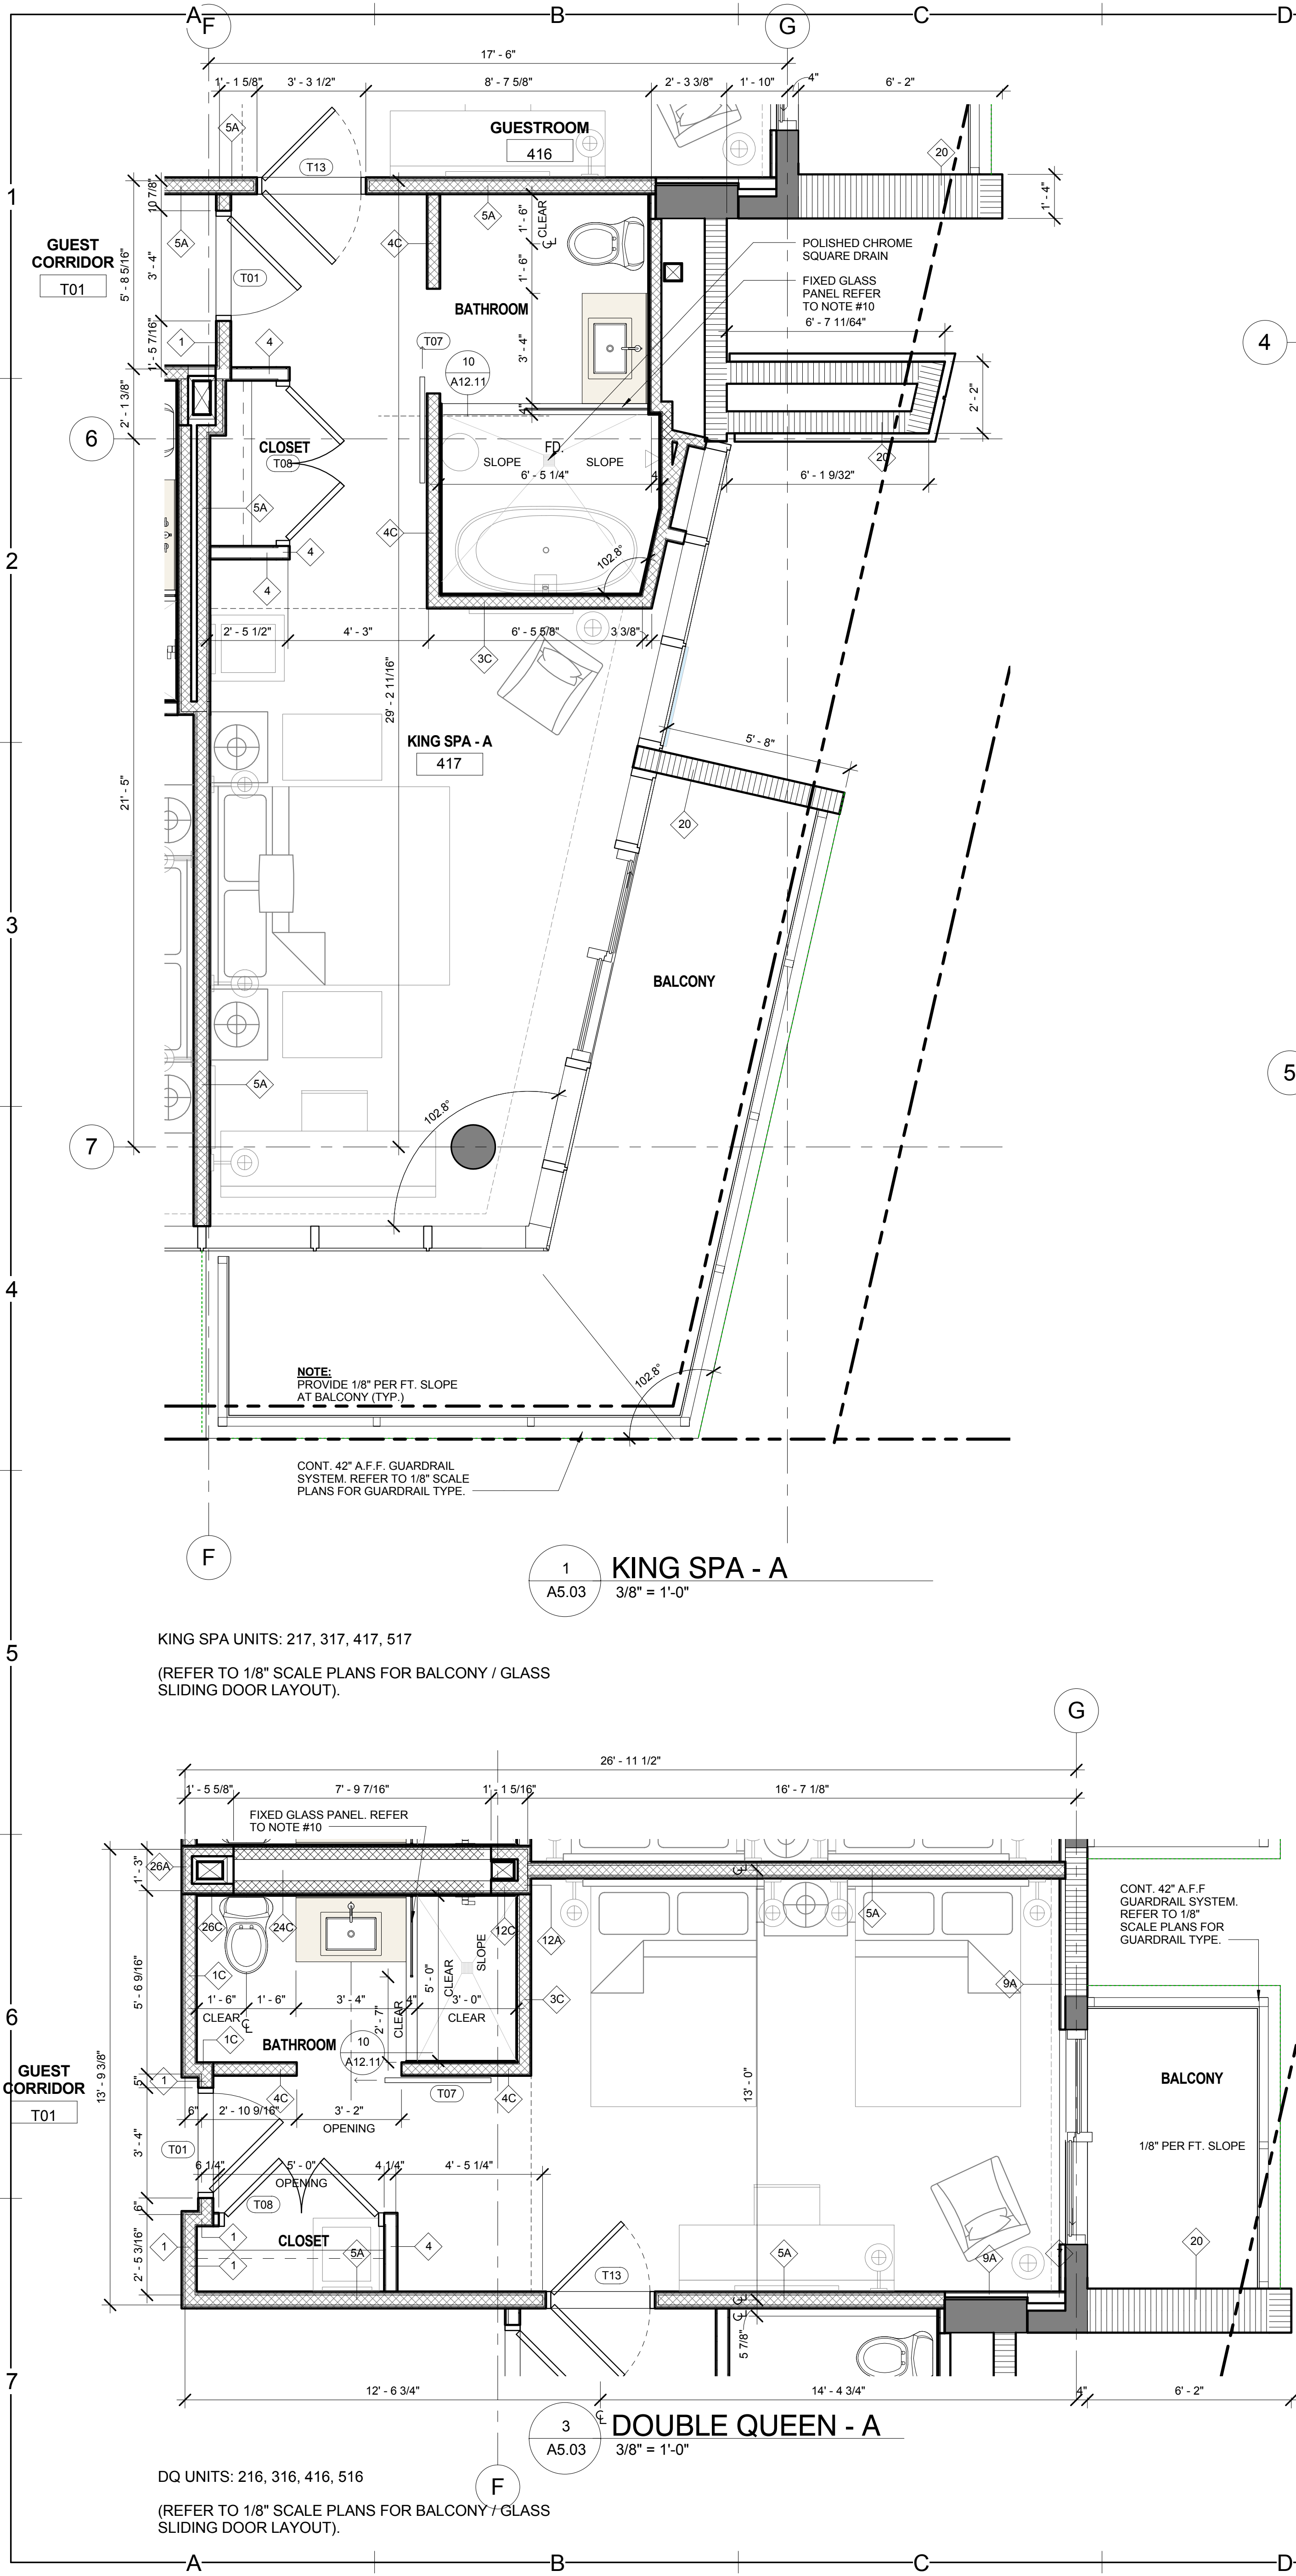


- ### HOTEL UNIT GENERAL NOTES
- ALL DIMENSIONS TO STUD CENTER OR FURRING FACE. (ACTUAL DIMENSIONS) CONTRACTOR TO CONFIRM WITH THE ARCHITECT ANY DISCREPANCY.
 - FOR WALL TYPE DETAILS REFER TO A12.00 SHEET SERIES.
 - PARTITION FRAMING TO BE 20 GA. 3-5/8" METAL STUDS (MIN.) AT 16" O.C. AT ALL HUNG ITEMS AND WALLS TO RECEIVE TILE.
 - CONTRACTOR TO COORDINATE SHEETS WITH MECHANICAL, PLUMBING, AND ELECTRICAL CONTRACTORS.
 - ALL SLOPES TO DRAINS SHALL BE 1/8"/FT. (MIN.); 2% MAX. AT ALL AREAS OTHER THAN SHOWERS.
 - ALL SHOWER WALLS TO HAVE 5/8" GLASS MAT FACED GYPSUM TILE BACKER BOARD MOUNTED ON THE STUD OR FURRING CHANNELS.
 - INSTALL SELF-BONDING SOUND CONTROL MEMBRANE TO ALL CONCRETE FLOORS BELOW TILE OR WOOD, INCLUDING FLOORS OTHER THAN SHOWERS. *PROFLEX 90 MSC" AS MANUFACTURED BY PROFLEX PRODUCTS, INC., OR ACCEPTABLE EQUIVALENT.
 - ALL UNITS SHALL MAINTAIN AN ACCESSIBLE ROUTE WITH MINIMUM WIDTH OF 36".
 - REFER TO INTERIOR DESIGN DRAWINGS FOR REFLECTED CEILING PLANS, FURNITURE LAYOUTS, MILLWORK DETAILS, HARDWARE-FIXTURE SELECTIONS & FINISHES.
 - ALL SHOWER GLASS DOORS & GLASS PANELS ADJACENT TO DOORS MUST BE SAFETY GLAZING IN COMPLIANCE W/ FBC 2406.4 & TB 2406.2(1) AND 2406.2(2) AS PER FBC SECTION 2406.4 PROVIDE SAFETY GLAZING TESTED IN ACCORDANCE WITH CPSC 16 CFR 1201. GLAZING IN DOORS AND ENCLOSURES FOR HOT TUBS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHTUBS AND SHOWERS WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE A STANDING SURFACE. GLAZING 9 SF OR LESS SHALL BE CATEGORY CLASS I. GLAZING 9 SF OR MORE SHALL BE CATEGORY CLASS II. GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE NEAREST EXPOSED EDGE OF THE GLAZING IS WITHIN A 24-INCH ARC OF EITHER VERTICAL EDGE OF THE DOOR IN A CLOSED POSITION AND WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE THE WALKING SURFACE. GLAZING 9 SF OR LESS SHALL BE CATEGORY CLASS B. GLAZING 9 SF OR MORE SHALL BE CATEGORY CLASS A.
 11. SOUND TRANSMISSION PER FBC 1207:
A. AIR-BORNE SOUND. WALLS, PARTITIONS AND FLOOR/CEILING ASSEMBLIES SEPARATING DWELLING UNITS FROM EACH OTHER OR FROM PUBLIC OR SERVICE AREAS SHALL HAVE A SOUND TRANSMISSION CLASS (STC) OF NOT LESS THAN 50 (45 IF FIELD TESTED) FOR AIR-BORNE NOISE WHEN TESTED IN ACCORDANCE WITH ASTM E 90. PENETRATIONS OR OPENINGS IN CONSTRUCTION ASSEMBLIES FOR PIPING; ELECTRICAL DEVICES; RECESSED CABINETS; BATHTUBS; SOFFITS; OR HEATING, VENTILATING OR EXHAUST DUCTS SHALL BE SEALED, LINED, INSULATED OR OTHERWISE TREATED TO MAINTAIN THE REQ. RATINGS. THIS REQUIREMENTS SHALL NOT APPLY TO DWELLING UNITS ENTRANCE DOORS; HOWEVER, SUCH DOORS SHALL BE TIGHT FITTING TO THE FRAME AND SILL.
B. STRUCTURE-BORNE SOUND. FLOOR/CEILING ASSEMBLIES BETWEEN A DWELLING UNIT AND A PUBLIC OR SERVICE AREA WITHIN THE STRUCTURES SHALL HAVE AN IMPACT INSULATION CLASS (IIC) RATING OF NOT LESS THAN 50 (45 IF FIELD TESTED) WHEN TESTED IN ACCORDANCE WITH ASTM E 492.
 13. ALL UNIT BARN DOORS TO BE SIZED (FIELD VERIFY) TO ALIGN WITH CENTER LINE OF BATHROOM VANITY.

REVISED GRIDS, STRUCTURE AND DIMENSIONS
- TYPICAL ALL GUESTROOMS


REVISIONS		
#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/15/15
3	CMB Bldg. Dept. Comments	03/25/15
5	Revisions	06-12-15
6	Revision 6	08-14-15

C:\Users\mhinciano\Documents\12064-ANGLERS_HOTEL_mhinciano.rvt
4/20/2016 4:29:17 PM

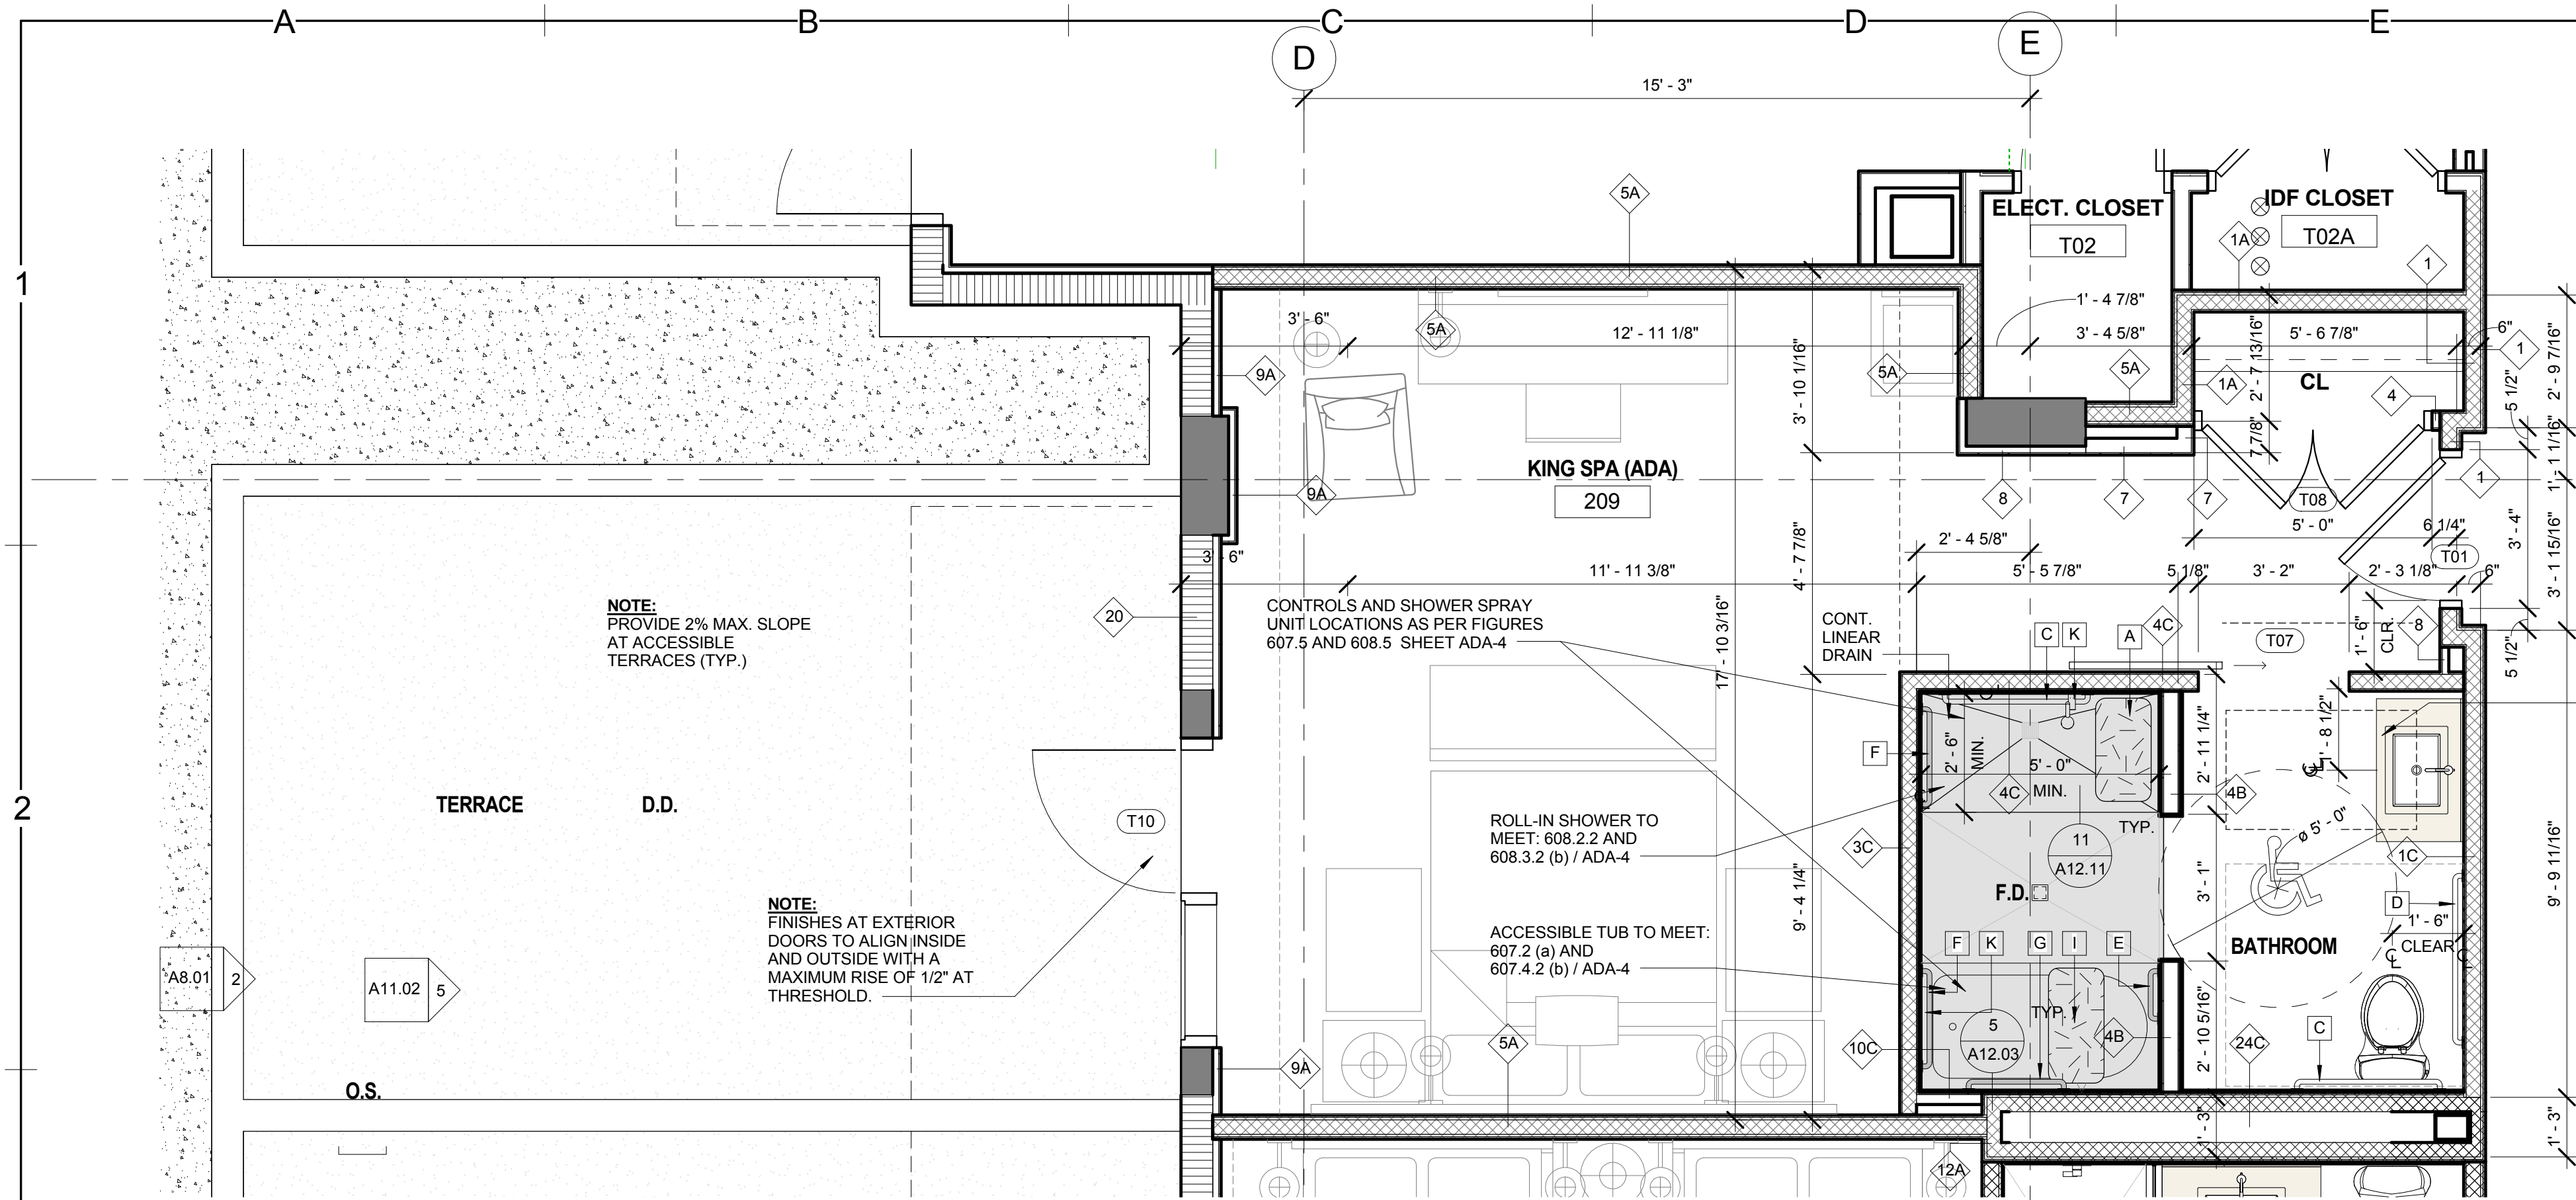


1 KING SPA - B, ADA WITH ROLL-IN SHOWER
A5.04 3/8" = 1'-0"

UNIT: 209

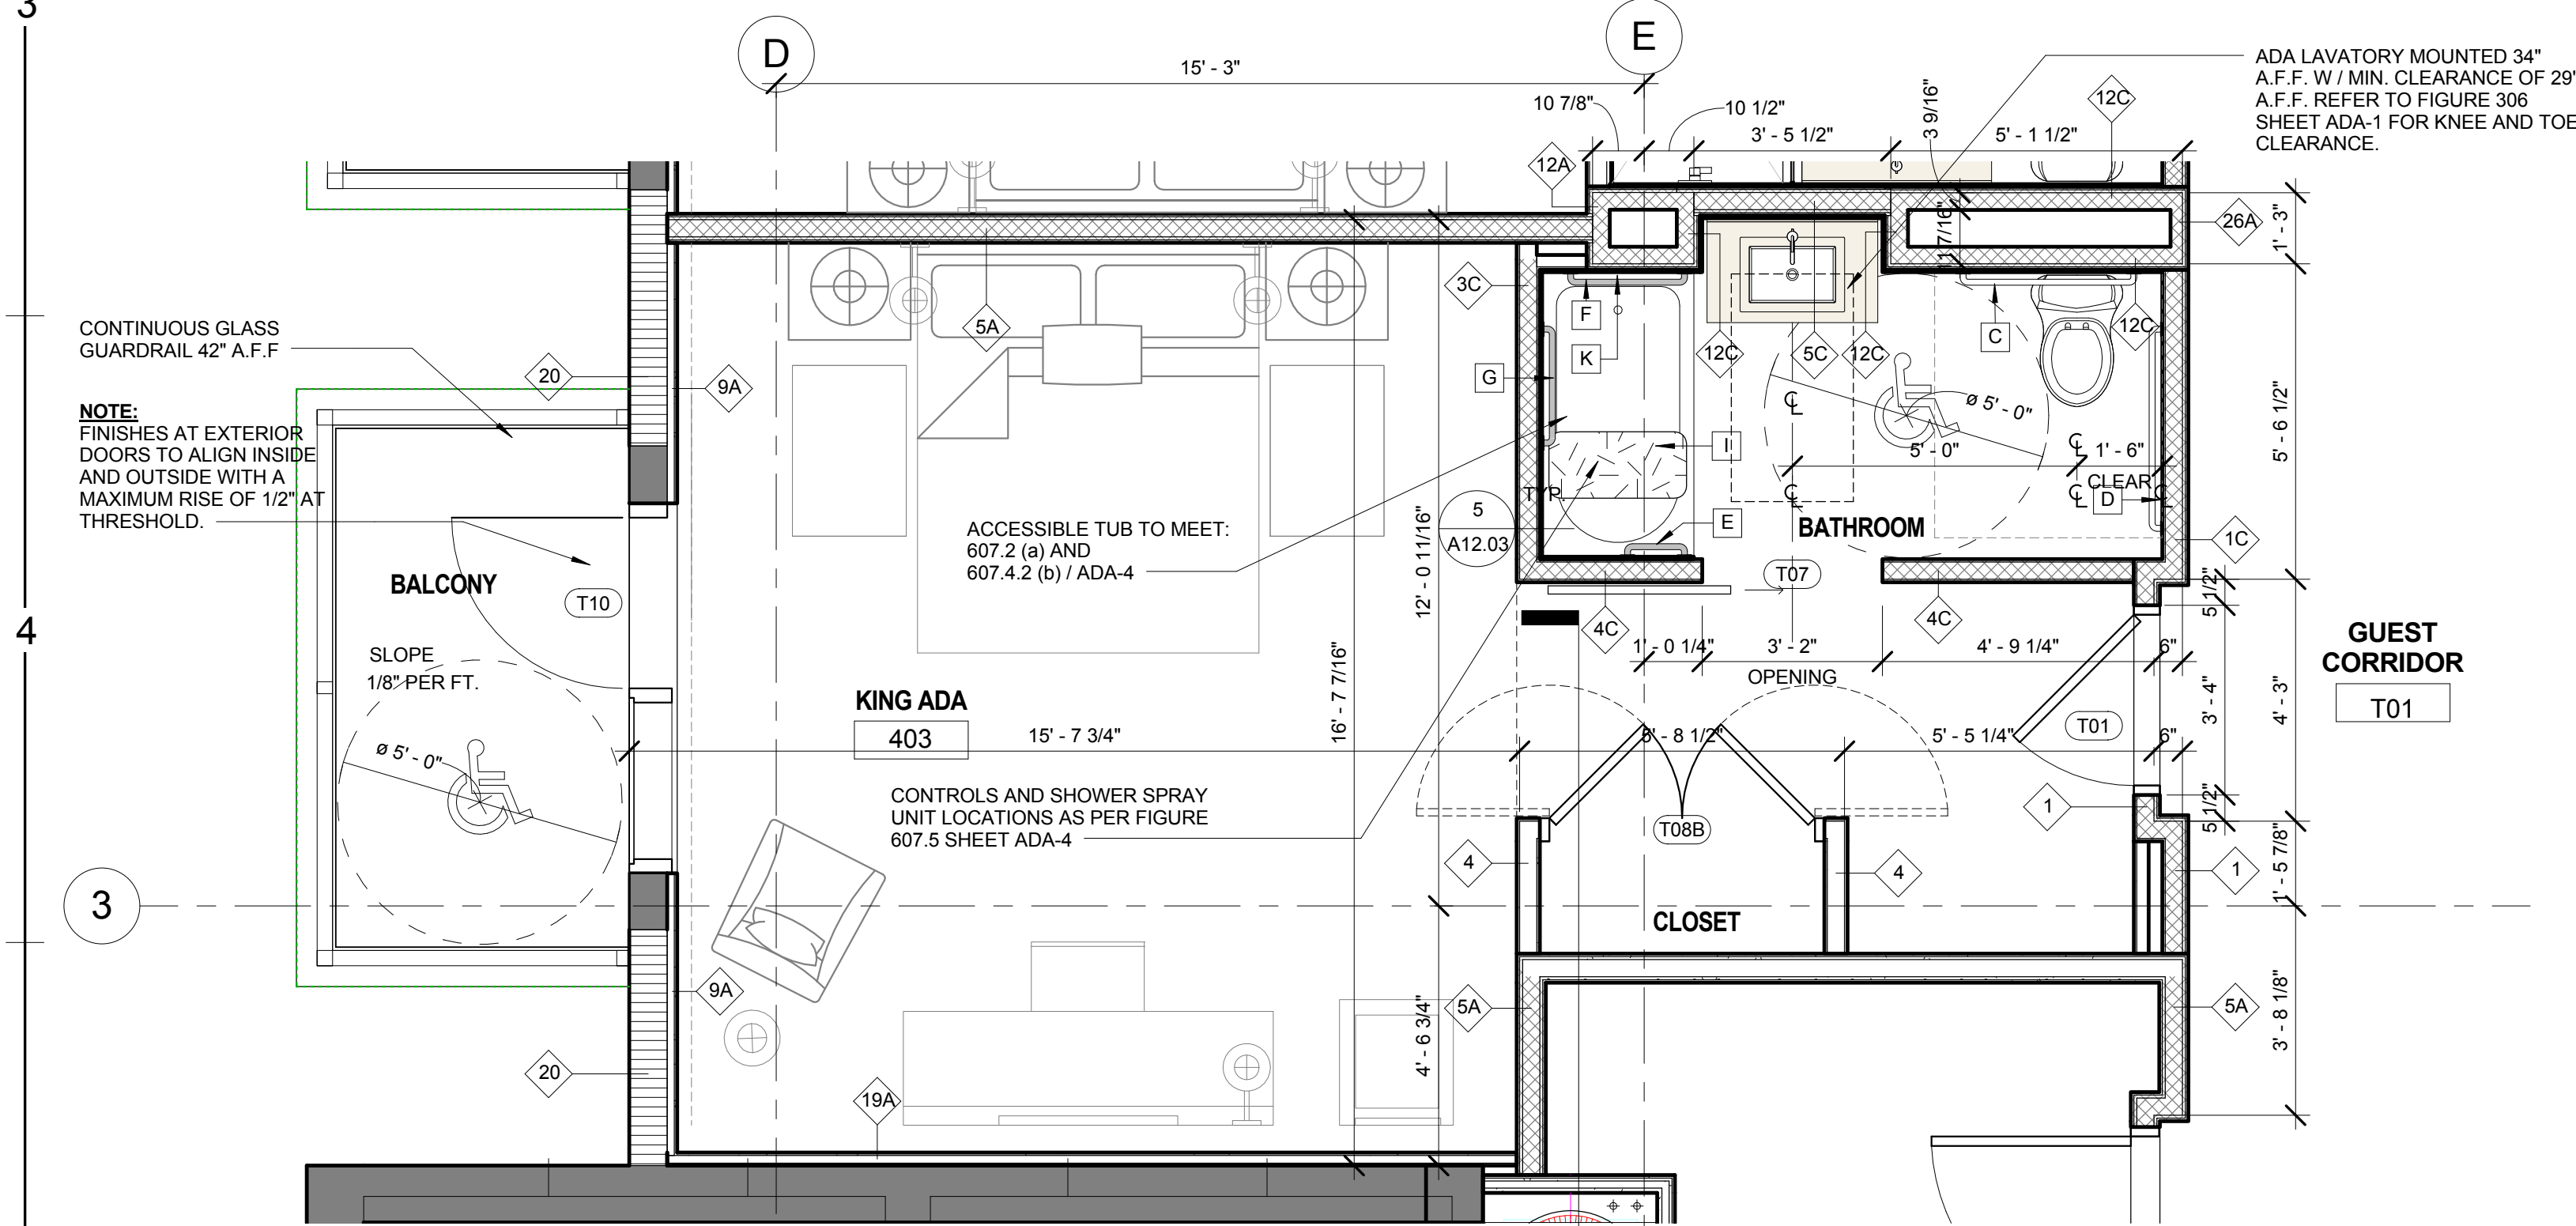

2 KING - ADA WITH TUB
A5.04 3/8" = 1'-0"

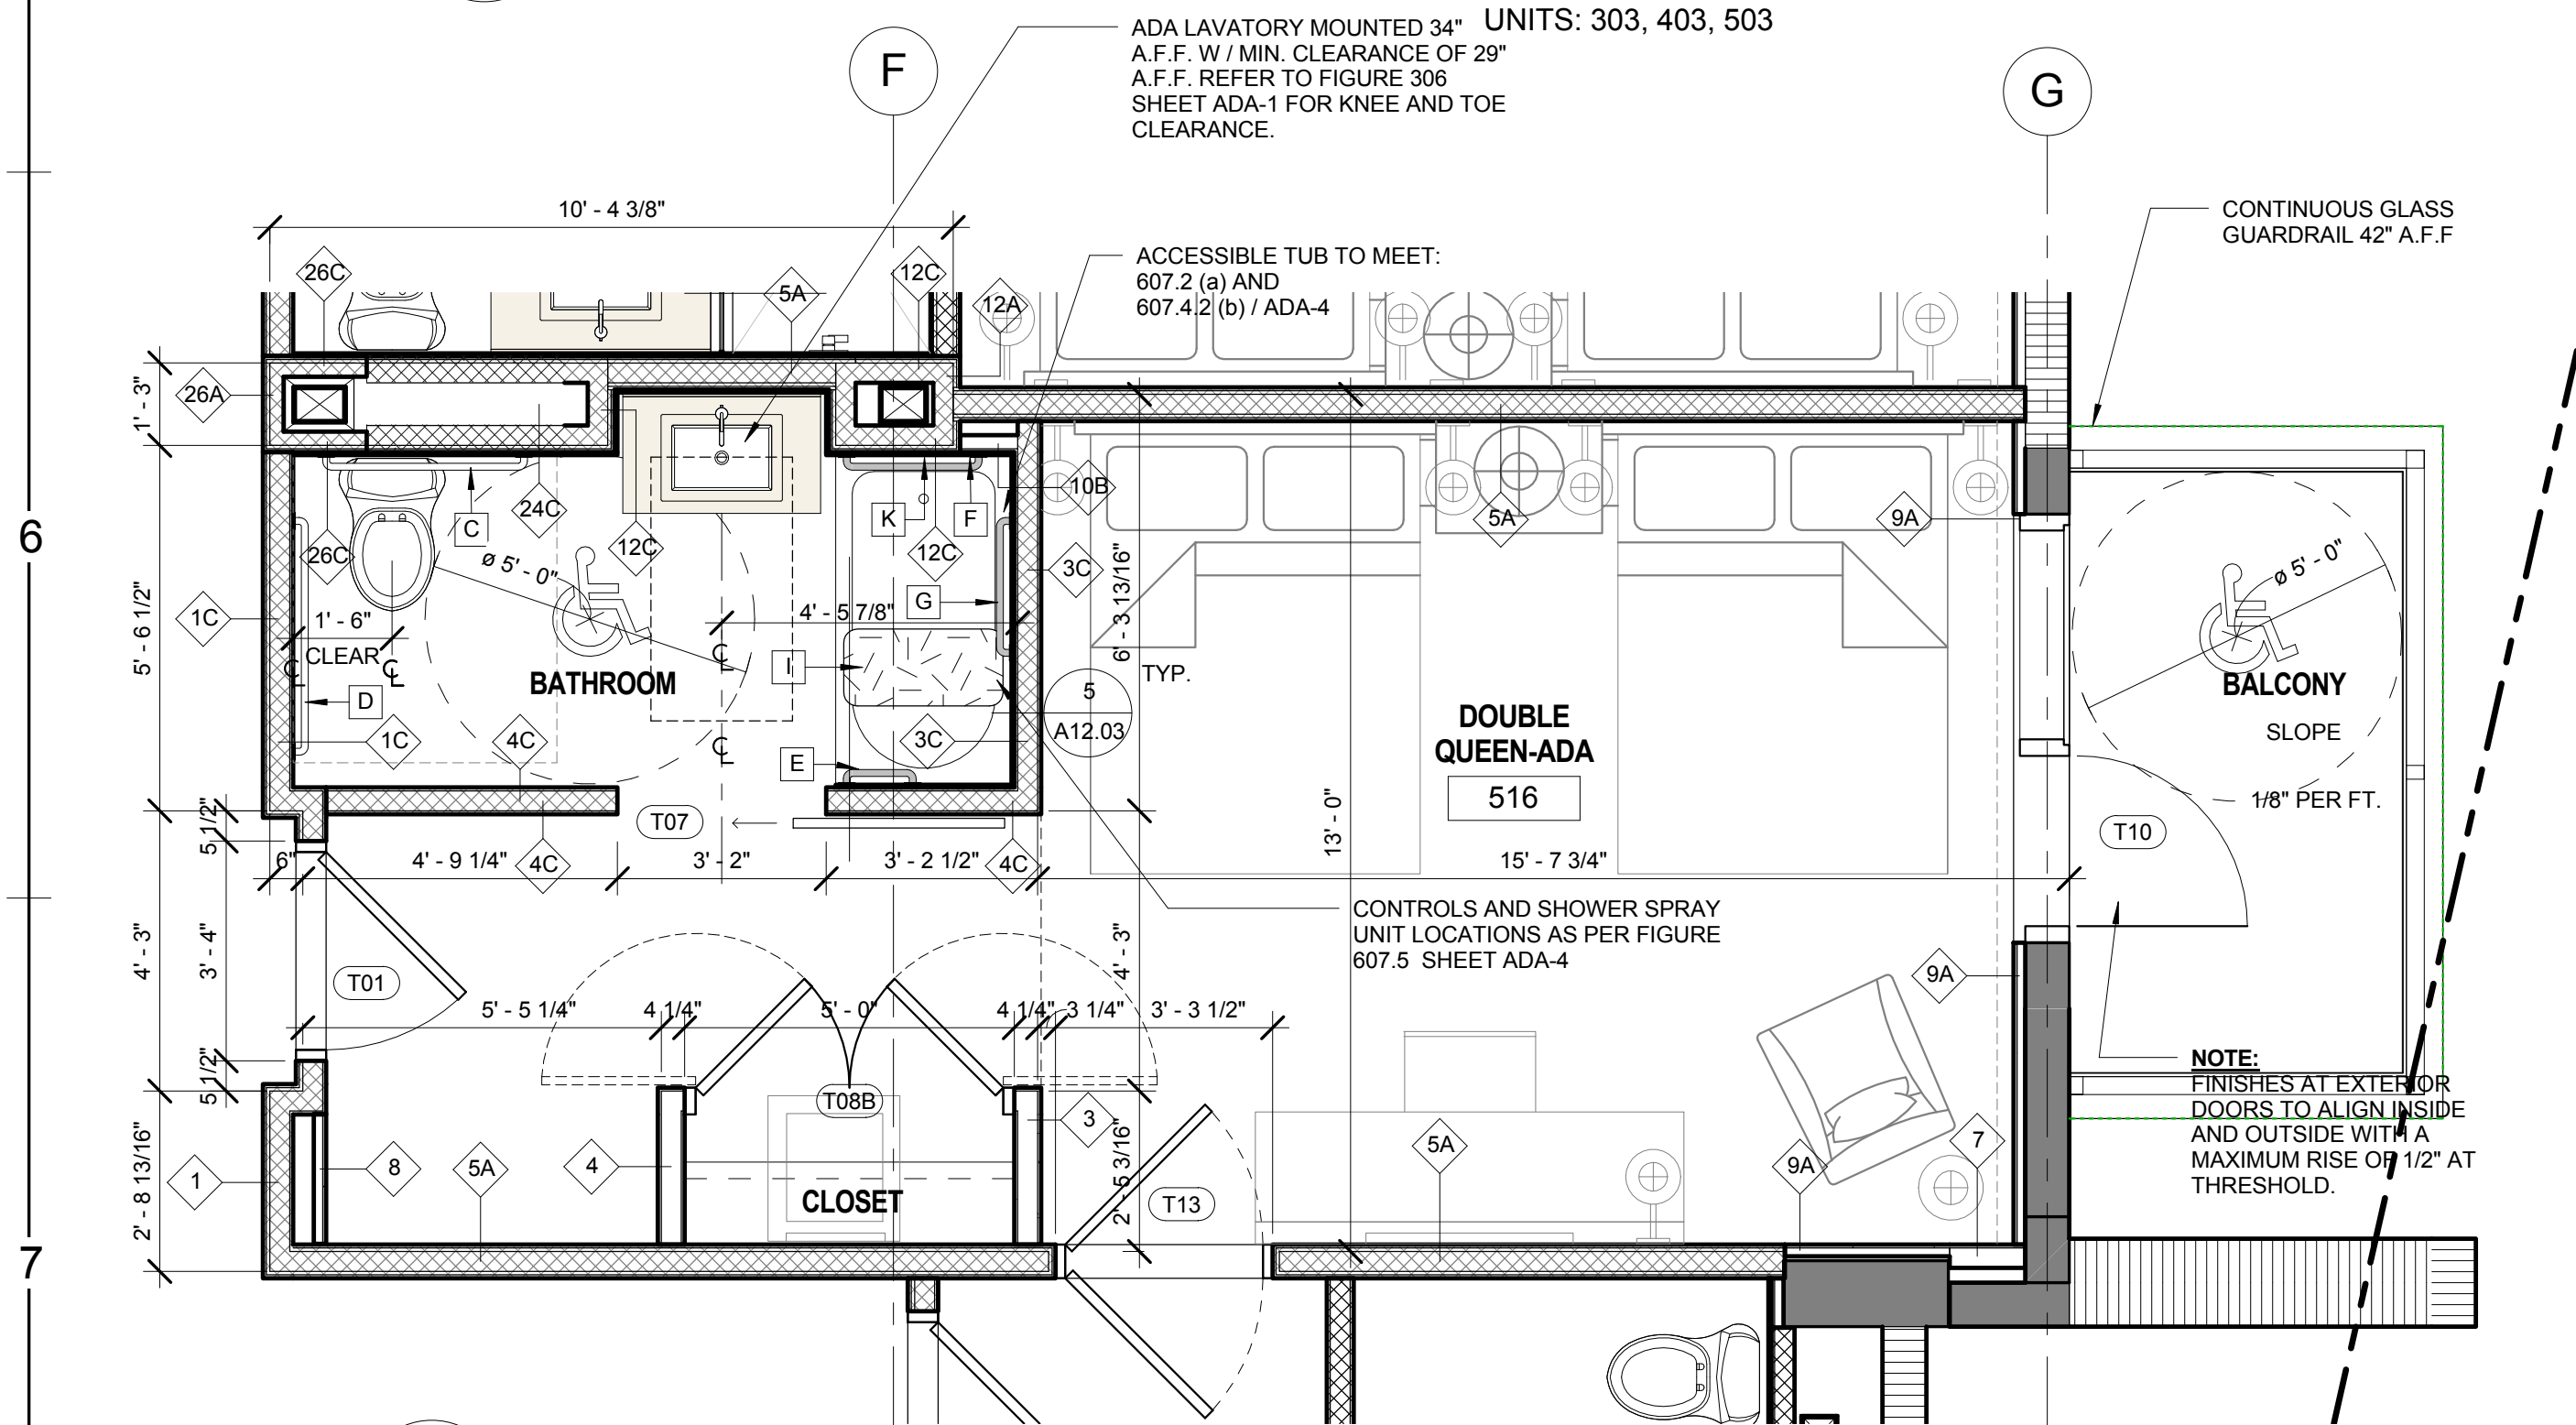

3 DOUBLE QUEEN - ADA WITH TUB
A5.04 3/8" = 1'-0"

UNITS: 516

ADA ACCESSORY LEGEND

- A** FOLD DOWN SHOWER SEAT, MOUNTED 18" TO TOP OF SEAT, (REFER TO FIGURE 36 SHEET ADA-2 FOR LAYOUT).
- B** SHOWER GRAB BAR 24" X 36", MOUNTED 34" A.F.F., TO TOP OF BAR.
- C** GRAB BAR, MOUNTED 34" A.F.F. TO TOP OF BAR, 36" LONG.
- D** GRAB BAR, MOUNTED 34" A.F.F. TO TOP OF BAR, 42" LONG.
- E** GRAB BAR, MOUNTED 34" A.F.F. TO TOP OF BAR, 12" LONG.
- F** GRAB BAR, MOUNTED 34" A.F.F. TO TOP OF BAR, 24" LONG.
- G** GRAB BAR, MOUNTED ONE DIRECTLY ABOVE THE OTHER - UPPER AT 34" A.F.F. AND LOWER AT 9". ABOVE TUB.
- H** EACH 24" LONG.
- I** SHOWER GRAB BAR 42" X 54", MOUNTED 34" A.F.F., TO TOP OF BAR.
- J** TUB SEAT
- K** PEEP HOLE MOUNTED 48" AND 60" A.F.F. (2 TOTAL)
- L** SHOWER CONTROLS
- M** GRAB BAR, MOUNTED 34" A.F.F. TO TOP OF BAR, 48" LONG.
- N** BABY CHANGING STATION 35.25" W X 20" H X 4" D (REFER TO I.D. DRAWINGS)
- O** PROVIDE ADA AUTOMATIC DOOR PUSH PLATE SWITCH MOUNTED 40" AFF. FULLY AUTOMATIC DOOR TO COMPLY WITH FAC 404.3

REVISED GRIDS, STRUCTURE AND DIMENSIONS - TYPICAL ALL GUESTROOMS

ACCESSIBLE GUESTROOM GENERAL NOTES


1. LAVATORY COUNTER TOP HEIGHT TO BE 34" A.F.F. WITH A MINIMUM CLEARANCE OF 29" A.F.F. TO BOTTOM OF APRON. LAVATORY TO HAVE SKIRT.
2. KNEE CLEARANCE UNDER SINKS SHALL BE AT LEAST 27" HIGH, 30" WIDE AND 19" DEEP.
3. FAUCETS TO BE LEVER-OPERATED, PUSH-TYPE OR ELECTRONICALLY CONTROLLED MECHANISMS.
4. SINK SHALL BE A MAXIMUM OF 6 1/2" DEEP.
5. TOP OF HANDICAP TOILET SEAT TO BE 17" TO 19" DEEP.
6. CLEARANCE OFF ALL GRAB BARS TO BE 1 1/2" DIAM. WITH 1 1/2" WALLS.
7. DOOR THRESHOLD NOT TO EXCEED 1/4".
8. CONTROLS FOR SHOWER TO BE LOCATED BETWEEN 38" AND 48" A.F.F. (SEE PLAN FOR LOCATION) AND SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING. ACTIVATE CONTROLS SHALL BE NO GREATER THAN 5 LB.
9. A SHOWER SPRAY UNIT WITH A HOSE AT LEAST 59" LONG, WHICH CAN BE USED BOTH AS A FIXED SHOWER HEAD AND AS A HAND HELD SHOWER, MUST BE PROVIDED IN ALL ACCESSIBLE GUESTROOMS. THE SHOWER SPRAY UNIT SHALL HAVE AN ON/OFF CONTROL WITH A NON- POSITIVE SHUT-OFF. IF AN ADJUSTABLE-HEIGHT SHOWER HEAD ON A VERTICAL BAR IS USED, THE BAR SHALL BE INSTALLED SO AS NOT TO OBSTRUCT THE USE OF GRAB BARS. SHOWER SPRAY UNITS DELIVER WATER THAT IS 120 DEG FAHRENHEIT (49 DEGREE CELSIUS) MAXIMUM. HAND - HELD SHOWER SPRAY UNITS MUST BE CAPABLE OF DELIVERING PRESSURE SUBSTANTIALLY EQUIVALENT TO FIXED SHOWER HEADS.
10. ACCESSIBLE SLEEPING ROOMS SHALL HAVE A 36" CLEAR WIDTH MANEUVERING SPACE LOCATED ALONG BOTH SIDES OF A BED, EXCEPT WHERE TWO BEDS ARE PROVIDED THIS REQUIREMENT CAN BE MET BY PROVIDING A 36" WIDE MANEUVERING SPACE LOCATED BETWEEN THE TWO BEDS.
11. ONE OF EACH TYPE OF STORAGE FACILITY IN HOTEL ROOMS SUCH AS DRAWERS, CLOSETS AND SHELVES SHALL BE ACCESSIBLE SHELVES MOUNTED 48" A.F.F. WIROD MOUNTED AT 46" A.F.F.
12. OUTLETS @ 15" TO CENTER LINE.
13. FLUSH CONTROL FOR TOILETS TO BE ON OPPOSITE SIDE OF GRAB BARS.
14. TYPICAL ACCESSIBLE UNIT'S FURNITURE:
DESK WITH KNEE CLEARANCE ACCESSIBLE ROUTE 36" BOTH SIDES OF BED. OPEN FRAME BED DOORS NOT OBSTRUCTED.
15. REFER TO REINFORCING BLOCKING DETAILS ON SHEET A12.23
16. HARDWARE FOR FIXED STORAGE FACILITIES SUCH AS CABINETS, SHELVES, CLOSETS AND DRAWERS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST; THE FORCE REQUIRED TO ACTIVATE CONTROLS SHALL BE NO GREATER THAN 5 LB.
17. DOOR HARDWARE:
HANDLES, PULLS LATCHES, LOCKS, AND OTHER OPERATING DEVICES ON ACCESSIBLE DOORS SHALL HAVE A SHAPE THAT IS EASY TO GRASP WITH ONE HAND AND DOES NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST TO OPERATE. LEVER MECHANISMS, PUSH MECHANISM, AND U-SHAPED HANDLES ARE ACCEPTABLE DESIGN. WHEN SLIDING DOORS ARE FULLY OPEN, OPERATING HARDWARE SHALL BE EXPOSED AND USABLE FROM BOTH SIDES. HARDWARE REQUIRED FOR ACCESSIBLE DOOR PASSAGE SHALL BE MOUNTED NO HIGHER THAN 48 INCHES A.F.F.
18. ADA SHOWER ENCLOSURES TO HAVE NO OBSTRUCTIONS TO CONTROLS OR TO TRANSFER FROM WHEELCHAIR INTO SHOWER SEAT.
19. IF DOOR HAS A CLOSER THEN THE SWEEP PERIOD OF THE CLOSER BE ADJUSTED SO THAT FROM AN OPEN POSITION OF DEGREES. THE DOOR WILL TAKE AT LEAST 3 SECONDS TO MOVE TO A POINT 3" FROM THE LATCH, MEASURED TO THE LEADING EDGE OF THE DOOR.
20. THE MAXIMUM FORCE FOR PUSHING OR PULLING OPEN A DOOR MUST BE AS FOLLOWS: EXTERIOR HINGED DOORS SHALL BE SO DESIGNED THAT SUCH DOORS CAN BE PUSHED OR PULLED OPEN WITH A FORCE NOT EXCEEDING 8.5 LB (37.8 N). INTERIOR HINGED DOOR: 5 LBF (22.2 N) SLIDING OR FOLDING DOOR: 5 LBF (22.2 N).
21. ANY WALK-THRU OPENING TO BE 32" CLEAR.
22. ANY DOUBLE DOOR TO HAVE AT LEAST ONE LEAF 3'-0" WIDE.
23. COMMUNICATION FEATURES:
GUESTROOMS WITH COMMUNICATIONS FEATURES TO COMPLY WITH FLORIDA ACCESSIBILITY CODE SECTION 806.3:

1. PROVIDE TELEPHONE INTERFACE JACKS THAT ARE COMPATIBLE WITH BOTH DIGITAL AND ANALOG SIGNAL USE. IF AN AUDIO HEADPHONE JACK IS PROVIDED ON A SPEAKER PHONE, A CUTOFF SWITCH CAN BE INCLUDED IN THE JACK SO THAT INSERTION OF THE JACK CUTS OFF THE SPEAKER. IF A TELEPHONE-LIKE HANDSET IS USED, THE EXTERNAL SPEAKERS CAN BE TURNED OFF WHEN THE HANDSET IS REMOVED FROM THE CRADLE. FOR HEADSET OR EXTERNAL AMPLIFICATION SYSTEM COMPATIBILITY, A STANDARD SUBMINIATURE JACK INSTALLED IN THE TELEPHONE WILL PROVIDE THE MOST FLEXIBILITY.

2. ALARMS SHALL COMPLY WITH SECTIONS 4.3 AND 4.4 OF NFPA 72 (1999 EDITION), OR SECTIONS 7.4 AND 7.5 OF NFPA 72 (2002 EDITION).

3. 806.3.2 NOTIFICATION DEVICES. VISIBLE NOTIFICATION DEVICES SHALL BE PROVIDED TO ALERT ROOM OCCUPANTS OF INCOMING TELEPHONE CALLS AND A DOOR KNOCK OR BELL. NOTIFICATION DEVICES SHALL NOT BE CONNECTED TO VISIBLE ALARM SIGNAL APPLIANCES. TELEPHONES SHALL HAVE VOLUME CONTROLS COMPATIBLE WITH THE TELEPHONE SYSTEM AND SHALL COMPLY WITH 704.3. TELEPHONES SHALL BE SERVED BY AN ELECTRICAL OUTLET COMPLYING WITH 309 LOCATED WITHIN 48 INCHES (1220MM) OF THE TELEPHONE TO FACILITATE THE USE OF

C:\Users\mhicario\Documents\12064-ANGLERS_HOTEL_mhicario.rvt
4/20/2016 4:29:23 PM

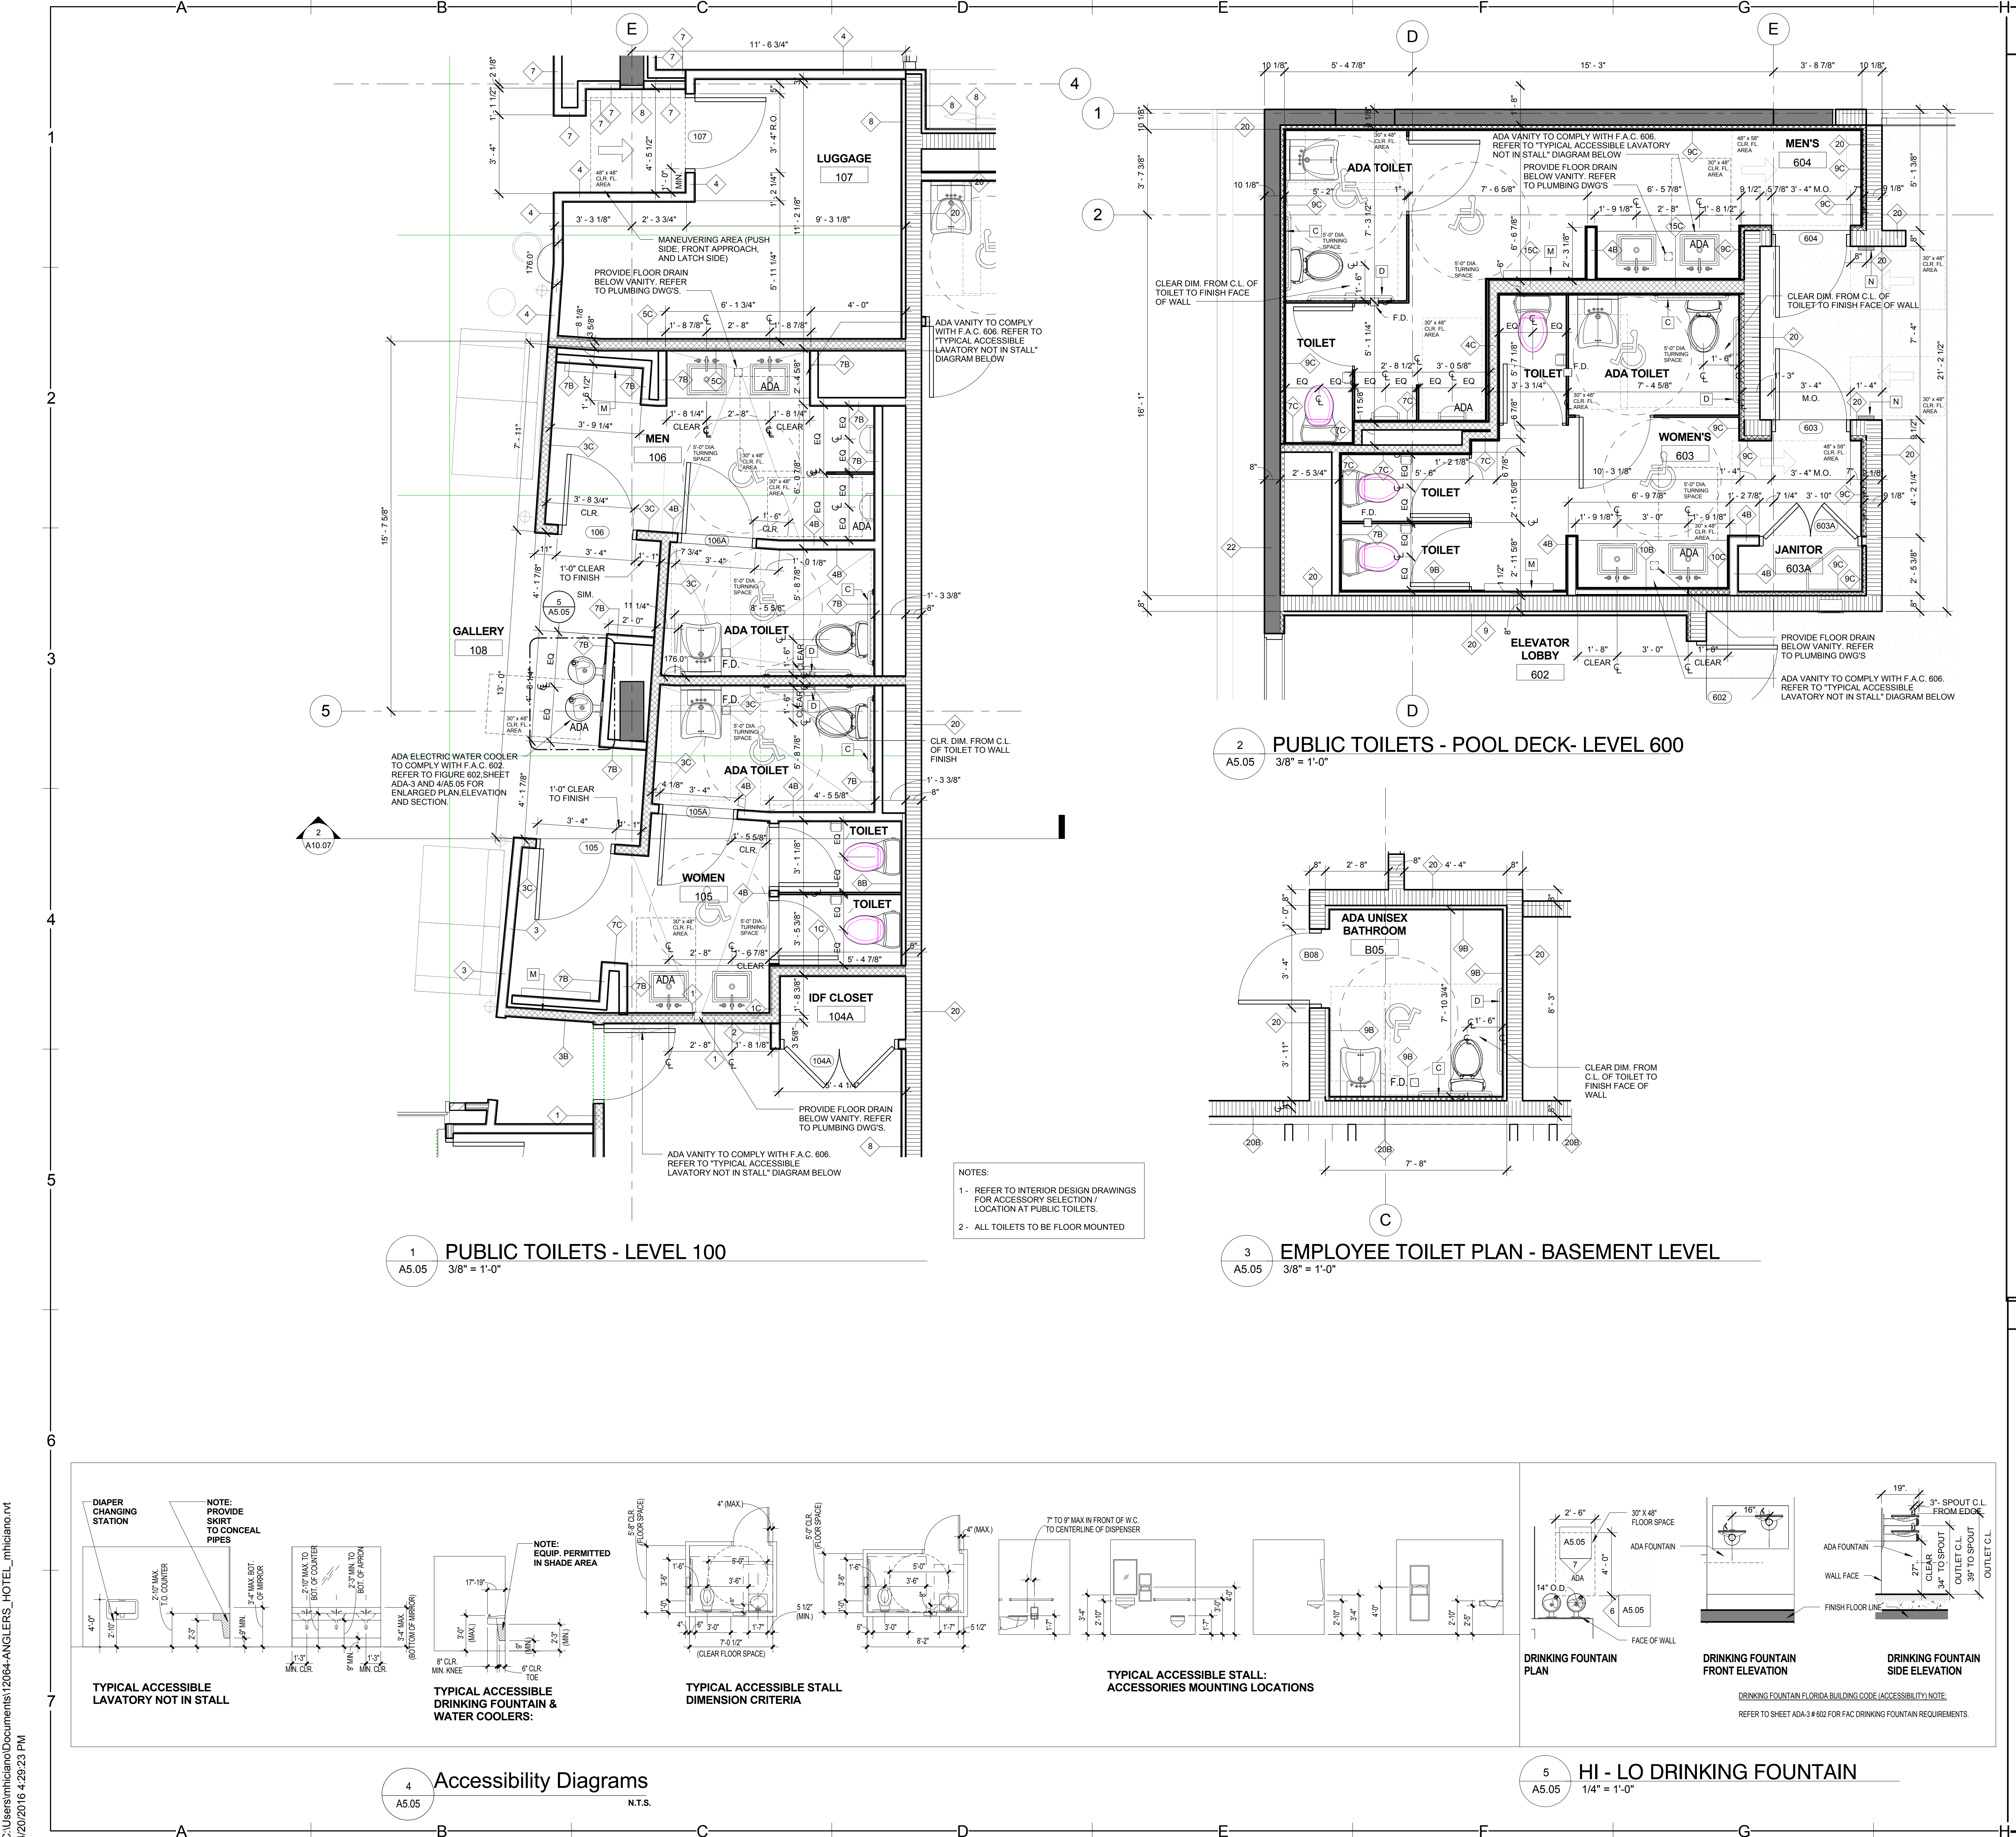


ACCESSIBLE RESTROOM GENERAL NOTES


1. LAVATORY COUNTERTOP HEIGHT TO BE 34" A.F.F. WITH A MINIMUM CLEARANCE OF 29" A.F.F. TO BOTTOM OF APRON. ALL LAVATORIES TO HAVE SKIRTS.
2. FAUCETS TO BE LEVER OPERATED, PUSH TYPE OR ELECTRONICALLY CONTROLLED MECHANISMS. IF SELF-CLOSING VALVES ARE USED THE FAUCET SHOULD REMAIN OPEN FOR AT LEAST 10 SECONDS.
3. HANDICAP URINAL TO HAVE RIM (ELONGATED TYPE) AT 17" A.F.F.
4. HANDICAP TOILET SEAT TO BE 17" TO 19" A.F.F.
5. ALL GRAB BARS TO BE 1 1/2" IN DIAMETER WITH 1 1/2" CLEARANCE FROM FINISH WALL.
6. ALL ACCESSIBLE TOILET STALL DOORS MUST HAVE A SELF-CLOSING FEATURE OR A PULL LATCH MOUNTED AT THE CENTER OF THE PARTITION DOOR.
7. WATER CLOSET AND URINAL FLUSH CONTROLS MUST BE 44" MAXIMUM ABOVE THE FINISHED FLOOR. CONTROLS SHALL BE HAND OPERATED OR AUTOMATIC CONTROLS MUST BE OPERABLE WITH ONE HAND AND MUST NOT REQUIRE TIGHT GRASPING, PINCHING OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE CONTROLS MUST BE NO GREATER THAN 5 LBF.
8. ACCESSIBLE TOILET AND BATHROOM MUST BE IDENTIFIED BY SHOWING INTERNATIONAL SYMBOL OF ACCESSIBILITY.
9. ALL ACCESSIBLE ACCESSORIES MUST BE MOUNTED WITH THE DISPENSING MECHANISM, START BUTTONS OR DISPENSER OPENINGS, NO MORE THAN 48" ABOVE FINISH FLOOR.
10. ACCESSIBLE WATER COOLER TO HAVE SPOUT HEIGHT AT 38" A.F.F. MAXIMUM WITH A MINIMUM KNEE CLEARANCE OF 27" A.F.F.
11. REFER TO REINFORCING BLOCKING DETAILS ON SHEET A-12. AREA TO RECEIVE REINFORCING IN STUD WALL PARTITION TO BE MINIMUM OF 20 GAGE.
12. FLUSH CONTROL FOR TOILETS TO BE OPPOSITE SIDE OF GRAB BAR.
13. CONTROL FOR SHOWERS TO BE LOCATED BETWEEN 38" AND 48" (SEE PLAN FOR LOCATION), AND SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE CONTROLS SHALL BE NO GREATER THAN 5 LBF.
14. DOOR HARDWARE: HANDLES, PULL LATCHES, LOCKS AND OTHER OPERATING DEVICES ON ACCESSIBLE DOORS SHALL HAVE A SHAPE THAT IS EASY TO GRASP WITH ONE HAND AND DOES NOT REQUIRE WRIST TO OPERATE. LEVER MECHANISMS, PUSH MECHANISMS AND U-SHAPED HANDLES ARE ACCEPTABLE DESIGN. WHEN SLIDING DOORS ARE FULLY OPEN, OPERATING HARDWARE SHALL BE EXPOSED AND USABLE FROM BOTH SIDES. HARDWARE REQUIRED FOR ACCESSIBLE DOOR PASSAGE SHALL BE MOUNTED NO HIGHER THAN 48" A.F.F.
15. ADA SHOWER ENCLOSURES TO HAVE NO OBSTRUCTIONS TO CONTROLS OR TO TRANSFER FROM WHEELCHAIR INTO SHOWER SEAT.
16. IF DOOR HAS A CLOSER, THEN THE SWEEP PERIOD OF THE CLOSER SHALL BE ADJUSTED SO THAT FROM AN OPEN POSITION OF 70 DEGREES THE DOOR WILL TAKE AT LEAST 3 SECONDS TO MOVE TO A POINT 3" FROM THE LATCH, MEASURED TO THE LEADING EDGE OF THE DOOR.
17. THE MAXIMUM FORCE FOR PUSHING OR PULLING OPEN A DOOR MUST BE AS FOLLOWS: EXTERIOR HINGED DOORS SHALL BE SO DESIGNED THAT SUCH DOORS CAN BE PUSHED OR PULLED OPEN WITH A FORCE NOT EXCEEDING 8.5 LBF (37.8 N). INTERIOR HINGED DOORS: 5 LBF (22.2 N). SLIDING OR FOLDING DOOR: 5 LBF (22.2 N).
18. ANY WALK-THRU OPENING MUST BE 32" CLEAR.
19. TOILET PAPER DISPENSERS SHALL COMPLY WITH FAC 309.4 AND SHALL BE 7 INCHES (180 MM) MINIMUM AND 9 INCHES (230 MM) MAXIMUM IN FRONT OF THE WATER CLOSET MEASURED TO THE CENTERLINE OF THE DISPENSER. THE OUTLET OF THE DISPENSER SHALL BE 15 INCHES (380 MM) MINIMUM AND 48 INCHES (1220 MM) MAXIMUM ABOVE THE FINISH FLOOR AND SHALL NOT BE LOCATED BEHIND GRAB BARS. DISPENSERS SHALL NOT BE OF A TYPE THAT CONTROLS DELIVERY OR THAT DOES NOT ALLOW CONTINUOUS PAPER FLOW.

ADA ACCESSORY LEGEND

- | # | Description | Date |
|---|--------------------------|----------|
| 1 | CMR Bldg. Dept. Comments | 12/16/14 |
| 2 | CMR Bldg. Dept. Comments | 01/15/15 |
| 3 | CMR Bldg. Dept. Comments | 03/25/15 |
| 5 | Revisions | 06-12-15 |
- A FOLD DOWN SHOWER SEAT, MOUNTED 18" TO TOP OF SEAT, (REFER TO FIGURE 36 SHEET ADA-2 FOR LAYOUT).
 - B SHOWER GRAB BAR 24" X 36", MOUNTED 34" A.F.F., TO TOP OF BAR.
 - C GRAB BAR, MOUNTED 34" A.F.F. TO TOP OF BAR, 36" LONG.
 - D GRAB BAR, MOUNTED 34" A.F.F. TO TOP OF BAR, 42" LONG.
 - E GRAB BAR, MOUNTED 34" A.F.F. TO TOP OF BAR, 12" LONG.
 - F GRAB BAR, MOUNTED 34" A.F.F. TO TOP OF BAR, 24" LONG.
 - G GRAB BAR, MOUNTED ONE DIRECTLY ABOVE THE OTHER - UPPER AT 34" A.F.F. AND LOWER AT 9". ABOVE TUB, EACH 24" LONG.
 - H SHOWER GRAB BAR 42" X 54", MOUNTED 34" A.F.F., TO TOP OF BAR.
 - I TUB SEAT
 - J PEEP HOLE MOUNTED 48" AND 60" A.F.F. (2 TOTAL)
 - K SHOWER CONTROLS
 - L GRAB BAR, MOUNTED 34" A.F.F. TO TOP OF BAR, 48" LONG.
 - M BABY CHANGING STATION 35.25"W X 20"H X 4" D (REFER TO I.D. DRAWINGS)
 - N PROVIDE ADA AUTOMATIC DOOR PUSH PLATE SWITCH MOUNTED 40" AFF. FULLY AUTOMATIC DOOR TO COMPLY WITH FAC 404.3

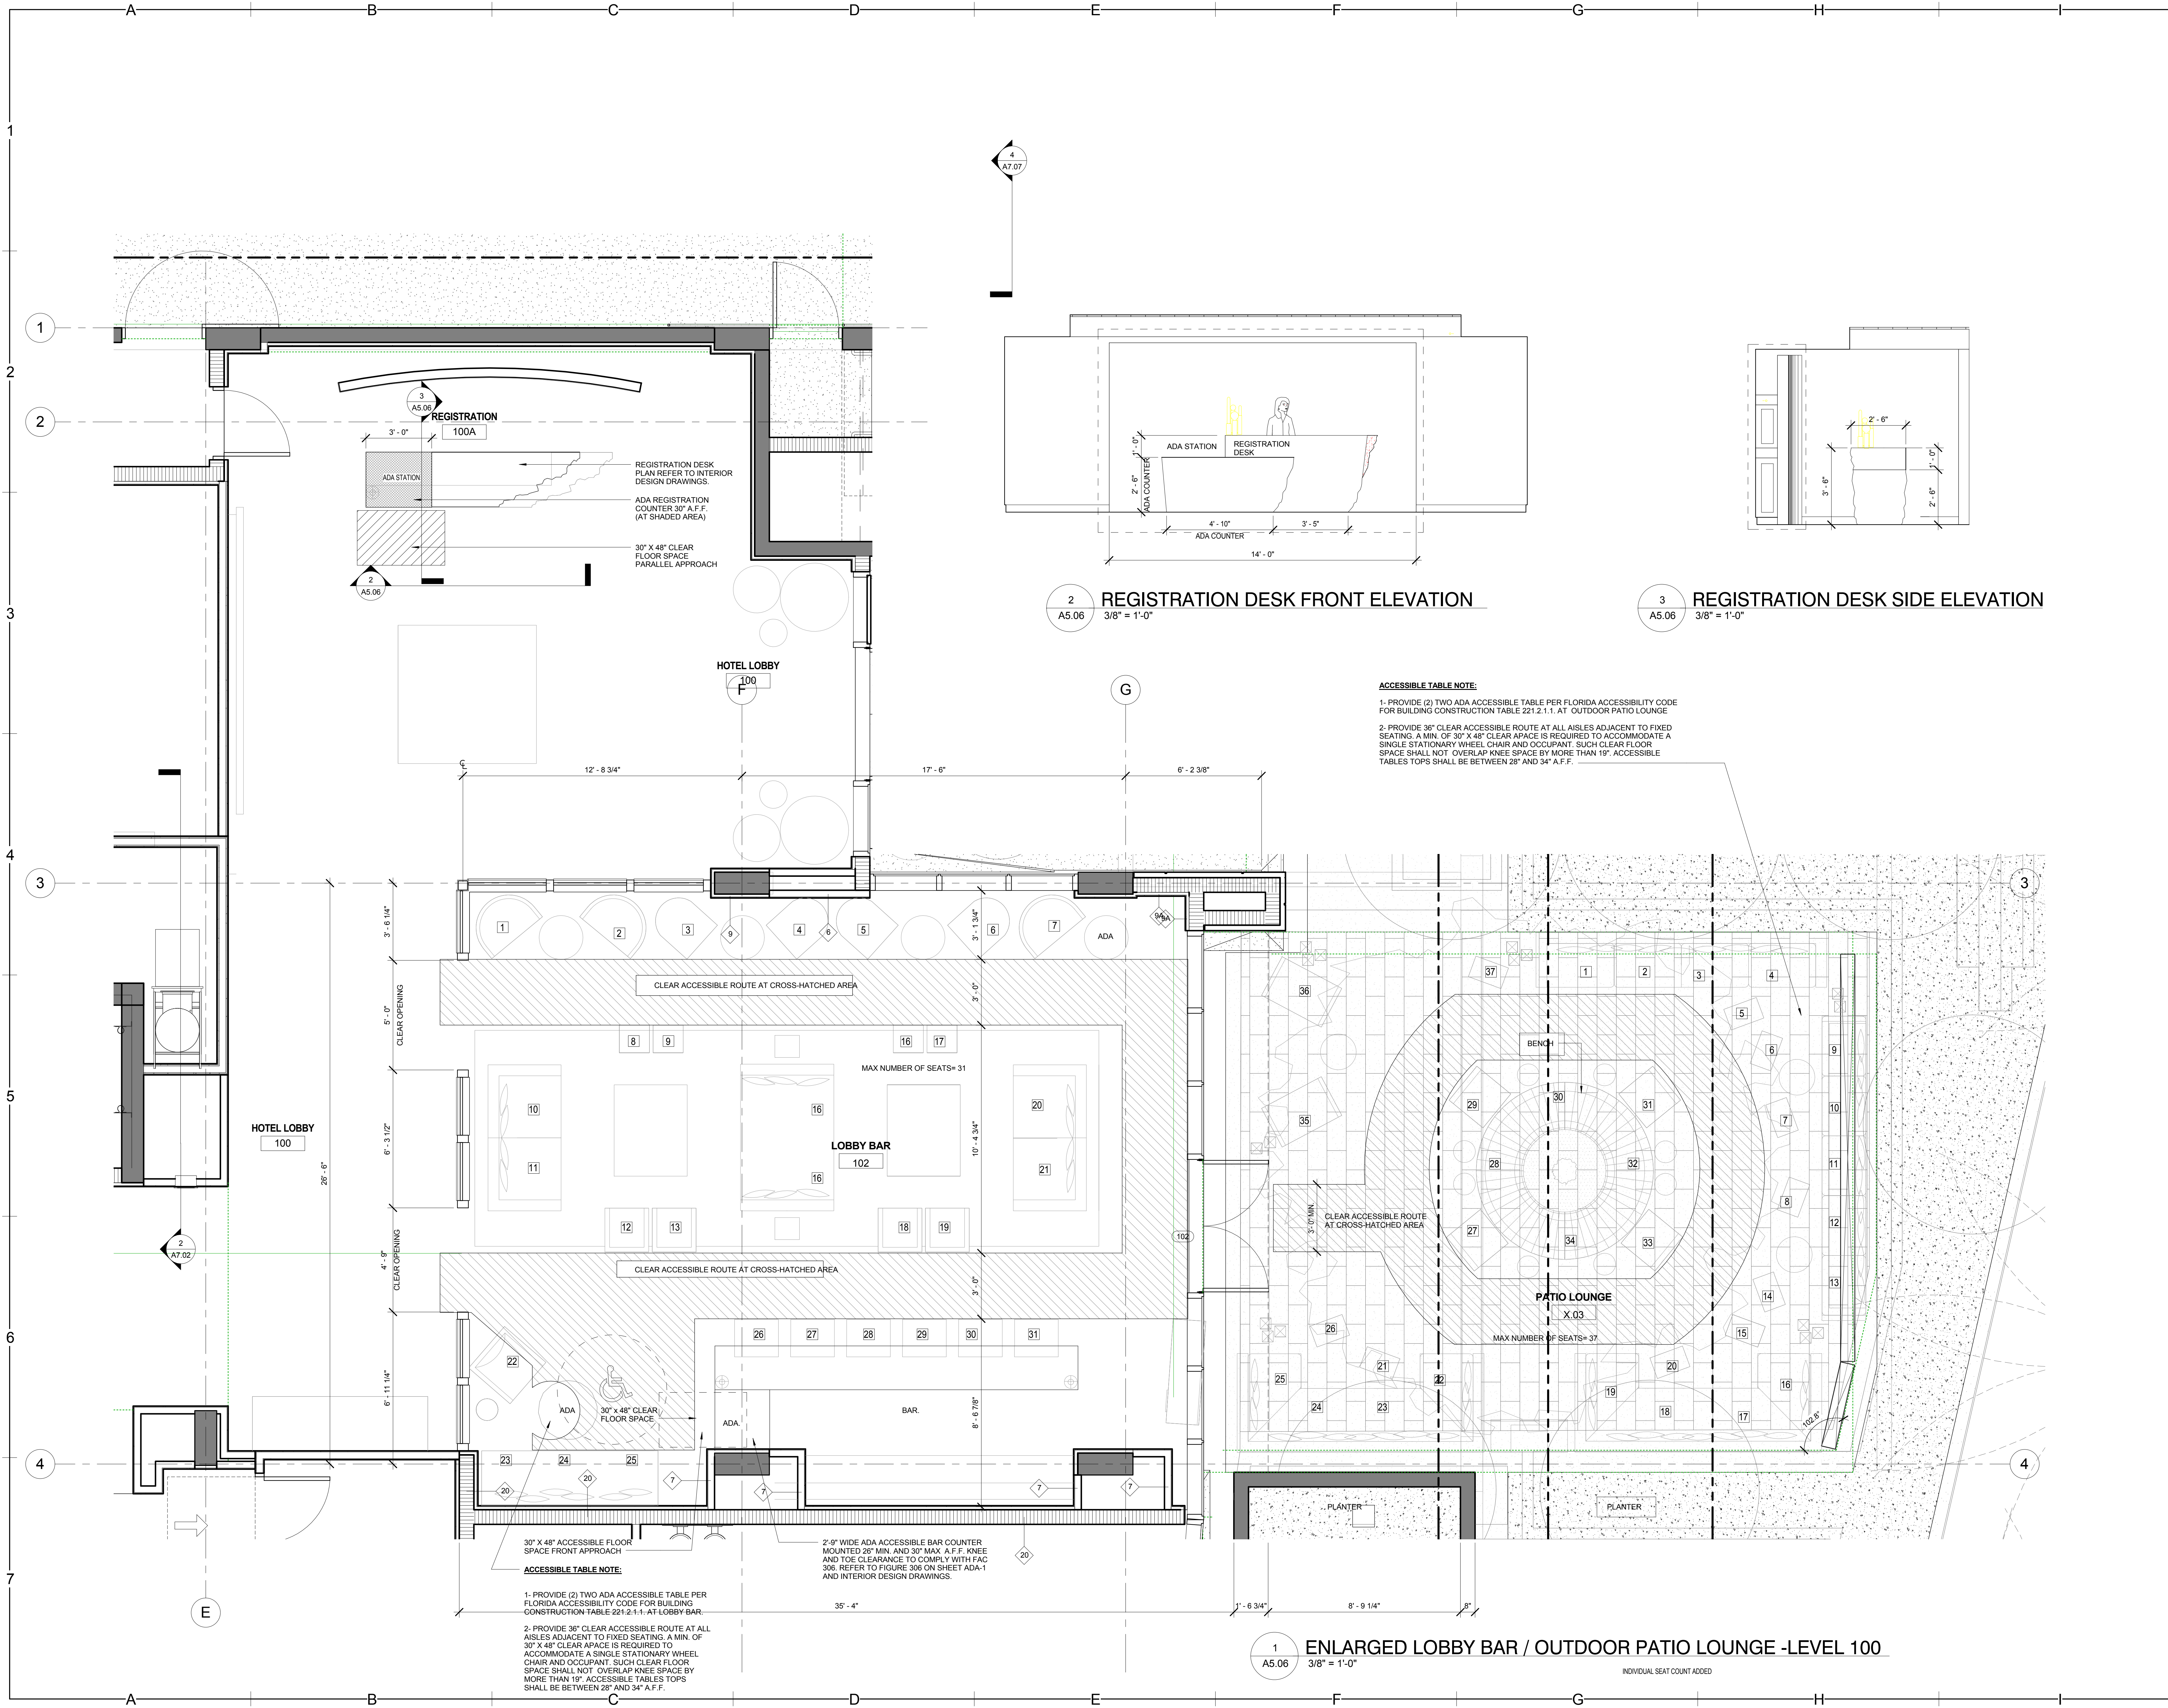

C:\Users\mhiciano\Documents\12064-ANGLERS-HOTEL_mhiciano.rvt
4/20/2016 4:29:37 PM

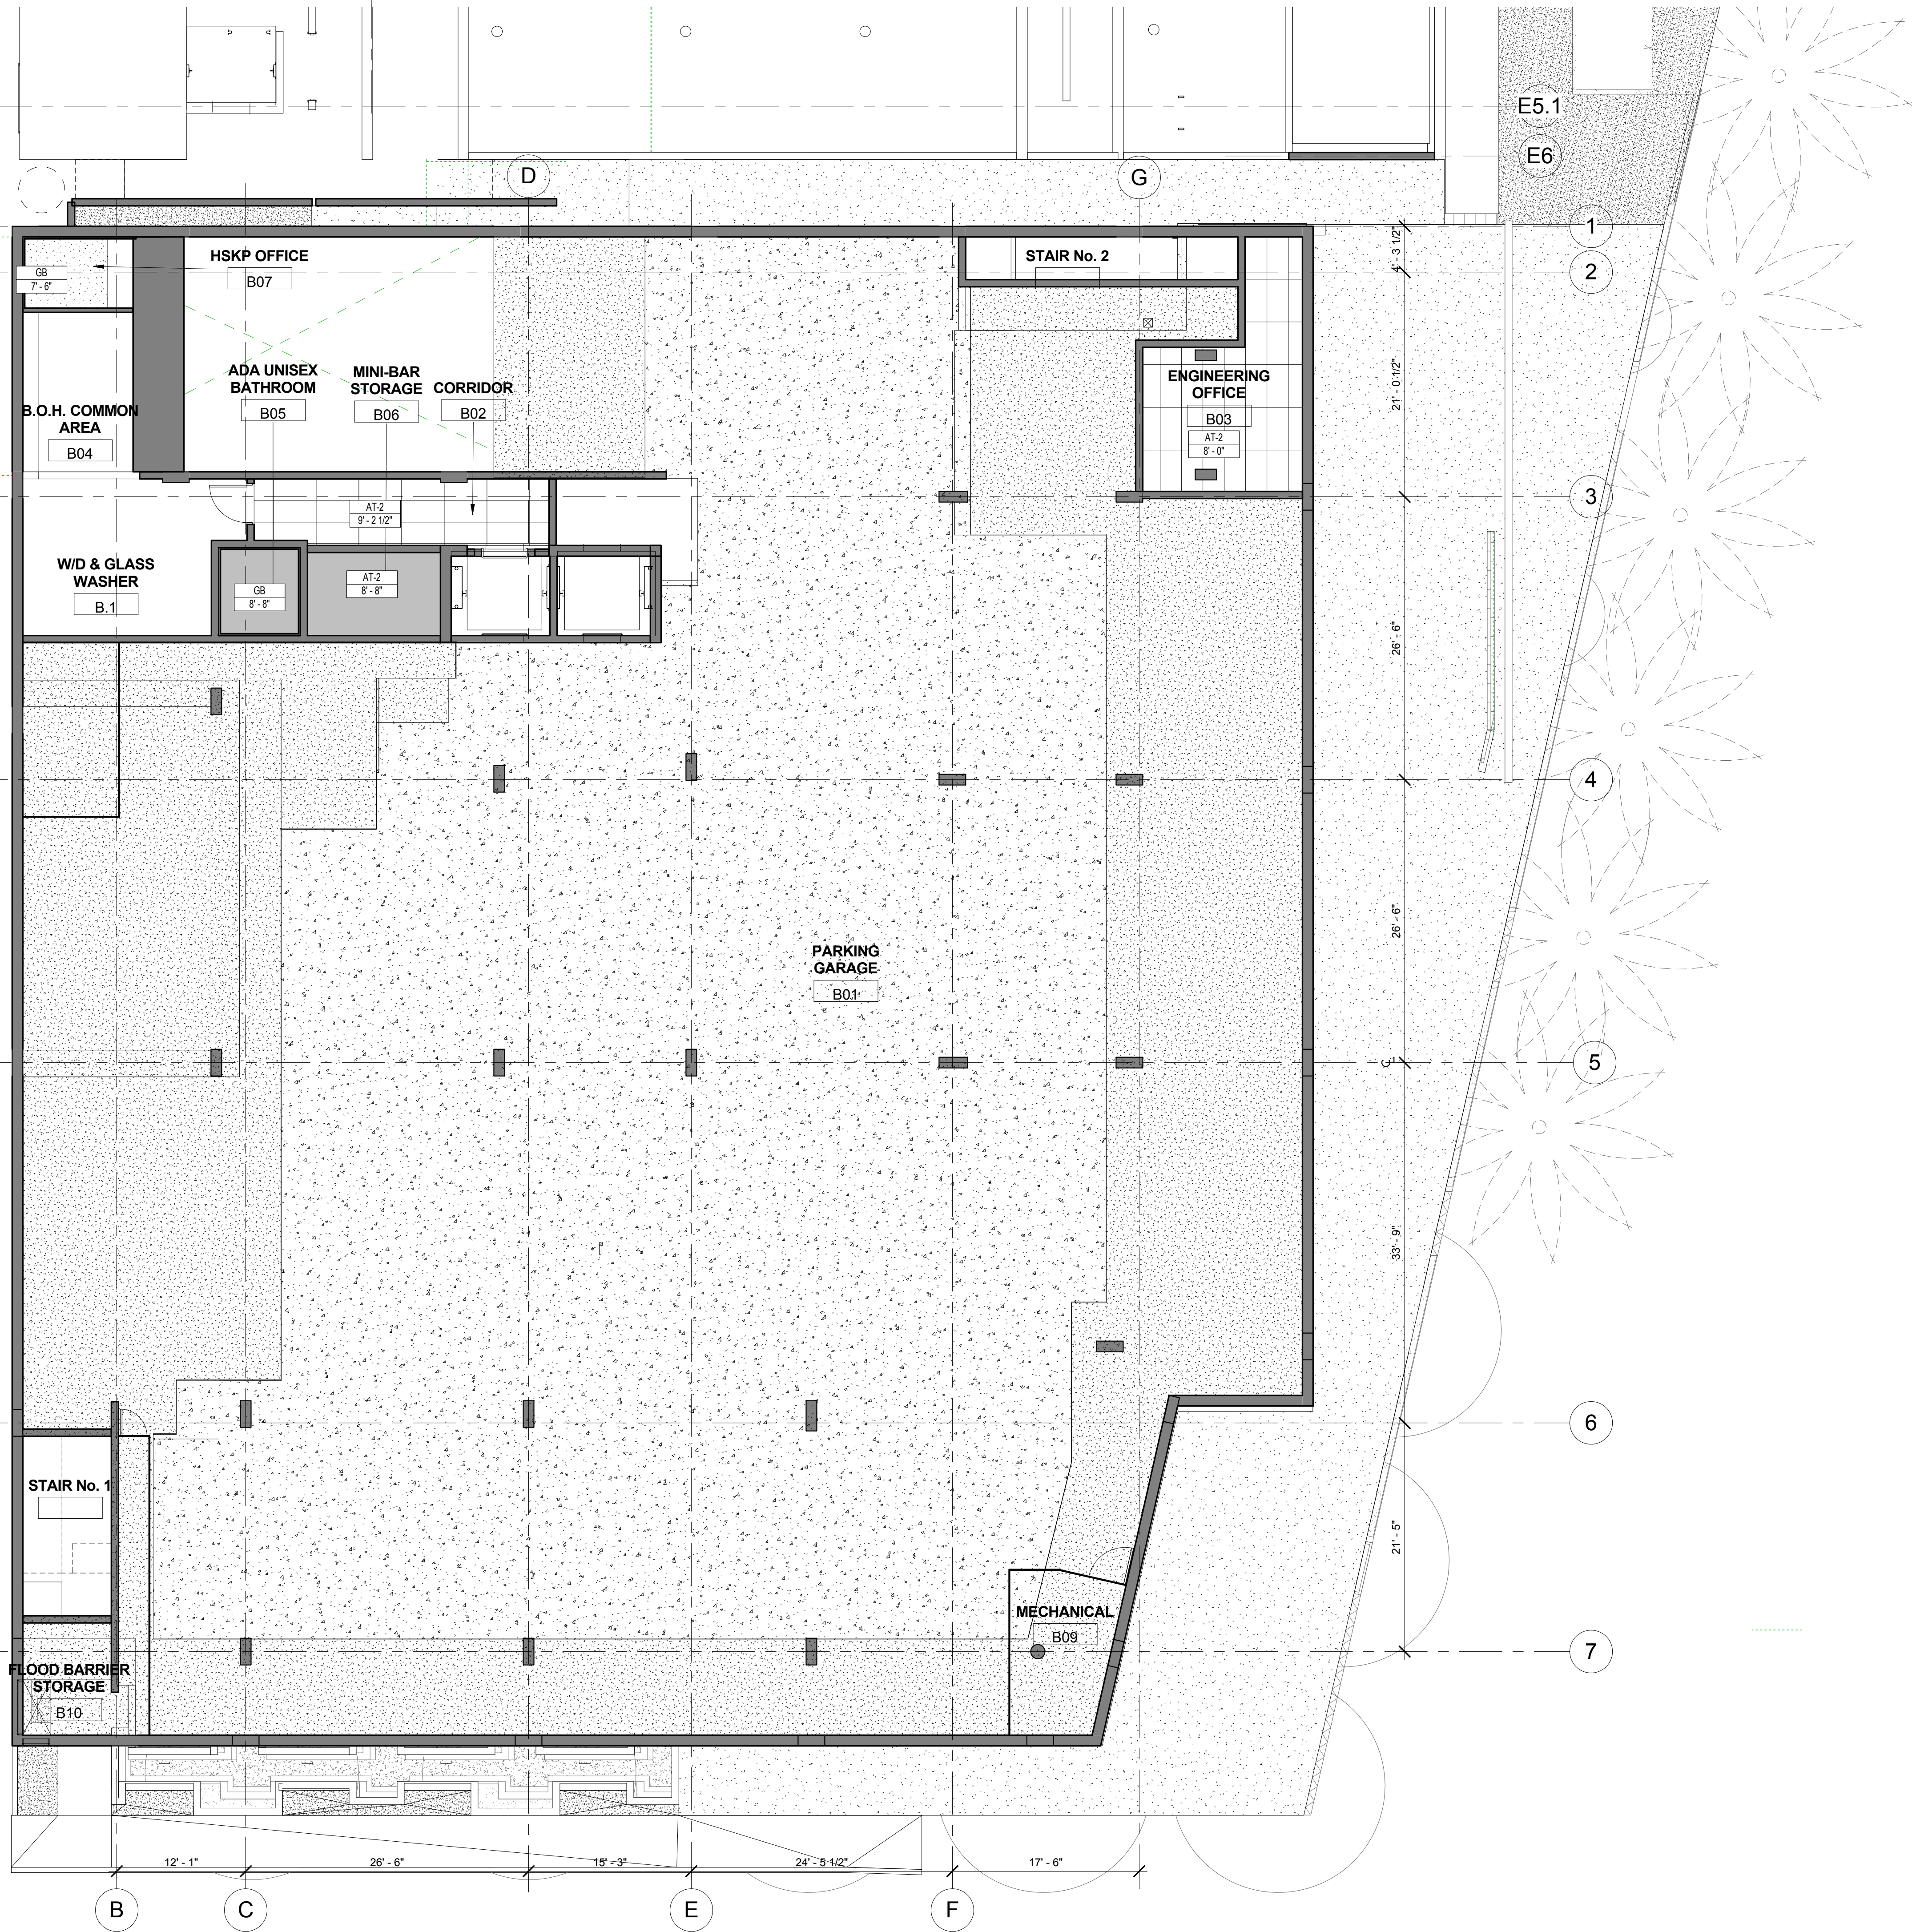

1 BASEMENT REFLECTED CEILING PLAN
A6.00 1/8" = 1'-0"

Permit Issue
10-13-14


REVISIONS

#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
5	Revisions	06-12-15

12064

A6.00

C:\Users\mhiciano\Documents\12064-ANGLERS-HOTEL_mhiciano.rvt
4/20/2016 4:29:45 PM

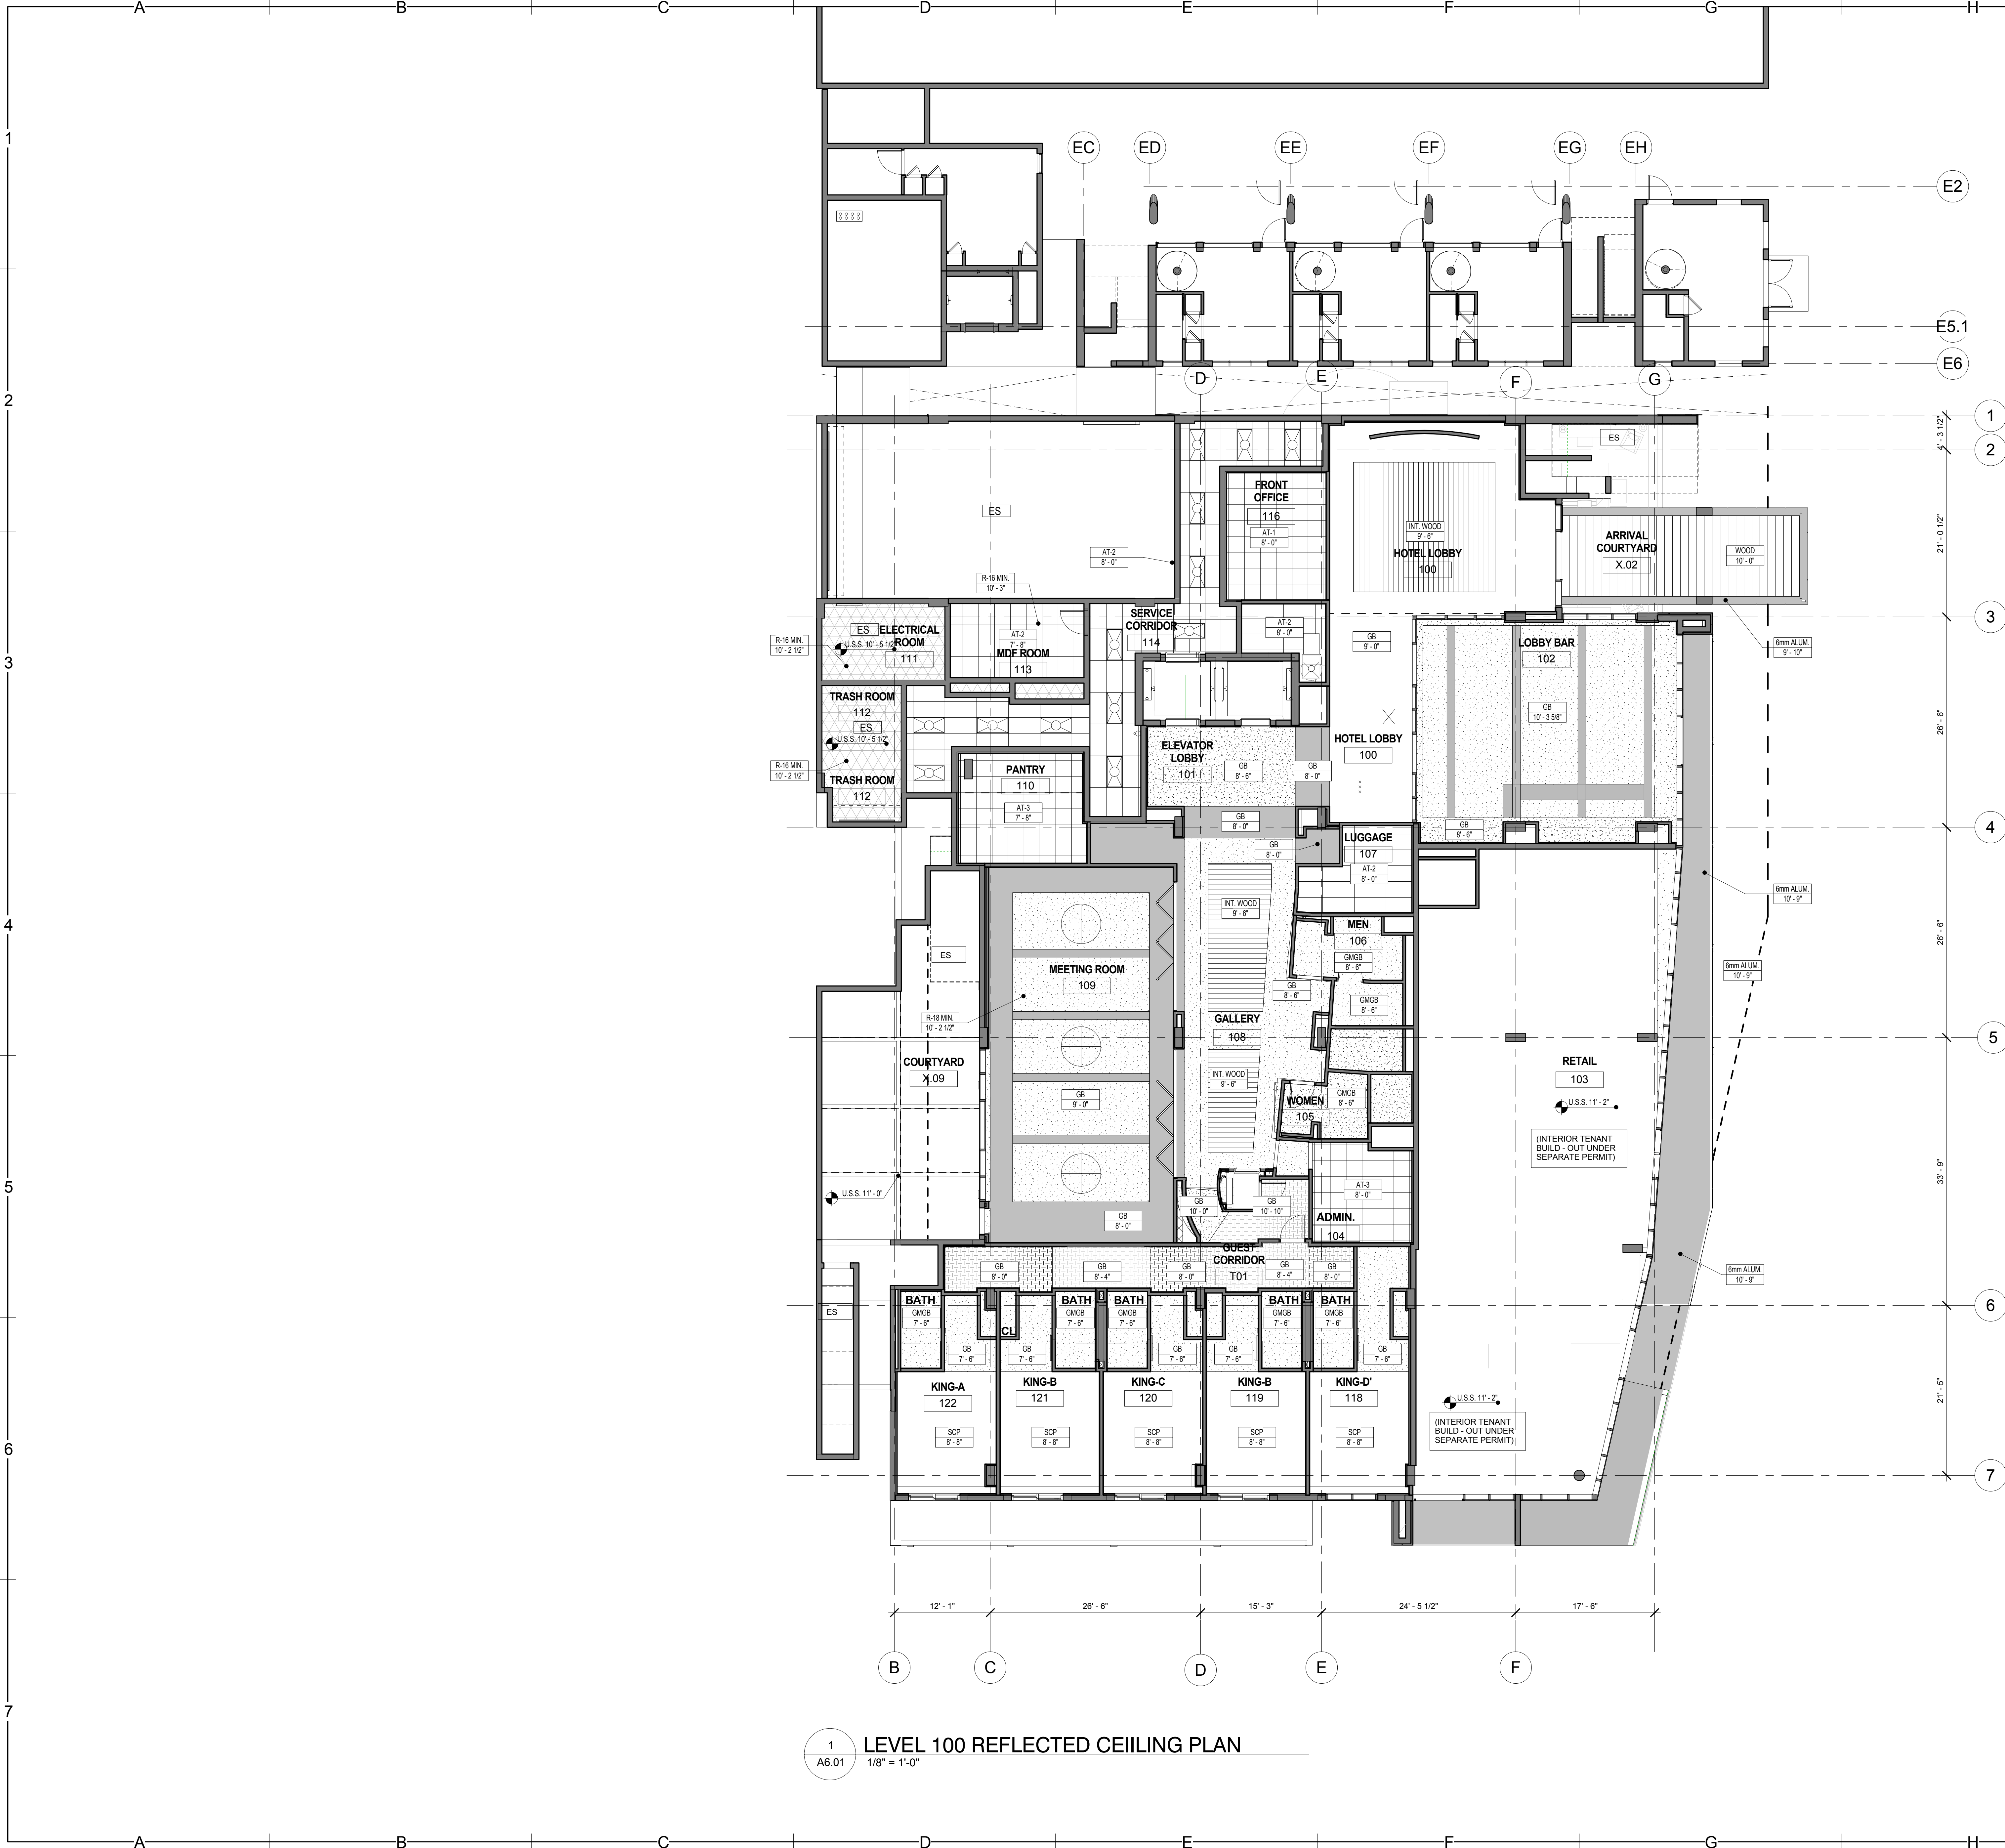

1
A6.01
LEVEL 100 REFLECTED CEILING PLAN
1/8" = 1'-0"

REFLECTED CEILING PLAN, SYMBOLS, AND NOTES

XXX	CEILING MATERIAL
X' - X"	CEILING HEIGHT ABOVE FINISH FLOOR

- PENDANT LIGHT
- WP RECESSED DOWNLIGHT (WP WHEN WATERPROOF)
- WALL SCONCE
- SURFACE MOUNTED FIXTURE
- CEILING MOUNTED EXIT LIGHT
- WALL MOUNTED EXIT LIGHT
- SD SMOKE DETECTOR
- AUDIBLE / VISIBLE SPEAKER
- ACCESS PANEL
- CEILING MOUNT A/C SUPPLY GRILL
- CEILING MOUNT A/C RETURN GRILL
- LINEAR DIFFUSER
- SEMI-RECESSED FIRE SPRINKLER HEAD
- FIRE SPRINKLER HEAD
- WALL MOUNTED FIRE SPRINKLER HEAD

- AT-1 ACOUSTICAL CEILING TILE (2X2)
- AT-2 ACOUSTICAL CEILING TILE (2X4)
- AT-3 ACOUSTICAL CEILING TILE (2X4) - DAMAGE RESISTANT

ES EXPOSED STRUCTURE

GB GYPSUM WALL BOARD

GMGB GLASS-MAT GYPSUM WALLBOARD

SPRAYED-ON INSULATION

2x2' RECESSED FLUORESCENT LIGHT FIXTURE

2x4' RECESSED FLUORESCENT LIGHT FIXTURE

2x2' SURFACE MOUNTED FLUORESCENT LIGHT FIXTURE

2x4' SURFACE MOUNTED FLUORESCENT LIGHT FIXTURE

WALL MOUNTED FLUORESCENT LIGHT FIXTURE

EMERGENCY LIGHTING LIGHT FIXTURE (SEE ELECTRICAL DRAWINGS)

REFLECTED CEILING NOTES:

- G.C. TO COORDINATE ARCHITECTURAL, MECHANICAL, ELECTRICAL, LIGHTING, AND FIRE PROTECTION INSTALLATIONS.
- SEE LIGHTING AND ELECTRICAL DRAWINGS FOR FIXTURE TYPES & SCHEDULE.
- ALL CEILING HEIGHTS ARE FROM THE TOP OF THE FINISH FLOOR.
- SUSPENDED ACOUSTICAL CEILING TILE & GRID SYSTEM IS NOT DESIGNED OR INTENDED TO SUPPORT THE WEIGHT OF ADDITIONAL EQUIPMENT, CABLE, CONDUIT, MECHANICAL EQUIPMENT OR OTHER CONSTRUCTION. ALL SUCH ELEMENTS ARE TO BE INDEPENDENTLY SUPPORTED FROM THE BUILDING STRUCTURE BY AT LEAST TWO OPPOSITE CORNERS.
- ALL LIGHTS NOT DIMENSIONED SHALL BE CENTERED OR PLACED EQUALLY WITHIN THE CEILING SPACE. FINAL PLACEMENT OF FIXTURES SHALL BE APPROVED BY ARCHITECT & INTERIOR DESIGNER PRIOR TO WIRING FIXTURES. CONTRACTOR SHALL MAKE MINOR ADJUSTMENTS TO LAYOUT WITHOUT ANY ADDITIONAL COST TO THE CONTRACT.
- HEAVY OR LARGE DECORATIVE LIGHT FIXTURES EXCEEDING 15-20 LBS. REQUIRE ATTACHMENT DETAILS WHICH EXCEED CONVENTIONAL METHODS FOR ATTACHING J-BOXES TO CEILING FRAMING. THEY SHALL BE SUSPENDED FROM STRUCTURAL SLAB FROM AN ENGINEERED METAL FRAMING SYSTEM.
- SEE MEP DRAWINGS FOR EXACT LOCATION AND SPECIFICATIONS OF FIRE ALARM, FIRE SPRINKLER & MECHANICAL SYSTEMS.

NOTE:
FOR PUBLIC AREA REFLECTED CEILING
ELEVATIONS, DIMENSIONS, LIGHT FIXTURES, ETC.
SEE INTERIOR DESIGN AND LIGHTING DRAWINGS.

ALL GUESTROOM BATH DROPPED CEILINGS
THROUGHOUT, INCLUDING SHOWERS, TO HAVE 5/8"
GLASS-MAT GYPSUM BOARD (MEETING ASTM
C1178) ON 1 5/8" GALV. MTL. STUD FRAMING AT 16"
O.C.

ALL EXPOSED CONCRETE CEILINGS TO RECEIVE
SKIM COAT PLASTER - PAINTED.

ALL DROPPED GYPSUM WALLBOARD CEILINGS
(OTHER THAN BATHROOM CEILINGS) TO BE 5/8"
GYPSUM WALLBOARD ON 1 5/8" GALV. MTL. STUD
FRAMING.

Permit Issue
10-13-14


REVISIONS

#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/13/15
3	Revisions	06-12-15

12064

A6.01

C:\Users\mhiciano\Documents\12064-ANGLERS_HOTEL_mhiciano.rvt
4/20/2016 4:29:51 PM

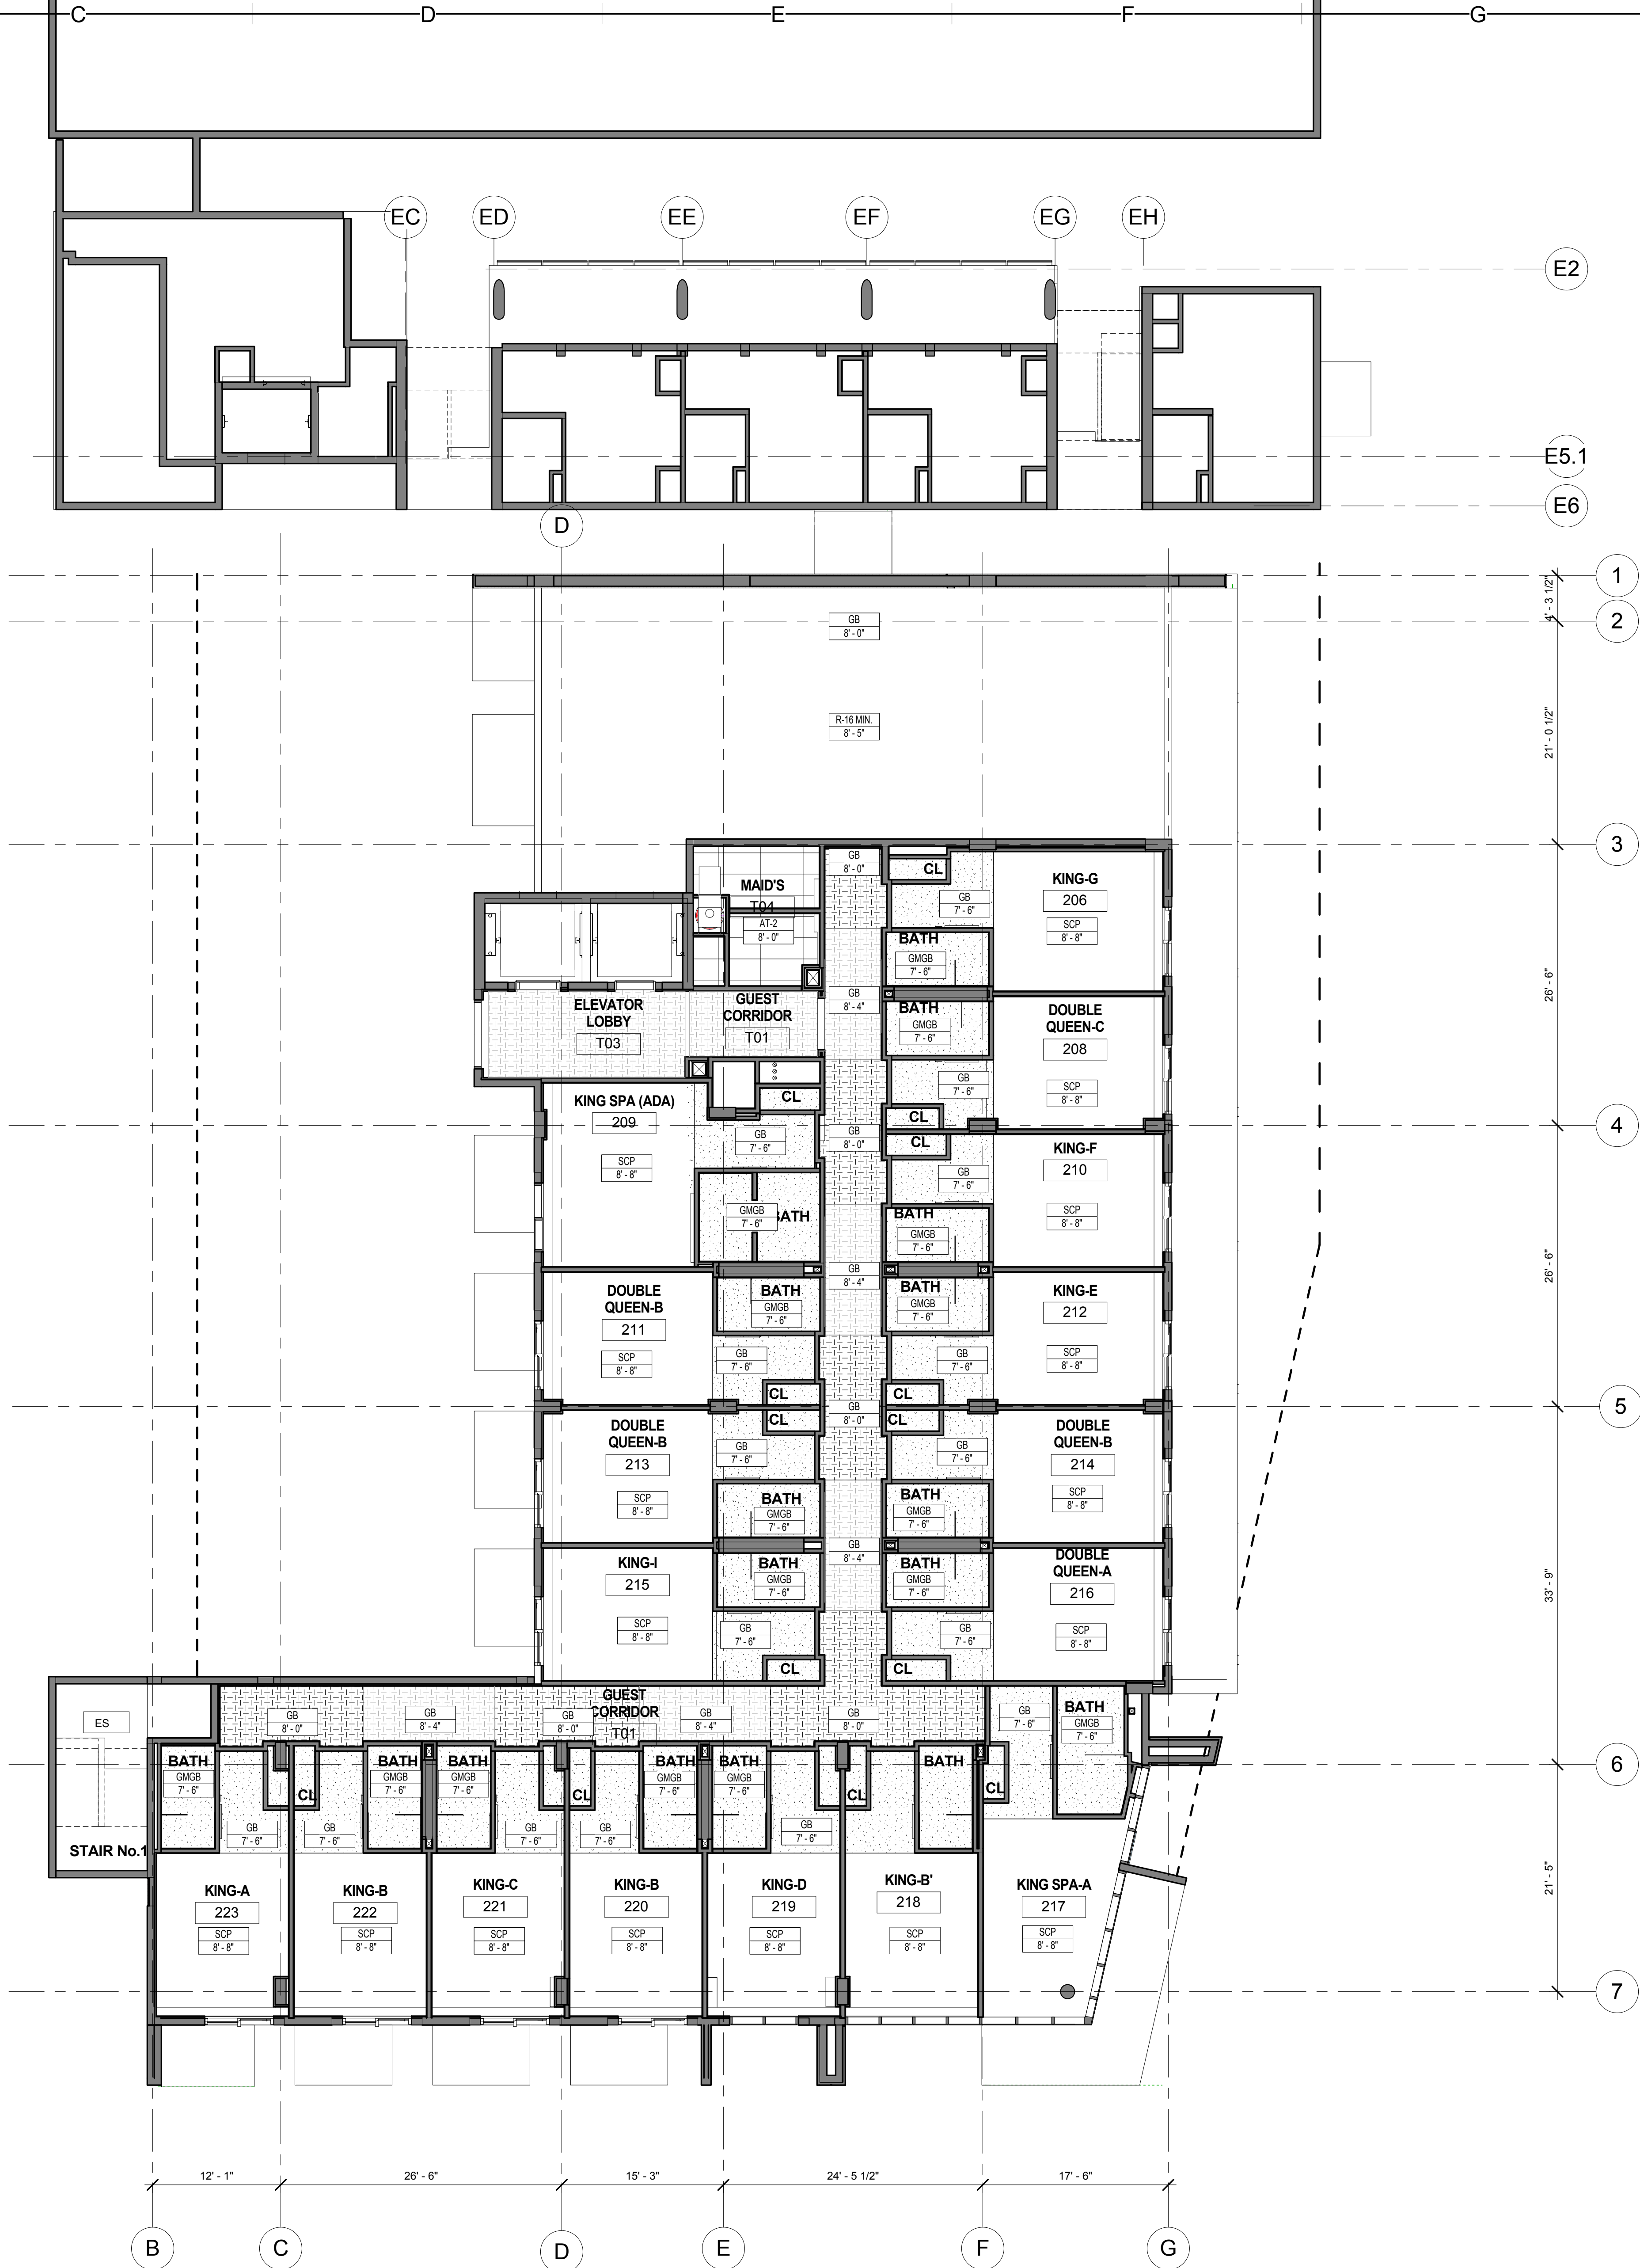

1
A6.02
LEVEL 200 REFLECTED CEILING PLAN
1/8" = 1'-0"

REFLECTED CEILING PLAN, SYMBOLS, AND NOTES

XXX	CEILING MATERIAL
X' - X"	CEILING HEIGHT ABOVE FINISH FLOOR

- PENDANT LIGHT
- WP RECESSED DOWNLIGHT (WP WHEN WATERPROOF)
- WALL SCONCE
- SURFACE MOUNTED FIXTURE
- CEILING MOUNTED EXIT LIGHT
- WALL MOUNTED EXIT LIGHT
- SD SMOKE DETECTOR
- AUDIBLE / VISIBLE SPEAKER
- ACCESS PANEL
- CEILING MOUNT A/C SUPPLY GRILL
- CEILING MOUNT A/C RETURN GRILL
- LINEAR DIFFUSER
- SEMI-RECESSED FIRE SPRINKLER HEAD
- FIRE SPRINKLER HEAD
- WALL MOUNTED FIRE SPRINKLER HEAD

- AT-1 ACOUSTICAL CEILING TILE (2X2)
- AT-2 ACOUSTICAL CEILING TILE (2X4)
- AT-3 ACOUSTICAL CEILING TILE (2X4) - DAMAGE RESISTANT

ES EXPOSED STRUCTURE

GB GYPSUM WALL BOARD

GMGB GLASS-MAT GYPSUM WALLBOARD

SPRAYED-ON INSULATION

- 2x2' RECESSED FLUORESCENT LIGHT FIXTURE
- 2x4' RECESSED FLUORESCENT LIGHT FIXTURE
- 2x2' SURFACE MOUNTED FLUORESCENT LIGHT FIXTURE
- 2x4' SURFACE MOUNTED FLUORESCENT LIGHT FIXTURE
- WALL MOUNTED FLUORESCENT LIGHT FIXTURE
- EMERGENCY LIGHTING LIGHT FIXTURE (SEE ELECTRICAL DRAWINGS)

REFLECTED CEILING NOTES:

- G.C. TO COORDINATE ARCHITECTURAL, MECHANICAL, ELECTRICAL, LIGHTING, AND FIRE PROTECTION INSTALLATIONS.
- SEE LIGHTING AND ELECTRICAL DRAWINGS FOR FIXTURE TYPES & SCHEDULE.
- ALL CEILING HEIGHTS ARE FROM THE TOP OF THE FINISH FLOOR.
- SUSPENDED ACOUSTICAL CEILING TILE & GRID SYSTEM IS NOT DESIGNED OR INTENDED TO SUPPORT THE WEIGHT OF ADDITIONAL EQUIPMENT, CABLE, CONDUIT, MECHANICAL EQUIPMENT OR OTHER CONSTRUCTION. ALL SUCH ELEMENTS ARE TO BE INDEPENDENTLY SUPPORTED FROM THE BUILDING STRUCTURE BY AT LEAST TWO OPPOSITE CORNERS.
- ALL LIGHTS NOT DIMENSIONED SHALL BE CENTERED OR PLACED EQUALLY WITHIN THE CEILING SPACE. FINAL PLACEMENT OF FIXTURES SHALL BE APPROVED BY ARCHITECT & INTERIOR DESIGNER PRIOR TO WIRING FIXTURES. CONTRACTOR SHALL MAKE MINOR ADJUSTMENTS TO LAYOUT WITHOUT ANY ADDITIONAL COST TO THE CONTRACT.
- HEAVY OR LARGE DECORATIVE LIGHT FIXTURES EXCEEDING 15-20 LBS. REQUIRE ATTACHMENT DETAILS WHICH EXCEED CONVENTIONAL METHODS FOR ATTACHING J-BOXES TO CEILING FRAMING. THEY SHALL BE SUSPENDED FROM STRUCTURAL SLAB FROM AN ENGINEERED METAL FRAMING SYSTEM.
- SEE MEP DRAWINGS FOR EXACT LOCATION AND SPECIFICATIONS OF FIRE ALARM, FIRE SPRINKLER & MECHANICAL SYSTEMS.

NOTE:
FOR PUBLIC AREA REFLECTED CEILING
ELEVATIONS, DIMENSIONS, LIGHT FIXTURES, ETC.
SEE INTERIOR DESIGN AND LIGHTING DRAWINGS.

ALL GUESTROOM BATH DROPPED CEILINGS
THROUGHOUT, INCLUDING SHOWERS, TO HAVE 5/8"
GLASS-MAT GYPSUM BOARD (MEETING ASTM
C1178) ON 1 5/8" GALV. MTL. STUD FRAMING AT 16"
O.C.

ALL EXPOSED CONCRETE CEILINGS TO RECEIVE
SKIM COAT PLASTER - PAINTED.

ALL DROPPED GYPSUM WALLBOARD CEILINGS
(OTHER THAN BATHROOM CEILINGS) TO BE 5/8"
GYPSUM WALLBOARD ON 1 5/8" GALV. MTL. STUD
FRAMING.

Permit Issue
10-13-14

REVISIONS

#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/13/15
3	Revisions	06-12-15

12064

A6.02

C:\Users\mhiciano\Documents\12064-ANGLERS_HOTEL_mhiciano.rvt
4/20/2016 4:29:57 PM



1
A6.03
LEVEL 300 REFLECTED CEILING PLAN
1/8" = 1'-0"

REFLECTED CEILING PLAN, SYMBOLS, AND NOTES

XXX	CEILING MATERIAL
X' - X"	CEILING HEIGHT ABOVE FINISH FLOOR

- PENDANT LIGHT
- WP RECESSED DOWNLIGHT (WP WHEN WATERPROOF)
- WALL SCONCE
- SURFACE MOUNTED FIXTURE
- CEILING MOUNTED EXIT LIGHT
- WALL MOUNTED EXIT LIGHT
- SD SMOKE DETECTOR
- AUDIBLE / VISIBLE SPEAKER
- ACCESS PANEL
- CEILING MOUNT A/C SUPPLY GRILL
- CEILING MOUNT A/C RETURN GRILL
- LINEAR DIFFUSER
- SEMI-RECESSED FIRE SPRINKLER HEAD
- FIRE SPRINKLER HEAD
- WALL MOUNTED FIRE SPRINKLER HEAD

- AT-1 ACOUSTICAL CEILING TILE (2X2)
- AT-2 ACOUSTICAL CEILING TILE (2X4)
- AT-3 ACOUSTICAL CEILING TILE (2X4) - DAMAGE RESISTANT

- ES EXPOSED STRUCTURE
- GB GYPSUM WALL BOARD
- GMGB GLASS-MAT GYPSUM WALLBOARD
- SPRAYED-ON INSULATION

- 2x2 RECESSED FLUORESCENT LIGHT FIXTURE
- 2x4 RECESSED FLUORESCENT LIGHT FIXTURE
- 2x2 SURFACE MOUNTED FLUORESCENT LIGHT FIXTURE
- 2x4 SURFACE MOUNTED FLUORESCENT LIGHT FIXTURE
- WALL MOUNTED FLUORESCENT LIGHT FIXTURE
- EMERGENCY LIGHTING LIGHT FIXTURE (SEE ELECTRICAL DRAWINGS)

REFLECTED CEILING NOTES:

- G.C. TO COORDINATE ARCHITECTURAL, MECHANICAL, ELECTRICAL, LIGHTING, AND FIRE PROTECTION INSTALLATIONS.
- SEE LIGHTING AND ELECTRICAL DRAWINGS FOR FIXTURE TYPES & SCHEDULE.
- ALL CEILING HEIGHTS ARE FROM THE TOP OF THE FINISH FLOOR.
- SUSPENDED ACOUSTICAL CEILING TILE & GRID SYSTEM IS NOT DESIGNED OR INTENDED TO SUPPORT THE WEIGHT OF ADDITIONAL EQUIPMENT, CABLE, CONDUIT, MECHANICAL EQUIPMENT OR OTHER CONSTRUCTION. ALL SUCH ELEMENTS ARE TO BE INDEPENDENTLY SUPPORTED FROM THE BUILDING STRUCTURE BY AT LEAST TWO OPPOSITE CORNERS.
- ALL LIGHTS NOT DIMENSIONED SHALL BE CENTERED OR PLACED EQUALLY WITHIN THE CEILING SPACE. FINAL PLACEMENT OF FIXTURES SHALL BE APPROVED BY ARCHITECT & INTERIOR DESIGNER PRIOR TO WIRING FIXTURES. CONTRACTOR SHALL MAKE MINOR ADJUSTMENTS TO LAYOUT WITHOUT ANY ADDITIONAL COST TO THE CONTRACT.
- HEAVY OR LARGE DECORATIVE LIGHT FIXTURES EXCEEDING 15-20 LBS. REQUIRE ATTACHMENT DETAILS WHICH EXCEED CONVENTIONAL METHODS FOR ATTACHING J-BOXES TO CEILING FRAMING. THEY SHALL BE SUSPENDED FROM STRUCTURAL SLAB FROM AN ENGINEERED METAL FRAMING SYSTEM.
- SEE MEP DRAWINGS FOR EXACT LOCATION AND SPECIFICATIONS OF FIRE ALARM, FIRE SPRINKLER & MECHANICAL SYSTEMS.

NOTE:
FOR PUBLIC AREA REFLECTED CEILING
ELEVATIONS, DIMENSIONS, LIGHT FIXTURES, ETC.
SEE INTERIOR DESIGN AND LIGHTING DRAWINGS.

ALL GUESTROOM BATH DROPPED CEILINGS
THROUGHOUT, INCLUDING SHOWERS, TO HAVE 5/8"
GLASS-MAT GYPSUM BOARD (MEETING ASTM
C1178) ON 1 5/8" GALV. MTL. STUD FRAMING AT 16"
O.C.

ALL EXPOSED CONCRETE CEILINGS TO RECEIVE
SKIM COAT PLASTER - PAINTED.

ALL DROPPED GYPSUM WALLBOARD CEILINGS
(OTHER THAN BATHROOM CEILINGS) TO BE 5/8"
GYPSUM WALLBOARD ON 1 5/8" GALV. MTL. STUD
FRAMING.

Permit Issue
10-13-14


REVISIONS

#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/13/15
3	Revisions	06-12-15

12064

A6.03

C:\Users\mhiciano\Documents\12064-ANGLERS_HOTEL_mhiciano.rvt
4/20/2016 4:30:02 PM

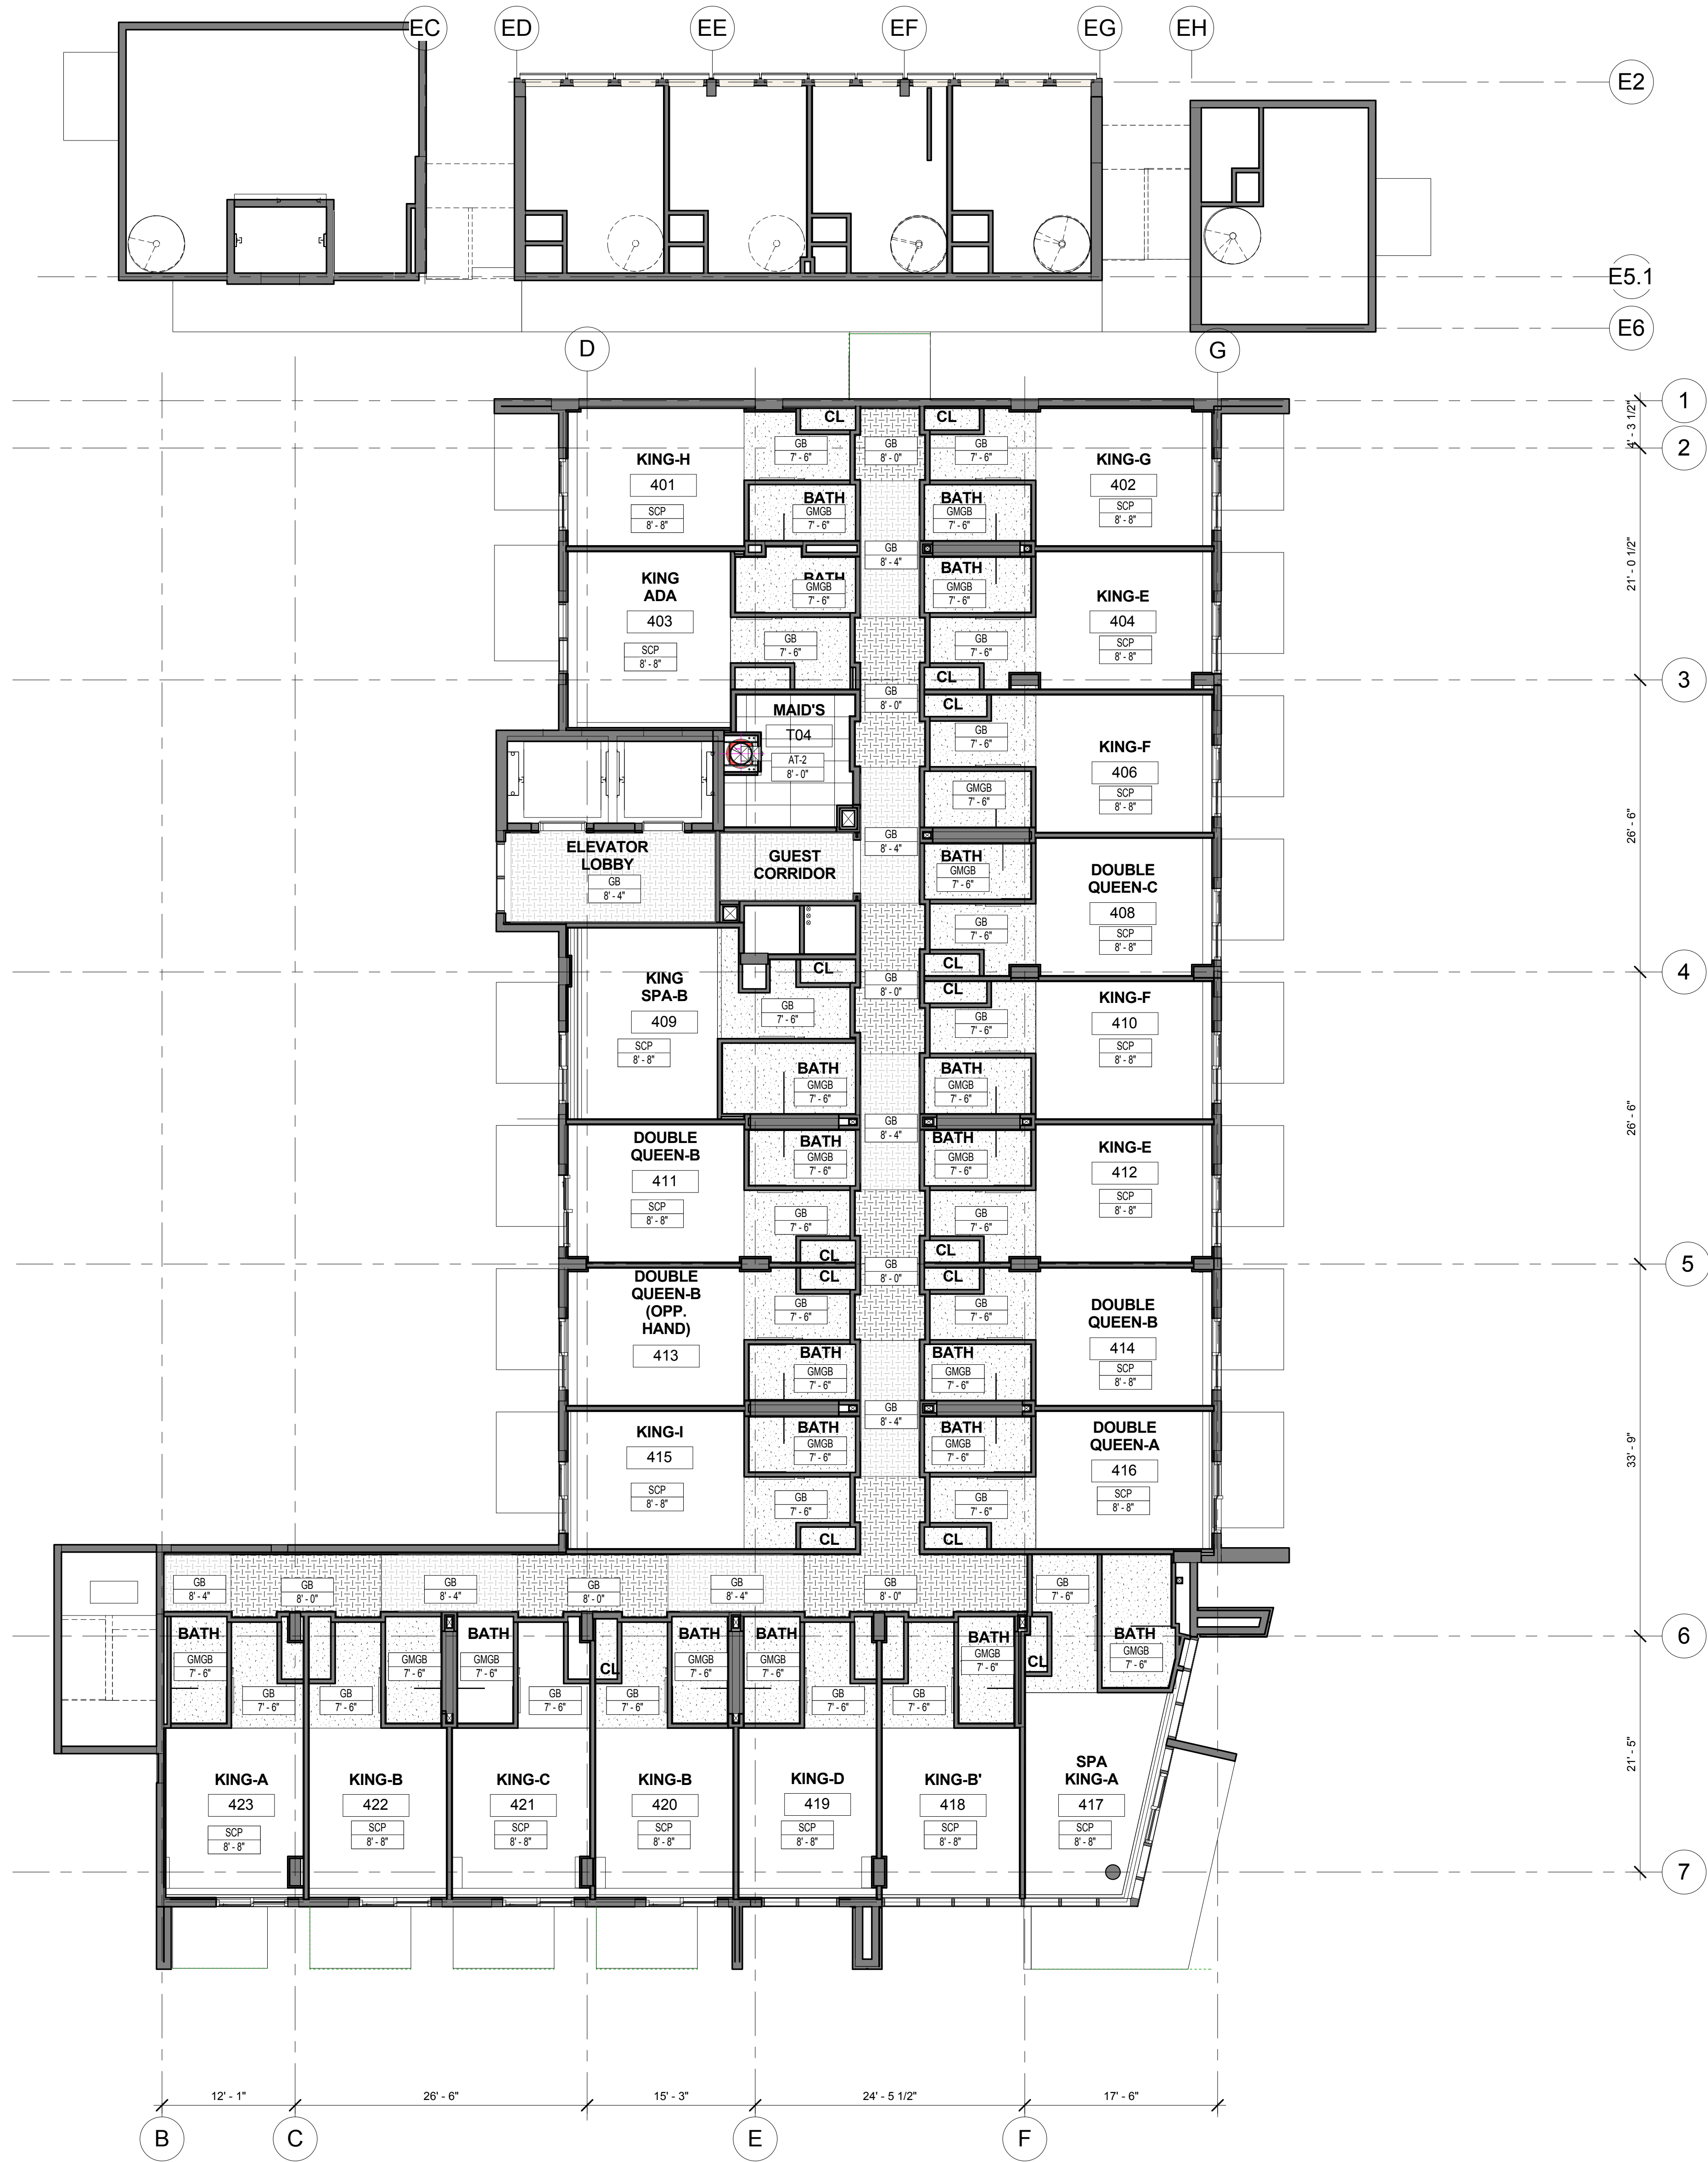

1
A6.04
LEVEL 400 REFLECTED CEILING PLAN
1/8" = 1'-0"

REFLECTED CEILING PLAN, SYMBOLS, AND NOTES

XXX	CEILING MATERIAL
X' - X"	CEILING HEIGHT ABOVE FINISH FLOOR

- PENDANT LIGHT
- WP RECESSED DOWNLIGHT (WP WHEN WATERPROOF)
- WALL SCONCE
- SURFACE MOUNTED FIXTURE
- CEILING MOUNTED EXIT LIGHT
- WALL MOUNTED EXIT LIGHT
- SD SMOKE DETECTOR
- AUDIBLE / VISIBLE SPEAKER
- ACCESS PANEL
- CEILING MOUNT A/C SUPPLY GRILL
- CEILING MOUNT A/C RETURN GRILL
- LINEAR DIFFUSER
- SEMI-RECESSED FIRE SPRINKLER HEAD
- FIRE SPRINKLER HEAD
- WALL MOUNTED FIRE SPRINKLER HEAD

- AT-1 ACOUSTICAL CEILING TILE (2X2)
- AT-2 ACOUSTICAL CEILING TILE (2X4)
- AT-3 ACOUSTICAL CEILING TILE (2X4) - DAMAGE RESISTANT

- ES EXPOSED STRUCTURE
- GB GYPSUM WALL BOARD
- GMGB GLASS-MAT GYPSUM WALLBOARD
- SPRAYED-ON INSULATION

- 2x2 RECESSED FLUORESCENT LIGHT FIXTURE
- 2x4 RECESSED FLUORESCENT LIGHT FIXTURE
- 2x2 SURFACE MOUNTED FLUORESCENT LIGHT FIXTURE
- 2x4 SURFACE MOUNTED FLUORESCENT LIGHT FIXTURE
- WALL MOUNTED FLUORESCENT LIGHT FIXTURE
- EMERGENCY LIGHTING LIGHT FIXTURE (SEE ELECTRICAL DRAWINGS)

REFLECTED CEILING NOTES:

- G.C. TO COORDINATE ARCHITECTURAL, MECHANICAL, ELECTRICAL, LIGHTING, AND FIRE PROTECTION INSTALLATIONS.
- SEE LIGHTING AND ELECTRICAL DRAWINGS FOR FIXTURE TYPES & SCHEDULE.
- ALL CEILING HEIGHTS ARE FROM THE TOP OF THE FINISH FLOOR.
- SUSPENDED ACOUSTICAL CEILING TILE & GRID SYSTEM IS NOT DESIGNED OR INTENDED TO SUPPORT THE WEIGHT OF ADDITIONAL EQUIPMENT, CABLE, CONDUIT, MECHANICAL EQUIPMENT OR OTHER CONSTRUCTION. ALL SUCH ELEMENTS ARE TO BE INDEPENDENTLY SUPPORTED FROM THE BUILDING STRUCTURE BY AT LEAST TWO OPPOSITE CORNERS.
- ALL LIGHTS NOT DIMENSIONED SHALL BE CENTERED OR PLACED EQUALLY WITHIN THE CEILING SPACE. FINAL PLACEMENT OF FIXTURES SHALL BE APPROVED BY ARCHITECT & INTERIOR DESIGNER PRIOR TO WIRING FIXTURES. CONTRACTOR SHALL MAKE MINOR ADJUSTMENTS TO LAYOUT WITHOUT ANY ADDITIONAL COST TO THE CONTRACT.
- HEAVY OR LARGE DECORATIVE LIGHT FIXTURES EXCEEDING 15-20 LBS. REQUIRE ATTACHMENT DETAILS WHICH EXCEED CONVENTIONAL METHODS FOR ATTACHING J-BOXES TO CEILING FRAMING. THEY SHALL BE SUSPENDED FROM STRUCTURAL SLAB FROM AN ENGINEERED METAL FRAMING SYSTEM.
- SEE MEP DRAWINGS FOR EXACT LOCATION AND SPECIFICATIONS OF FIRE ALARM, FIRE SPRINKLER & MECHANICAL SYSTEMS.

NOTE:
FOR PUBLIC AREA REFLECTED CEILING
ELEVATIONS, DIMENSIONS, LIGHT FIXTURES, ETC.
SEE INTERIOR DESIGN AND LIGHTING DRAWINGS.

ALL GUESTROOM BATH DROPPED CEILINGS
THROUGHOUT, INCLUDING SHOWERS, TO HAVE 5/8"
GLASS-MAT GYPSUM BOARD (MEETING ASTM
C1178) ON 1 5/8" GALV. MTL. STUD FRAMING AT 16"
O.C.

ALL EXPOSED CONCRETE CEILINGS TO RECEIVE
SKIM COAT PLASTER - PAINTED.

ALL DROPPED GYPSUM WALLBOARD CEILINGS
(OTHER THAN BATHROOM CEILINGS) TO BE 5/8"
GYPSUM WALLBOARD ON 1 5/8" GALV. MTL. STUD
FRAMING.

Permit Issue
10-13-14


REVISIONS

#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/13/15
3	Revisions	06-12-15

12064


A6.04

C:\Users\mhiciano\Documents\12064-ANGLERS-HOTEL_mhiciano.rvt
4/20/2016 4:30:08 PM

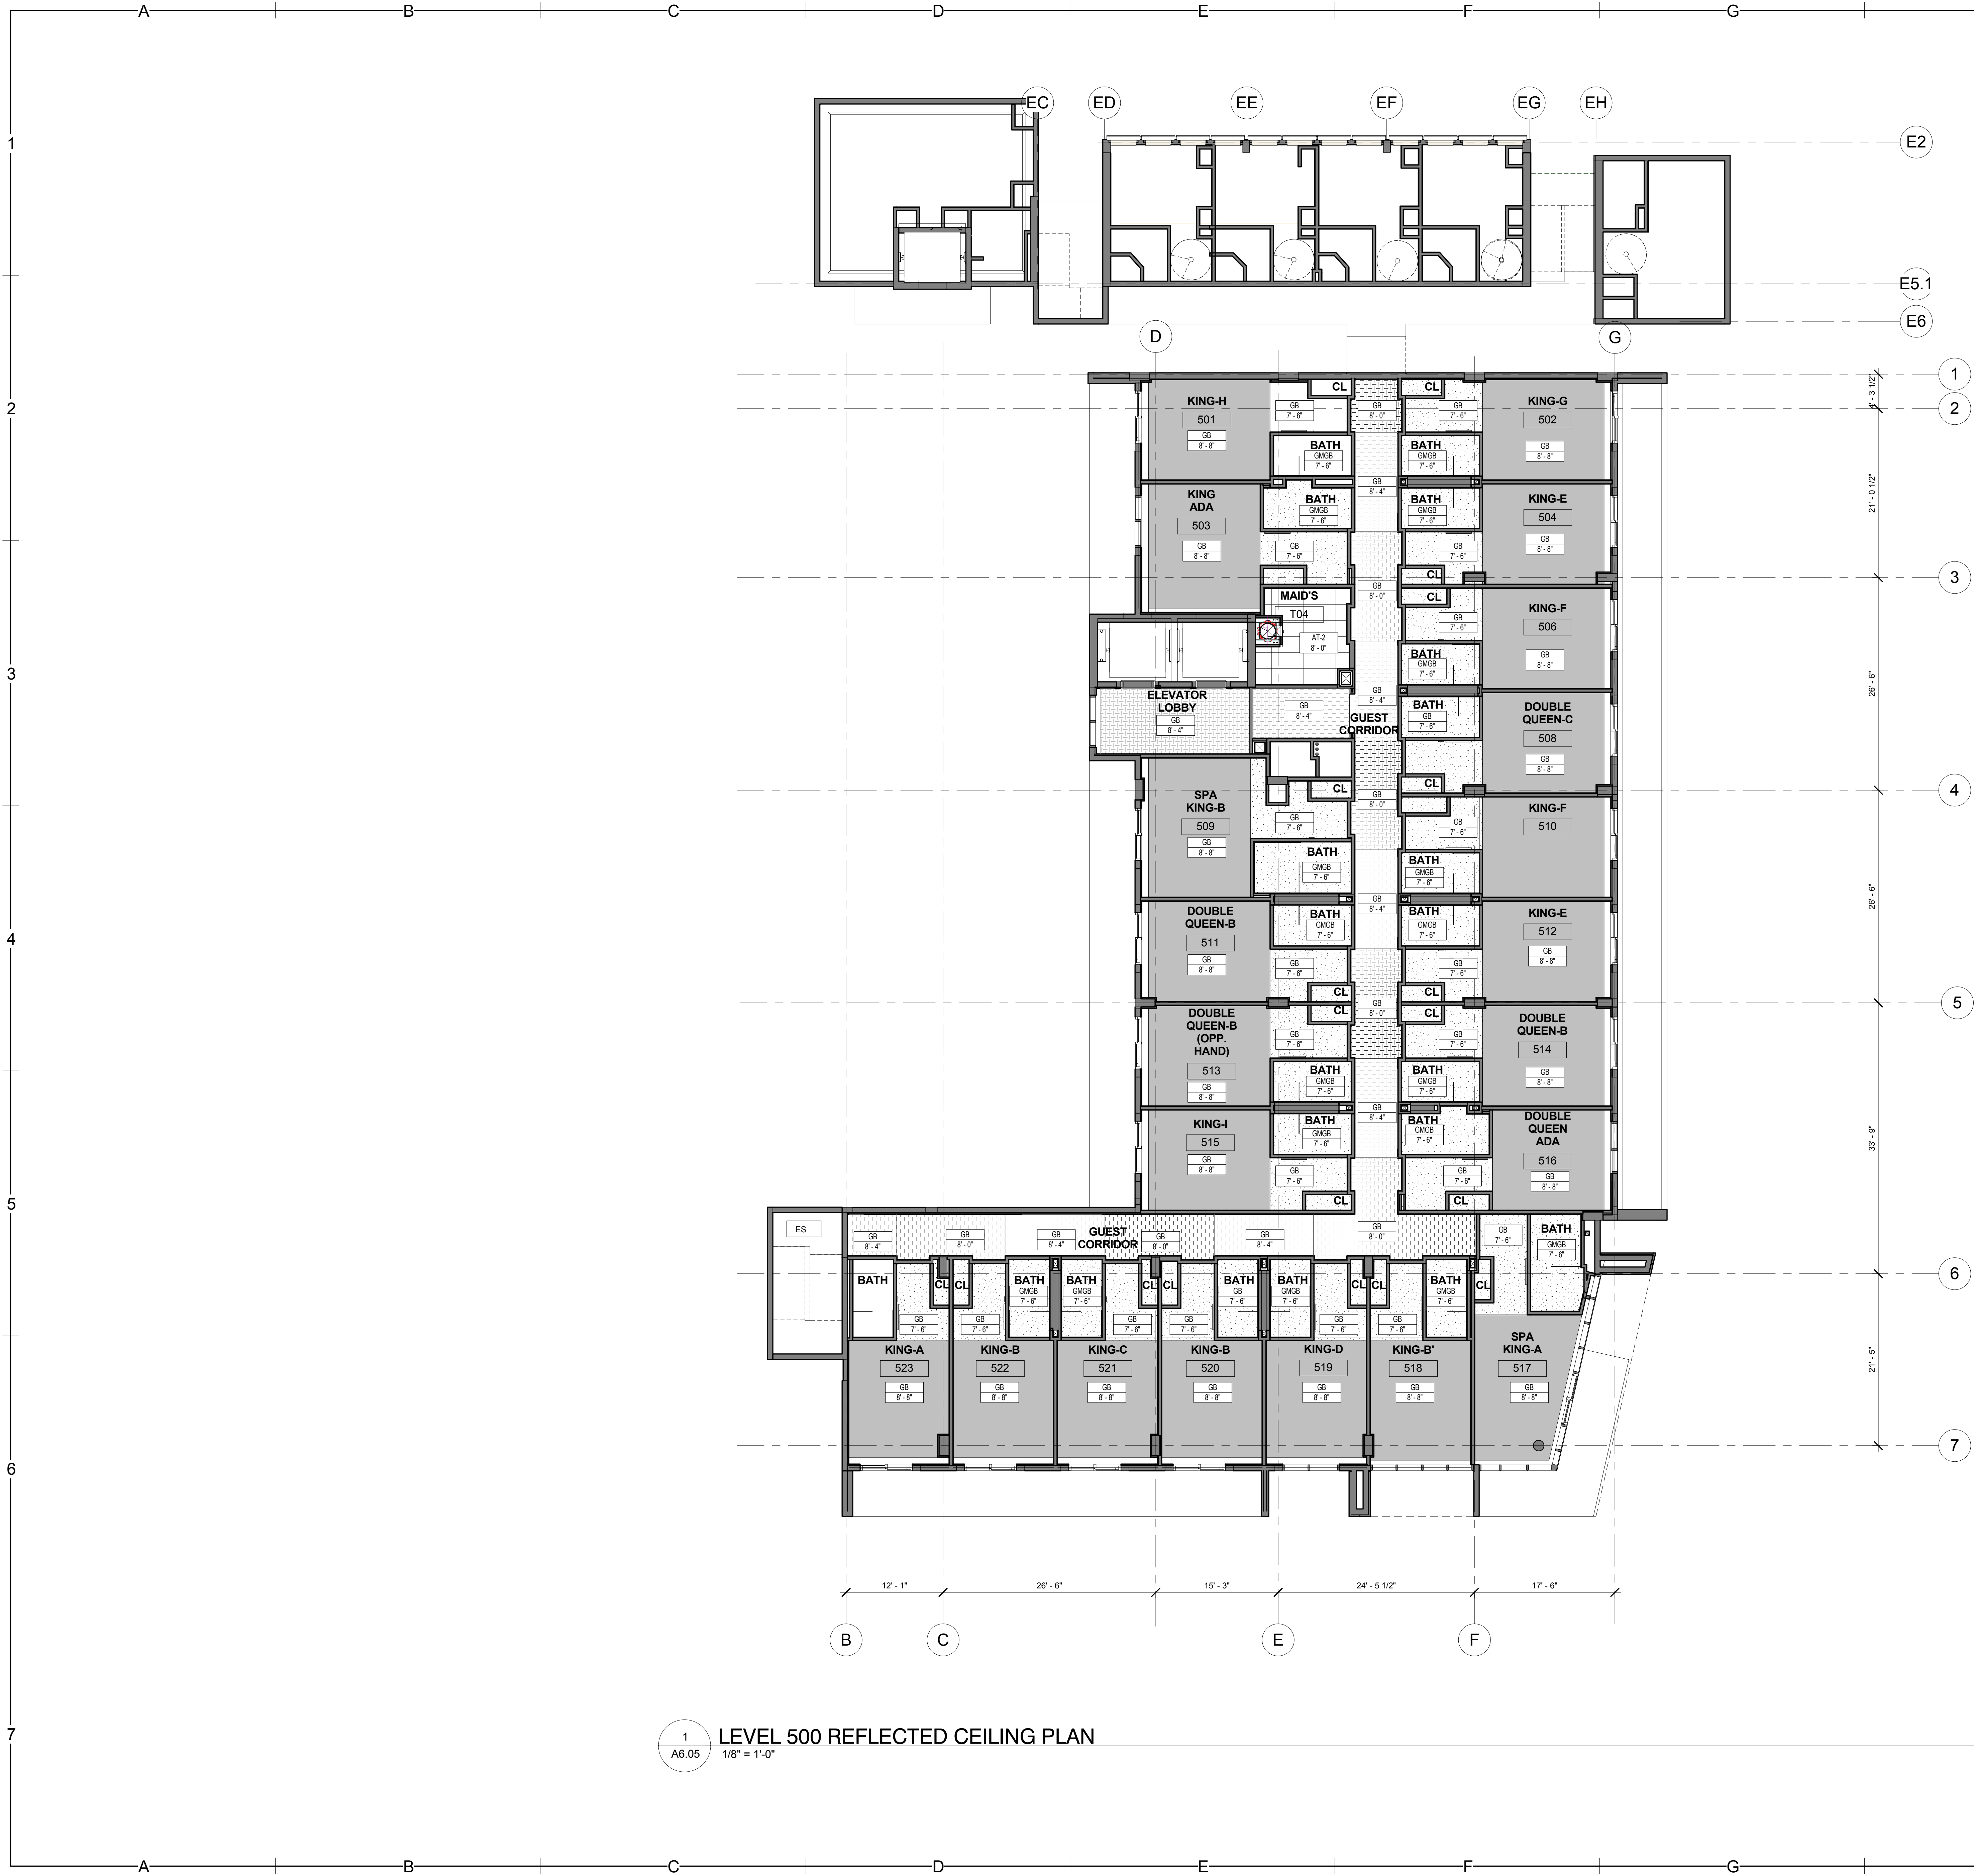


1 LEVEL 500 REFLECTED CEILING PLAN
A6.05 1/8" = 1'-0"


REVISIONS		
#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/13/15
3	Revisions	06-12-15

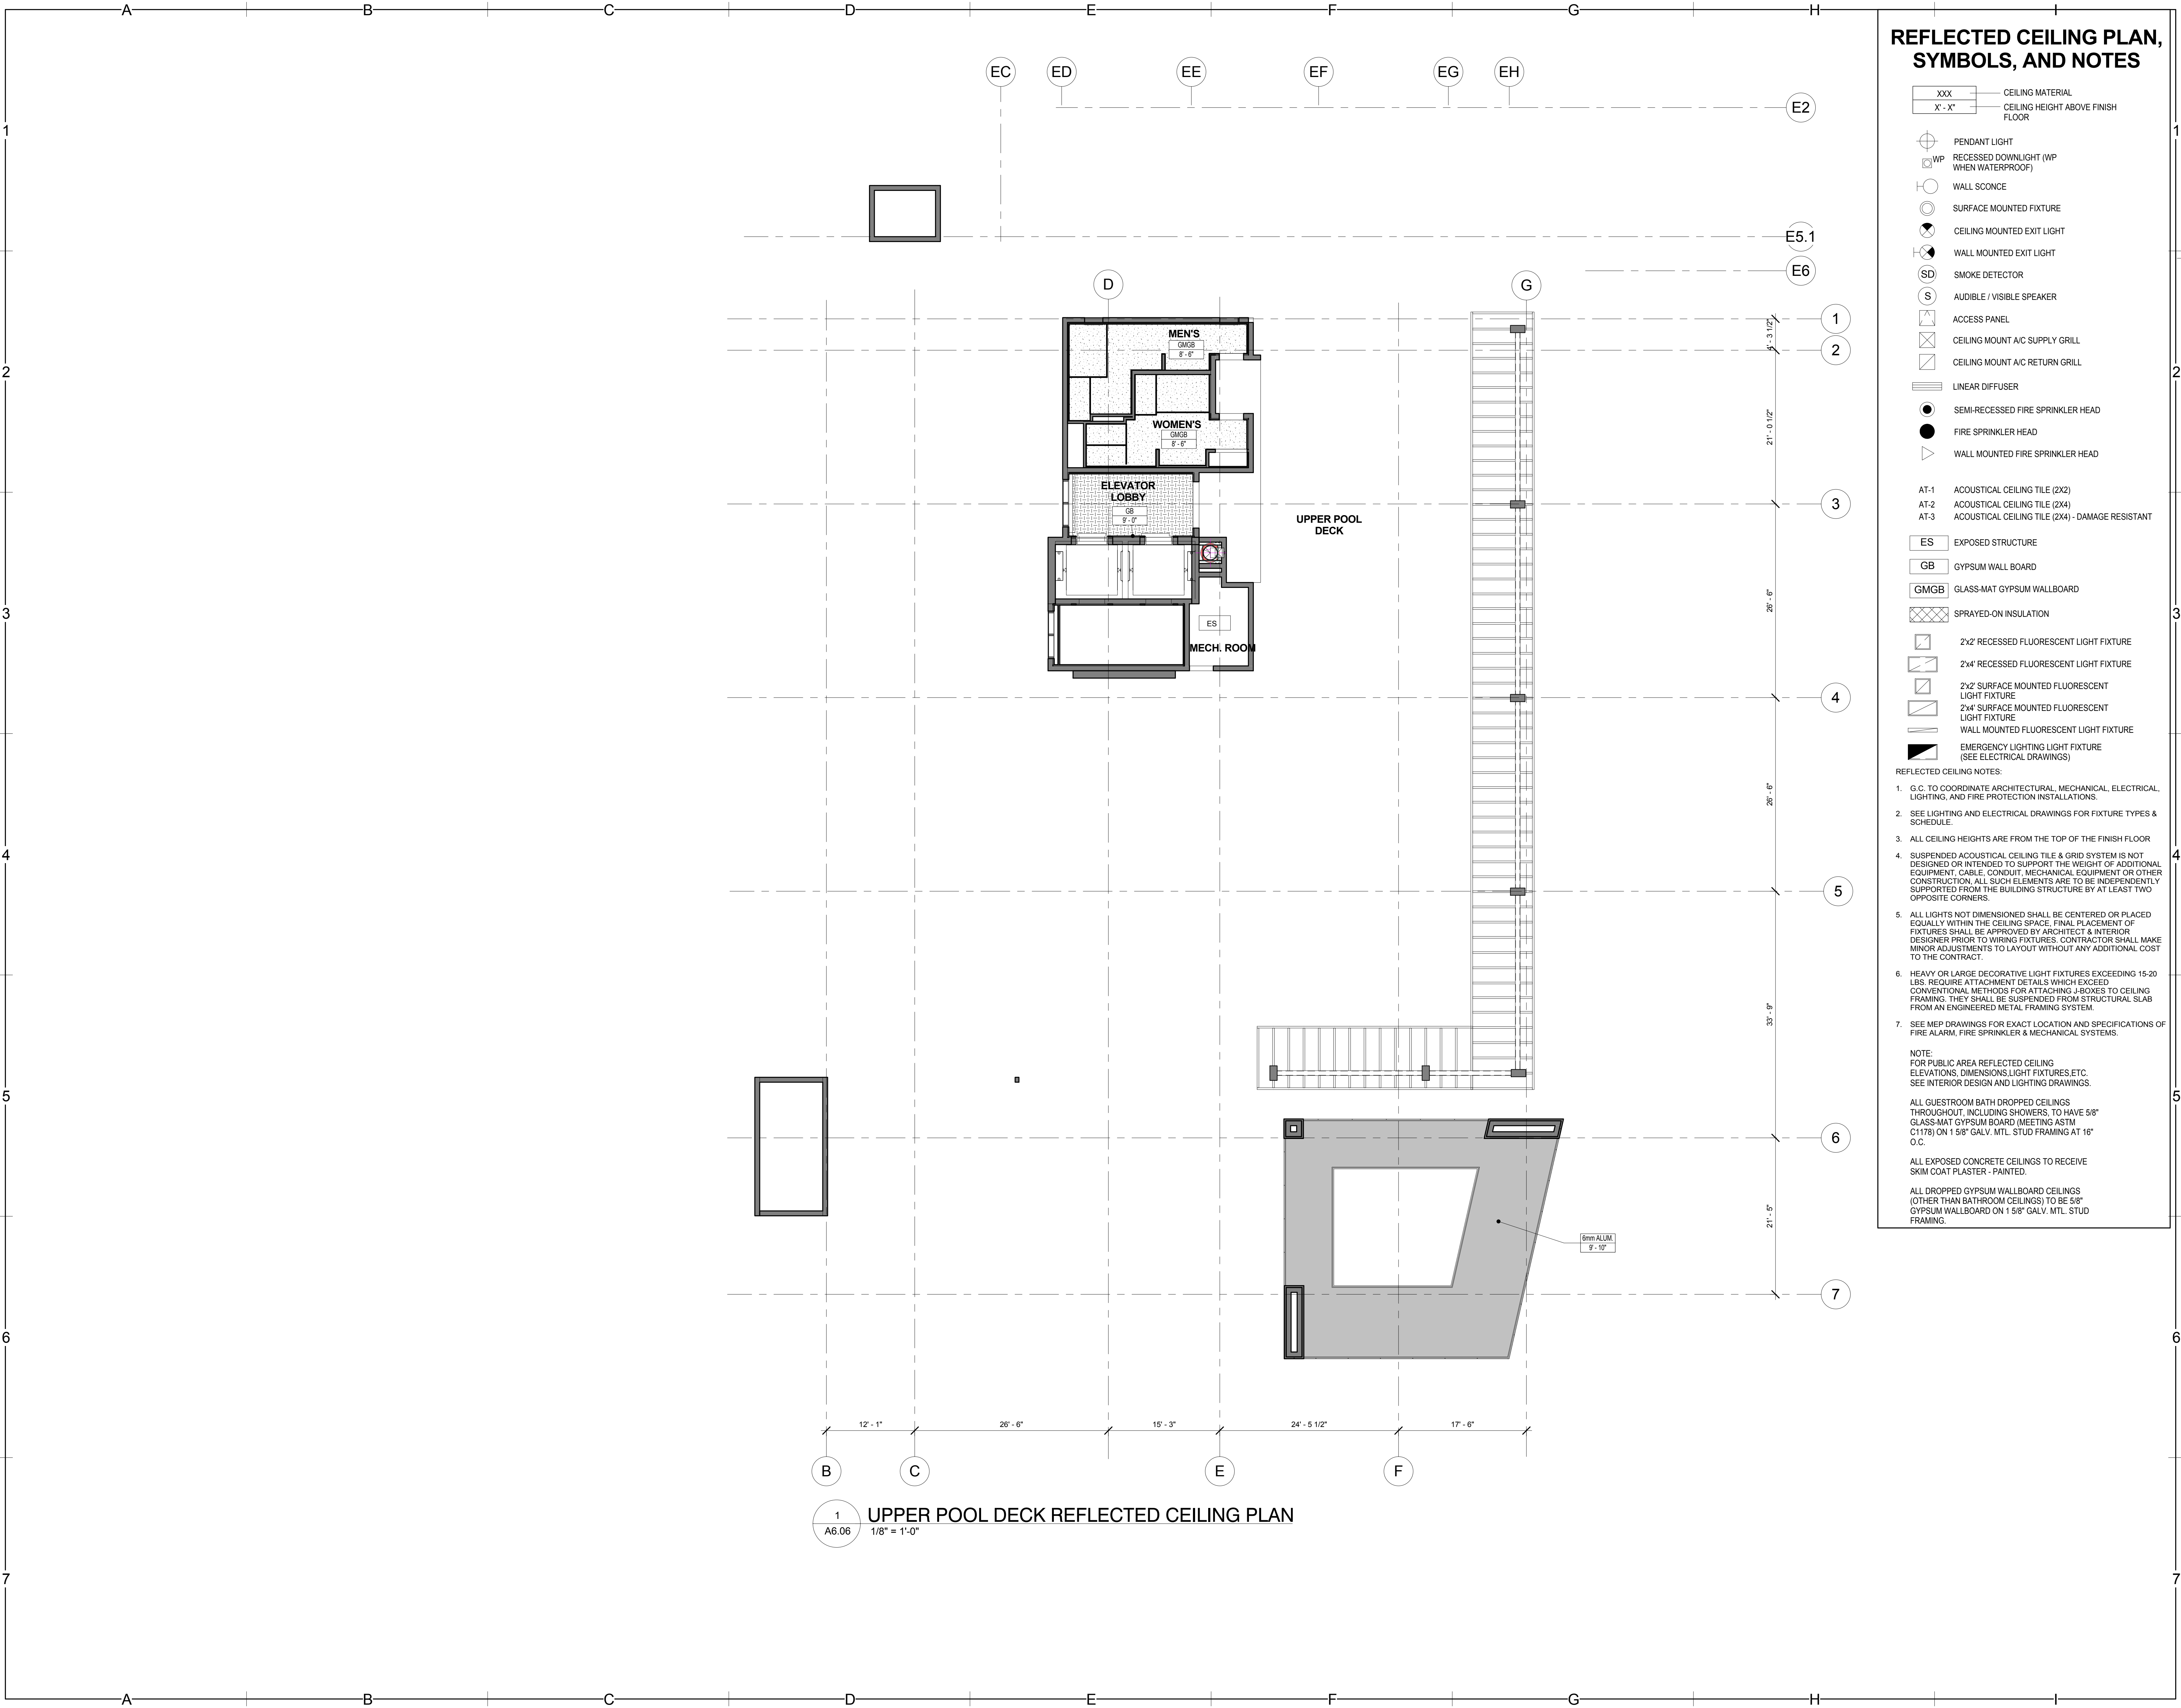


C:\Users\mhicario\Documents\12064-ANGLERS-HOTEL_mhicario.rvt
4/20/2016 4:30:16 PM

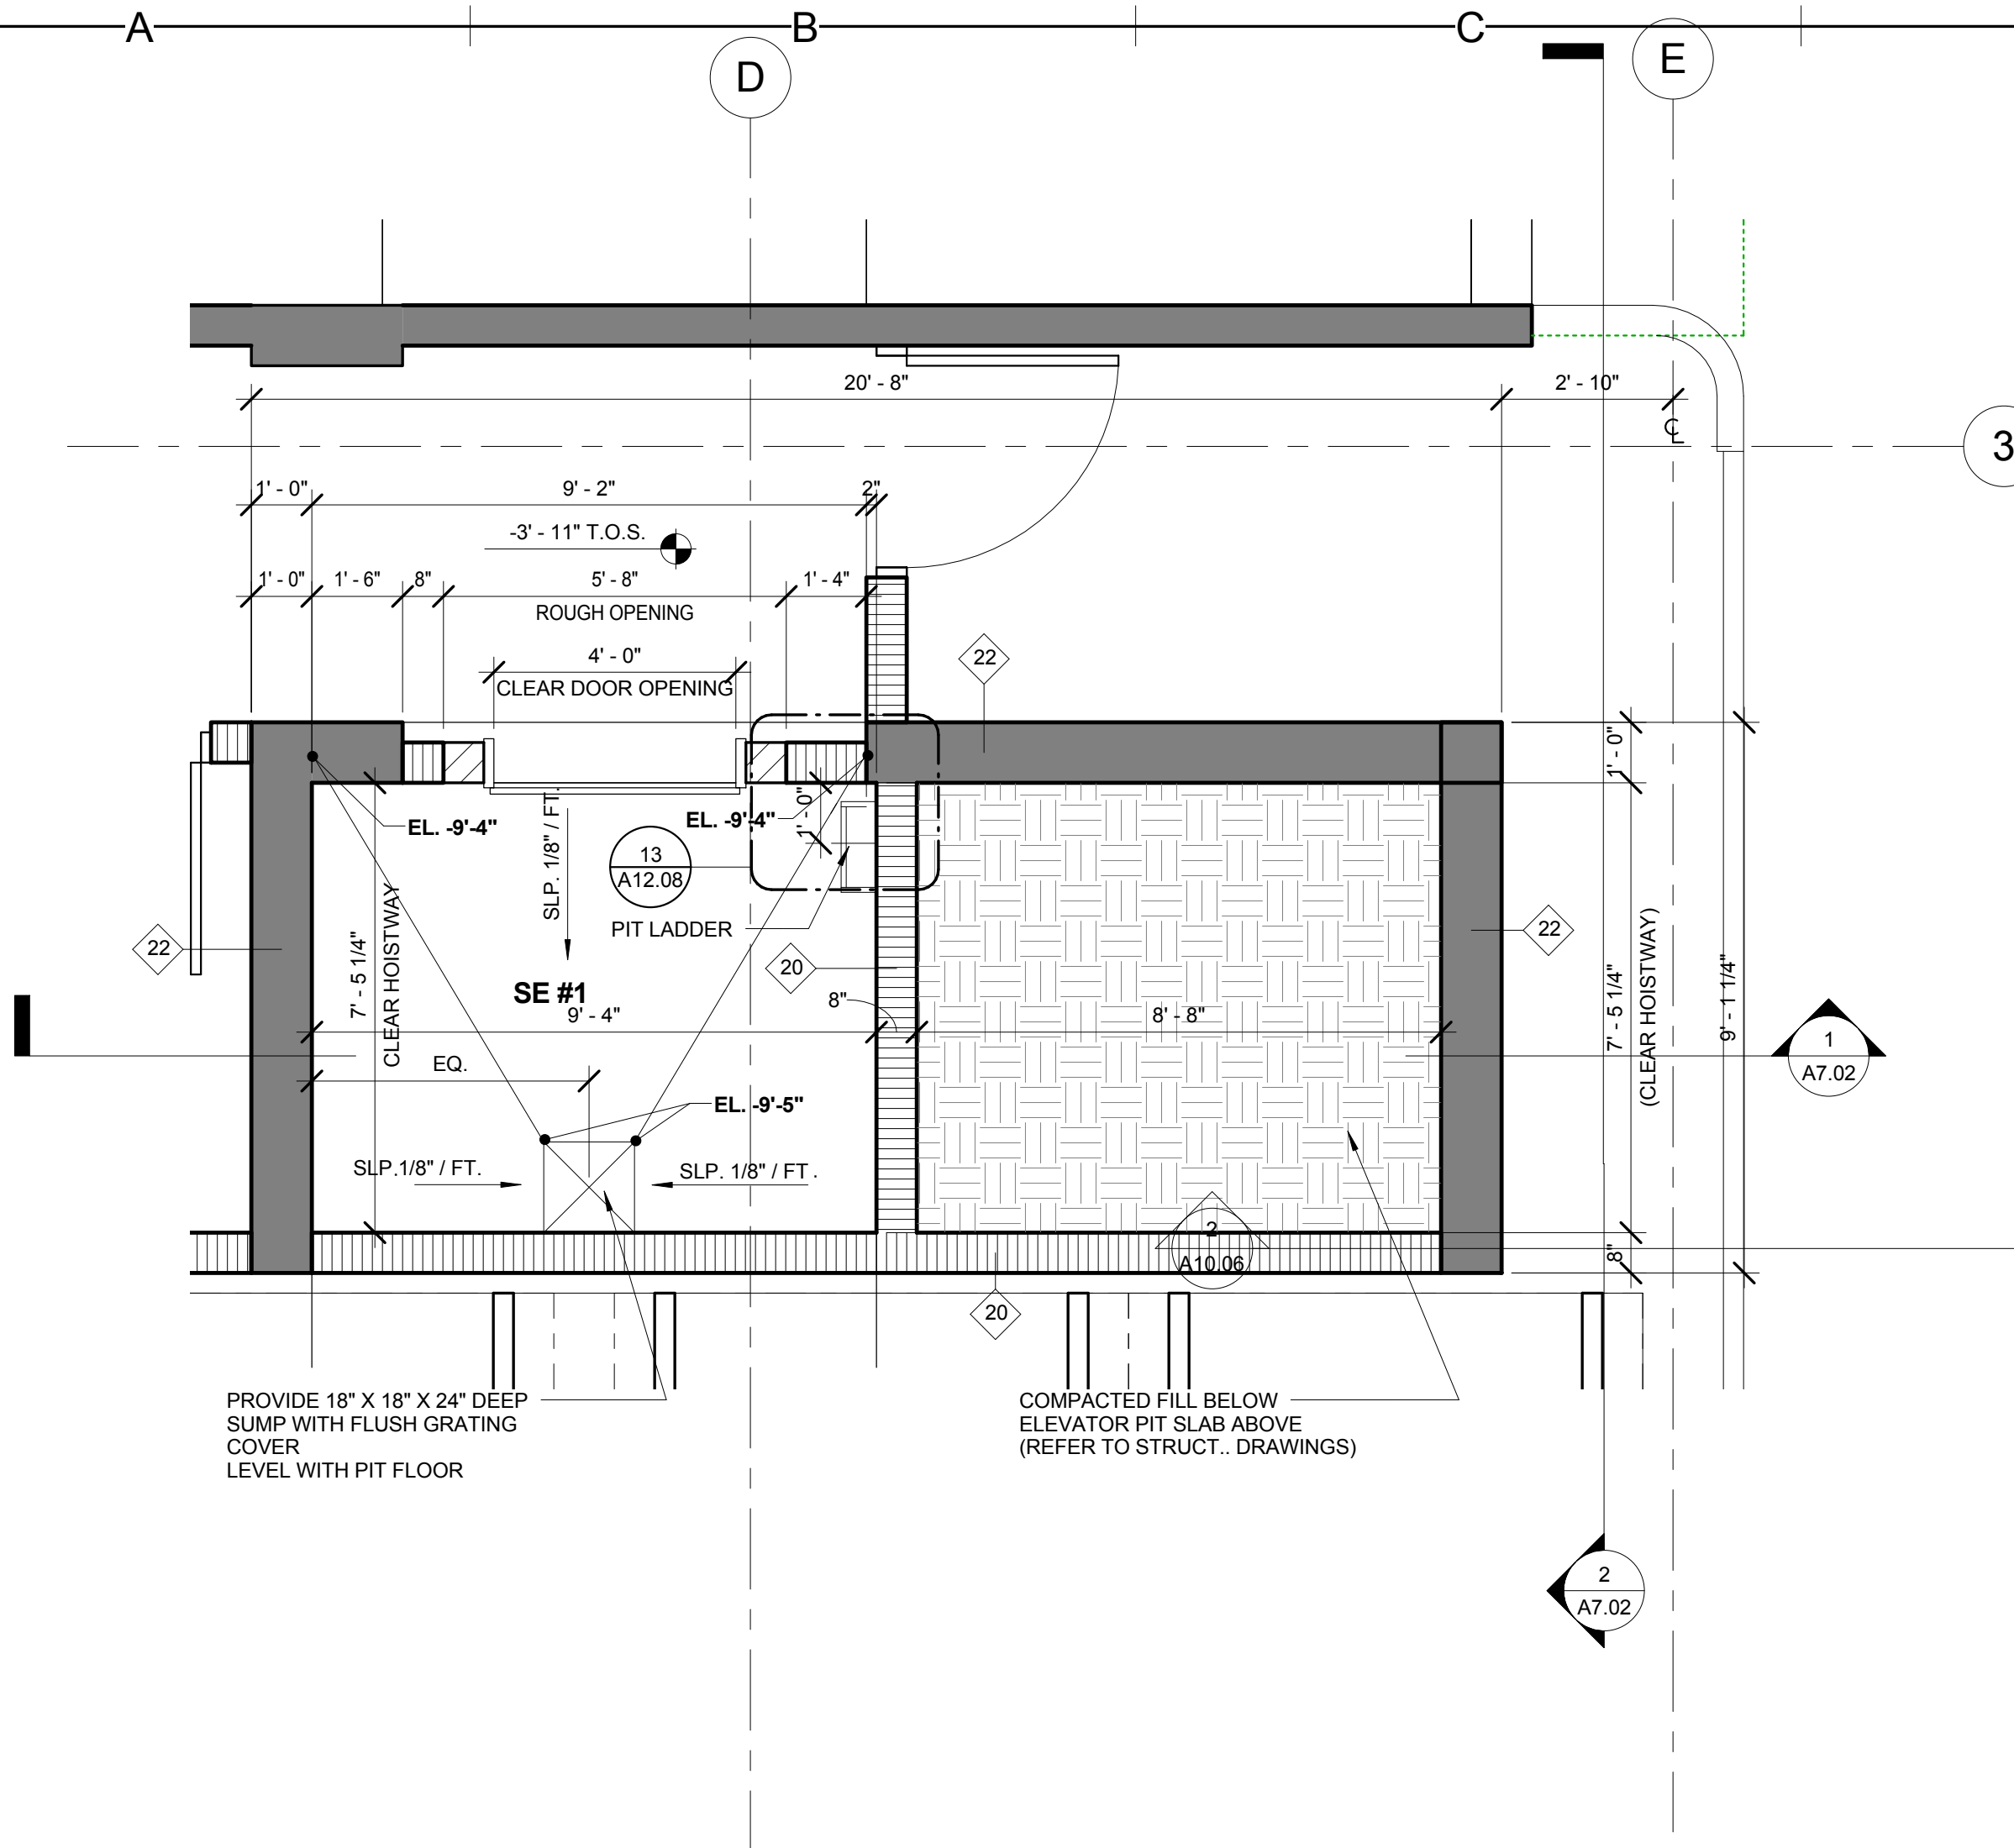


1
A7.00
ELEVATOR CORE - PIT PLAN
3/8" = 1'-0"

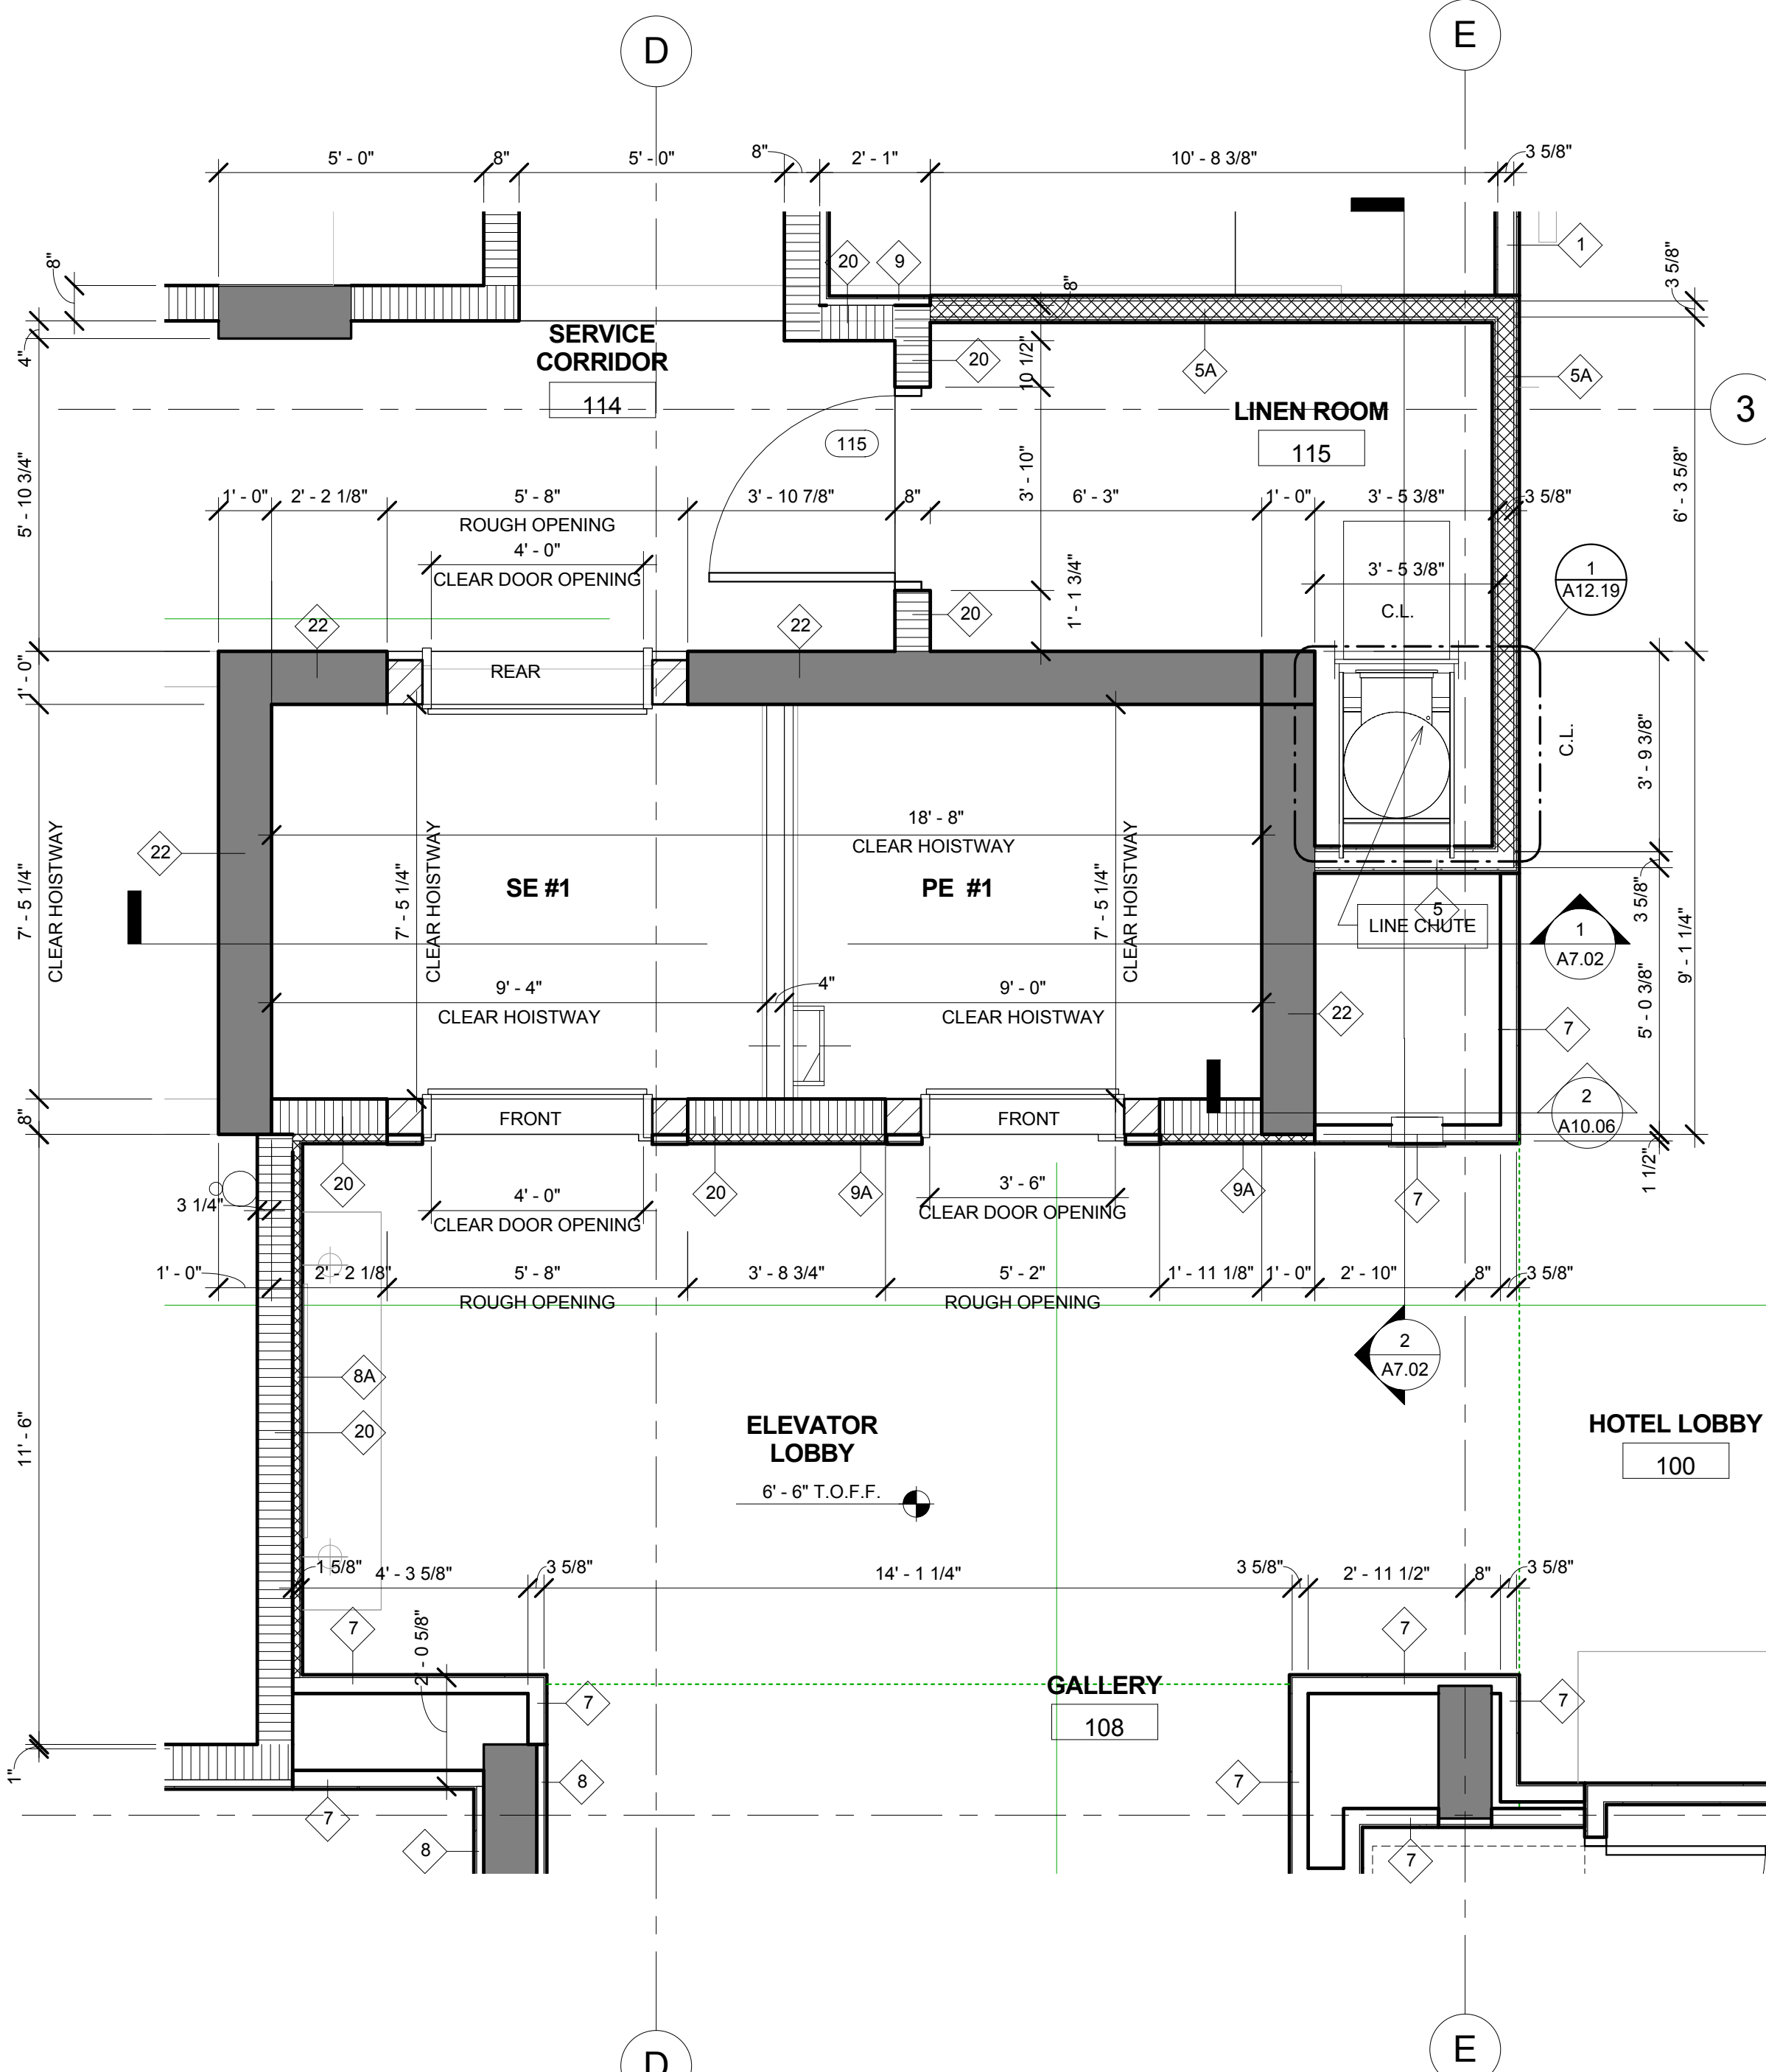

3
A7.00
ELEVATOR CORE - LEVEL 100
3/8" = 1'-0"

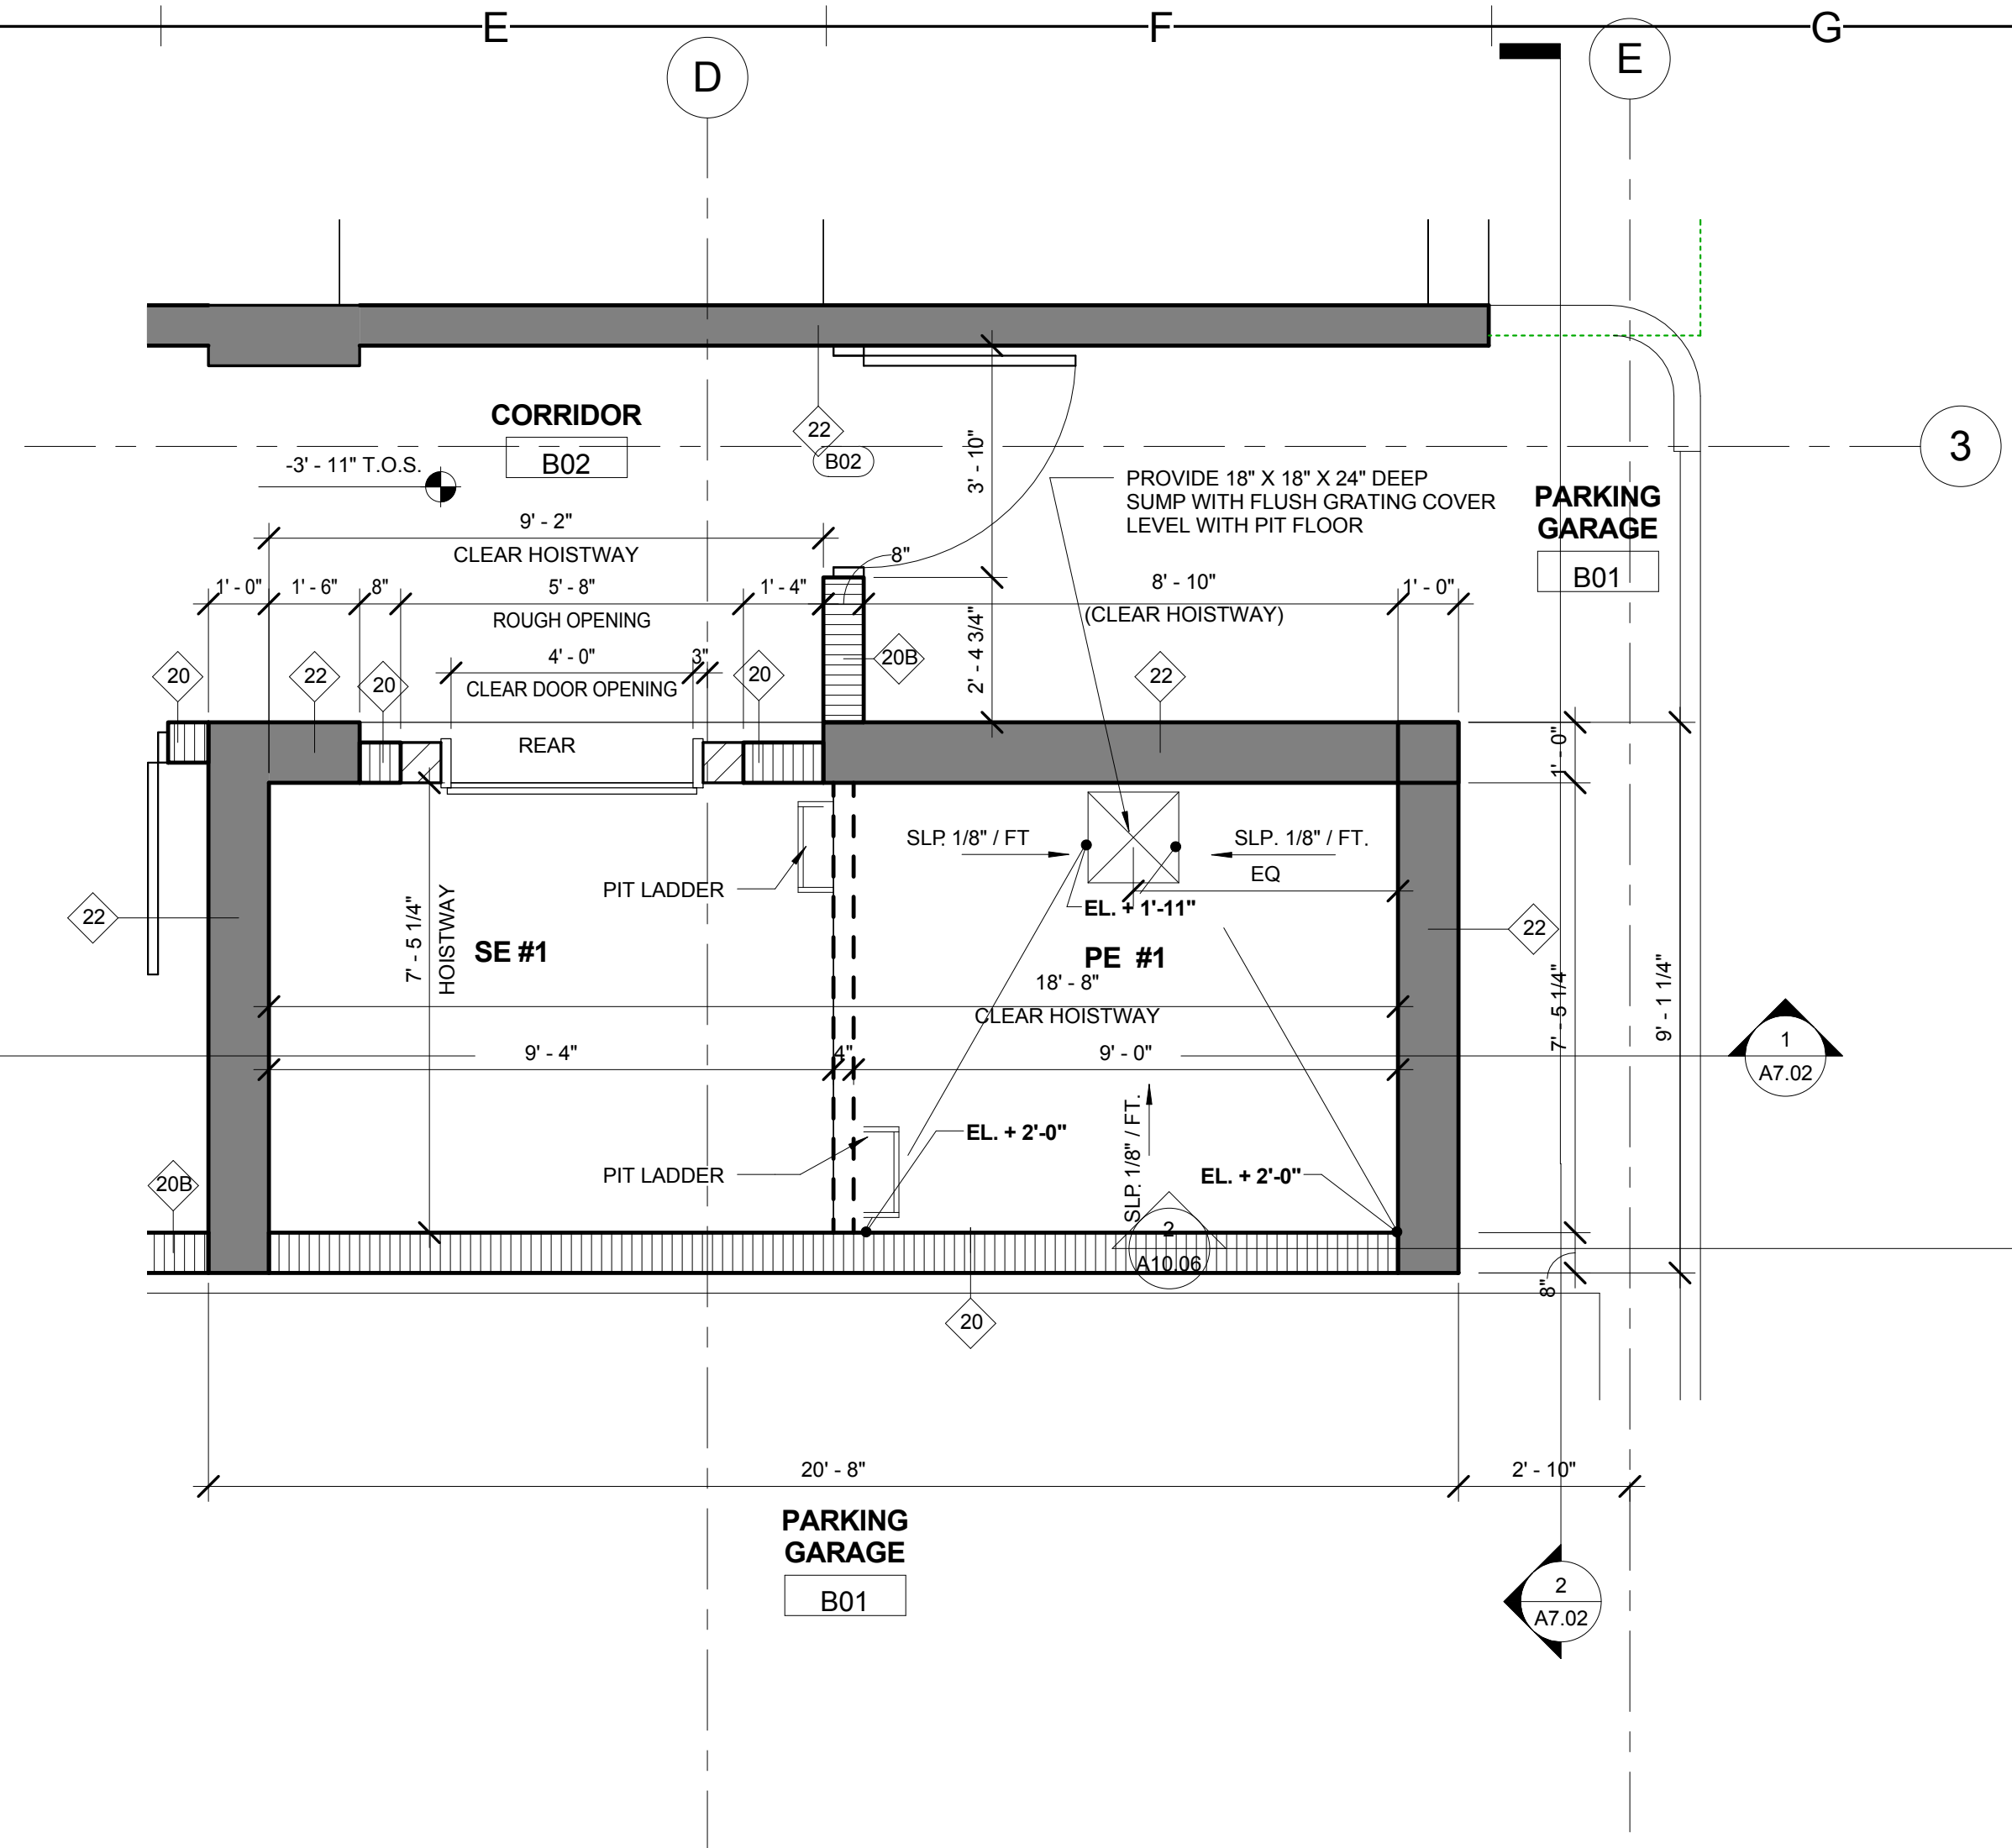

2
A7.00
ELEVATOR CORE - BASEMENT
3/8" = 1'-0"

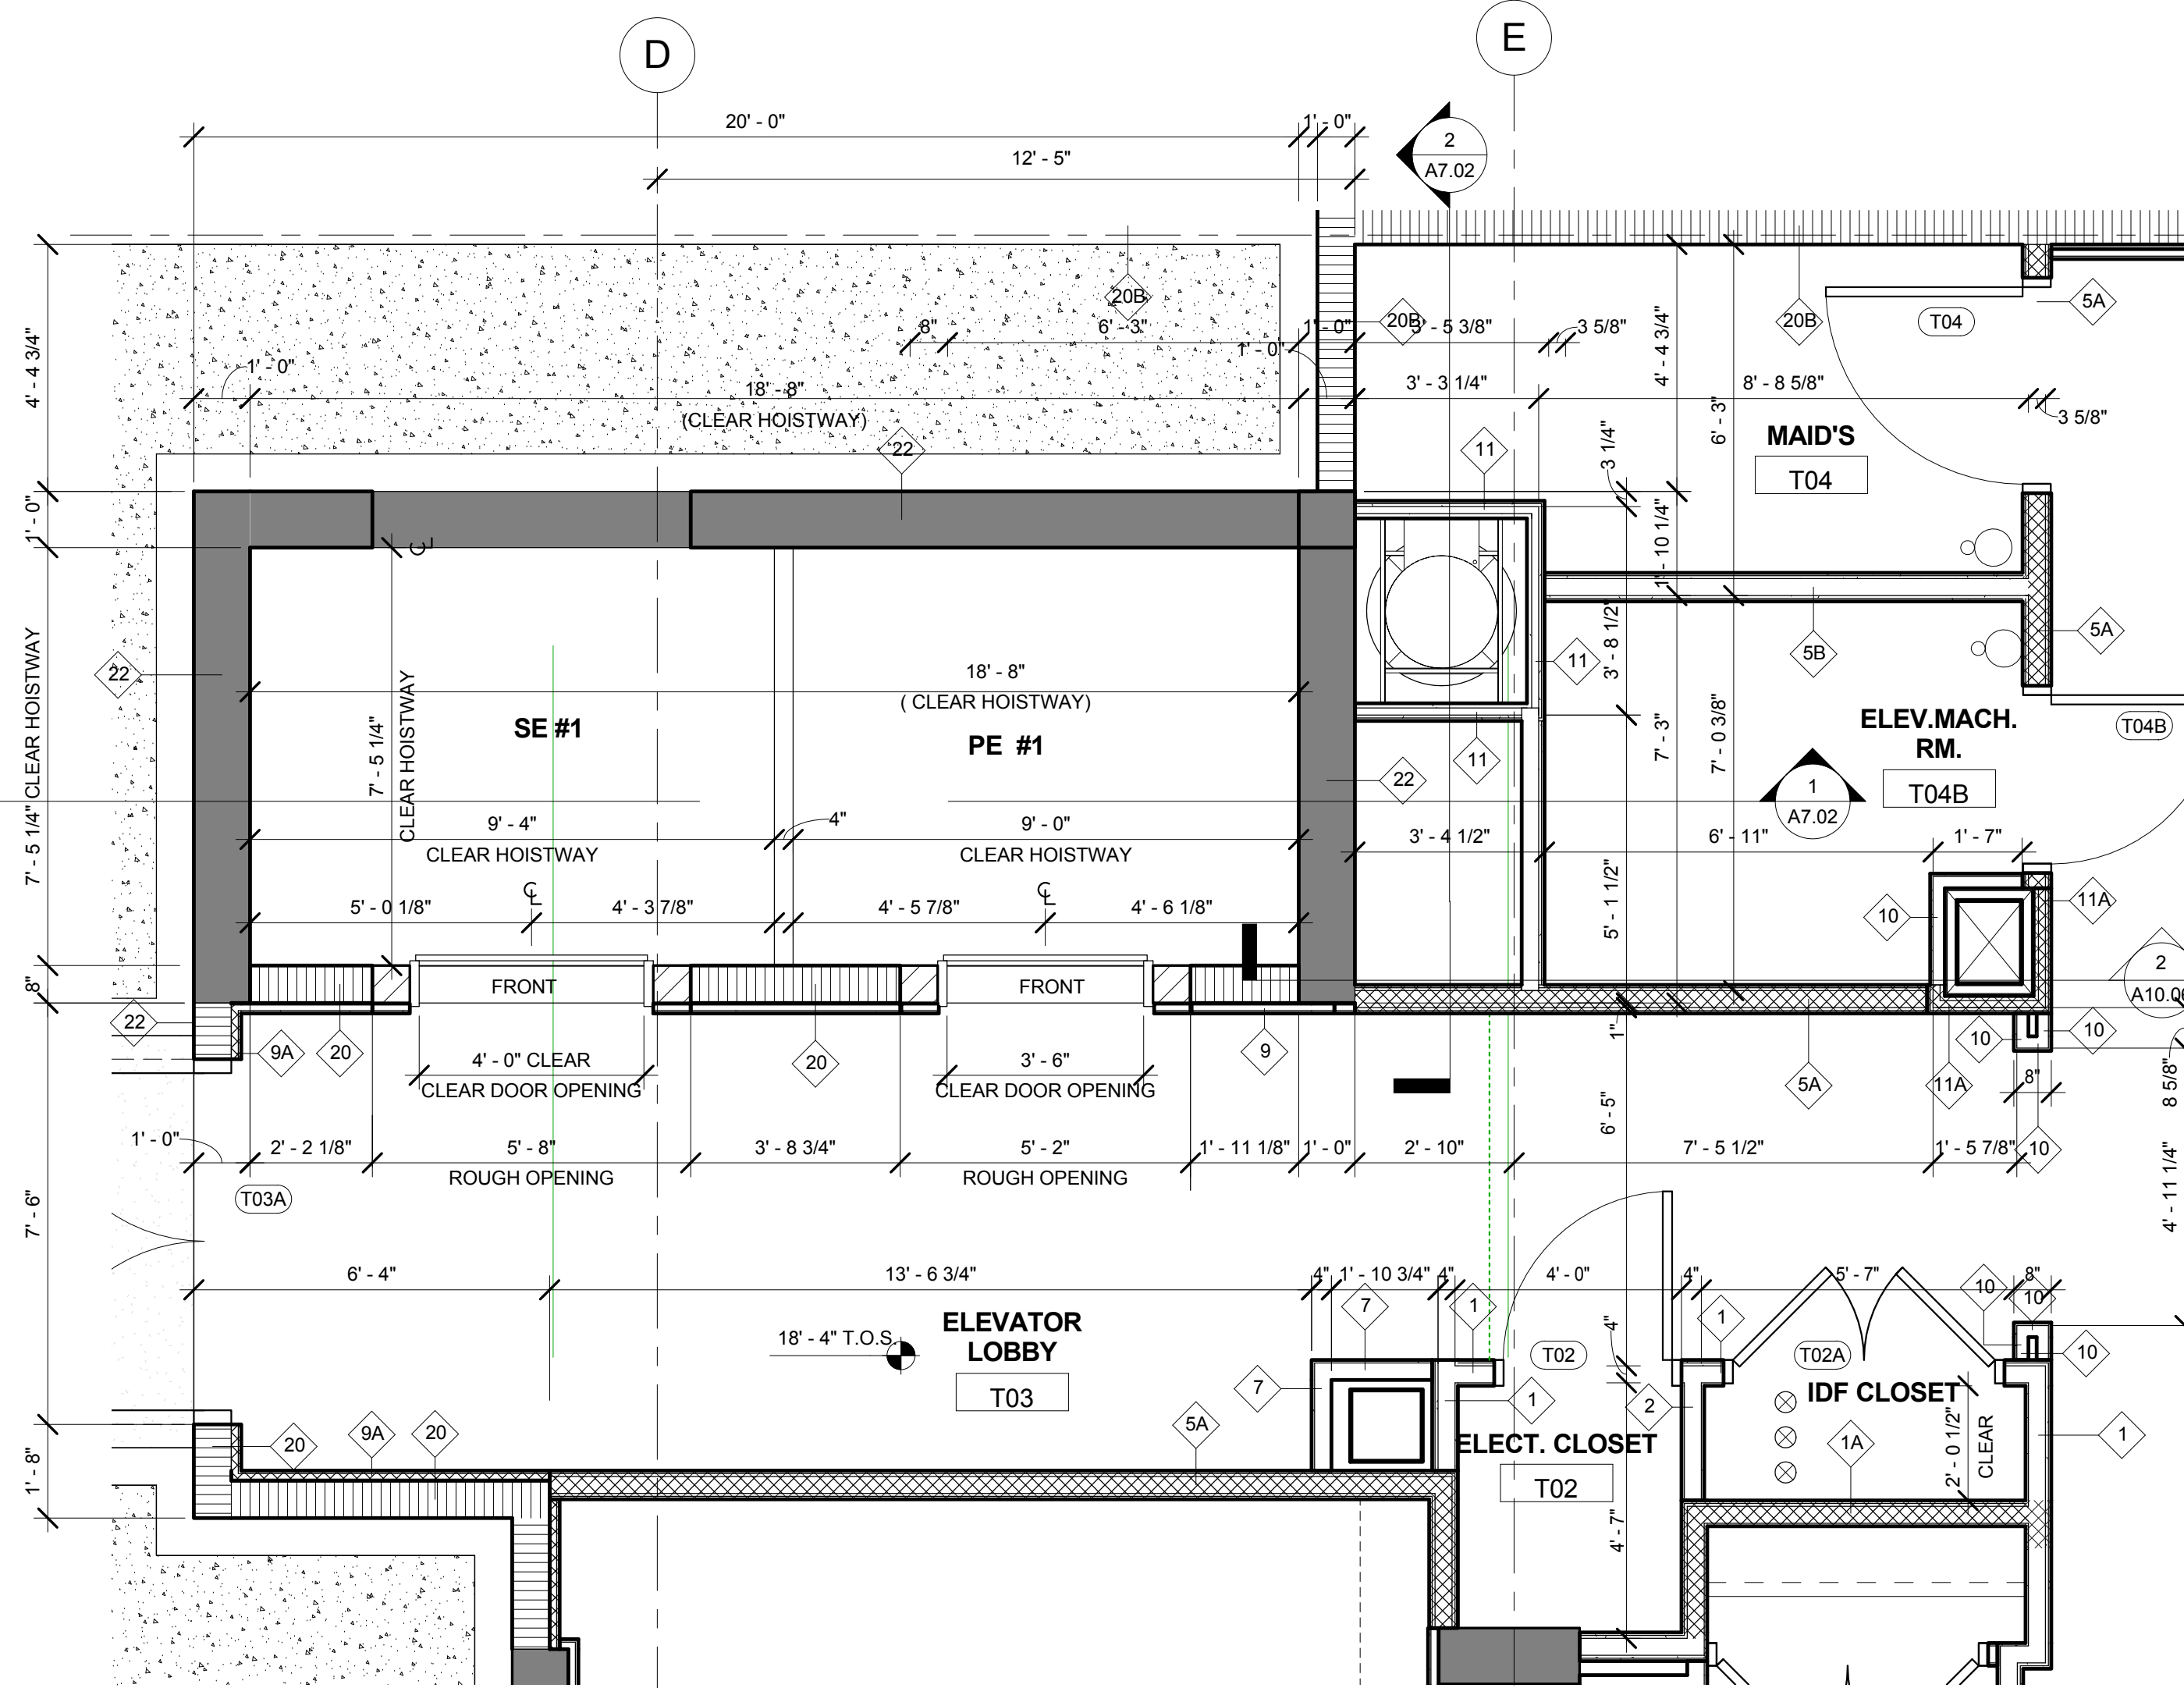

4
A7.00
ELEVATOR CORE - LEVEL 200
3/8" = 1'-0"

NOTE:
ALL ELEVATORS SHALL BE DESIGNED AND INSTALLED IN
ACCORDANCE WITH ASCE 24-05 7.5 AND FEMA TECHNICAL
BULLETIN 4-2010

ELEVATOR GENERAL NOTES:

GENERIC DRAWINGS:

- THESE DRAWINGS FOR GENERAL INFORMATION ONLY. REQUIREMENTS OF INDIVIDUAL VENDORS MAY VARY.
- THESE DRAWINGS SHALL BE DISTRIBUTED TO APPROPRIATE CONSULTING AND ENGINEERING FIRMS INCLUDING ARCHITECT, STRUCTURAL, ELECTRICAL AND MECHANICAL ENGINEERS
- FIELD VERIFY ALL EXISTING DIMENSIONS.
- ROUGH OPENING DIMENSIONS FOR ELEVATOR ENTRANCES APPLY ONLY IN THE CASE OF MASONRY OR CONCRETE CONSTRUCTION.
- VERTICAL STRUCTURAL SUPPORT FOR RAIL BRACKETING IS PROVIDED BY HOISTWAY WALL IN THE CASE OF REINFORCED CONCRETE HOISTWAY CONSTRUCTION.
- ELEVATOR SHAFT VENTILATION SHALL COMPLY WITH FBC SECTION 3004 AND 13-409 ABC.3.1

NOTES:

APPLICATION DESIGNED FOR:
OTIS
SCHINDLER
THYSSENKRUPP

PIT NOTES:

- PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 100 LUX (10 FC) ILLUMINATION AT PIT FLOOR.
 - PROVIDE PIT ACCESS LADDERS, LIGHT SWITCHES, LIGHTS, AND GFCI-PROTECTED UTILITY OUTLETS.
 - PROVIDE ONE PIT LADDER, LIGHT SWITCH, LIGHT FIXTURE, AND OUTLET PER ELEVATOR.
 - PROVIDE ADEQUATE STRUCTURAL SUPPORT REQUIRED FOR BUFFER AND RAIL FORCE REACTIONS
- PIT AND OVERHEAD PLANS INDICATE REACTIONS FOR MACHINE ROOM-LESS EQUIPMENT OF VARIOUS ELEVATOR VENDORS. WHERE REACTIONS OF DIFFERENT VENDORS OVERLAP, THE HIGHER REACTION IS INDICATED. REACTIONS FOR ONE VENDOR DO NOT OCCUR WITH THE REACTIONS OF OTHER VENDORS. OVERHEAD PLANS ARE NOT SHOWN FOR VENDORS WITH NO REACTIONS IN THE OVERHEAD.

- ELEVATOR PITTS SHALL COMPLY WITH ASME A17.1-2009 SECTION 2.2.2.2.3.3.4 THRU 2.2.2.6

CONTROL ROOM NOTES:

PROVIDE SELF-CLOSING, SELF-LOCKING CONTROL ROOM ACCESS DOOR. PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 200 LUX (19 FC) ILLUMINATION AT CONTROL ROOM FLOOR. PROVIDE LIGHT(S), LIGHT SWITCHES AND GFCI-PROTECTED UTILITY OUTLETS). COORDINATE LOCATIONS WITH ELEVATOR CONTRACTOR. FOR MOST VENDORS, CONTROLLER MUST BE WITHIN 80' WIRE RUN LENGTH FROM THE CORRESPONDING MACHINE AT THE TOP OF THE HOISTWAY.

OVERHEAD NOTES:

PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 200 LUX (19 FC) ILLUMINATION AT TOP OF HOISTWAY. PROVIDE LIGHTS, LIGHT SWITCHES AND GFCI-PROTECTED UTILITY OUTLETS. COORDINATE LOCATIONS WITH ELEVATOR CONTRACTOR. PROVIDE STRUCTURAL SUPPORT TO SUSTAIN REACTIONS INDICATED.

APPLICABLE STANDARDS:

- AMERICAN STANDARD SAFETY CODE FOR ELEVATORS, DUMBWATERS, ESCALATORS AND MOVING WALKS (ASME A17.1)
- FLORIDA BUILDING CODE ACCESSIBILITY - 2010 EDITION.
- FLORIDA BUILDING CODE CHAPTER 30 - 2010 EDITION.
- NATIONAL ELECTRICAL CODE
- OTHER SUCH STATE AND LOCAL CODES AS MAY BE APPLICABLE.

EMERGENCY SIGNS

AN APPROVED PICTORIAL SIGN OF STANDARDIZED DESIGN SHALL BE POSTED ADJACENT TO EACH ELEVATOR CALL STATION ON ALL FLOORS INSTRUCTING OCCUPANTS TO USE THE EXIT STAIRWAYS AND NOT TO USE ELEVATORS IN CASE OF FIRE. THE SIGN SHALL READ: IN FIRE EMERGENCY, DO NOT USE ELEVATOR, USE EXIT STAIRS.

AMBULANCE STRETCHER ELEVATOR

ELEVATOR CAR TO ACCOMMODATE AMBULANCE STRETCHER. THIS BUILDING MUST BE CONSTRUCTED TO CONTAIN AT LEAST ONE PASSENGER ELEVATOR THAT IS OPERATIONAL FOR BUILDING OCCUPANTS AND FIRE DEPARTMENT EMERGENCY ACCESS TO ALL FLOORS. THE ELEVATOR CAR SHALL BE OF SUCH SIZE AND ARRANGEMENT TO ACCOMMODATE AN AMBULANCE STRETCHER 34 INCHES BY 84 INCHES WITH NOT LESS THAN 5-INCH RADIUS CORNERS. IN THE HORIZONTAL, OPEN POSITION AND SHALL BE IDENTIFIED BY THE INTERNATIONAL SYMBOL FOR EMERGENCY MEDICAL SERVICES (STAR OF LIFE). THE SYMBOL SHALL NOT BE LESS THAN 3 INCHES HIGH AND SHALL BE PLACED INSIDE ON BOTH SIDES OF THE HOISTWAY DOOR FRAME.

TRACTION ELEVATOR EQUIPMENT

1 PASSENGER ELEVATOR, 1 SERVICE ELEVATOR

CAPACITY:

3500 # (PASSENGER PE # 1)
4000 # (PASSENGER / SERVICE PE-1/SE-1)

CLASS LOADING: PASSENGER CLASS A

CONTRACT SPEED:

ELEVATORS PE-1/SE-1, PE-2: 350 F.P.M.

ROPING SPEED: MANUFACTURER'S STANDARDS

MACHINE: GEARLESS MACHINE ROOM LESS

MACHINE LOCATION: REFER TO DRAWINGS

SUPERVISORY CONTROL: GROUP AUTOMATIC
MICROPROCESSOR- BASED SYSTEM

OPERATIONAL CONTROL: DUPLEX SELECTIVE COLLECTIVE

MICROPROCESSOR-BASED SYSTEM

MOTOR CONTROL: AC VARIABLE VOLTAGE VARIABLE
FREQUENCY, MICROPROCESSOR-BASED WITH DIGITAL
CLOSED-LOOP FEEDBACK

POWER CHARACTERISTICS: 480 VOLTS, 3 PHASE, 60 HERTZ

ELEVATOR QUANTITY - DESCRIPTION:

- 2- MAIN GUEST ELEVATORS PE # 1
- 1- SERVICE ELEVATOR SE #1

STOPS:

6 STOPS PE#1
7 STOPS SE#1

OPENINGS:

6 FRONT, 3 REAR; PE # 1
6 FRONT, 3 REAR; PE # 1

TRAVEL: REFER TO PLANS AND SECTIONS

PLATFORM SIZE:

3500 # STANDARD PASSENGER- PE#1
4000# SERVICE ELEVATOR -SE#1

CLEAR INSIDE SIZE:

3500 # STANDARD PASSENGER : 6'-8" WIDE X 5'-5 1/2" DEEP

ENTRANCE SIZE:


CO 42" W X 84" H (PASSENGER)

ENTRANCE TYPE:


CENTER OPENING

#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/13/15
3	Revisions	06-12-15
4	Revisions	06-14-15
5	Revisions	06-14-15
6	Revisions	11-24-15
7	HFB FILE #7582/ Bldg Dept comments	


C:\Users\mhiciano\Documents\12064-ANGLERS-HOTEL_mhiciano.rvt
4/20/2016 4:30:21 PM

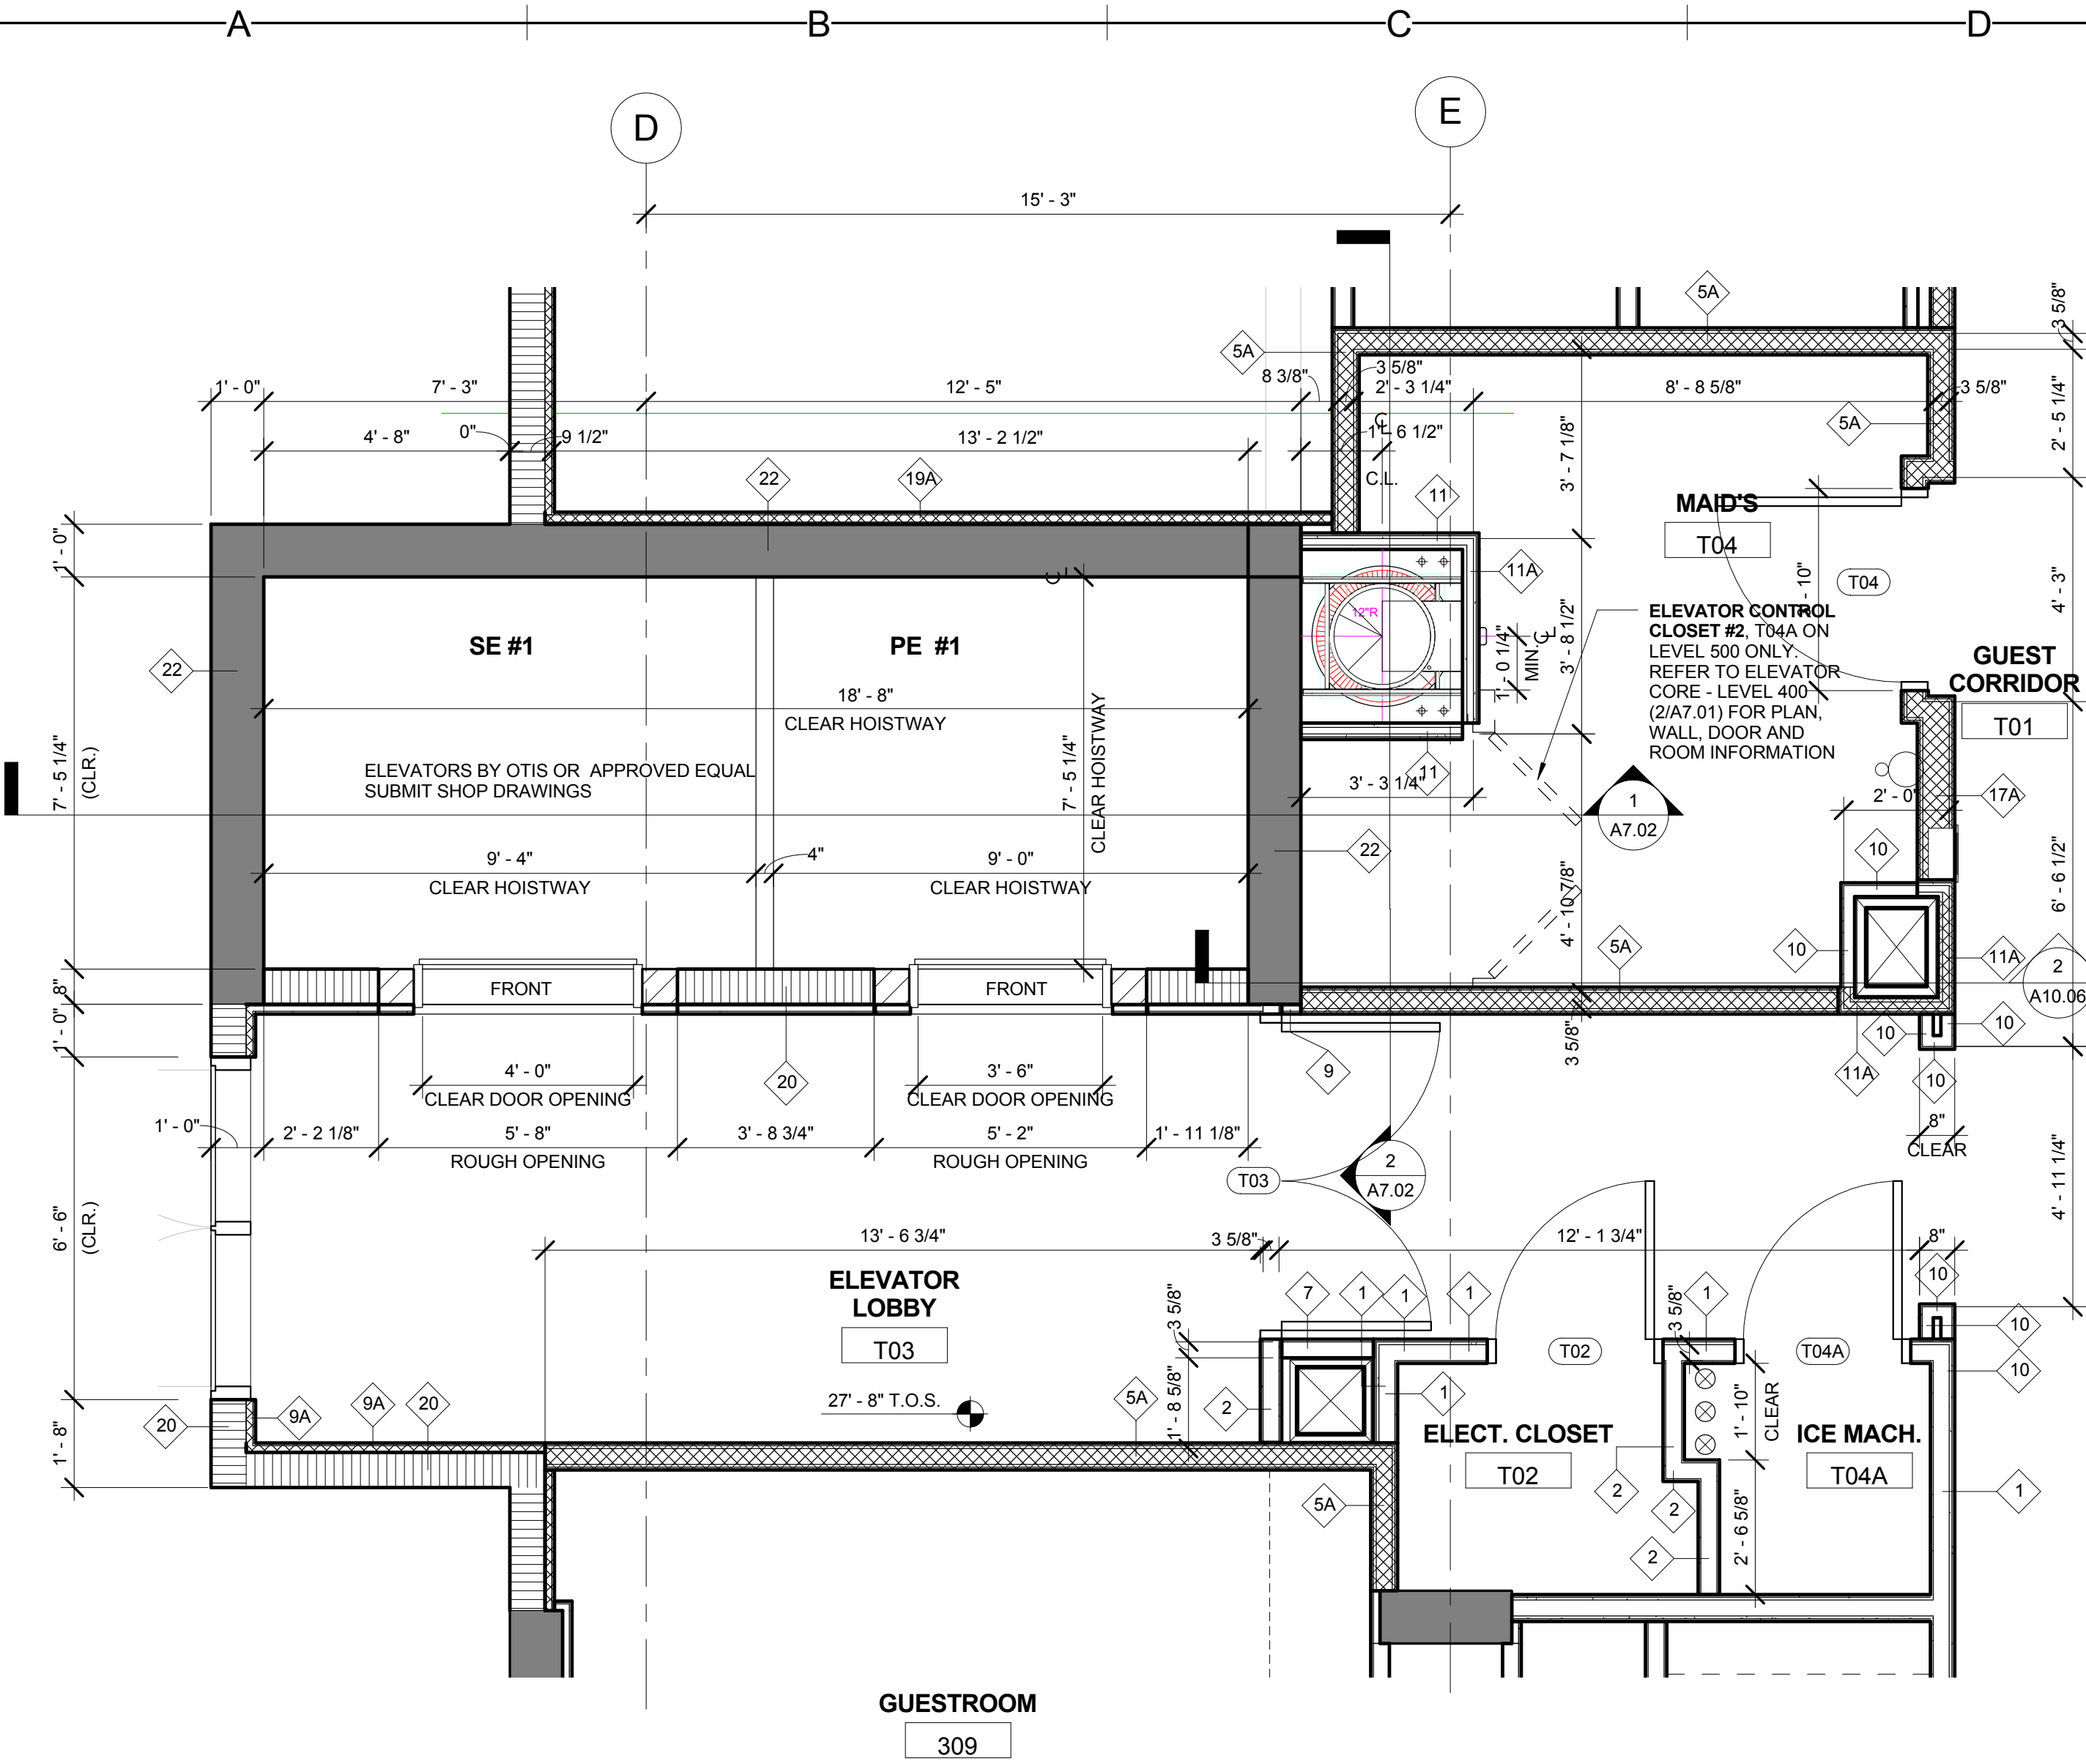


1 ELEVATOR CORE - LEVEL 300 & 500
A7.01 3/8" = 1'-0"

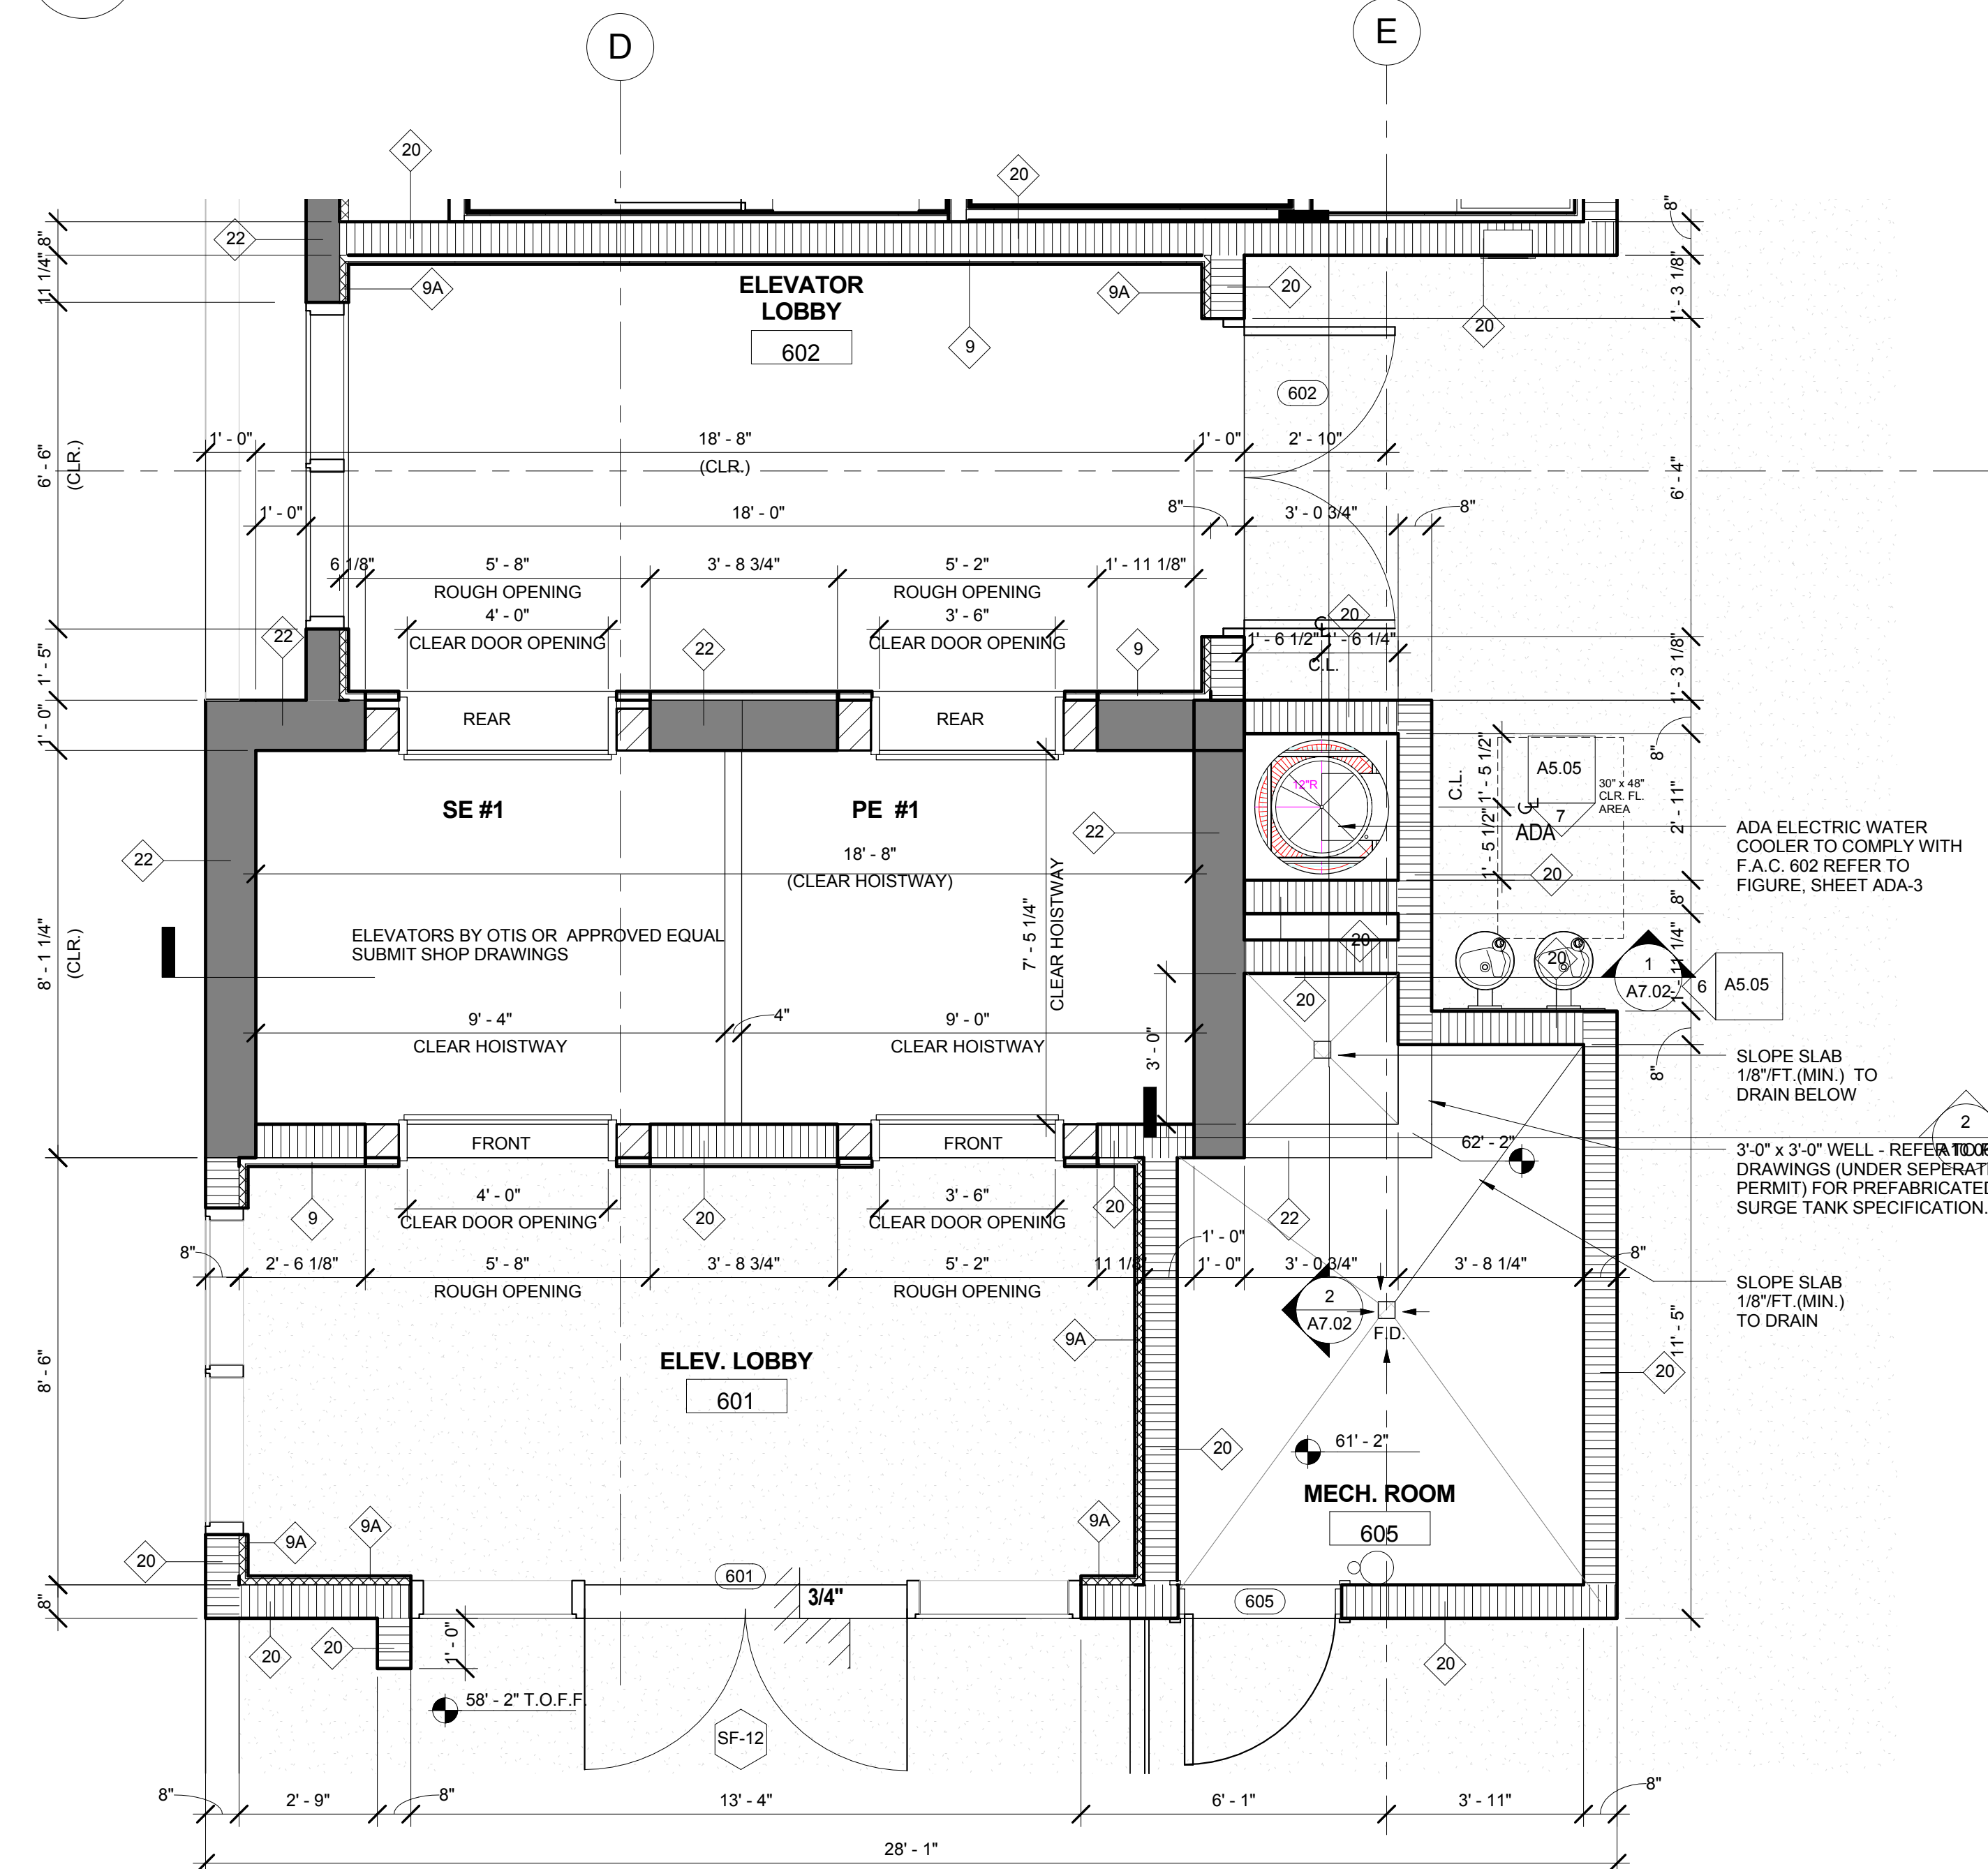


3 ELEVATOR CORE - UPPER & LOWER POOL DECK
A7.01 3/8" = 1'-0"

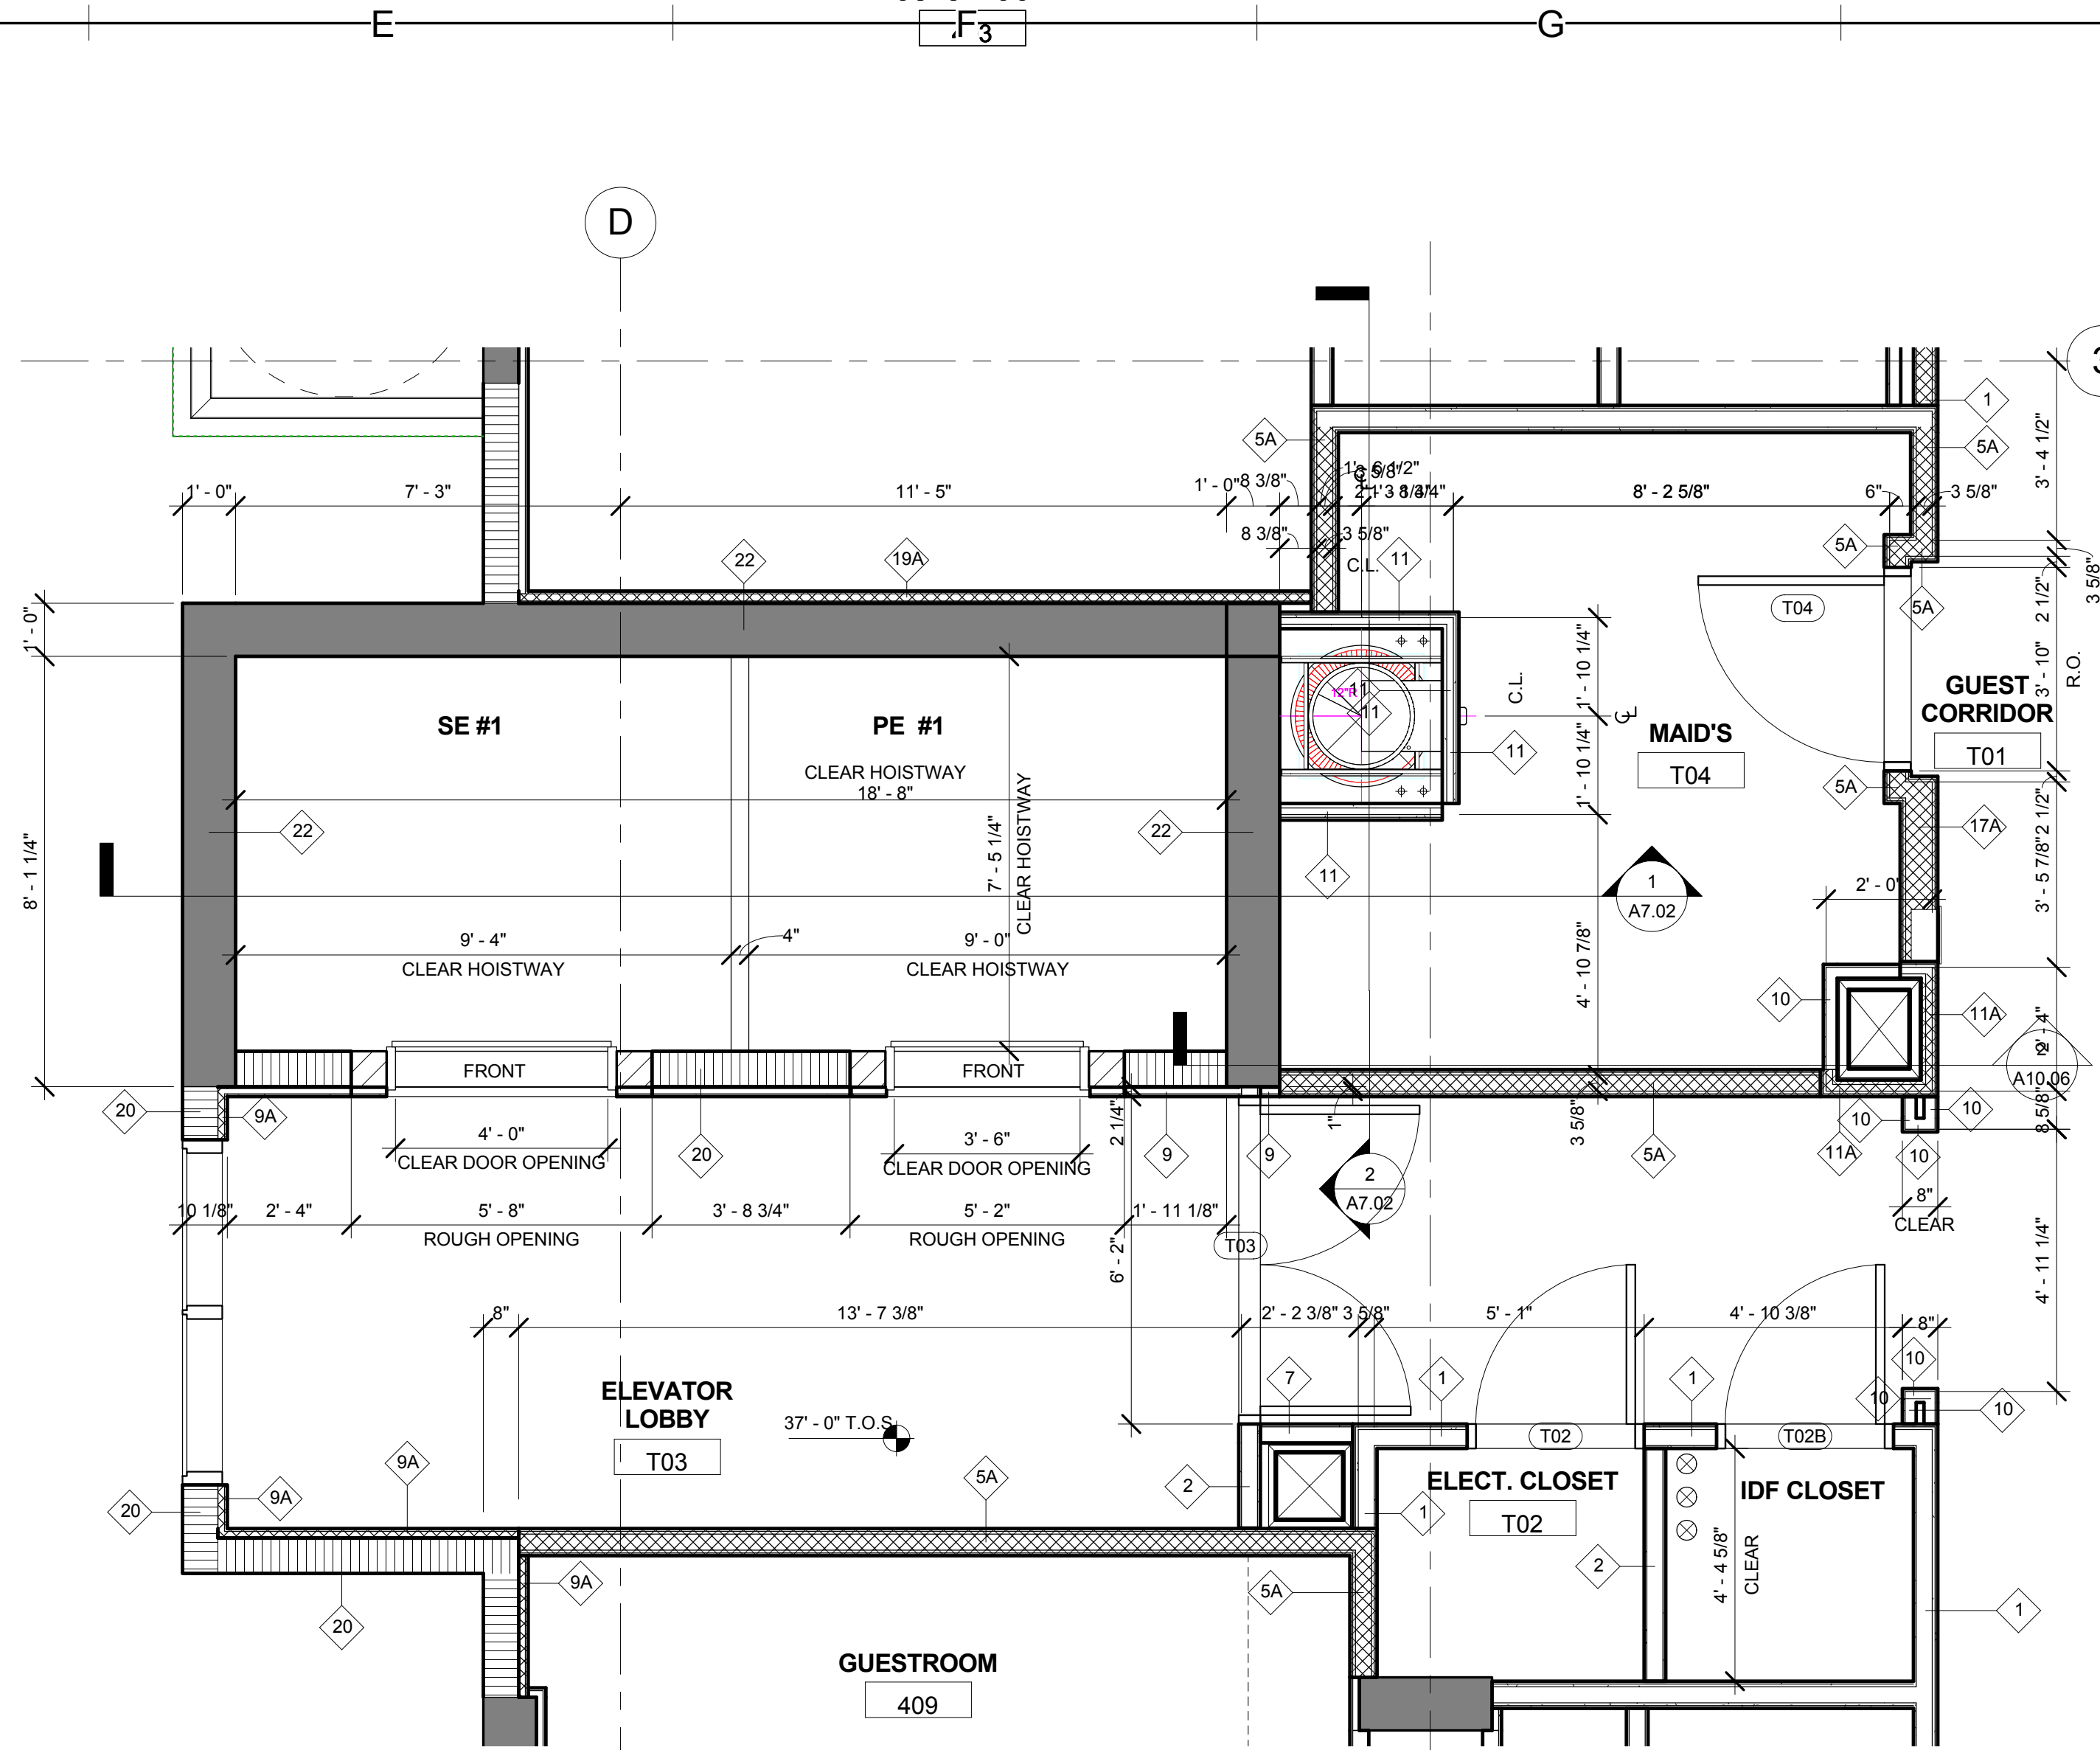

2 ELEVATOR CORE - LEVELS 400
A7.01 3/8" = 1'-0"

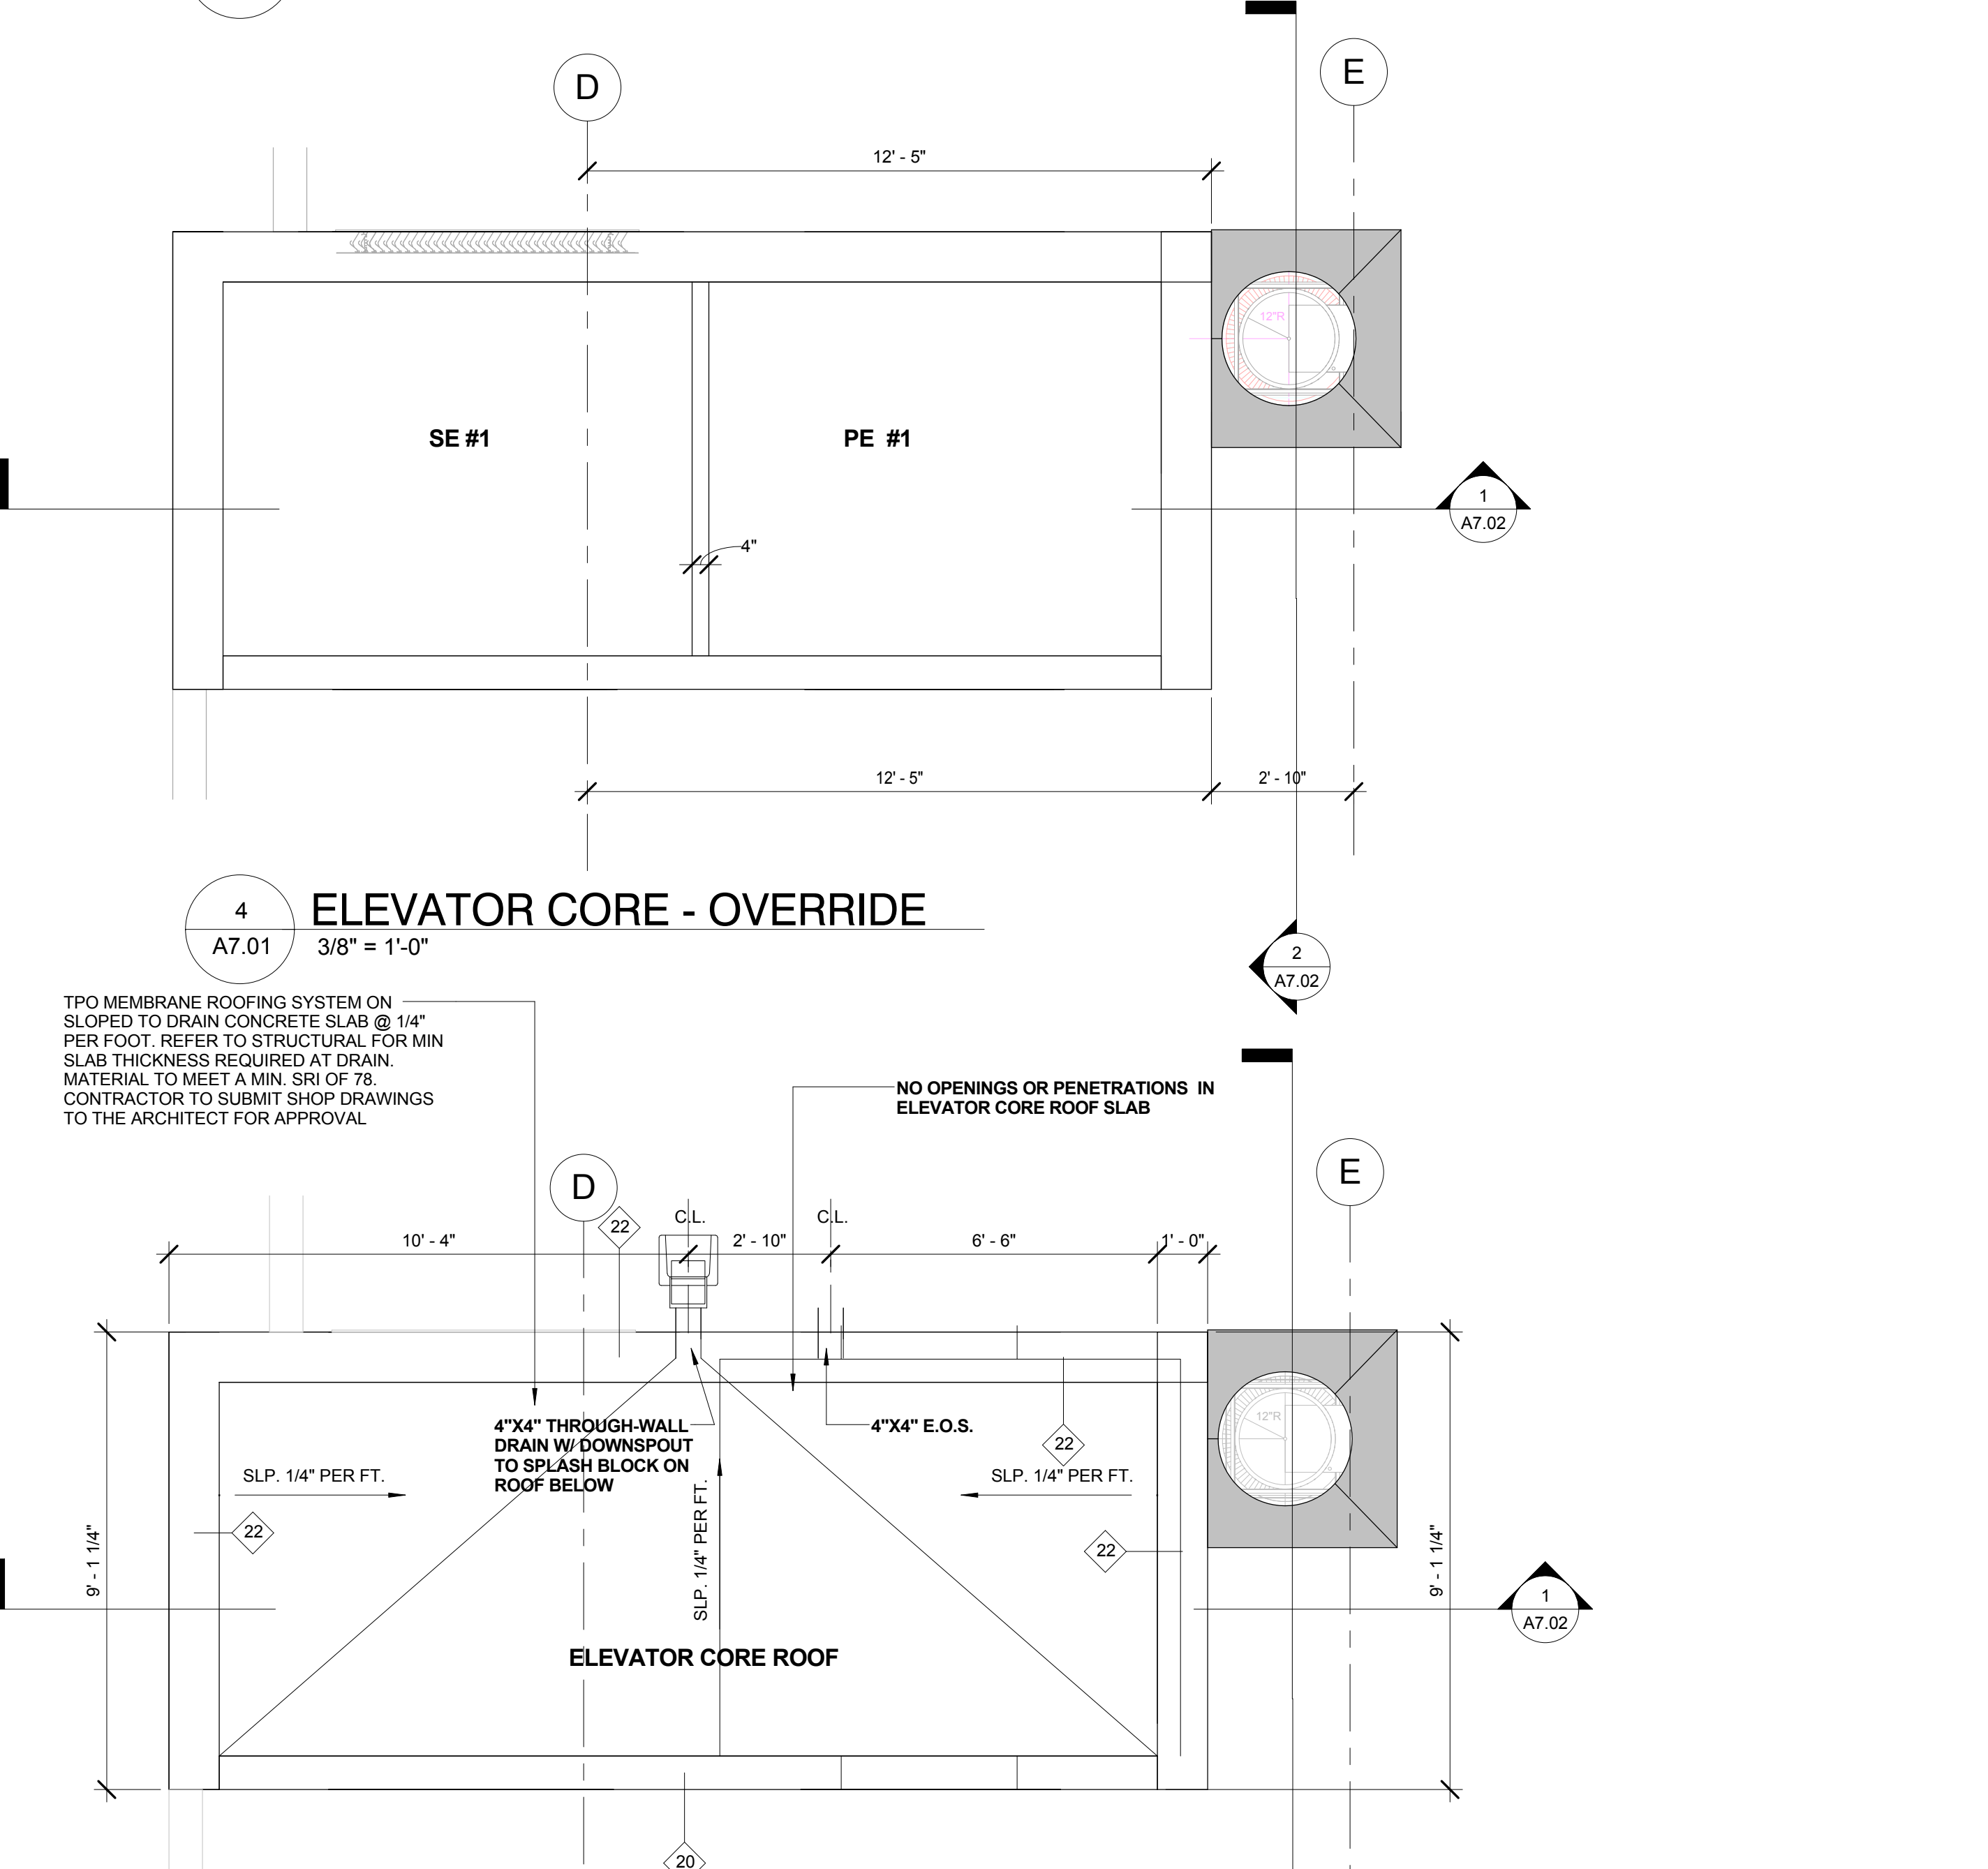

4 ELEVATOR CORE - OVERRIDE
A7.01 3/8" = 1'-0"

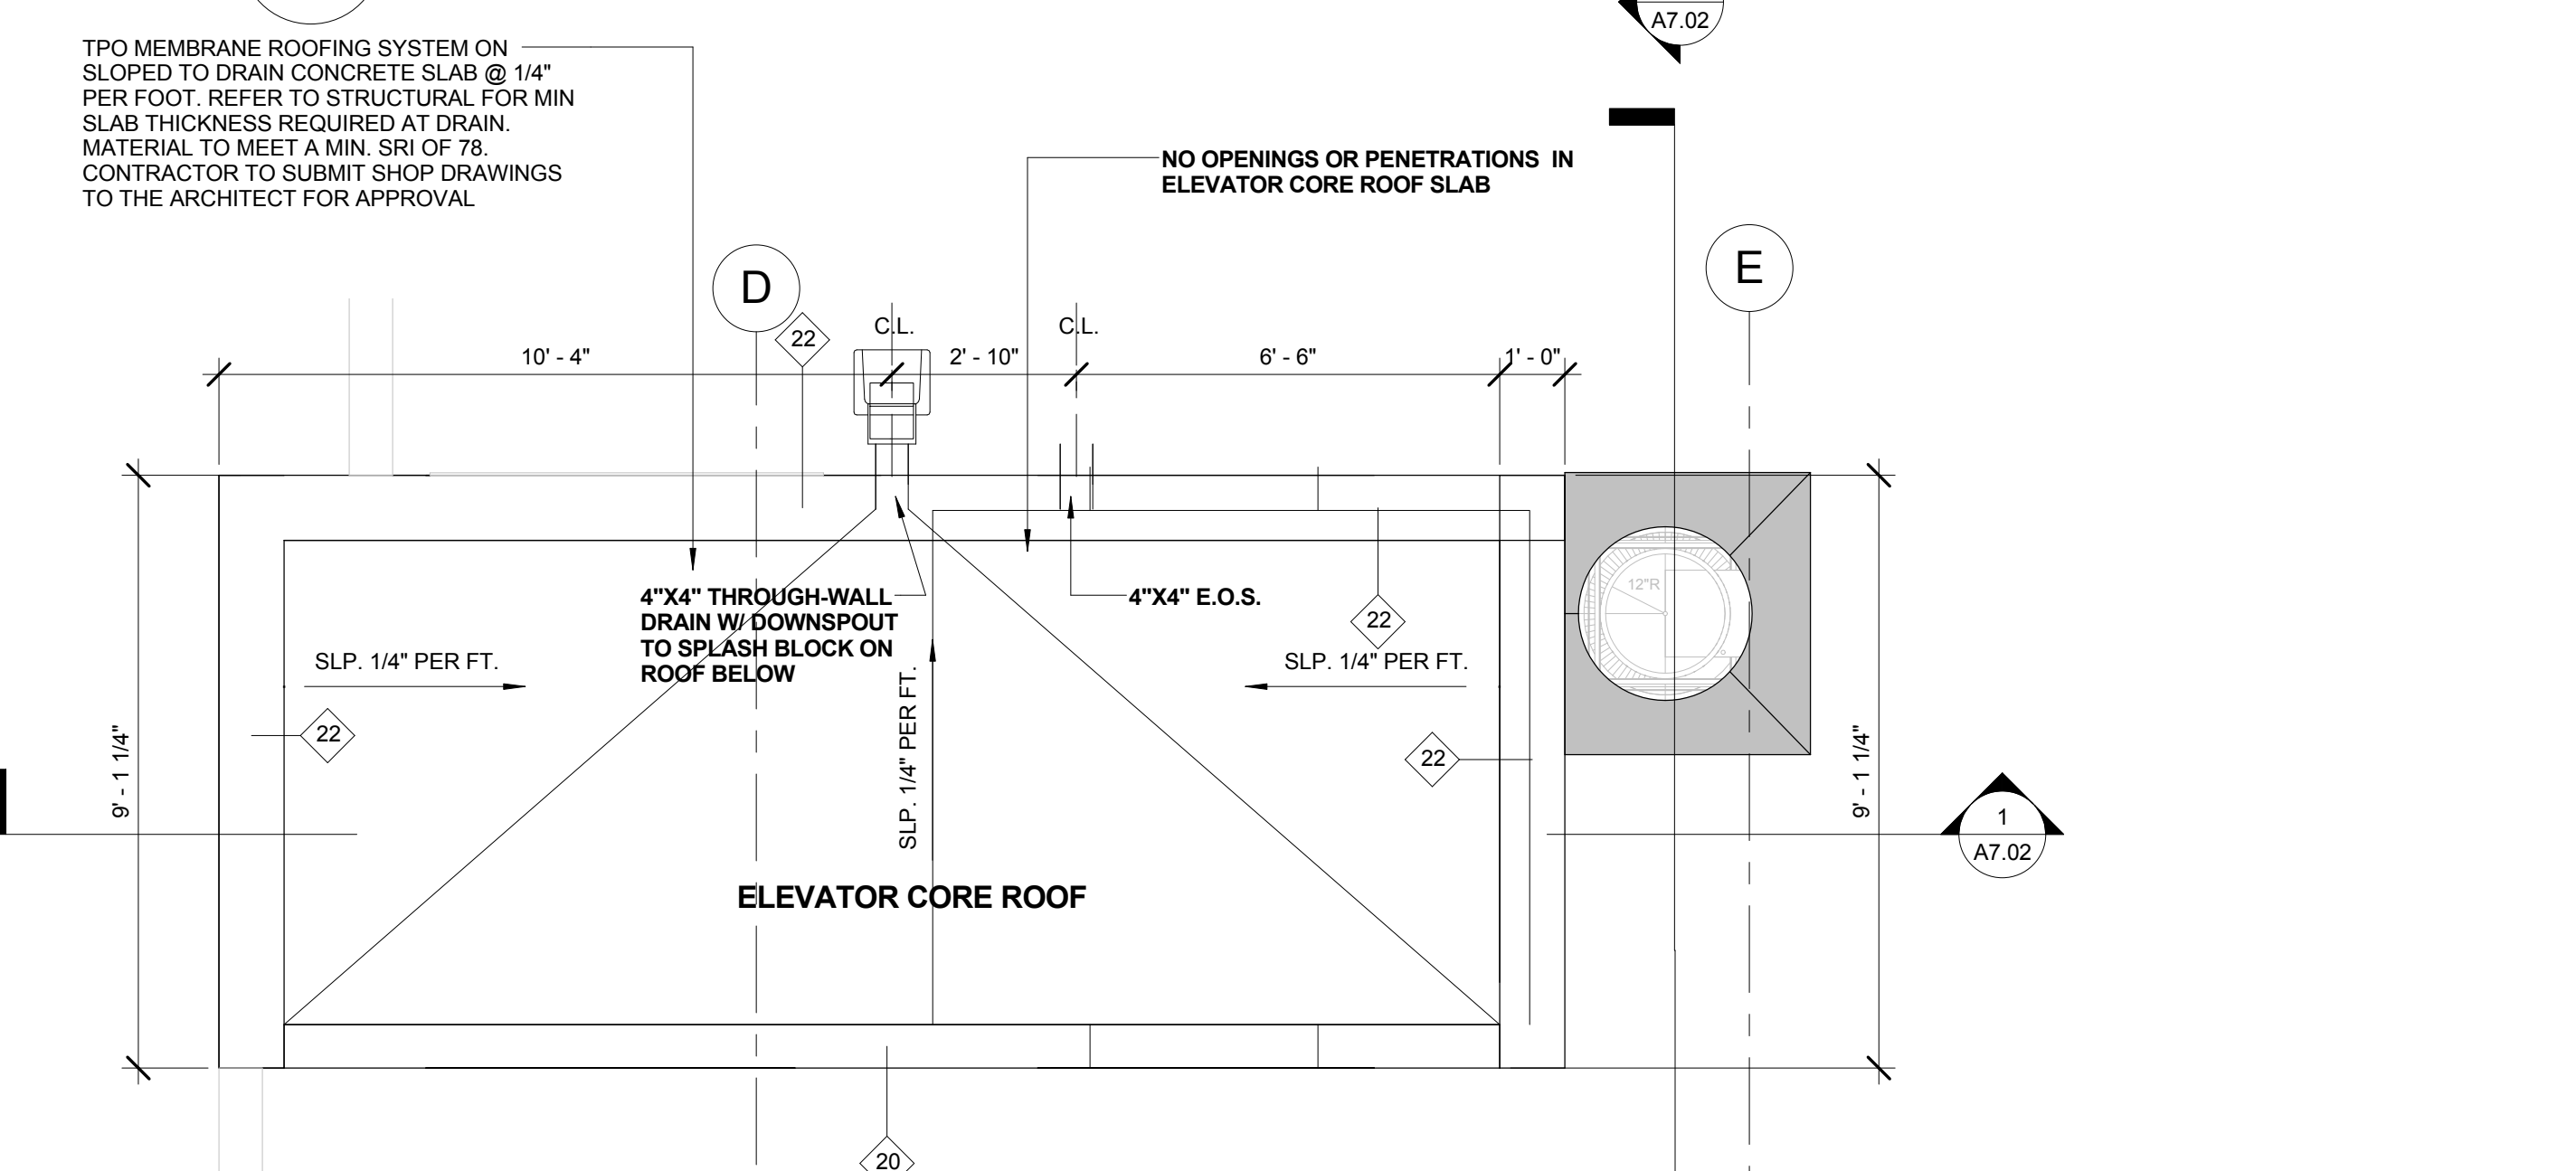

5 ELEVATOR CORE ROOF
A7.01 3/8" = 1'-0"

ELEVATOR GENERAL NOTES:

GENERIC DRAWINGS:

- THESE DRAWINGS FOR GENERAL INFORMATION ONLY. REQUIREMENTS OF INDIVIDUAL VENDORS MAY VARY.
- THESE DRAWINGS SHALL BE DISTRIBUTED TO APPROPRIATE CONSULTING AND ENGINEERING FIRMS INCLUDING ARCHITECT, STRUCTURAL, ELECTRICAL AND MECHANICAL ENGINEERS
- FIELD VERIFY ALL EXISTING DIMENSIONS.
- ROUGH OPENING DIMENSIONS FOR ELEVATOR ENTRANCES APPLY ONLY IN THE CASE OF MASONRY OR CONCRETE CONSTRUCTION.
- VERTICAL STRUCTURAL SUPPORT FOR RAIL BRACKETING IS PROVIDED BY HOISTWAY WALL IN THE CASE OF REINFORCED CONCRETE HOISTWAY CONSTRUCTION.
- ELEVATOR SHAFT VENTILATION SHALL COMPLY WITH FBC SECTION 3004 AND 13-409 ABC.3.1

NOTES:

APPLICATION DESIGNED FOR:
OTIS
SCHINDLER
THYSSENKRUPP

PIT NOTES:

- PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 100 LUX (10 FC) ILLUMINATION AT PIT FLOOR.
- PROVIDE PIT ACCESS LADDERS, LIGHT SWITCHES, LIGHTS, AND GFCI-PROTECTED UTILITY OUTLETS.
- PROVIDE ONE PIT LADDER, LIGHT SWITCH, LIGHT FIXTURE, AND OUTLET PER ELEVATOR.
- PROVIDE ADEQUATE STRUCTURAL SUPPORT REQUIRED FOR BUFFER AND RAIL FORCE REACTIONS

PIT AND OVERHEAD PLANS INDICATE REACTIONS FOR MACHINE ROOM LESS EQUIPMENT OF VARIOUS ELEVATOR VENDORS. WHERE REACTIONS OF DIFFERENT VENDORS OVERLAP, THE HIGHER REACTION IS INDICATED. REACTIONS FOR ONE VENDOR DO NOT OCCUR WITH THE REACTIONS OF OTHER VENDORS. OVERHEAD PLANS ARE NOT SHOWN FOR VENDORS WITH NO REACTIONS IN THE OVERHEAD.

- ELEVATOR PITS SHALL COMPLY WITH ASME A17.1-2009 SECTION 2.2.2.2.3.3.4 THRU 2.2.2.6

CONTROL ROOM NOTES:

PROVIDE SELF-CLOSING, SELF-LOCKING CONTROL ROOM ACCESS DOOR. PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 200 LUX (19 FC) ILLUMINATION AT CONTROL ROOM FLOOR. PROVIDE LIGHTS, LIGHT SWITCHES AND GFCI-PROTECTED UTILITY OUTLET(S). COORDINATE LOCATIONS WITH ELEVATOR CONTRACTOR. FOR MOST VENDORS, CONTROLLER MUST BE WITHIN 80 WIRE RUN LENGTH FROM THE CORRESPONDING MACHINE AT THE TOP OF THE HOISTWAY.

OVERHEAD NOTES:

PROVIDE ADEQUATE LIGHTING TO MAINTAIN MIN. 200 LUX (19 FC) ILLUMINATION AT TOP OF HOISTWAY. PROVIDE LIGHTS, LIGHT SWITCHES AND GFCI-PROTECTED UTILITY OUTLETS. COORDINATE LOCATIONS WITH ELEVATOR CONTRACTOR. PROVIDE STRUCTURAL SUPPORT TO SUSTAIN REACTIONS INDICATED.

APPLICABLE STANDARDS:

- AMERICAN STANDARD SAFETY CODE FOR ELEVATORS, DUMBWATERS, ESCALATORS AND MOVING WALKS (ASME A17.1)
- FLORIDA BUILDING CODE ACCESSIBILITY - 2010 EDITION.
- FLORIDA BUILDING CODE CHAPTER 30 - 2010 EDITION.
- NATIONAL ELECTRICAL CODE
- OTHER SUCH STATE AND LOCAL CODES AS MAY BE APPLICABLE.

EMERGENCY SIGNS

AN APPROVED PICTORIAL SIGN OF STANDARDIZED DESIGN SHALL BE POSTED ADJACENT TO EACH ELEVATOR CALL STATION ON ALL FLOORS INSTRUCTING OCCUPANTS TO USE THE EXIT STAIRWAYS AND NOT TO USE ELEVATORS IN CASE OF FIRE. THE SIGN SHALL READ: IN FIRE EMERGENCY, DO NOT USE ELEVATOR, USE EXIT STAIRS.

AMBULANCE STRETCHER ELEVATOR

ELEVATOR CAR TO ACCOMMODATE AMBULANCE STRETCHER. THIS BUILDING MUST BE CONSTRUCTED TO CONTAIN AT LEAST ONE PASSENGER ELEVATOR THAT IS OPERATIONAL FOR BUILDING OCCUPANTS AND FIRE DEPARTMENT EMERGENCY ACCESS TO ALL FLOORS. THE ELEVATOR CAR SHALL BE OF SUCH SIZE AND ARRANGEMENT TO ACCOMMODATE AN AMBULANCE STRETCHER 24 INCHES BY 84 INCHES WITH NOT LESS THAN 5 INCH RADIUS CORNERS. IN THE HORIZONTAL, OPEN POSITION AND SHALL BE IDENTIFIED BY THE INTERNATIONAL SYMBOL FOR EMERGENCY MEDICAL SERVICES (STAR OF LIFE). THE SYMBOL SHALL NOT BE LESS THAN 3 INCHES HIGH AND SHALL BE PLACED INSIDE ON BOTH SIDES OF THE HOISTWAY DOOR FRAME.

TRACTION ELEVATOR EQUIPMENT

1 PASSENGER ELEVATOR, 1 SERVICE ELEVATOR

CAPACITY:

3500 # (PASSENGER PE #1)
4000 # (PASSENGER / SERVICE PE-1/SE-1)

CLASS LOADING: PASSENGER CLASS A

CONTRACT SPEED:
ELEVATORS PE-1/SE-1, PE-2: 350 F.P.M.

ROPING SPEED: MANUFACTURER'S STANDARDS

MACHINE: GEARLESS MACHINE ROOM LESS

MACHINE LOCATION: REFER TO DRAWINGS

SUPERVISORY CONTROL: GROUP AUTOMATIC
MICROPROCESSOR-BASED SYSTEM

OPERATIONAL CONTROL: DUPLEX SELECTIVE COLLECTIVE
MICROPROCESSOR-BASED SYSTEM

MOTOR CONTROL: AC VARIABLE VOLTAGE VARIABLE
FREQUENCY, MICROPROCESSOR-BASED WITH DIGITAL
CLOSED-LOOP FEEDBACK

POWER CHARACTERISTICS: 480 VOLTS, 3 PHASE, 60 HERTZ

ELEVATOR QUANTITY - DESCRIPTION:

2 - MAIN GUEST ELEVATORS PE #1
1 - SERVICE ELEVATOR SE #1

STOPS:
6 STOPS PE#1
7 STOPS SE#1

OPENINGS:
6 FRONT, 3 REAR; PE #1
6 FRONT, 3 REAR; PE #1

TRAVEL: REFER TO PLANS AND SECTIONS

PLATFORM SIZE:

3500 # STANDARD PASSENGER- PE#1
4000# SERVICE ELEVATOR -SE#1

CLEAR INSIDE SIZE:

3500 # STANDARD PASSENGER : 6'-8" WIDE X 5'-1/2" DEEP

ENTRANCE SIZE:

CO 42" W X 84" H (PASSENGER)


ENTRANCE TYPE:

CENTER OPENING


REVISIONS		
#	Description	Date
2	CMR Bldg. Dept. Comments	01/15/16
3	CMR Bldg. Dept. Comments	03/29/15
5	Revisions	06-12-15
6	Revision 6	06-14-15
7	HFR FILE #7582/ Bldg Dept comments	11-24-15

2'-6" X 6'-0" (6 SQ. FT. FREE AIR WITH A 50% FREE AIR LOUVER.) ALUMINUM LOUVER FOR ELEVATOR HOISTWAY VENTILATION INSTALLED AS PER MANUFACTURE REFER TO MEP DWGS. FOR DAMPER REQUIREMENTS INFORMATION. CONTRACTOR TO SUBMIT SHOP DRAWINGS. COLOR TO BE SELECTED BY THE ARCHITECT.

PROVIDE OPERABLE LOUVER AS REQUIRED BY OTIS LOUVER TO BE TIED TO FIRE ALARM AND TO BE OPENED UPON ANY SMOKE OR FIRE FROM WITHIN THE ELEVATOR SHAFT. LOUVER SHALL REMAIN CLOSED AT ALL OTHERWISE.

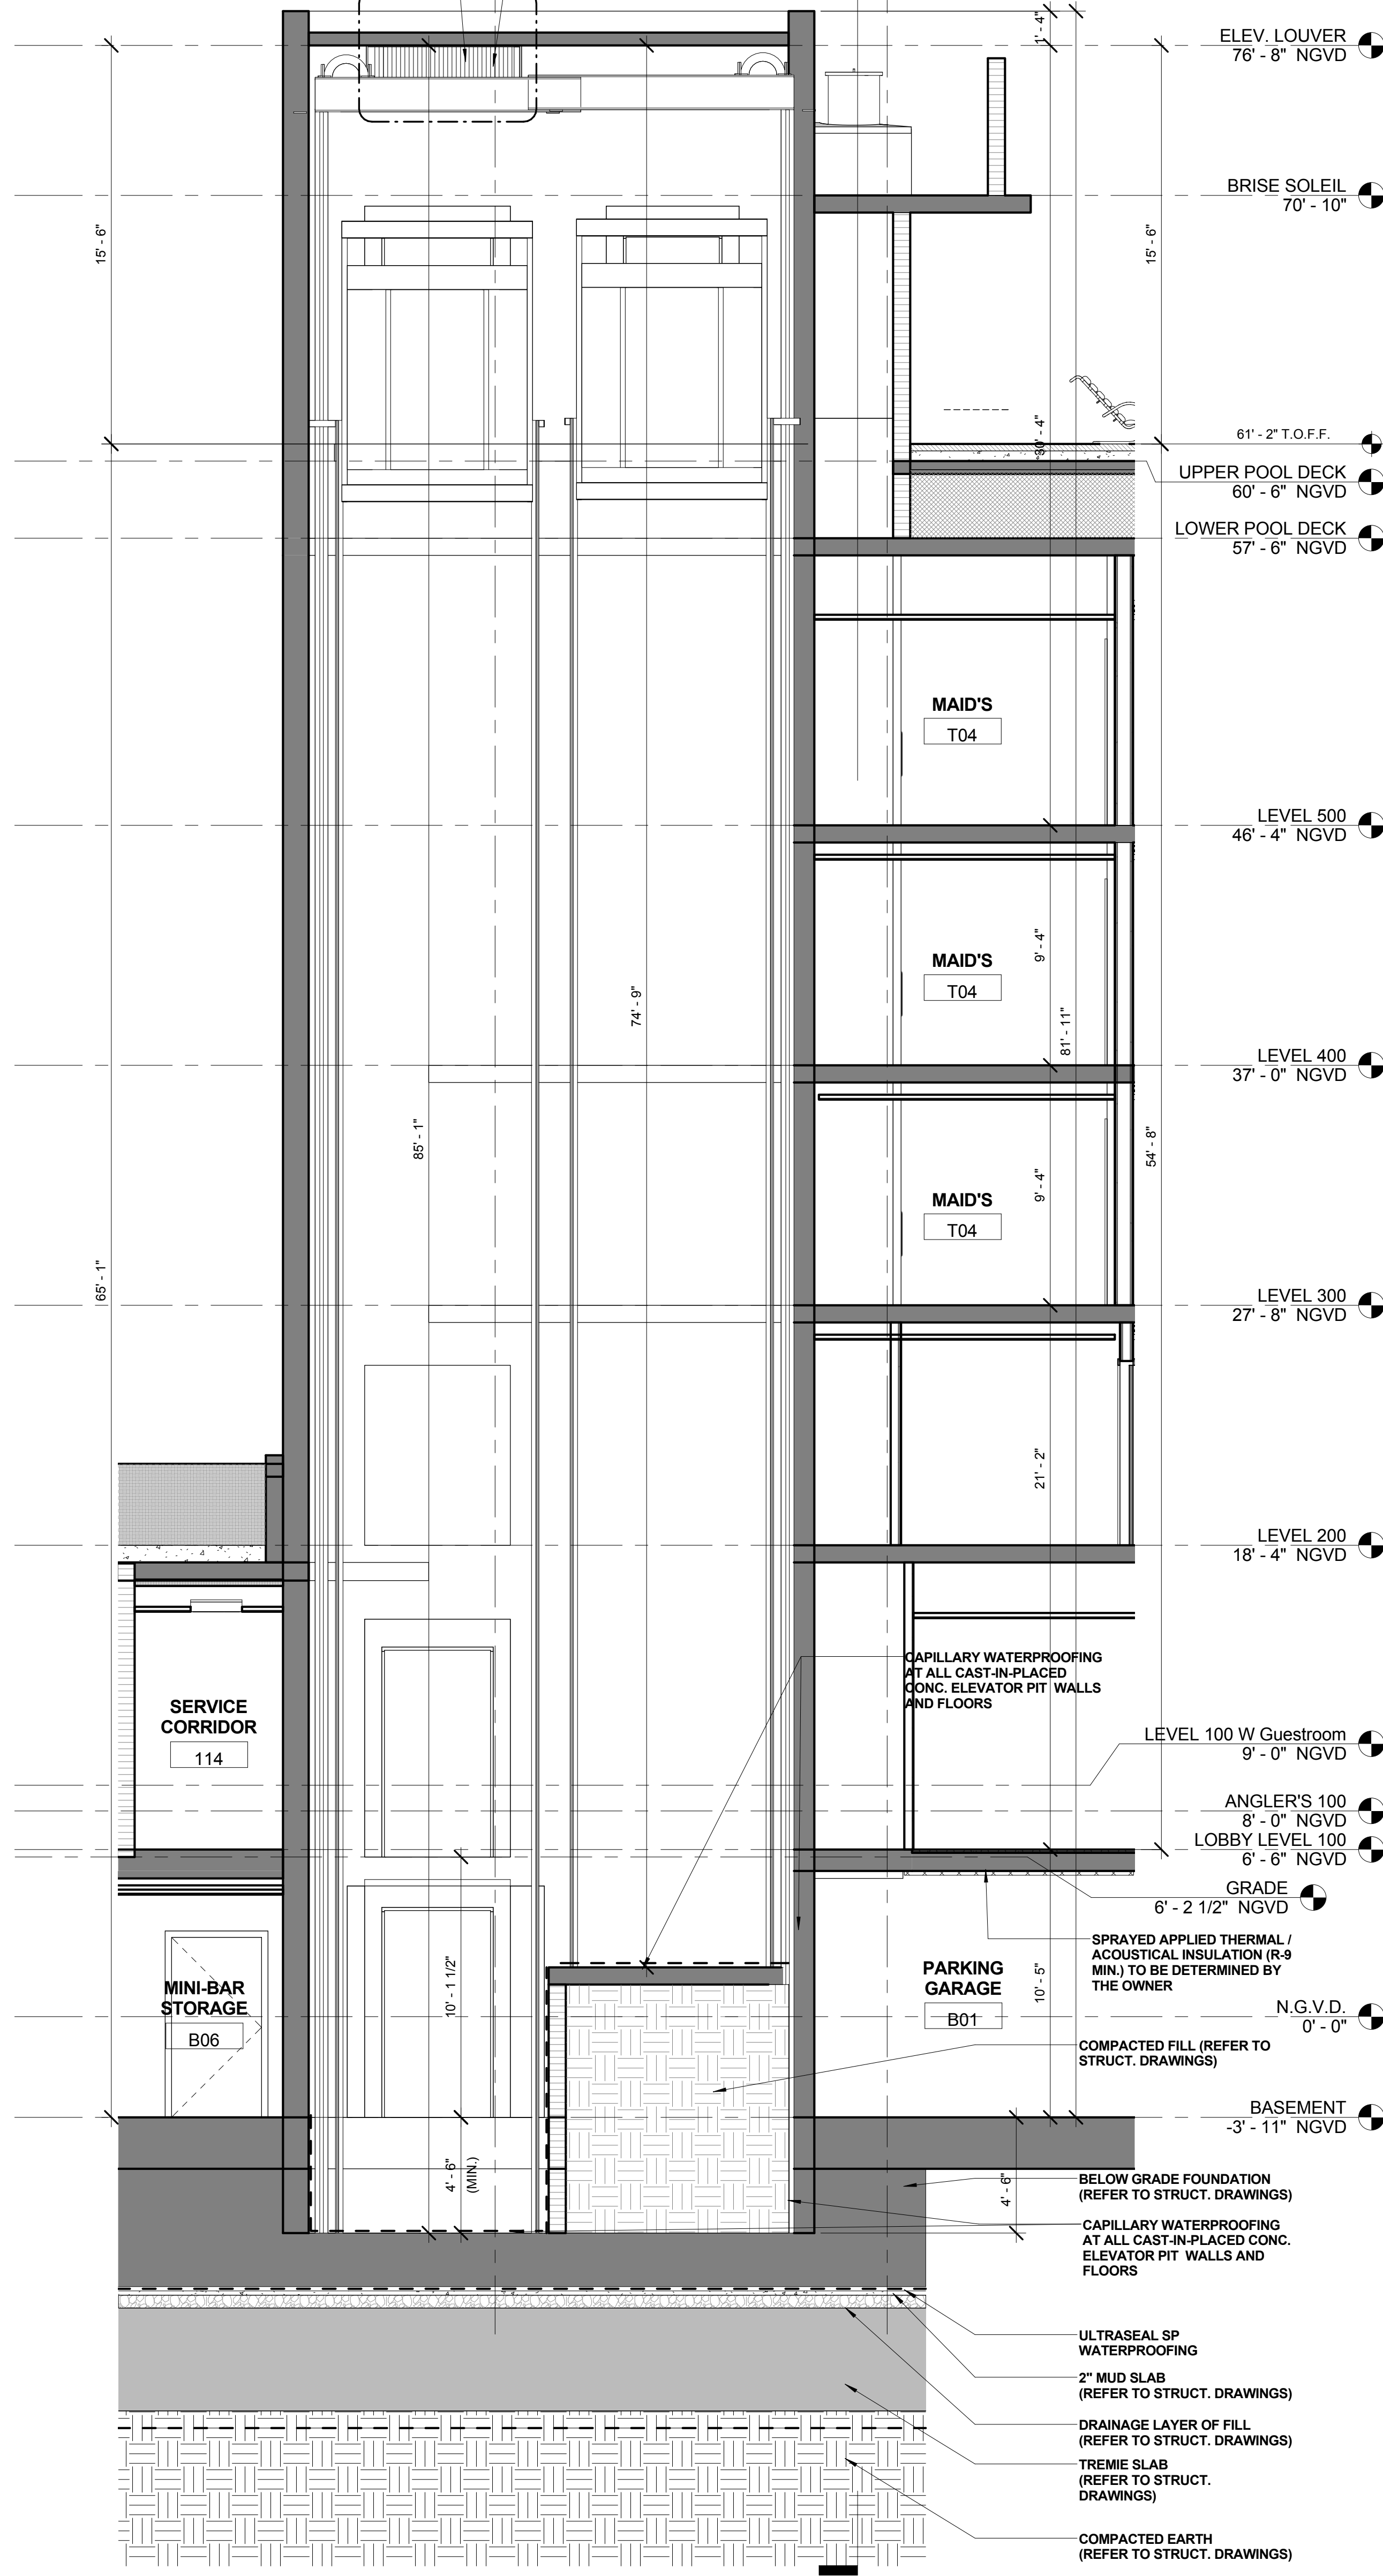

1
A7.02
SECTION - ELEVATOR CORE
1/4" = 1'-0"

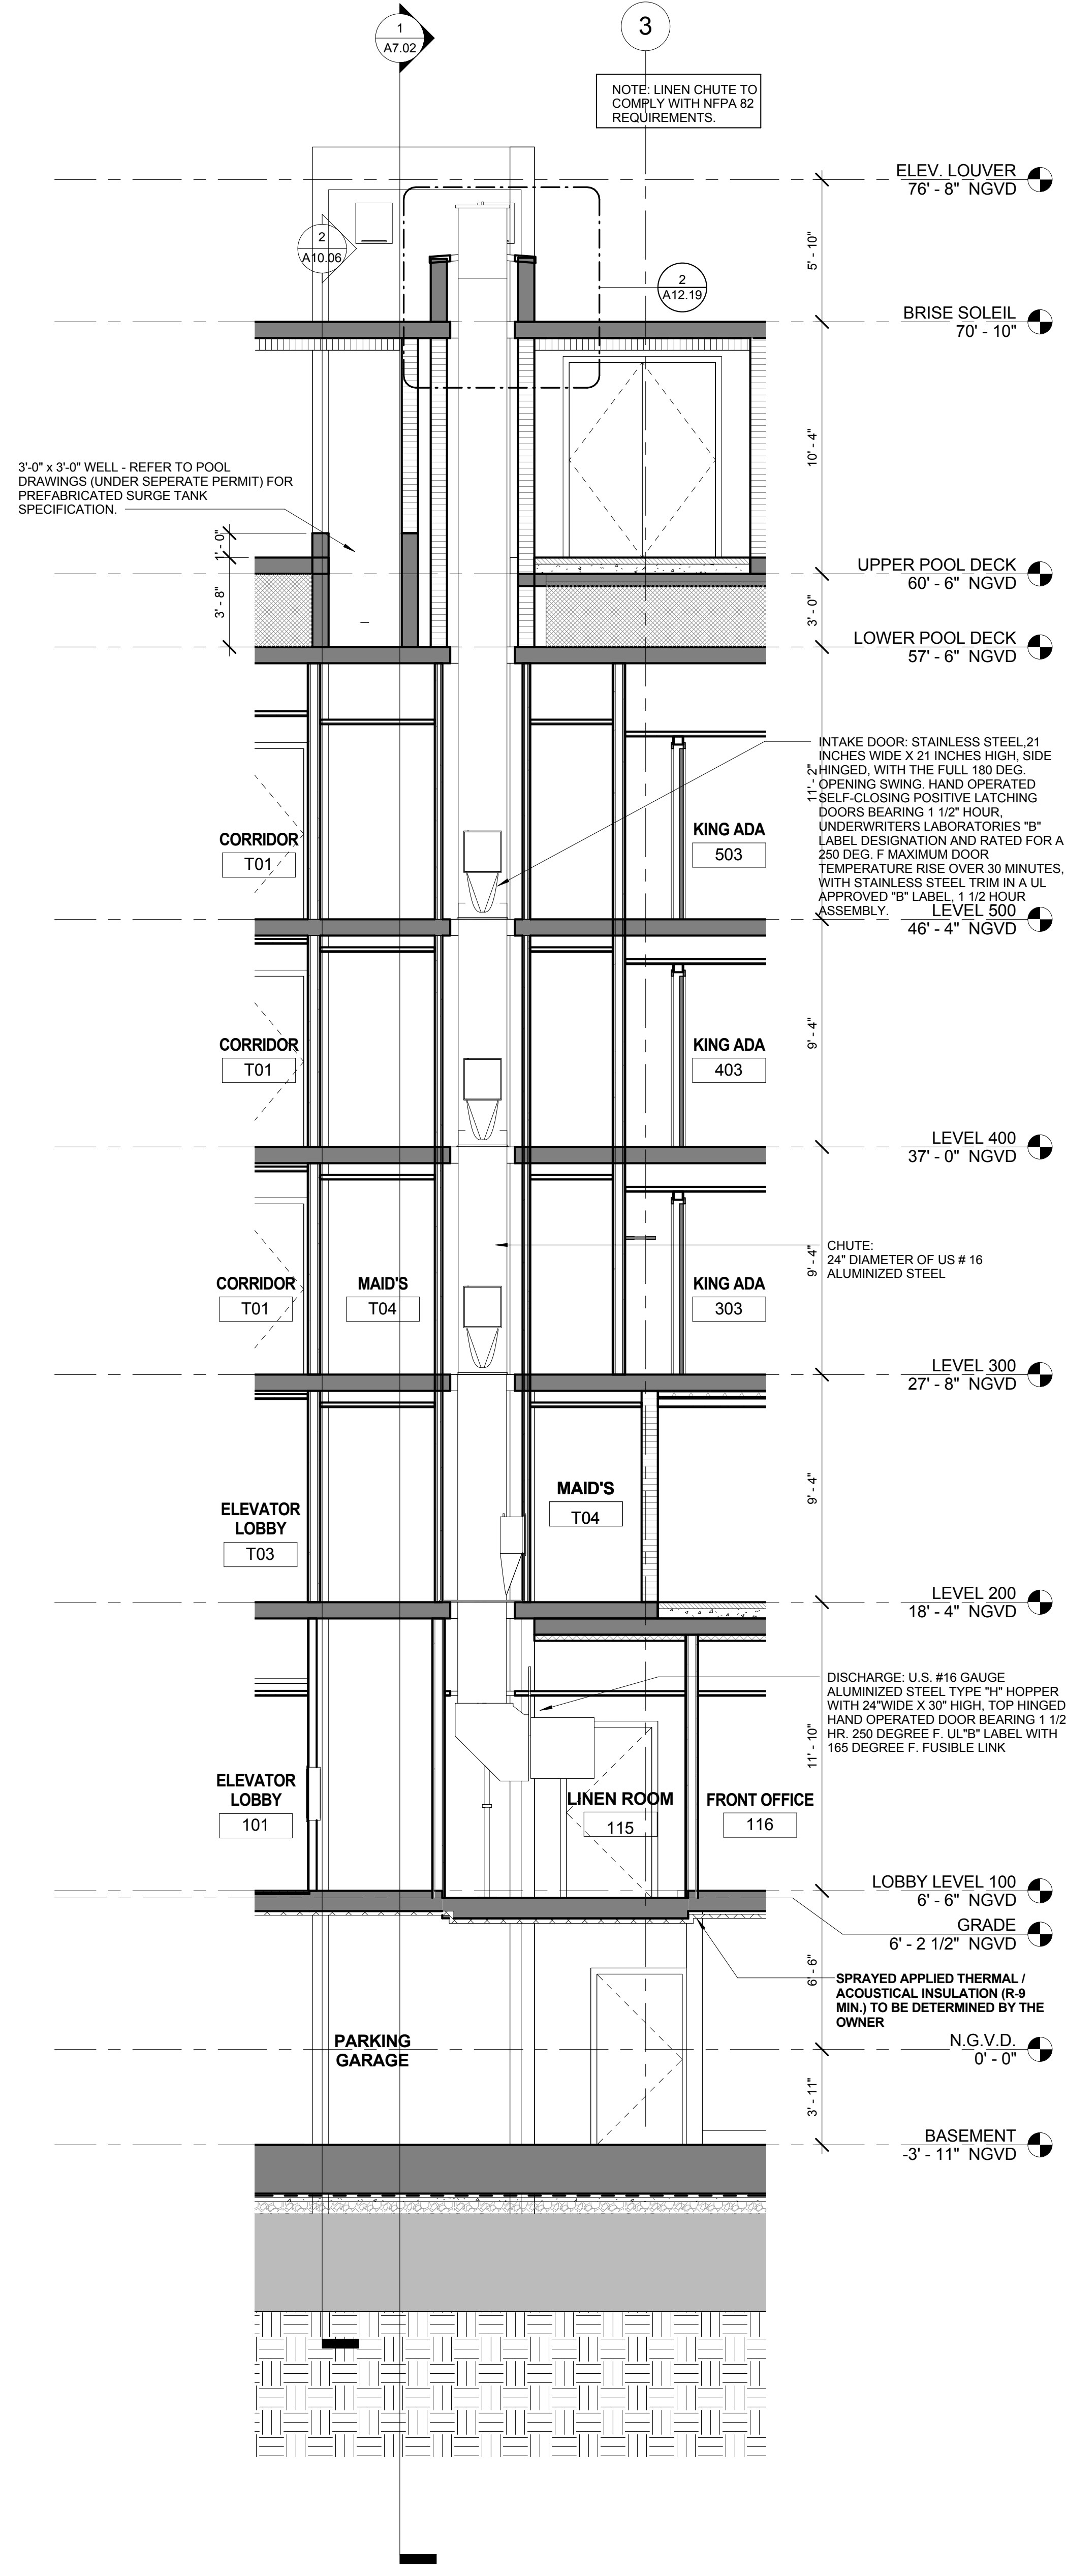


2
A7.02
SECTION-LINEN CHUTE
1/4" = 1'-0"

Permit Issue
10-13-14

#	Description	Date
2	CMR Bldg. Dept. Comments	01/15/15
3	CMR Bldg. Dept. Comments	03/23/15
5	Revisions	06-12-15
6	Revision 6	06-14-15

C:\Users\mhicario\Documents\12064-ANGLERS_HOTEL_mhicanio.rvt
4/20/2016 4:30:32 PM

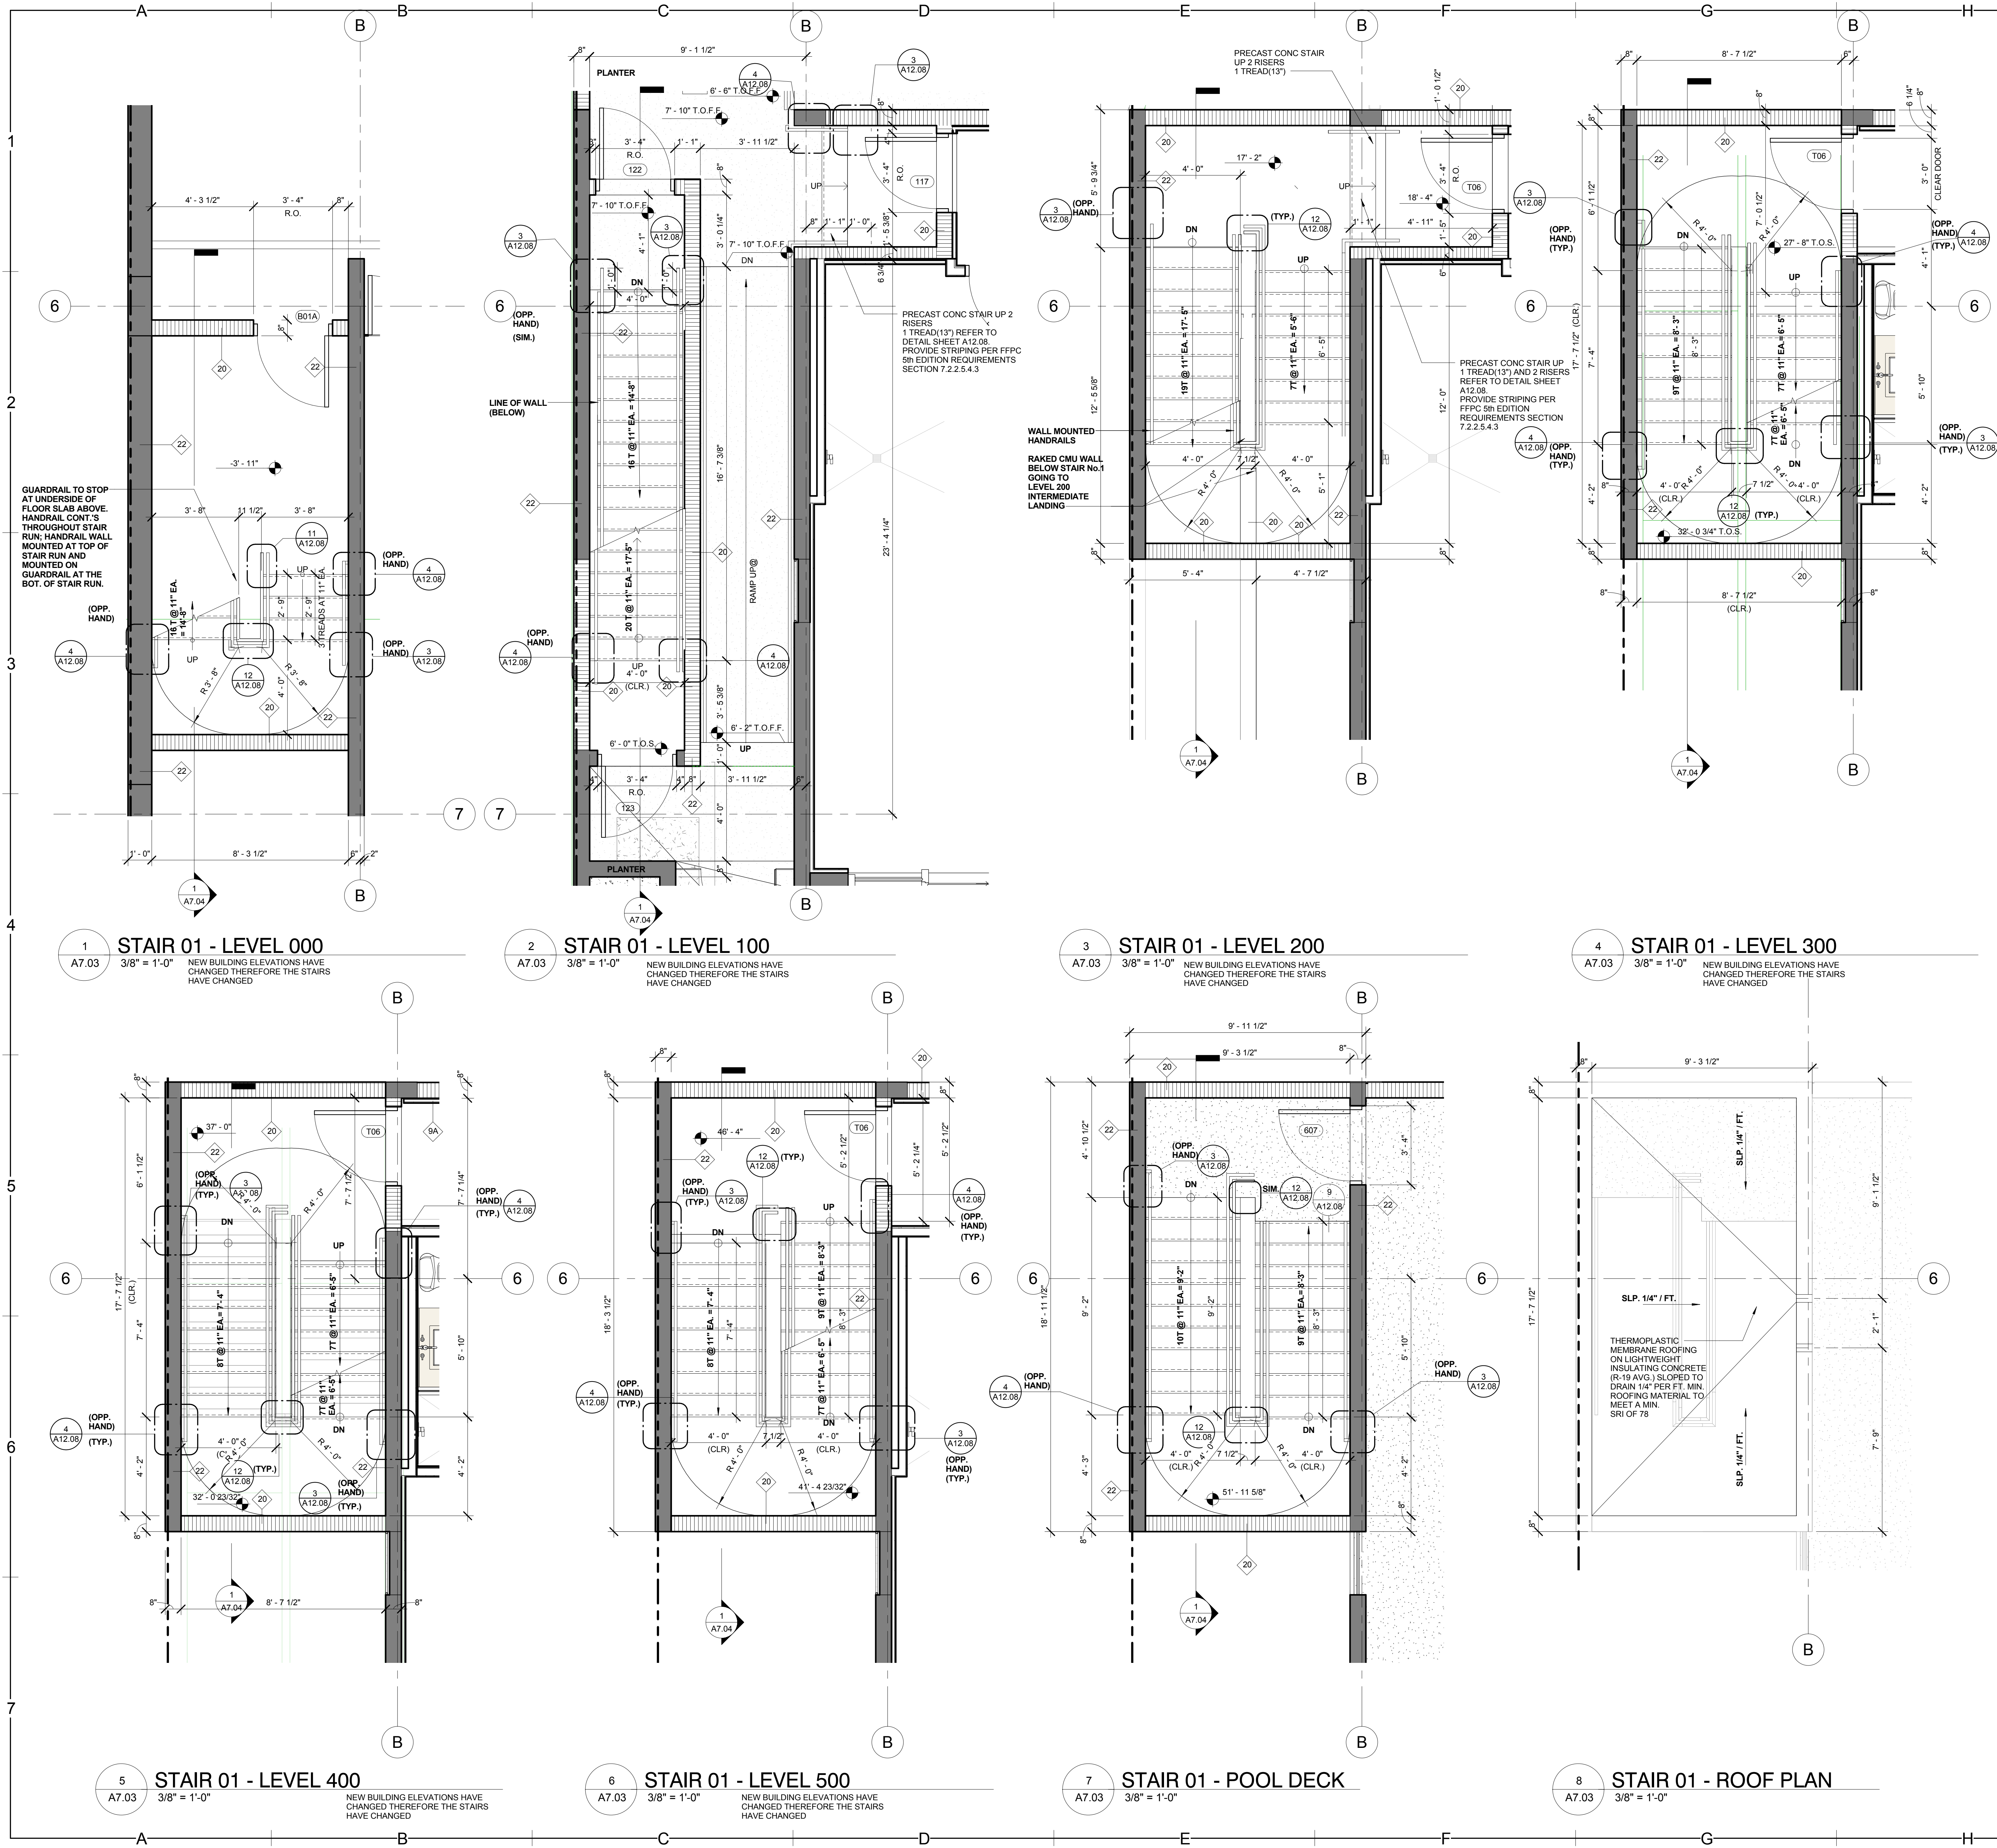

STAIR GENERAL NOTES

TYPICAL FOR ALL STAIRS PROVIDING EGRESS FROM BUILDING UNLESS OTHERWISE NOTED.

HANDRAILS:

- SHALL BE 1 1/2" DIA. STEEL UNLESS OTHERWISE NOTED.
- HEIGHT SHALL BE 36" ABOVE NOSING.
- SHALL EXTEND 12" PAST NOSING AT TOP AND BOTTOM OF LANDING
- CLEAR SPACE BETWEEN A HANDRAIL AND A WALL OR GUARDRAIL SHALL BE 1 1/2" MIN
- HANDRAILS TO COMPLY WITH SECTION 1012 OF THE F.B.C.

GUARDRAILS:

- SHALL BE 1 1/2" DIA. STEEL UNLESS OTHERWISE NOTED.
- SHALL BE 42" ABOVE NOSING.
- SHALL HAVE 1" PICKETS, O.C. TO REJECT A 4" DIA. SPHERE (TYP.)
- BOTTOM SHALL REJECT A 2" DIA. SPHERE (TYP.)
- AT CENTER OF STAIR THERE SHALL BE AN ADDITIONAL CONT. HANDRAIL, CONFORMING TO HANDRAIL CRITERIA ABOVE.
- HANDRAILS MAY NOT BE SHOWN IN SECTION. REFER TO PLANS.
- REFER TO SHEET A12.08 FOR TYPICAL DETAILS.
- GUARDRAILS SHALL COMPLY WITH SECTION 1013 OF THE F.B.C.
- EGRESS WIDTH OF STAIR IS THE CLEAR DIMENSION FROM THE INSIDE WALL OR GUARDRAIL TO THE OPPOSITE SIDE INSIDE WALL OR GUARDRAIL.

EXIT ENCLOSURES:

- EXIT ENCLOSURES TO COMPLY W/ FBC SECTION 1022.
- EXIT ENCLOSURE SIGNAGE TO COMPLY W/ FBC SECTION 1022.8

SIGNAGE:

PROVIDE STAIR IDENTIFICATION PER FBC 1009.6.4:
AN APPROVED SIGN SHALL BE LOCATED AT EACH FLOOR LEVEL LANDING IN ALL ENCLOSED STAIRWAYS OF BUILDINGS FOUR OR MORE STORIES IN HEIGHT. THE SIGN SHALL INDICATE THE FLOOR LEVEL AND THE AVAILABILITY OF ROOF ACCESS FROM THAT STAIRWAY AND IDENTIFICATION OF THE STAIRWAY. THE SIGN SHALL ALSO STATE THE FLOOR LEVEL OF AND DIRECTION TO EXIT DISCHARGE. THE SIGN SHALL BE LOCATED APPROXIMATELY 5 FEET (1524mm) ABOVE THE FLOOR LANDING IN A POSITION WHICH IS READILY VISIBLE WHEN THE DOOR IS IN THE OPEN OR CLOSED POSITION. THE FLOOR LEVEL DESIGNATION SHALL ALSO BE TACTILE IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, ACCESSIBILITY.

SIGNAGE REQUIREMENTS AS PER FBC 1022.8.1:
STAIRWAY IDENTIFICATION SIGNS SHALL COMPLY WITH ALL OF THE FOLLOWING REQUIREMENTS:

1. THE SIGN SHALL BE A MINIMUM SIZE OF 18 INCHES BY 12 INCHES (457 MM BY 305 MM).
2. THE LETTERS DESIGNATING THE IDENTIFICATION OF THE STAIR ENCLOSURE SHALL BE A MINIMUM OF 1 1/2 INCHES (38MM).
3. THE NUMBER DESIGNATING THE FLOOR LEVEL SHALL BE A MINIMUM OF 5 INCHES (127MM) IN HEIGHT AND LOCATED IN THE CENTER OF THE SIGN.
4. ALL OTHER LETTERING AND NUMBERS SHALL BE A MINIMUM OF 1 INCH (25MM) IN HEIGHT.
5. CHARACTERS AND THEIR BACKGROUND SHALL HAVE A NONGLARE FINISH. CHARACTERS SHALL CONTRAST WITH THEIR BACKGROUND, WITH EITHER LIGHT CHARACTERS ON A DARK BACKGROUND OR DARK CHARACTERS ON A LIGHT BACKGROUND.
6. WHEN SIGNS REQUIRED BY SECTION 1022.8 ARE INSTALLED IN INTERIOR EXIST ENCLOSURES OF BUILDINGS SUBJECT TO SECTION 1024, THE SIGNS SHALL BE MADE OF THE SAME MATERIALS AS REQUIRED BY SECTION 1024.4.

NICHOLS
BROSCH
WURST
WOLFE
& ASSOCIATES, INC.
Architecture & Planning

1815 NW 10th Avenue
Coral Gables, FL 33134
(305) 443-5200
(305) 448-2872
AAC-000000

ANGLER'S HOTEL

600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139

DEVELOPED BY: Angler's Boutique Resort LLC


Permit Issue
10-13-14

REVISIONS

#	Description	Date
2	CMB Bldg. Dept. Comments	01/15/16
5	Revisions	06-12-15
7	HPS FILE #7582/ Bldg Dept comments	11-24-15

12064

A7.03

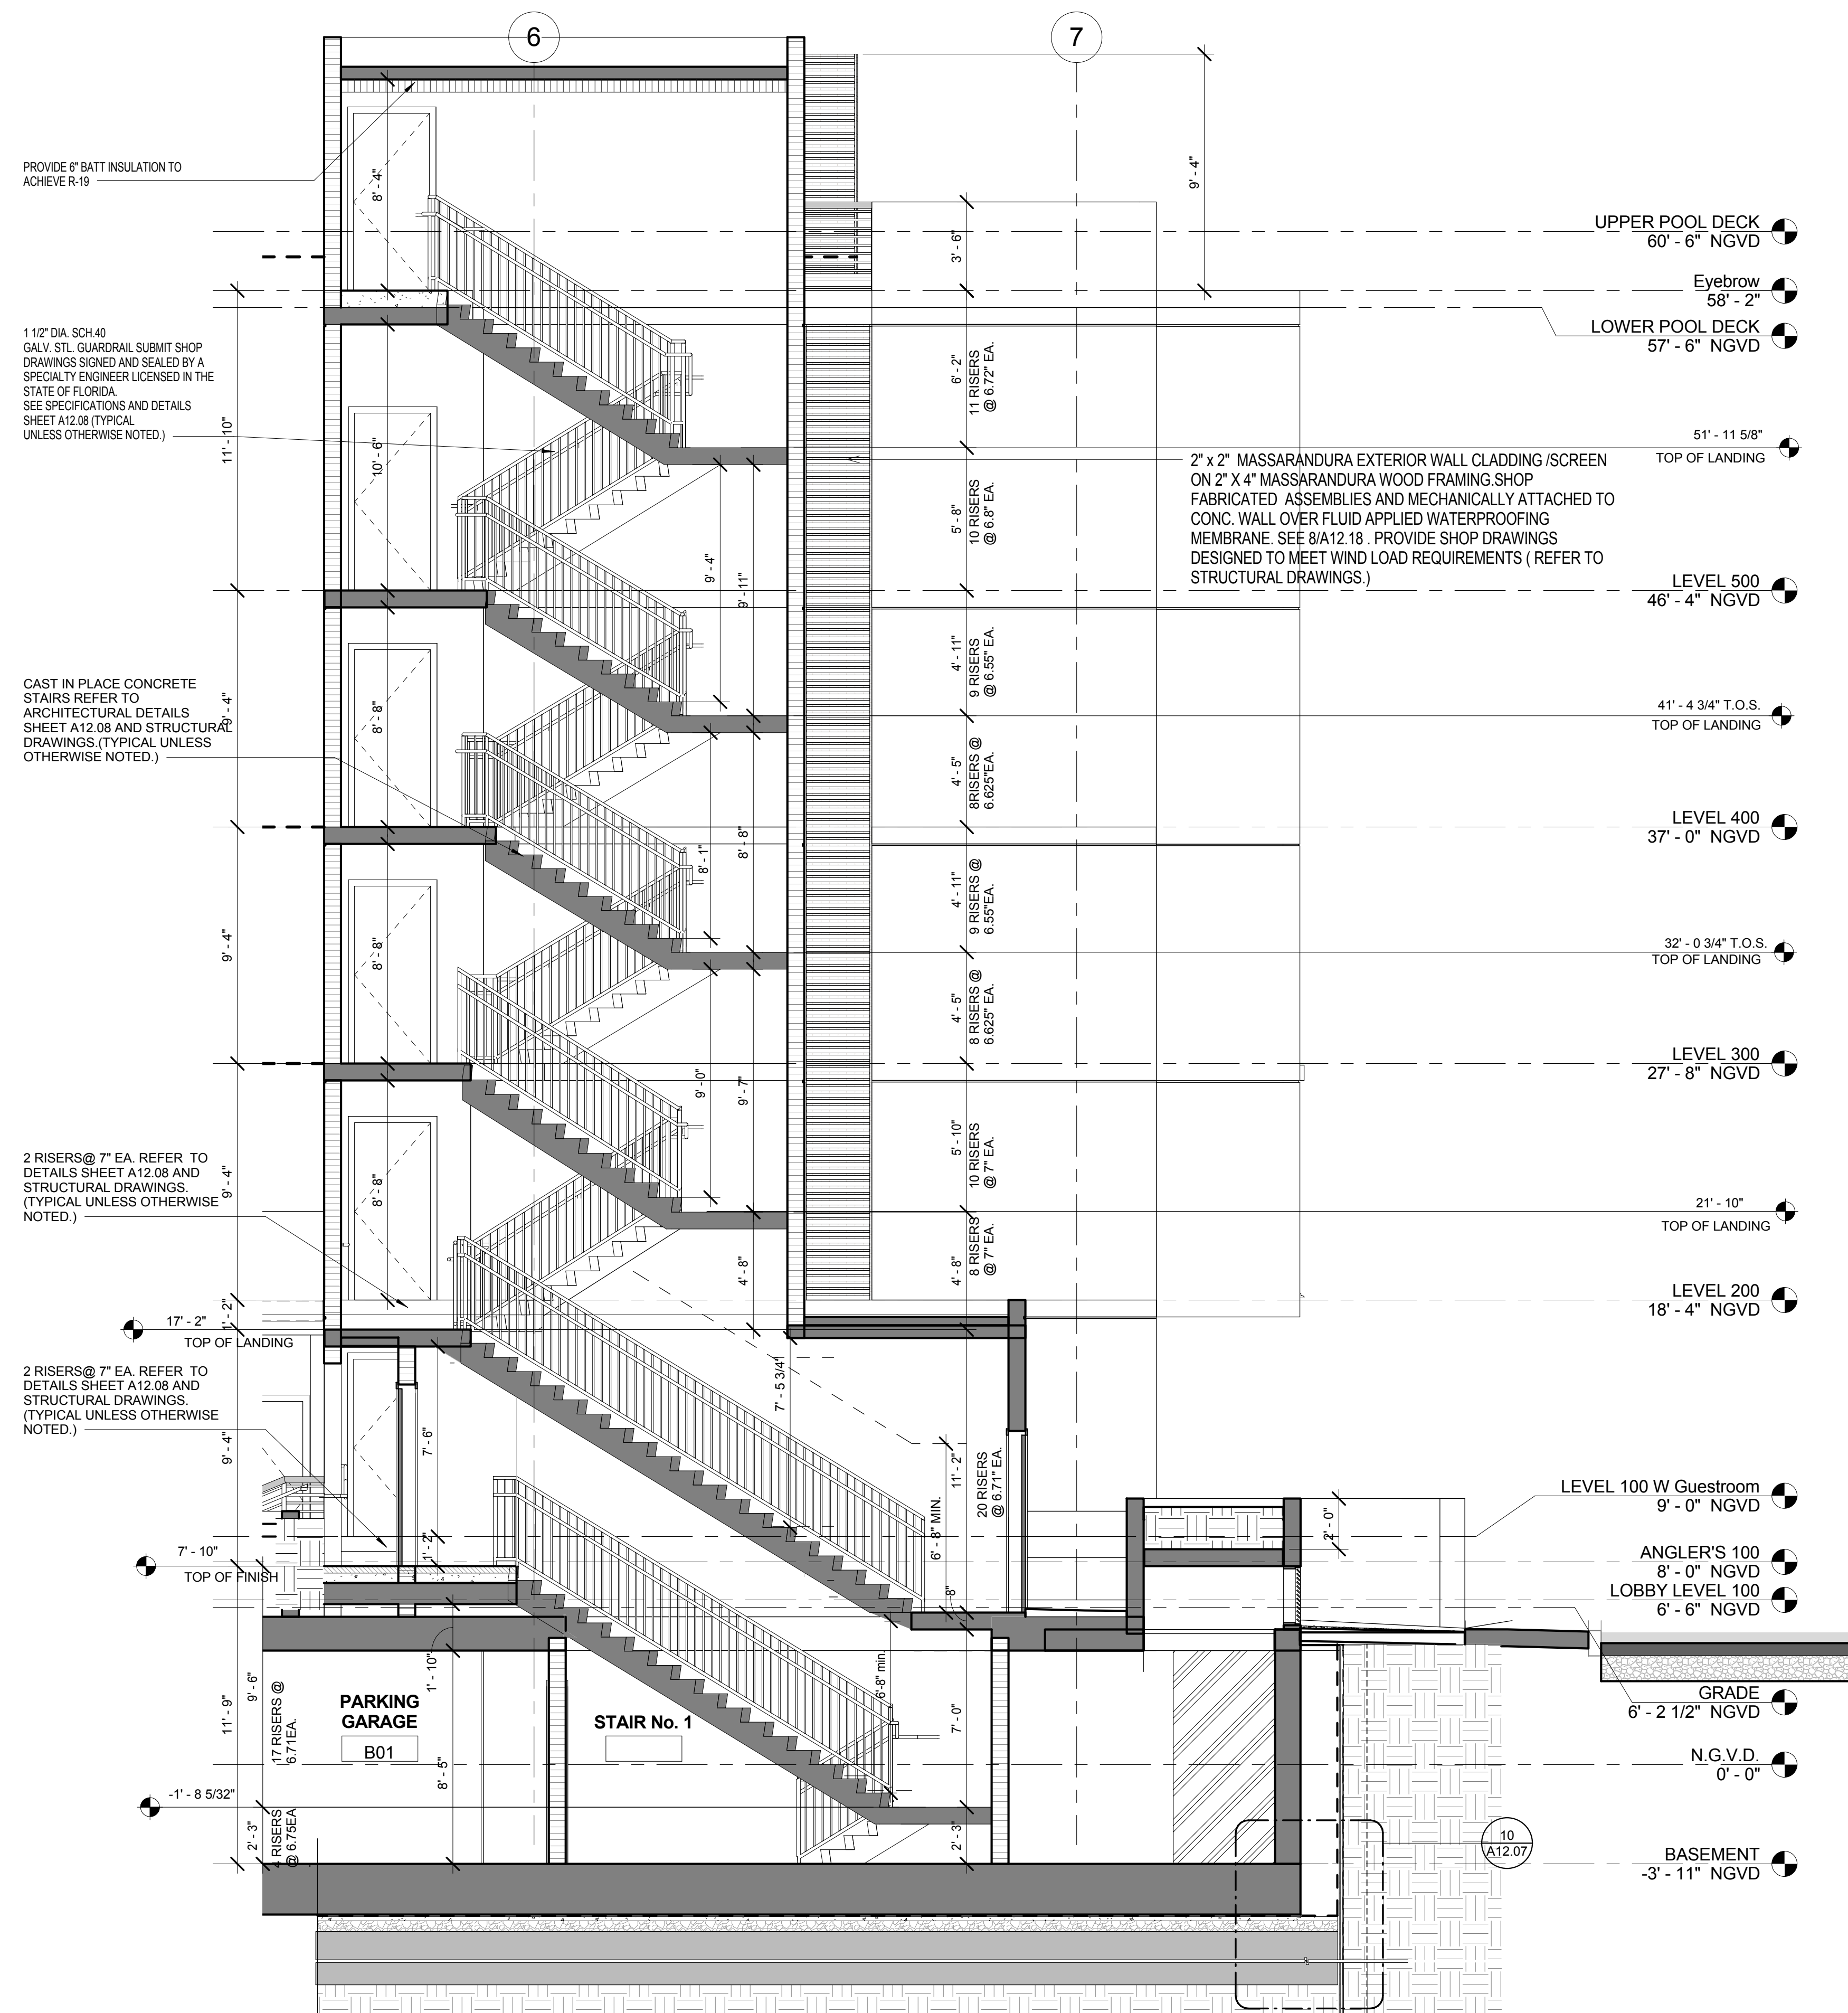

SECTION - STAIR 01

$$1/4'' = 1'-0''$$

NEW BUILDING ELEVATIONS HAVE
CHANGED THEREFORE THE STAIRS
HAVE CHANGED

STAIR GENERAL NOTES

TYPICAL FOR ALL STAIRS PROVIDING EGRESS FROM BUILDING
UNLESS OTHERWISE NOTED.

HANDRAILS:

- SHALL BE 1 1/2" DIA. STEEL UNLESS OTHERWISE NOTED.
- HEIGHT SHALL BE 36" ABOVE NOSING.
- SHALL EXTEND 12" PAST NOSING AT TOP AND BOTTOM OF LANDING.
- CLEAR SPACE BETWEEN A HANDRAIL AND A WALL OR GUARDRAIL SHALL BE 1 1/2" MIN.
- HANDRAILS TO COMPLY WITH SECTION 1012 OF THE F.B.C.

GUARDRAILS:

- SHALL BE 11/2" DIA. STEEL UNLESS OTHERWISE NOTED.
- SHALL BE 42" ABOVE NOISING.
- SHALL HAVE 14" PICKETS, O.C. TO REJECT A 4" DIA. SPHERE (TYP.)
- BOTTOM SHALL REJECT A 2" DIA. SPHERE (TYP.)
- AT CENTER OF STAIR THERE SHALL BE AN ADDITIONAL CON. HANDRAIL, CONFORMING TO HANDRAIL CRITERIA ABOVE.
- HANDRAILS MAY NOT BE SHOWN IN SECTION. REFER TO PLANS.
- REFER TO SHEET A12.08 FOR TYPICAL DETAILS.
- GUARDRAILS SHALL COMPLY WITH SECTION 1013 OF THE F.B.C.
- EGGS WIDTH OF STAIR IS THE CLEAR DIMENSION FROM THE INSIDE WALL OR GUARDRAIL TO THE OPPOSITE SIDE INSIDE WALL OR GUARDRAIL.

EXIT ENCLOSURES:

- EXIT ENCLOSURES TO COMPLY W/ FBC SECTION 1022.
- EXIT ENCLOSURE SIGNAGE TO COMPLY W/ FBC SECTION 1022.8

SIGNAGE:

PROVIDE STAIR IDENTIFICATION PER FBC 1009.6.4:
AN APPROVED SIGN SHALL BE LOCATED AT EACH FLOOR
LEVEL LANDING IN ALL ENCLOSED STAIRWAYS OF BUILDINGS
FOUR OR MORE STORIES IN HEIGHT. THE SIGN SHALL INDICATE
THE FLOOR LEVEL AND THE AVAILABILITY OF ROOF ACCESS
FROM THAT STAIRWAY AND IDENTIFICATION OF THE
STAIRWAY. THE SIGN SHALL ALSO STATE THE FLOOR LEVEL
AND DIRECTION TO EXIT DISCHARGE. THE SIGN SHALL BE
LOCATED APPROXIMATELY 5 FEET (1524mm) ABOVE THE
FLOOR LANDING IN A POSITION WHICH IS READILY VISIBLE
WHEN THE DOOR IS IN THE OPEN OR CLOSED POSITION. THE
FLOOR LEVEL IDENTIFICATION SHALL ALSO BE FILED IN
ACCORDANCE WITH THE FLORIDA BUILDING CODE
ACCESSIBILITY.

SIGNAGE REQUIREMENTS AS PER FBC 1022.8.1:
STAIRWAY IDENTIFICATION SIGNS SHALL COMPLY WITH ALL
OF THE FOLLOWING REQUIREMENTS:

1. THE SIGN SHALL BE A MINIMUM SIZE OF 18 INCHES BY 12 INCHES (458 MM BY 305 MM).
2. THE LETTERS DESIGNATING THE IDENTIFICATION OF THE STAIR ENCLOSURE SHALL BE A MINIMUM OF 1 1/2 INCHES (38MM).
3. THE NUMBER DESIGNATING THE FLOOR LEVEL SHALL BE A MINIMUM OF 5 INCHES (127MM) IN HEIGHT AND LOCATED IN THE CENTER OF THE SIGN.
4. ALL OTHER LETTERING AND NUMBERS SHALL BE A MINIMUM OF 1 INCH (25MM) IN HEIGHT.
5. CHARACTERS AND THEIR BACKGROUND SHALL HAVE A NONGLARE FINISH. CHARACTERS SHALL CONTRAST WITH THEIR BACKGROUND, WITH EITHER LIGHT CHARACTERS ON A DARK BACKGROUND OR DARK CHARACTERS ON A LIGHT BACKGROUND.
6. WHEN SIGNS REQUIRED BY SECTION 1022.8 ARE INSTALLED IN INTERIOR EXIST ENCLOSURES OF BUILDINGS SUBJECT TO SECTION 1024, THE SIGNS SHALL BE MADE OF THE SAME MATERIALS AS REQUIRED BY SECTION 1024.4.



ANGLER'S HOTEL

DEVELOPED BY: Angler's Boutique Resort LLC


DEVELOPED BY: Angler's Boutique Resort LLC

Permit Issue 10-13-14		
REVISIONS		
#	Description	Date
2	CMB Bldg. Dept. Comments	01/15/15
3	CMB Bldg Dept. Comments	03/25/15
5	Revisions	06-12-15
6	Revision 6	08-14-15
7	HPB FILE #7582/ Bldg.Dept.comments	11-24-15

12064


A7.04

C:\Users\mhinciano\Documents\12064-ANGLERS-HOTEL_mhinciano.rvt
4/20/2016 4:30:42 PM

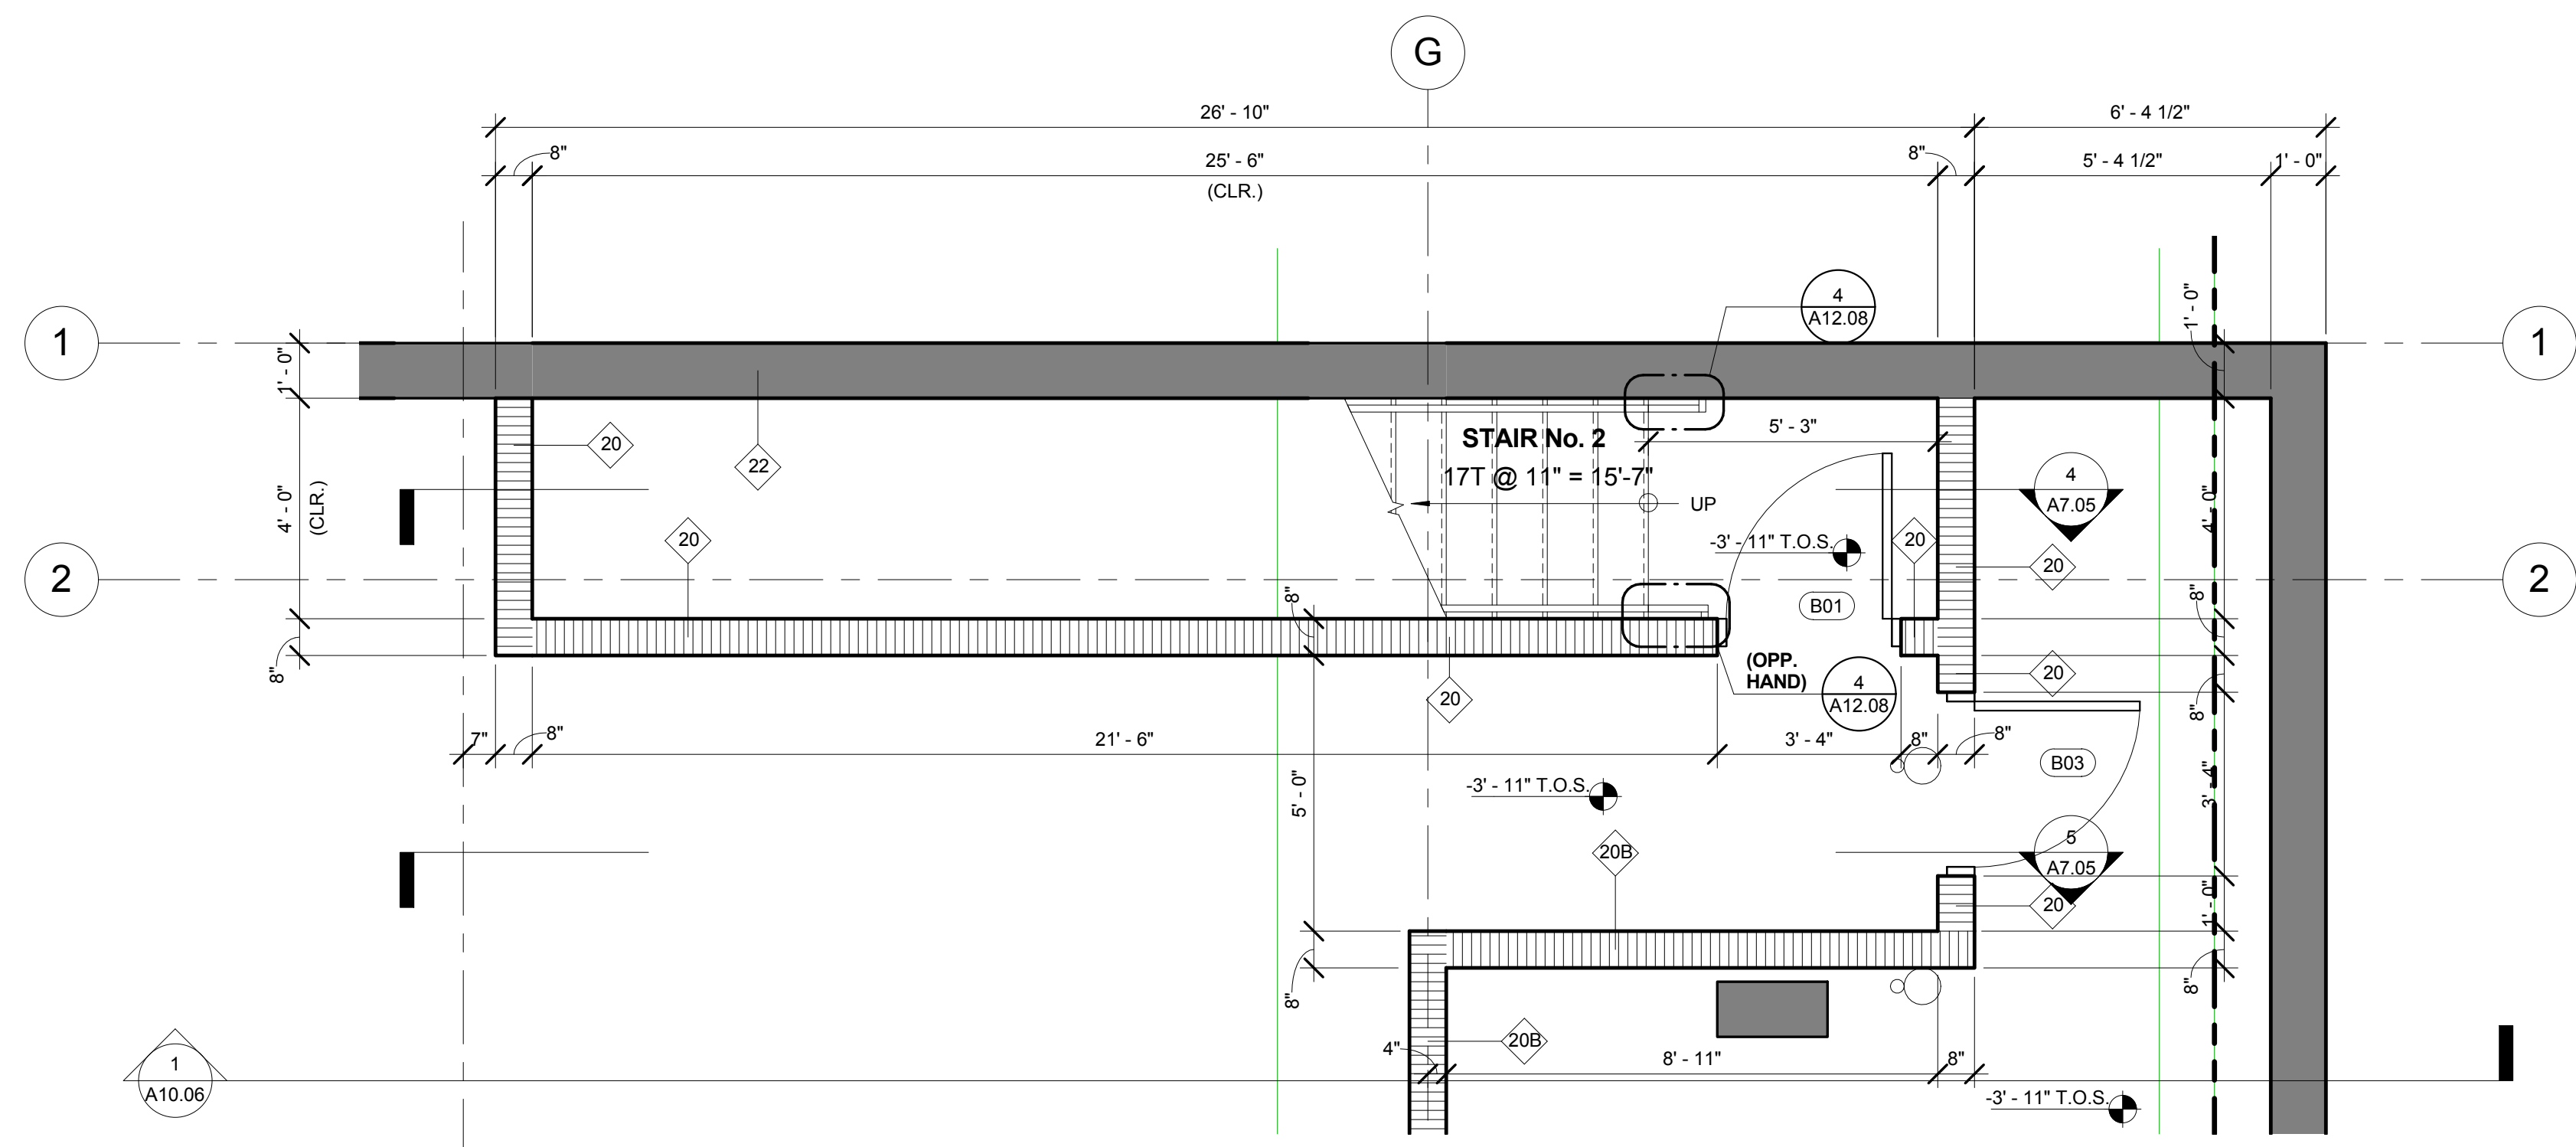


1 STAIR 02_LEVEL 000

NEW BUILDING ELEVATIONS HAVE
CHANGED THEREFORE THE STAIRS
HAVE CHANGED

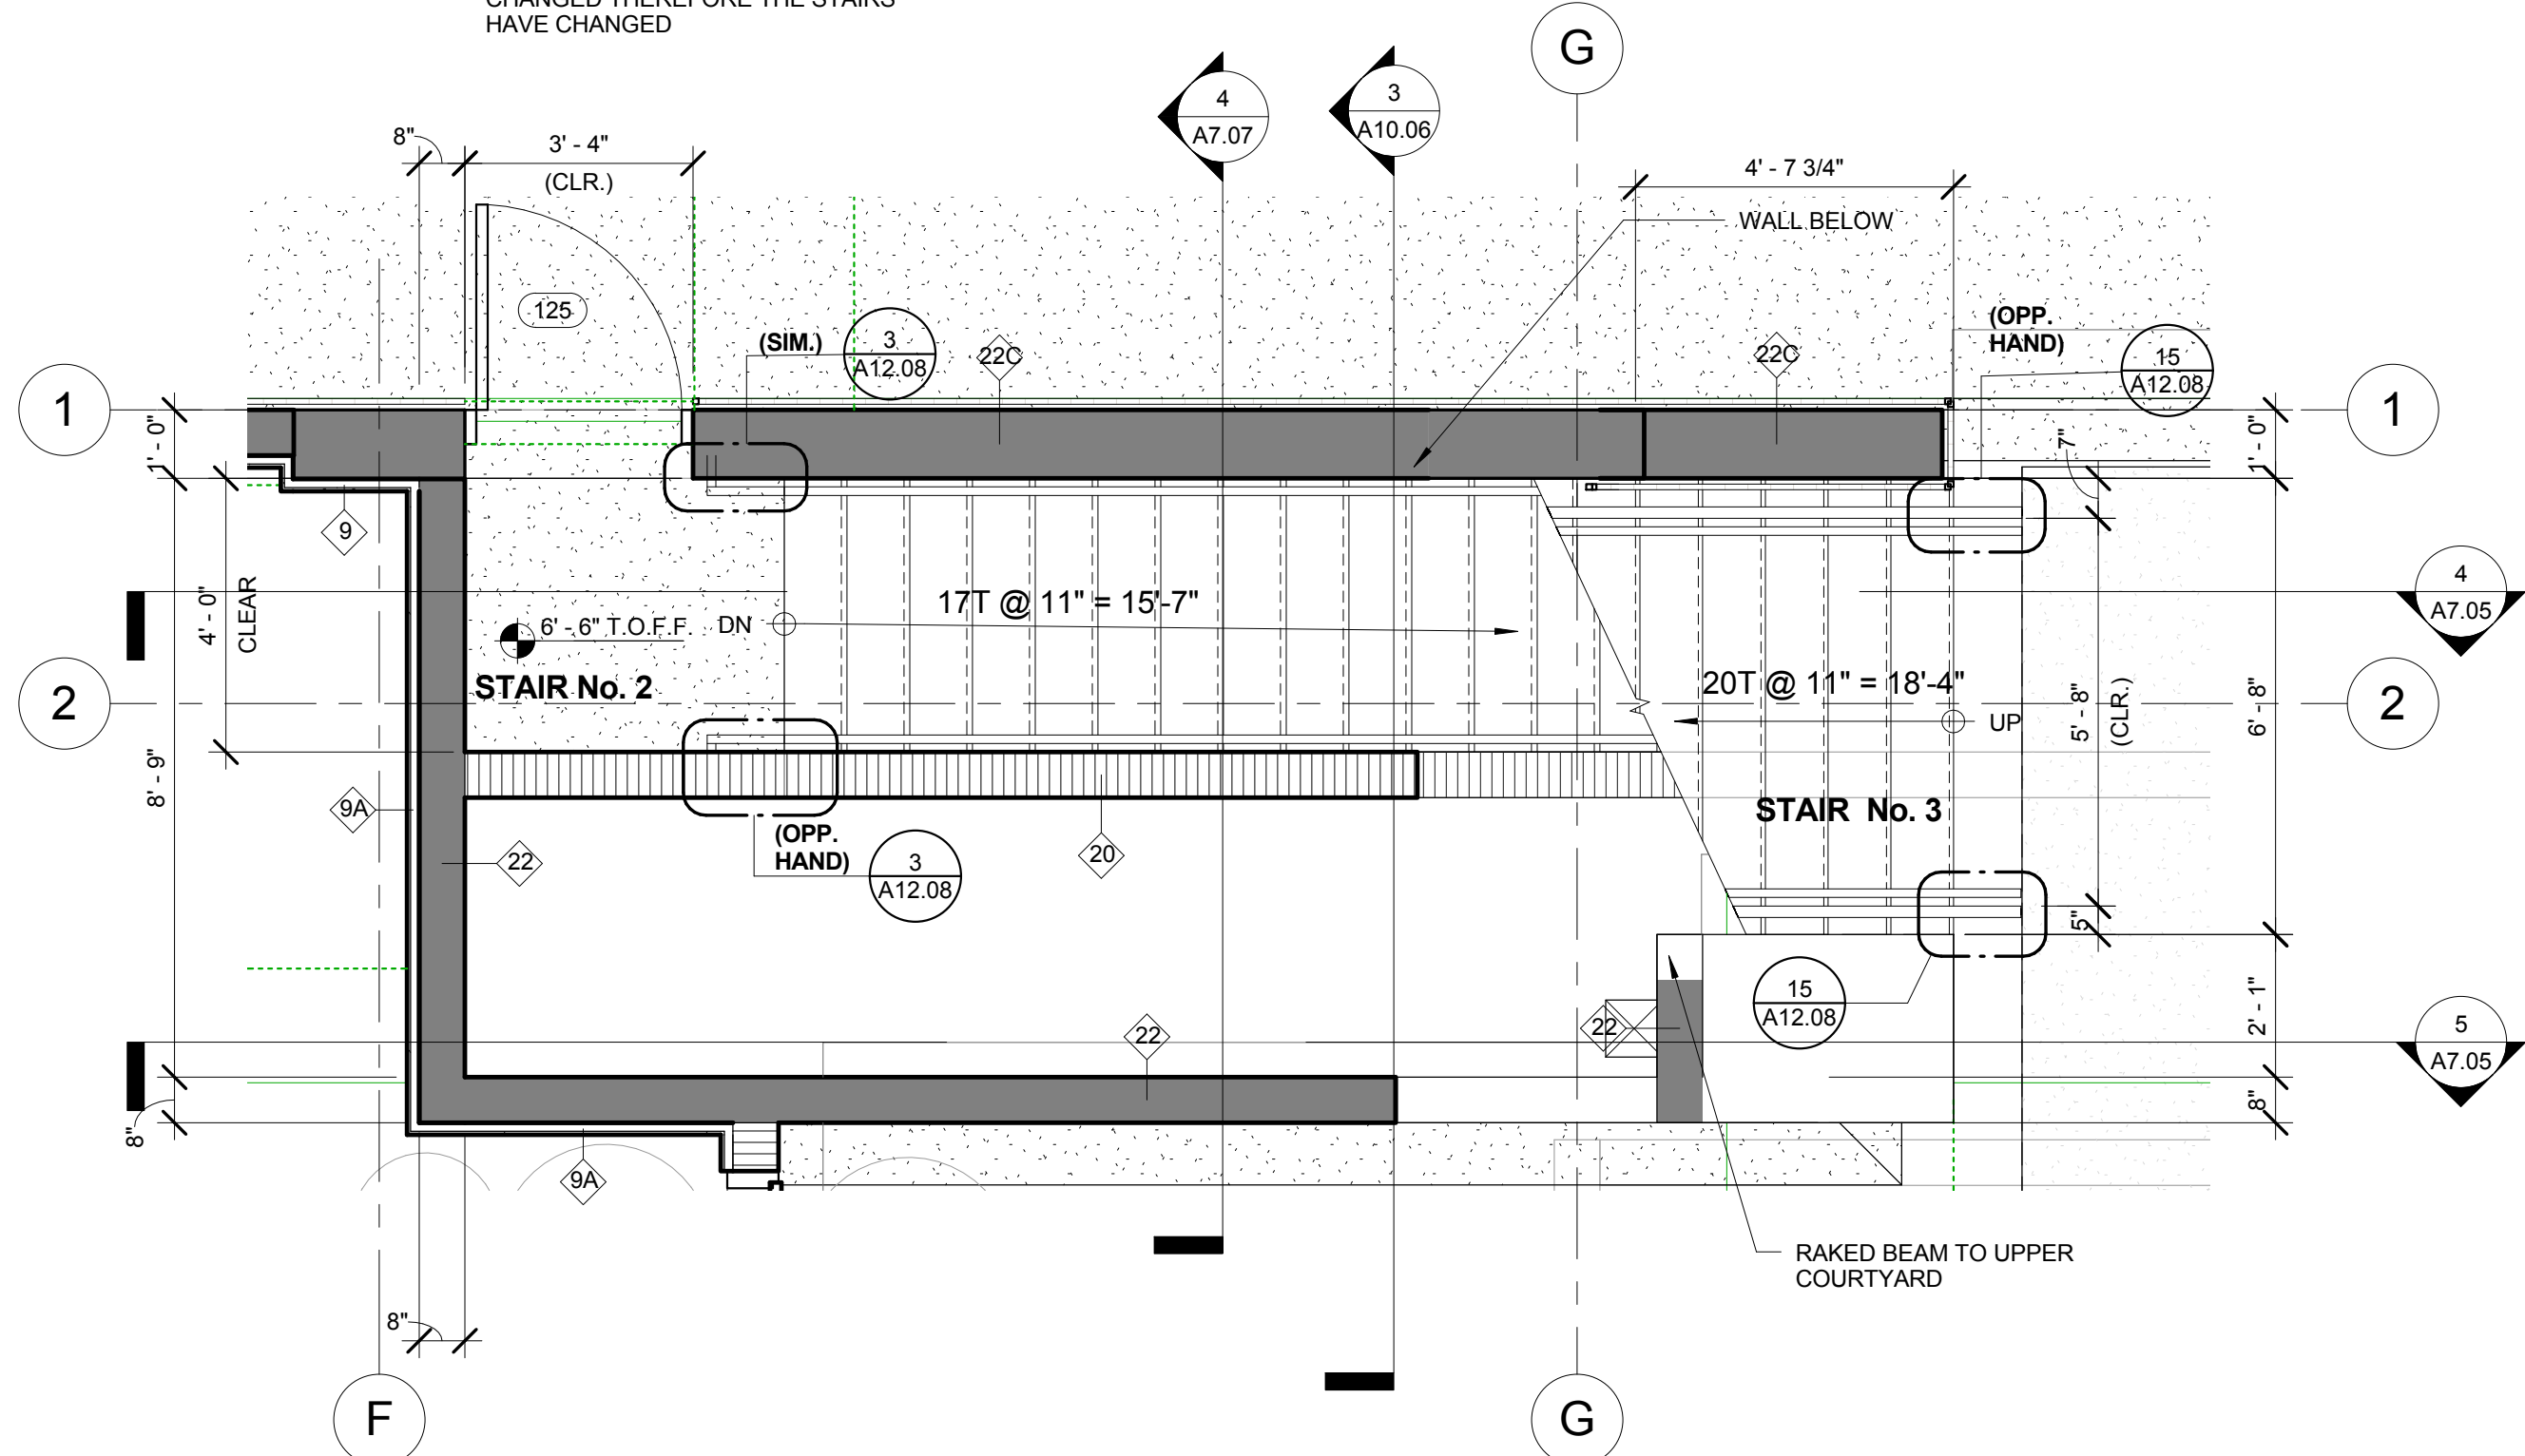


2 STAIR 02 AND 03 - LEVEL 100

NEW BUILDING ELEVATIONS HAVE
CHANGED THEREFORE THE STAIRS
HAVE CHANGED

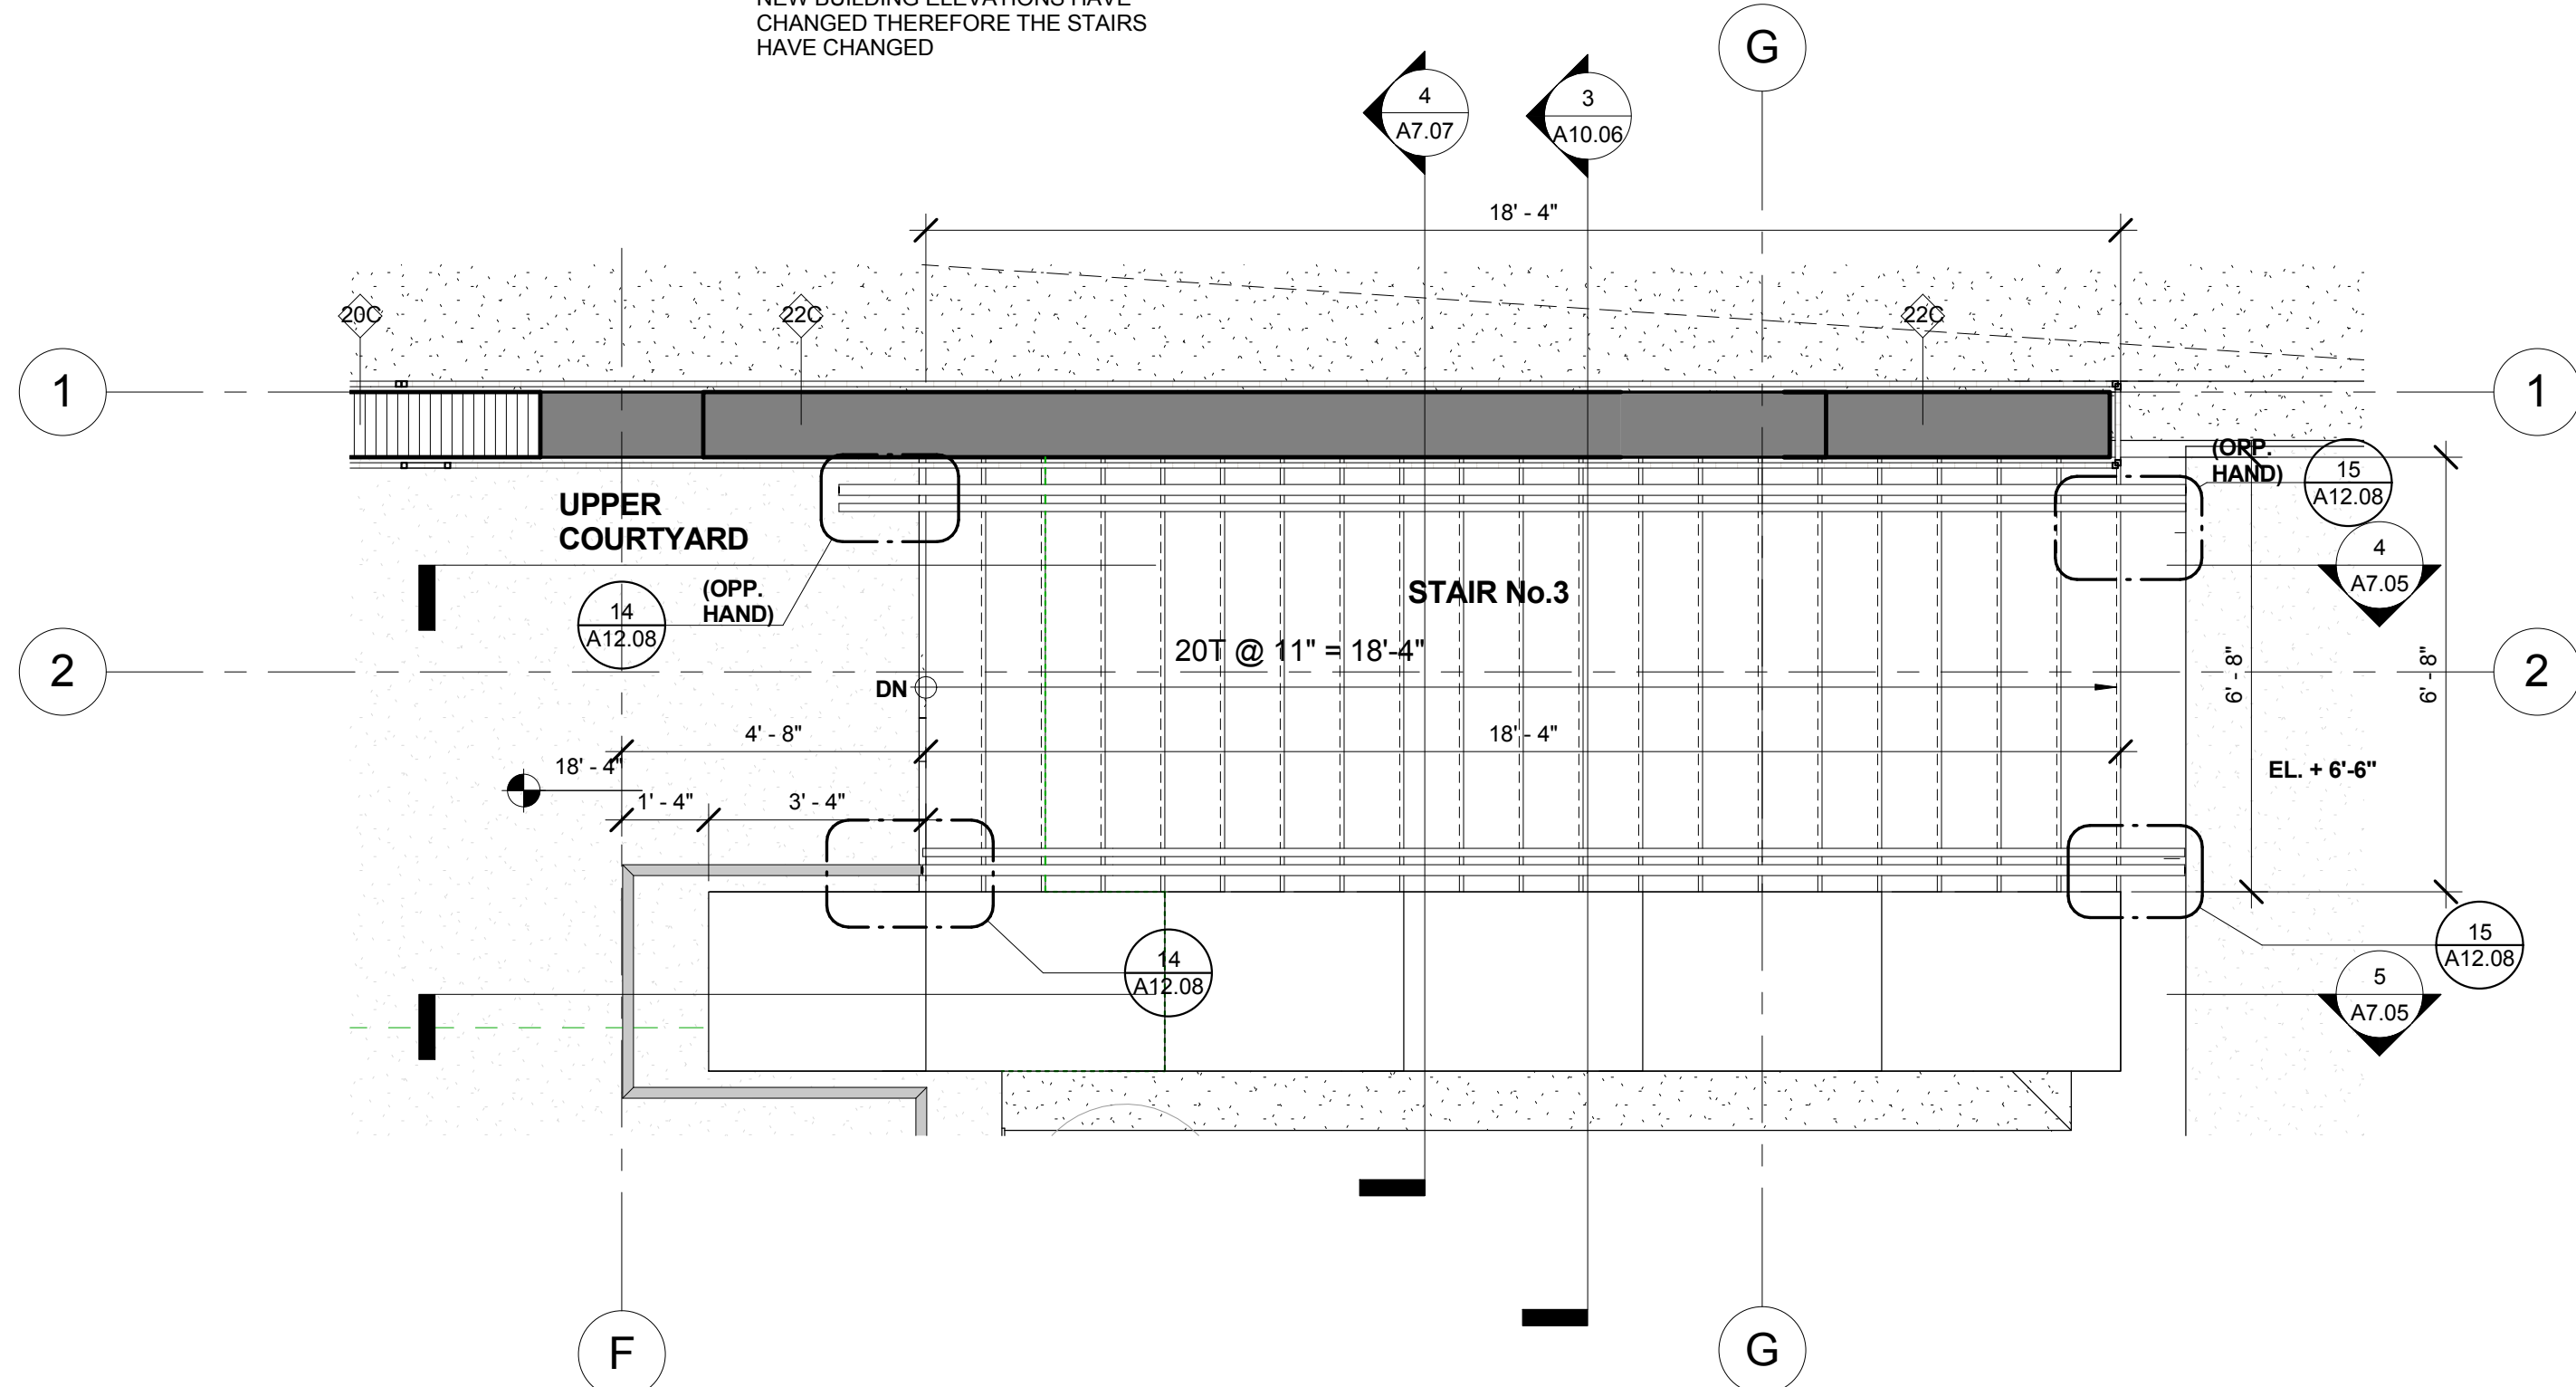

3 STAIR 03 - LEVEL 200


NEW BUILDING ELEVATIONS HAVE
CHANGED THEREFORE THE STAIRS
HAVE CHANGED

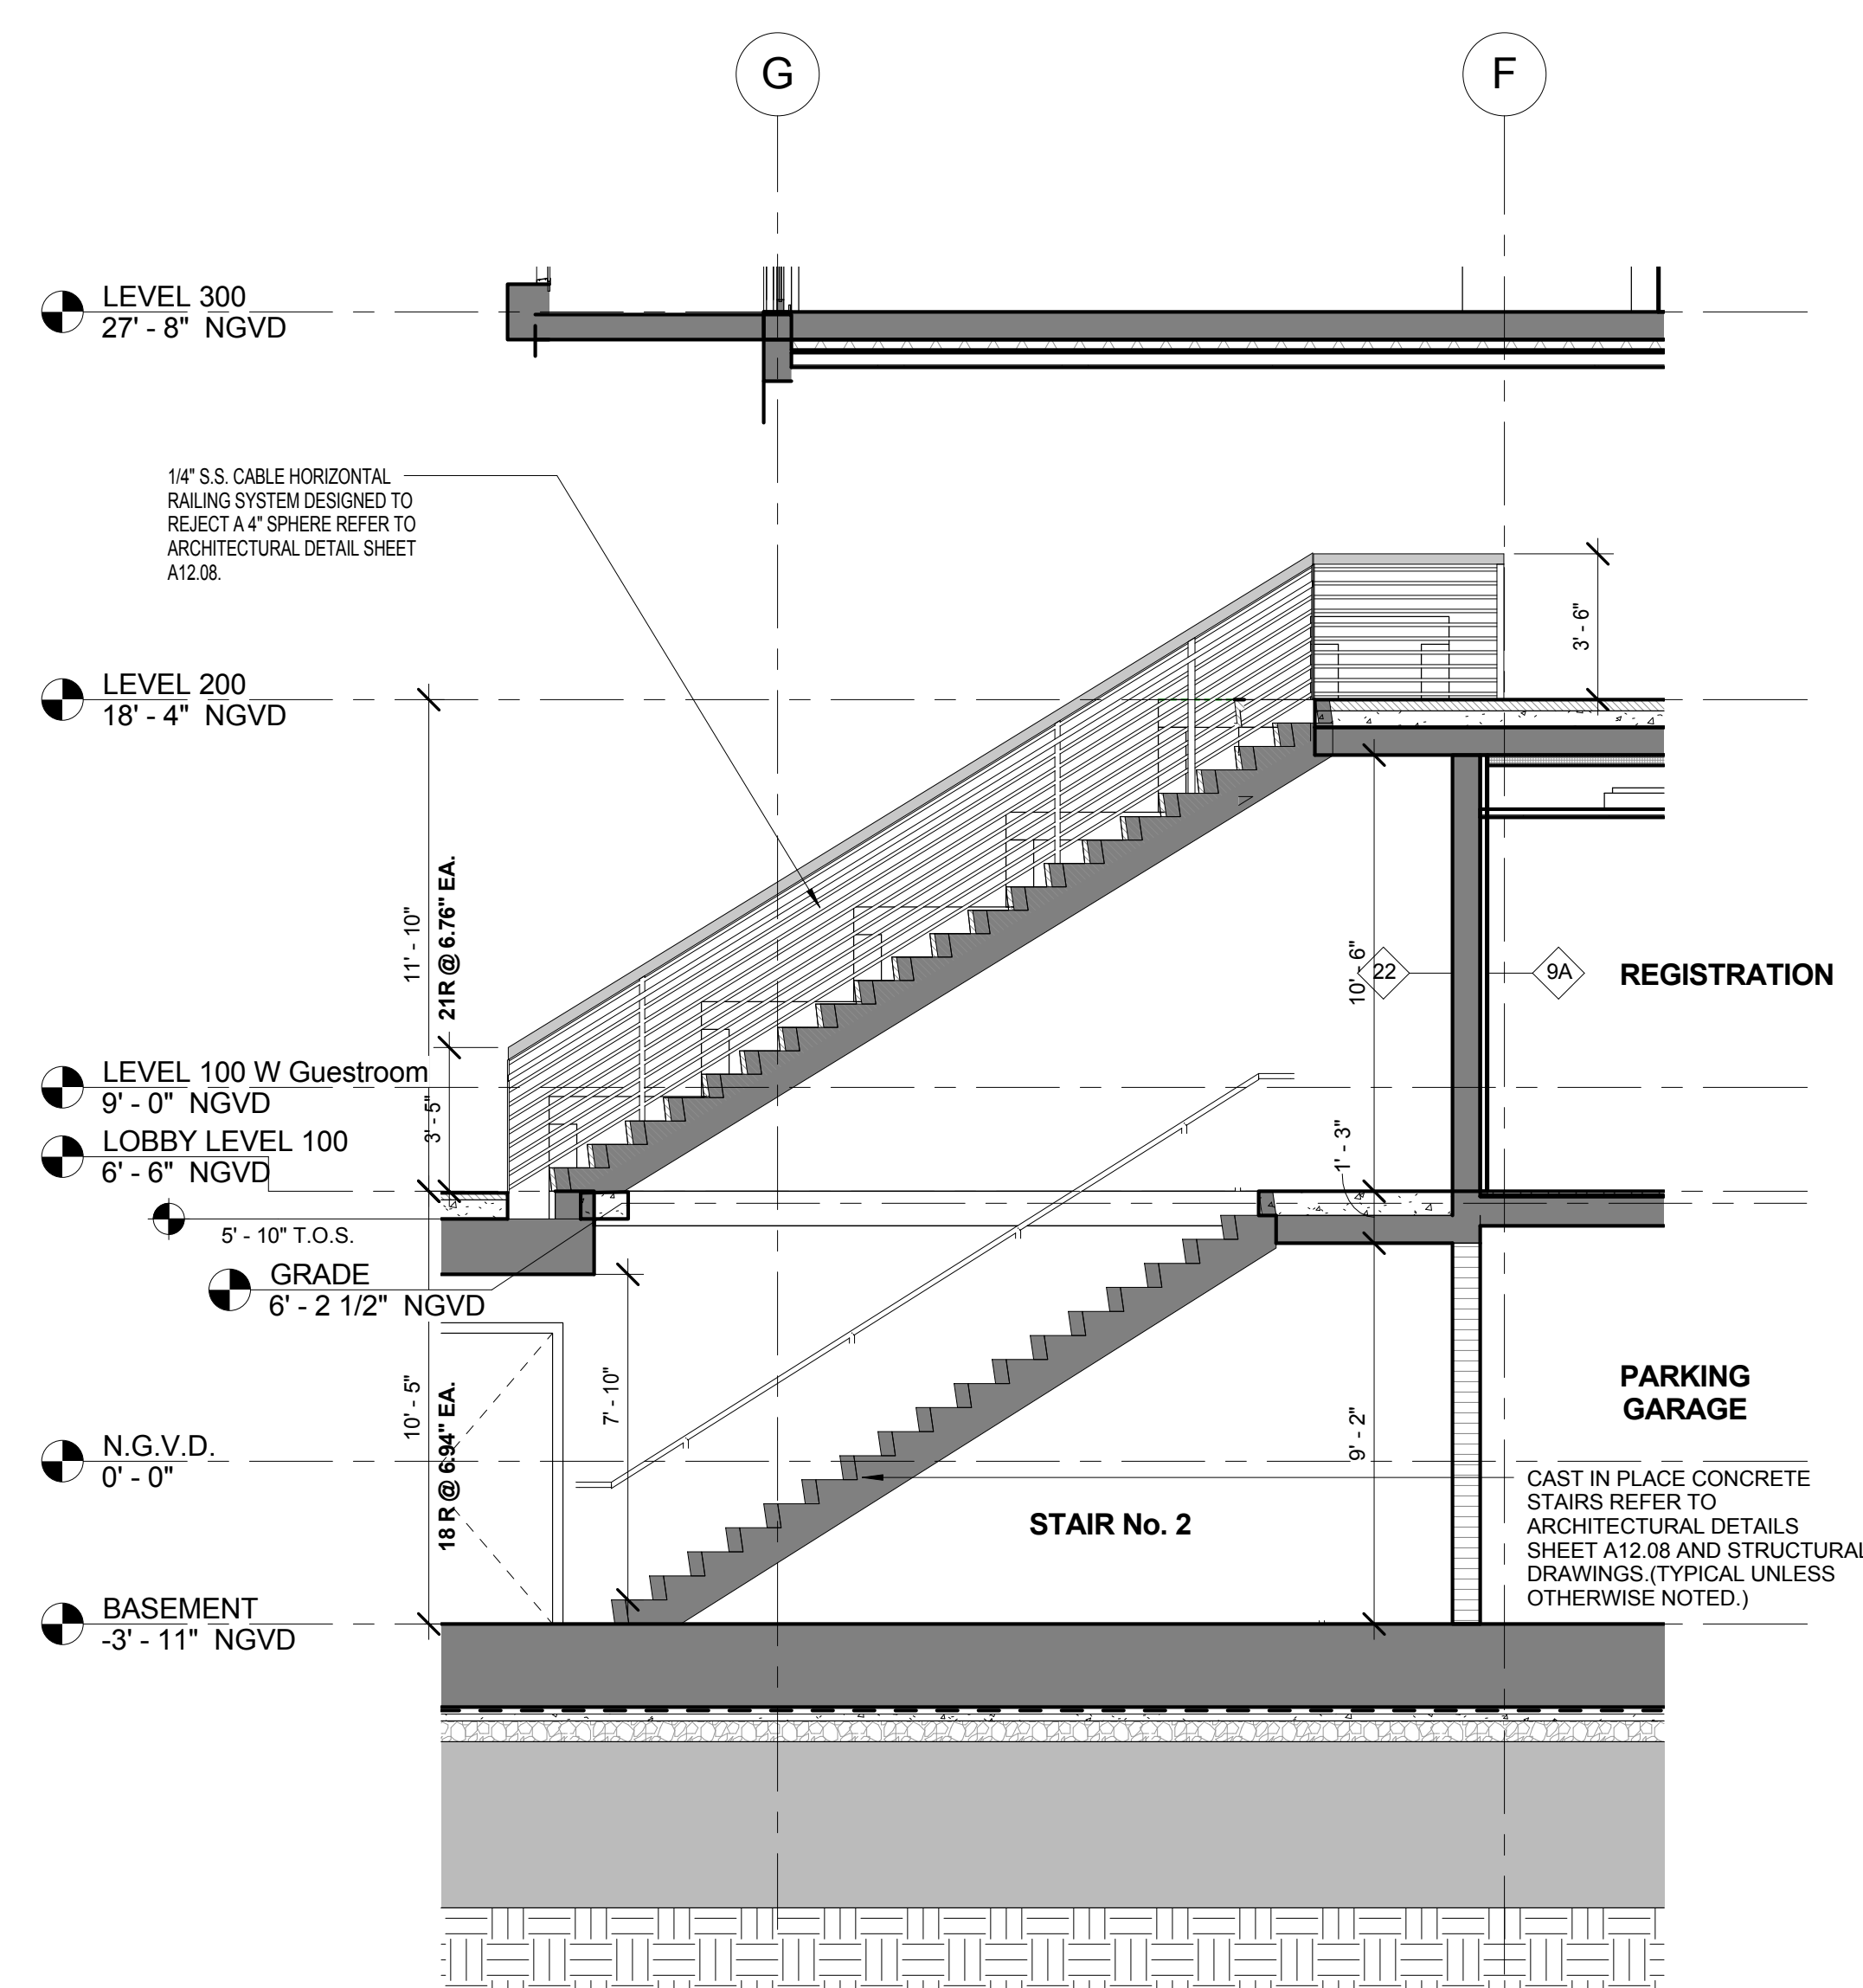

4 SECTION - STAIR 02 AND STAIR 03

1/4" = 1'-0"

NEW BUILDING ELEVATIONS HAVE
CHANGED THEREFORE THE STAIRS
HAVE CHANGED

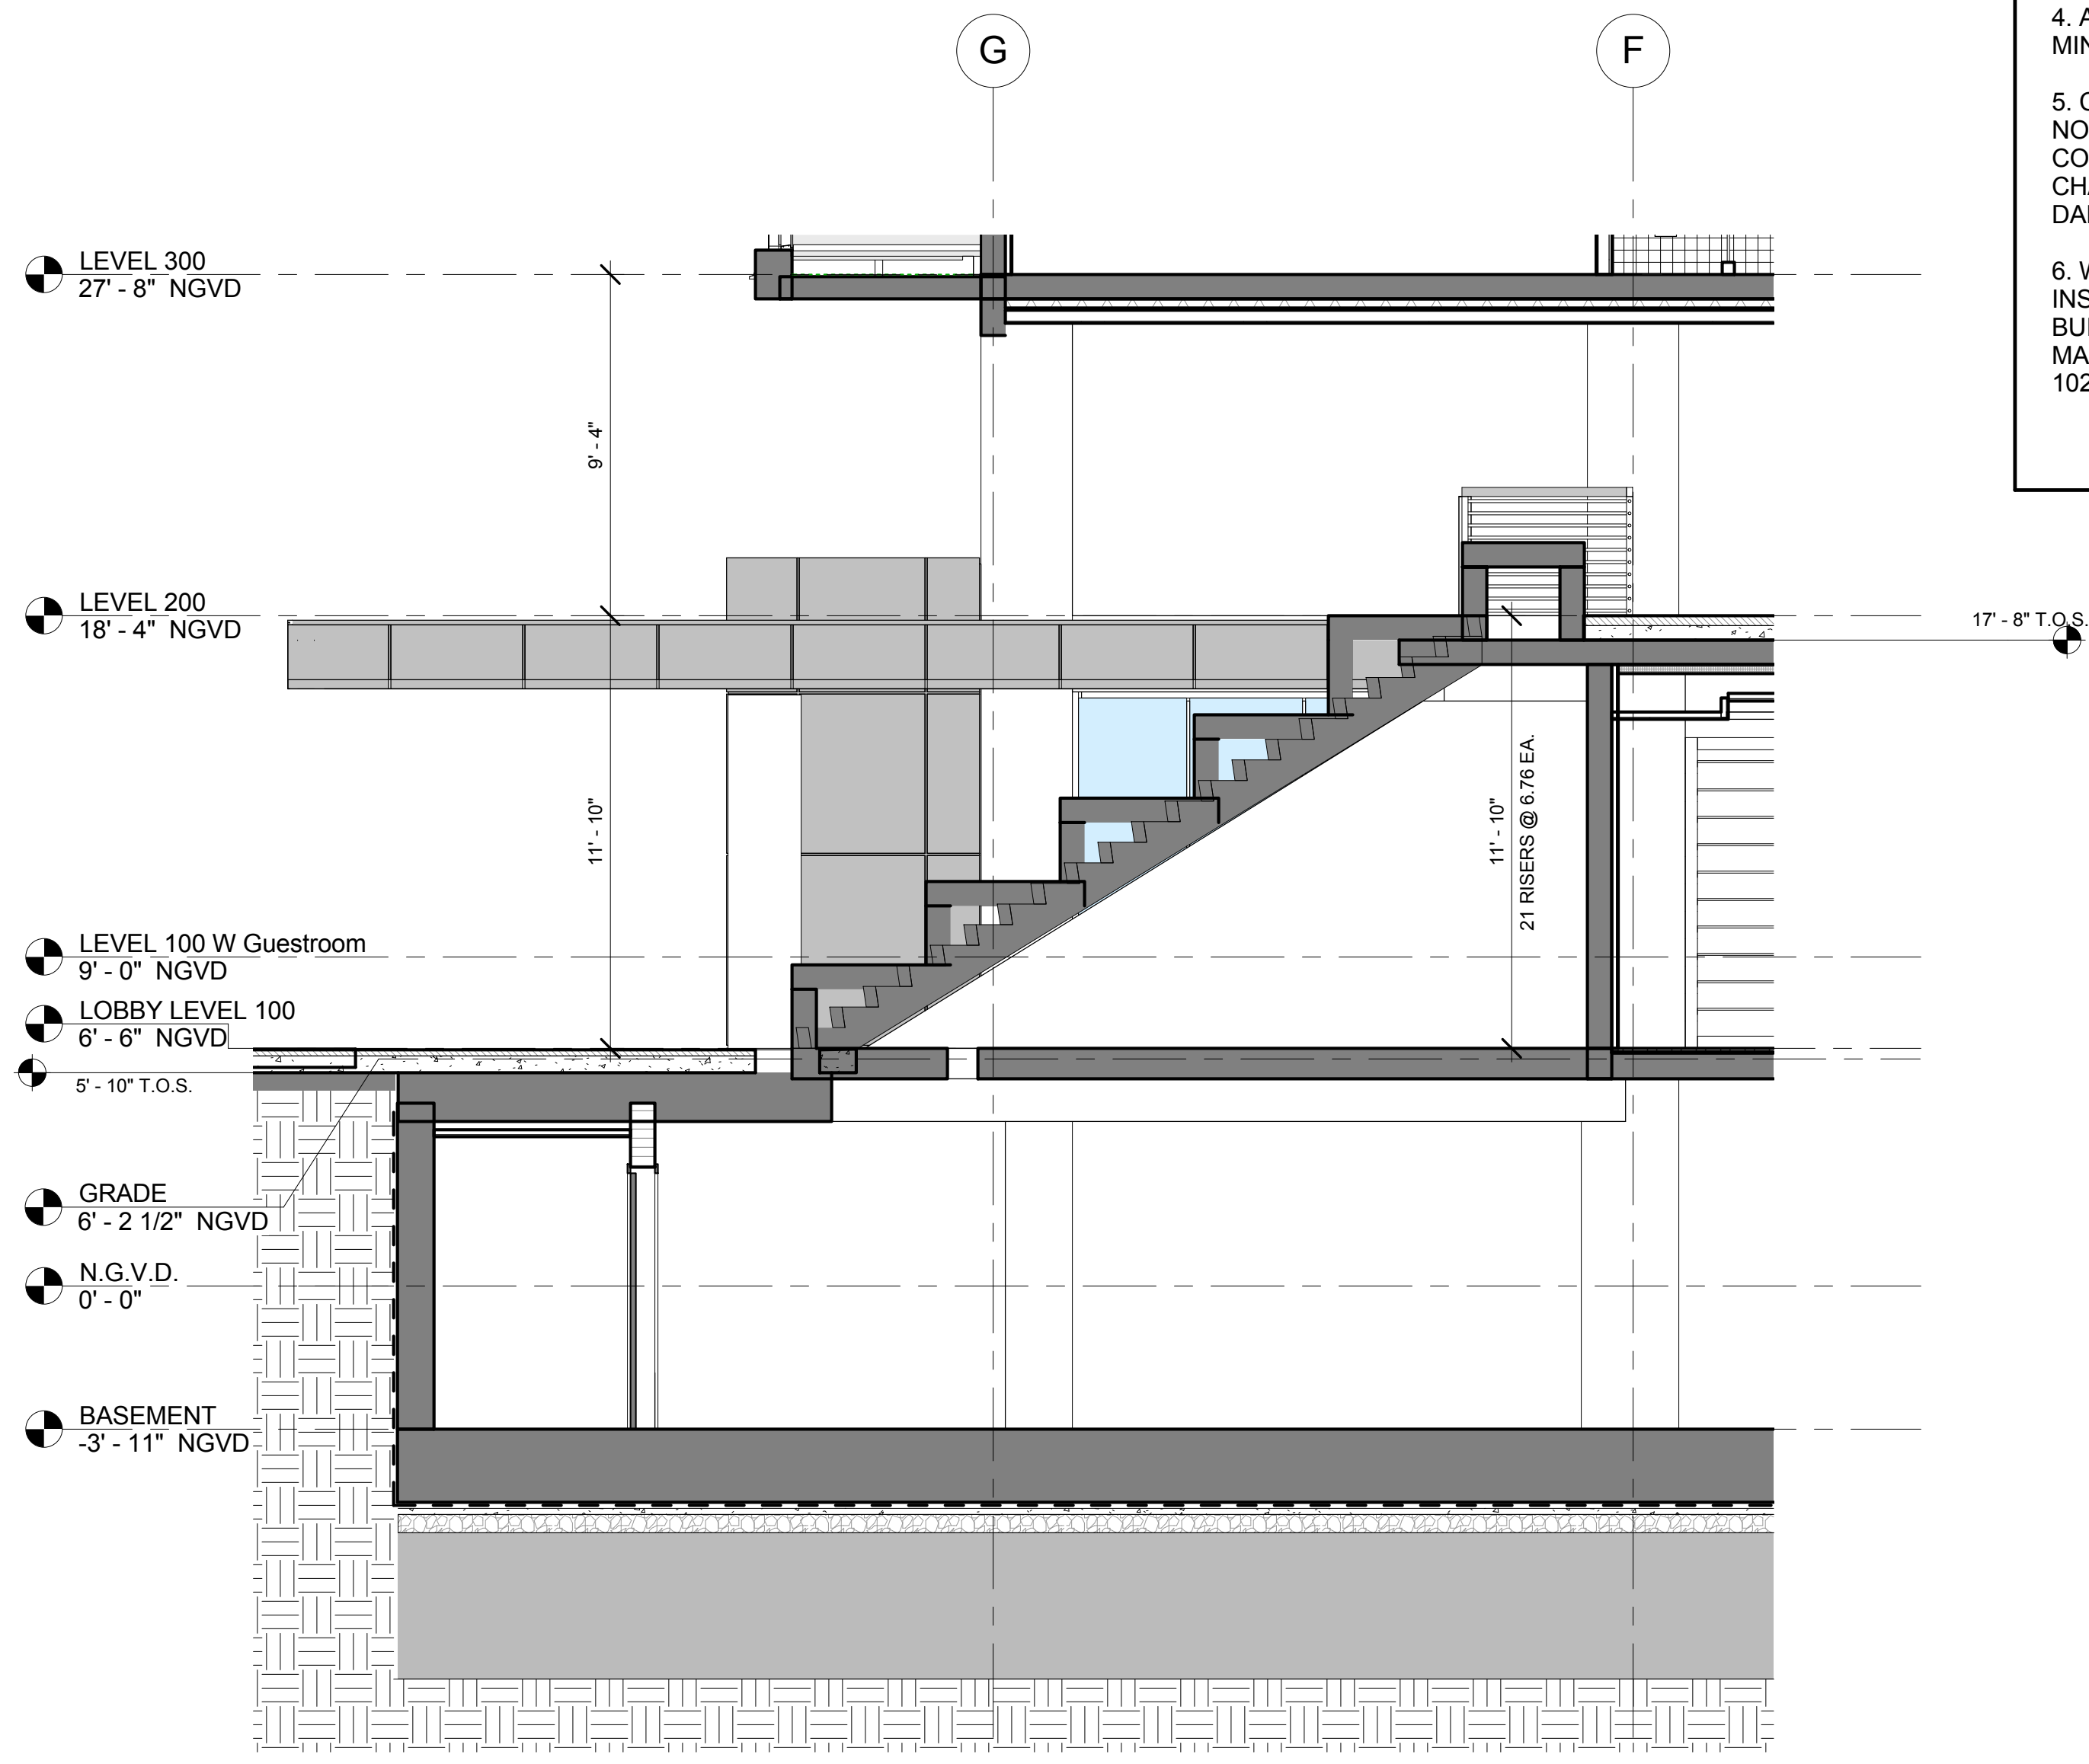

5 SECTION - STAIR 03 PEDESTAL STEPS

1/4" = 1'-0"

NEW BUILDING ELEVATIONS HAVE
CHANGED THEREFORE THE STAIRS
HAVE CHANGED

STAIR GENERAL NOTES

TYPICAL FOR ALL STAIRS PROVIDING EGRESS FROM BUILDING
UNLESS OTHERWISE NOTED.

HANDRAILS:

- SHALL BE 1 1/2" DIA. STEEL UNLESS OTHERWISE NOTED.
- HEIGHT SHALL BE 36" ABOVE NOSING.
- SHALL EXTEND 12" PAST NOSING AT TOP AND BOTTOM OF LANDING.
- CLEAR SPACE BETWEEN A HANDRAIL AND A WALL OR GUARDRAIL SHALL BE 1 1/2" MIN.
- HANDRAILS TO COMPLY WITH SECTION 1012 OF THE F.B.C.

GUARDRAILS:

- SHALL BE 1 1/2" DIA. STEEL UNLESS OTHERWISE NOTED.
- SHALL BE 42" ABOVE NOSING.
- SHALL HAVE 1" PICKETS, O.C. TO REJECT A 4" DIA. SPHERE (TYP.)
- BOTTOM SHALL REJECT A 2" DIA. SPHERE (TYP.).
- AT CENTER OF STAIR THERE SHALL BE AN ADDITIONAL CONT. HANDRAIL, CONFORMING TO HANDRAIL CRITERIA ABOVE.
- HANDRAILS MAY NOT BE SHOWN IN SECTION. REFER TO PLANS.
- REFER TO SHEET A12.08 FOR TYPICAL DETAILS.
- GUARDRAILS SHALL COMPLY WITH SECTION 1013 OF THE F.B.C.
- EGRESS WIDTH OF STAIR IS THE CLEAR DIMENSION FROM THE INSIDE WALL OR GUARDRAIL TO THE OPPOSITE SIDE INSIDE WALL OR GUARDRAIL.

EXIT ENCLOSURES:

- EXIT ENCLOSURES TO COMPLY W/ FBC SECTION 1022.
- EXIT ENCLOSURE SIGNAGE TO COMPLY W/ FBC SECTION 1022.8

SIGNAGE:

PROVIDE STAIR IDENTIFICATION PER FBC 1009.6.4:
AN APPROVED SIGN SHALL BE LOCATED AT EACH FLOOR LEVEL LANDING IN ALL ENCLOSED STAIRWAYS OF BUILDINGS FOUR OR MORE STORIES IN HEIGHT. THE SIGN SHALL INDICATE THE FLOOR LEVEL AND THE AVAILABILITY OF ROOF ACCESS FROM THAT STAIRWAY AND IDENTIFICATION OF THE STAIRWAY. THE SIGN SHALL ALSO STATE THE FLOOR LEVEL OF AND DIRECTION TO EXIT DISCHARGE. THE SIGN SHALL BE LOCATED APPROXIMATELY 5 FEET (1524mm) ABOVE THE FLOOR LANDING IN A POSITION WHICH IS READILY VISIBLE WHEN THE DOOR IS IN THE OPEN OR CLOSED POSITION. THE FLOOR LEVEL DESIGNATION SHALL ALSO BE TACTILE IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, ACCESSIBILITY.

SIGNAGE REQUIREMENTS AS PER FBC 1022.8.1:
STAIRWAY IDENTIFICATION SIGNS SHALL COMPLY WITH ALL OF THE FOLLOWING REQUIREMENTS:

1. THE SIGN SHALL BE A MINIMUM SIZE OF 18 INCHES BY 12 INCHES (457 MM BY 305 MM).
2. THE LETTERS DESIGNATING THE IDENTIFICATION OF THE STAIR ENCLOSURE SHALL BE A MINIMUM OF 1 1/2 INCHES (38MM).
3. THE NUMBER DESIGNATING THE FLOOR LEVEL SHALL BE A MINIMUM OF 5 INCHES (127MM) IN HEIGHT AND LOCATED IN THE CENTER OF THE SIGN.
4. ALL OTHER LETTERING AND NUMBERS SHALL BE A MINIMUM OF 1 INCH (25MM) IN HEIGHT.
5. CHARACTERS AND THEIR BACKGROUND SHALL HAVE A NONGLARE FINISH. CHARACTERS SHALL CONTRAST WITH THEIR BACKGROUND, WITH EITHER LIGHT CHARACTERS ON A DARK BACKGROUND OR DARK CHARACTERS ON A LIGHT BACKGROUND.
6. WHEN SIGNS REQUIRED BY SECTION 1022.8 ARE INSTALLED IN INTERIOR EXIST ENCLOSURES OF BUILDINGS SUBJECT TO SECTION 1024, THE SIGNS SHALL BE MADE OF THE SAME MATERIALS AS REQUIRED BY SECTION 1024.4.

Permit Issue
10-13-14


REVISIONS

#	Description	Date
1	CMB Bldg. Dept. Comments	12/16/14
2	CMB Bldg. Dept. Comments	01/15/15
3	CMB Bldg. Dept. Comments	03/25/15
5	Revisions	06-12-15

12064

A7.05


4- SURFACE -APPLIED MARKING STRIPES USING ADHESIVE-BACKED TAPES SHALL NOT BE USED

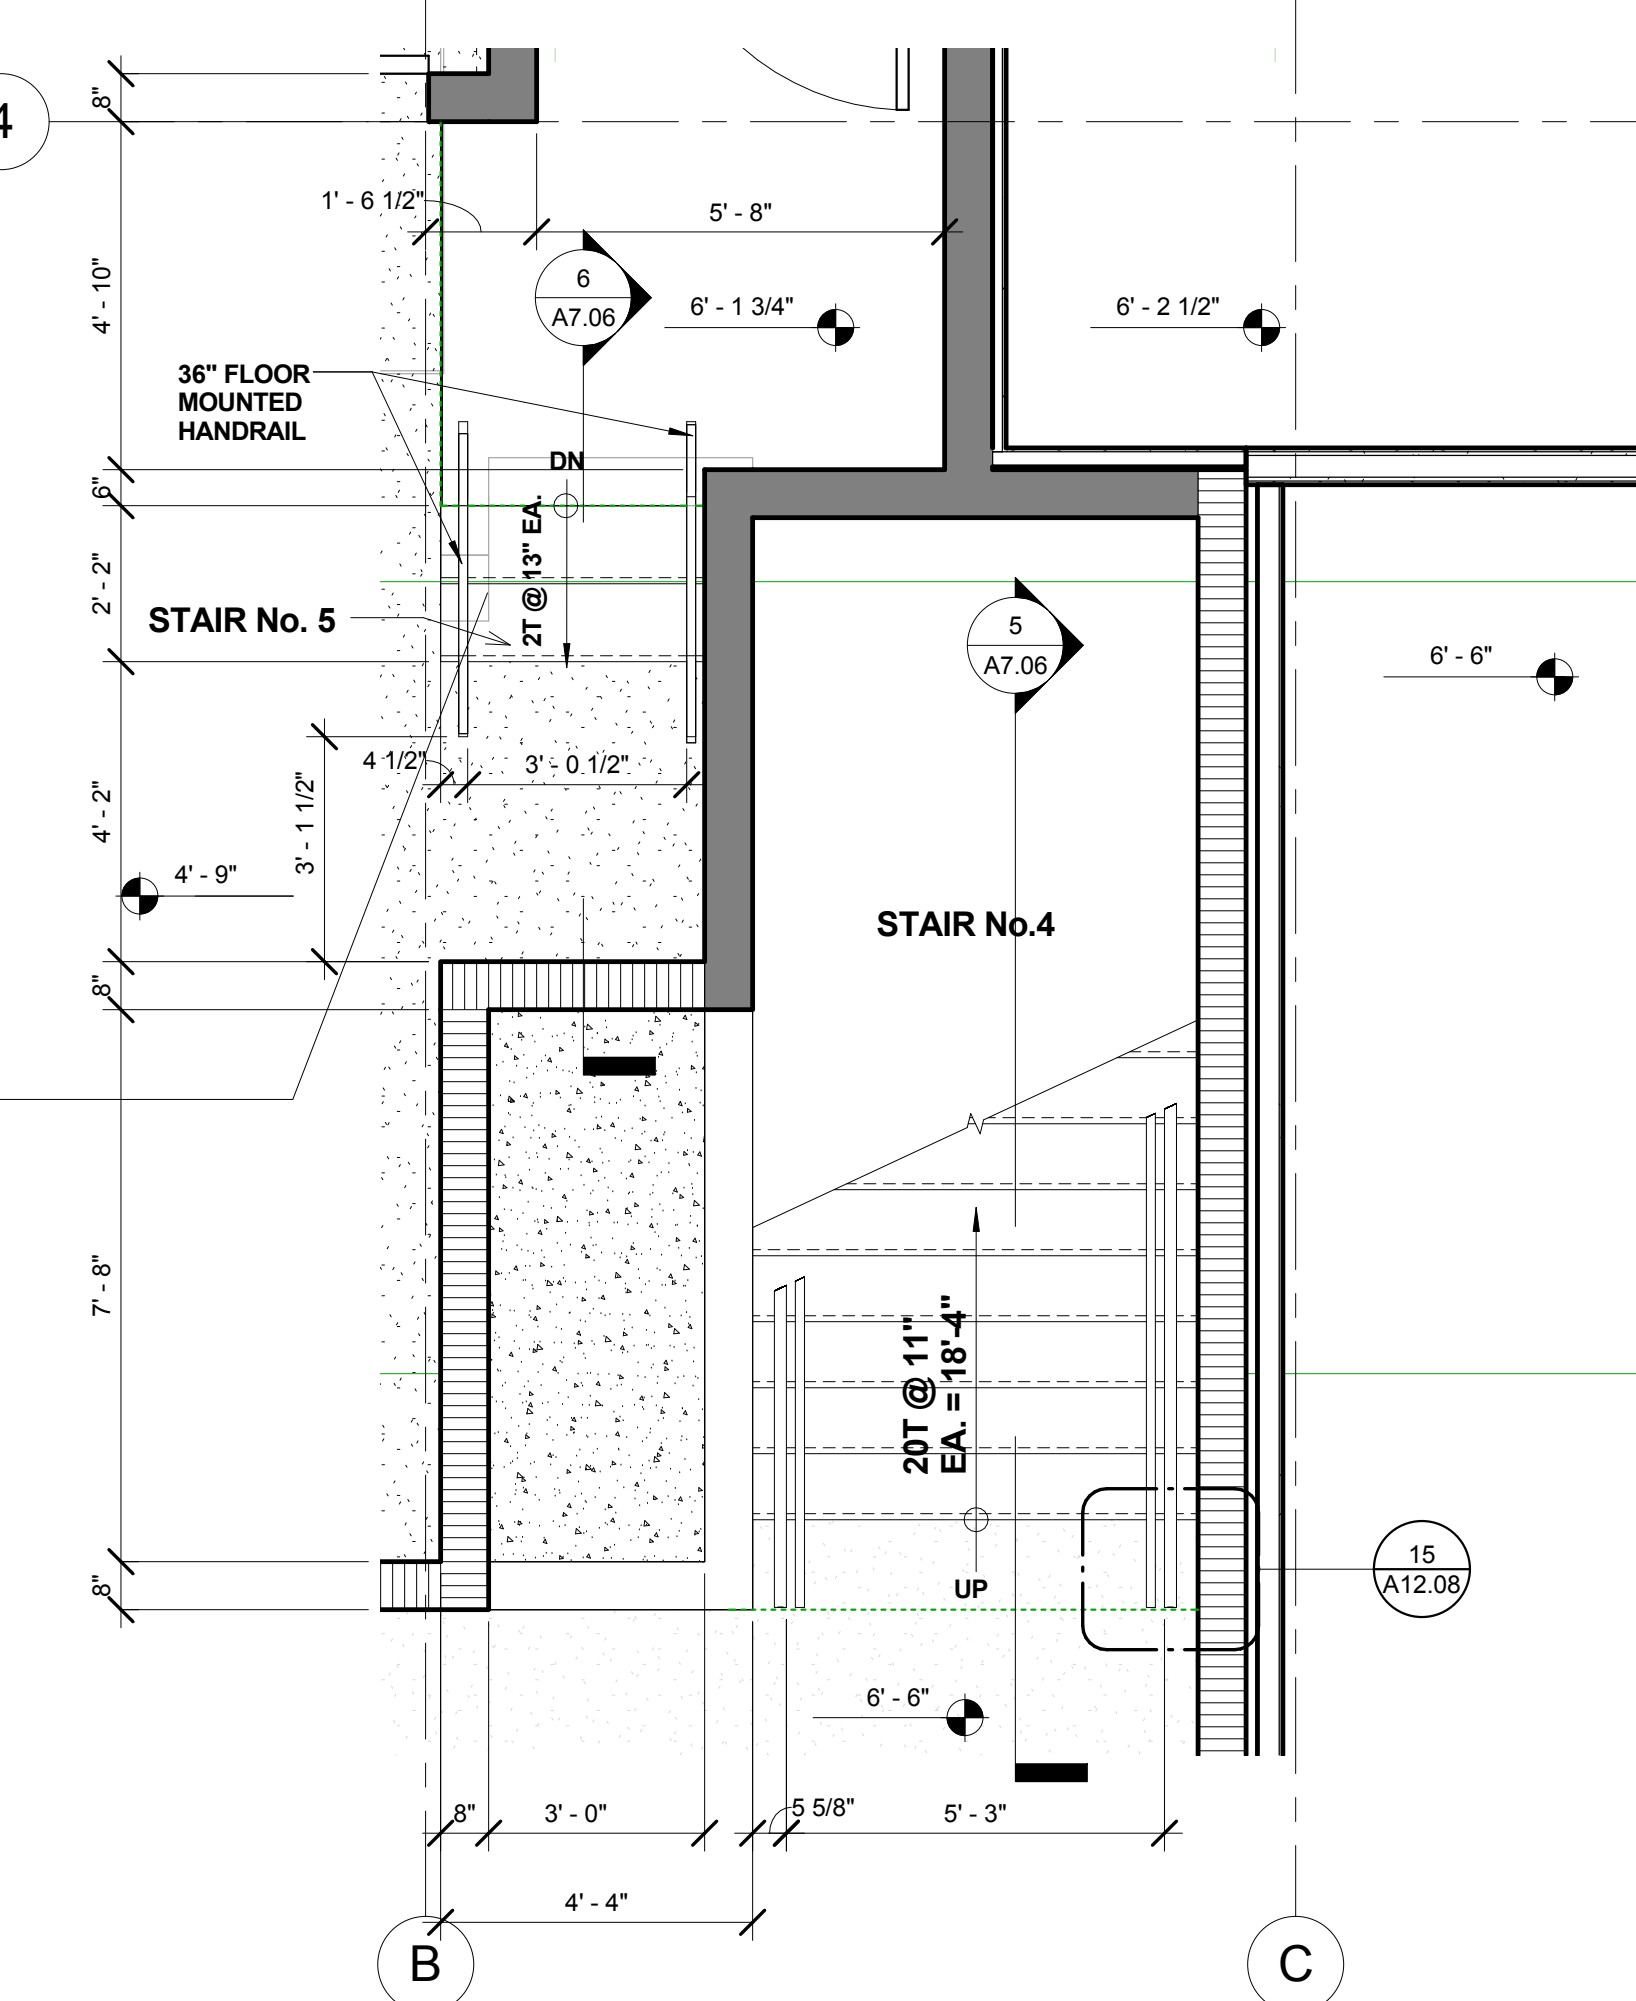


STAIR 04 AND 05 - LEVEL 100

$$\frac{3}{8}'' = 1'-0''$$


NEW BUILDING ELEVATIONS HAVE
CHANGED THEREFORE THE STAIRS
HAVE CHANGED IN HEIGHT

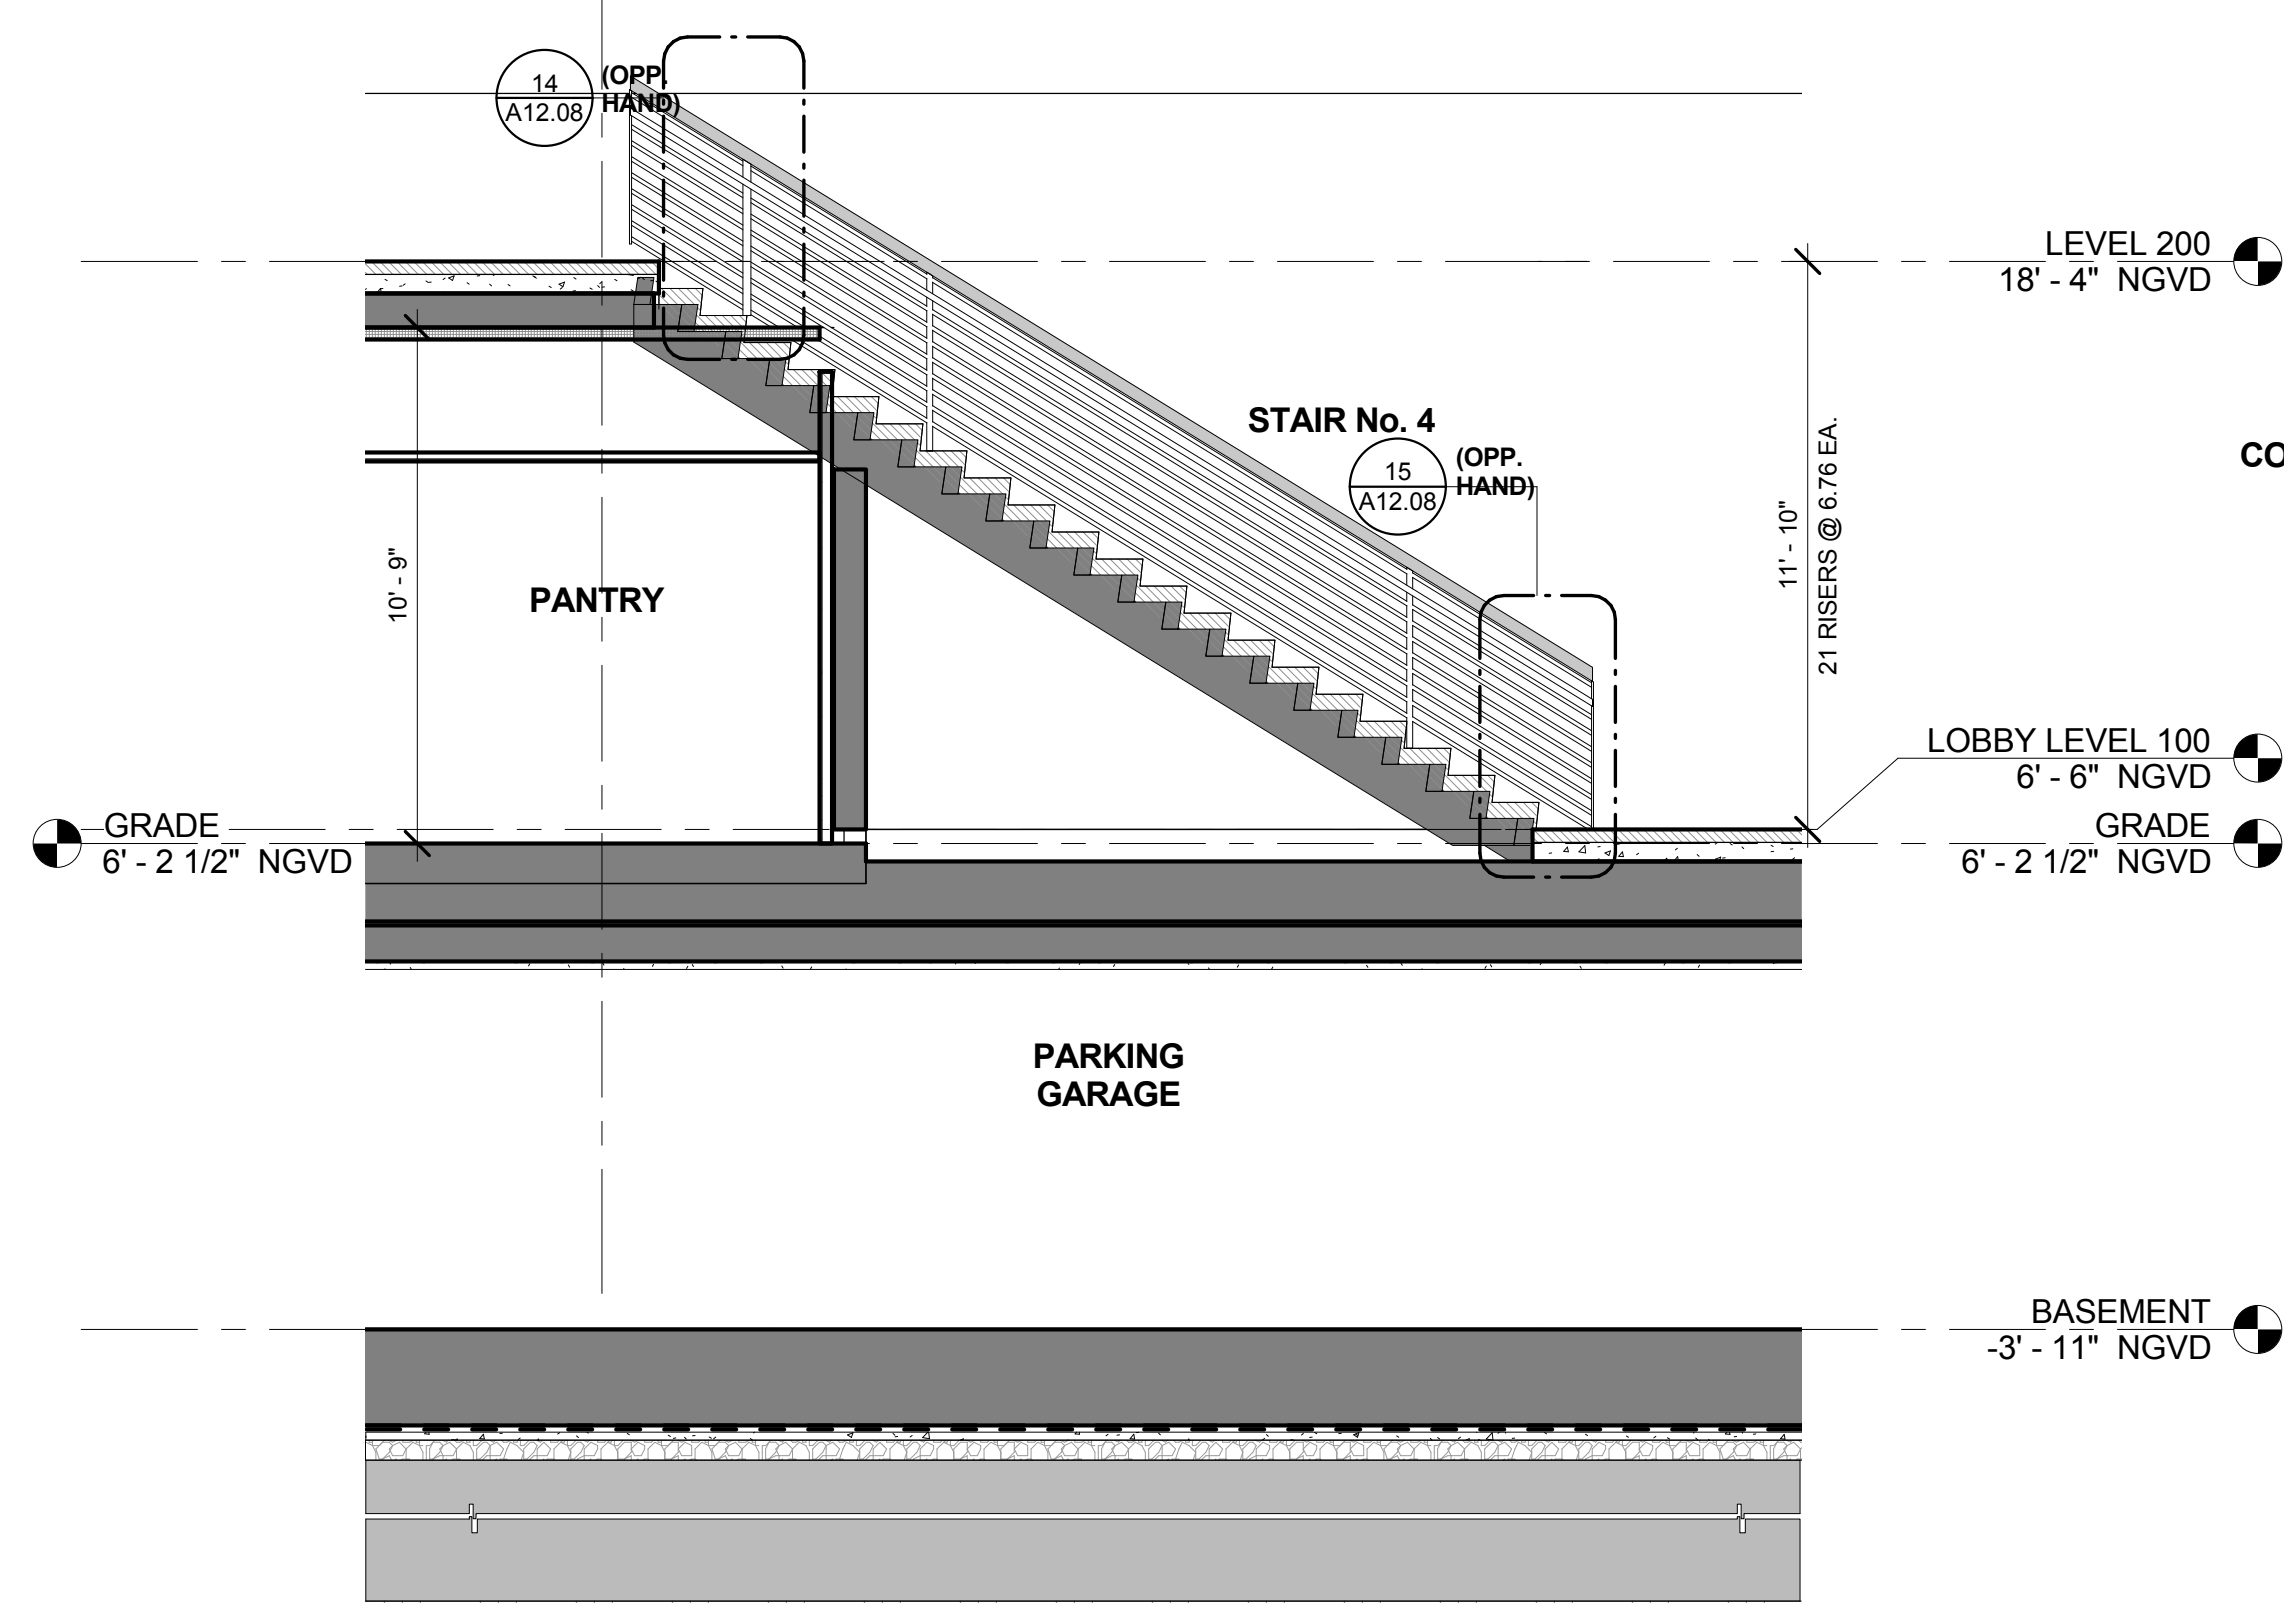

SECTION - STAIR 04
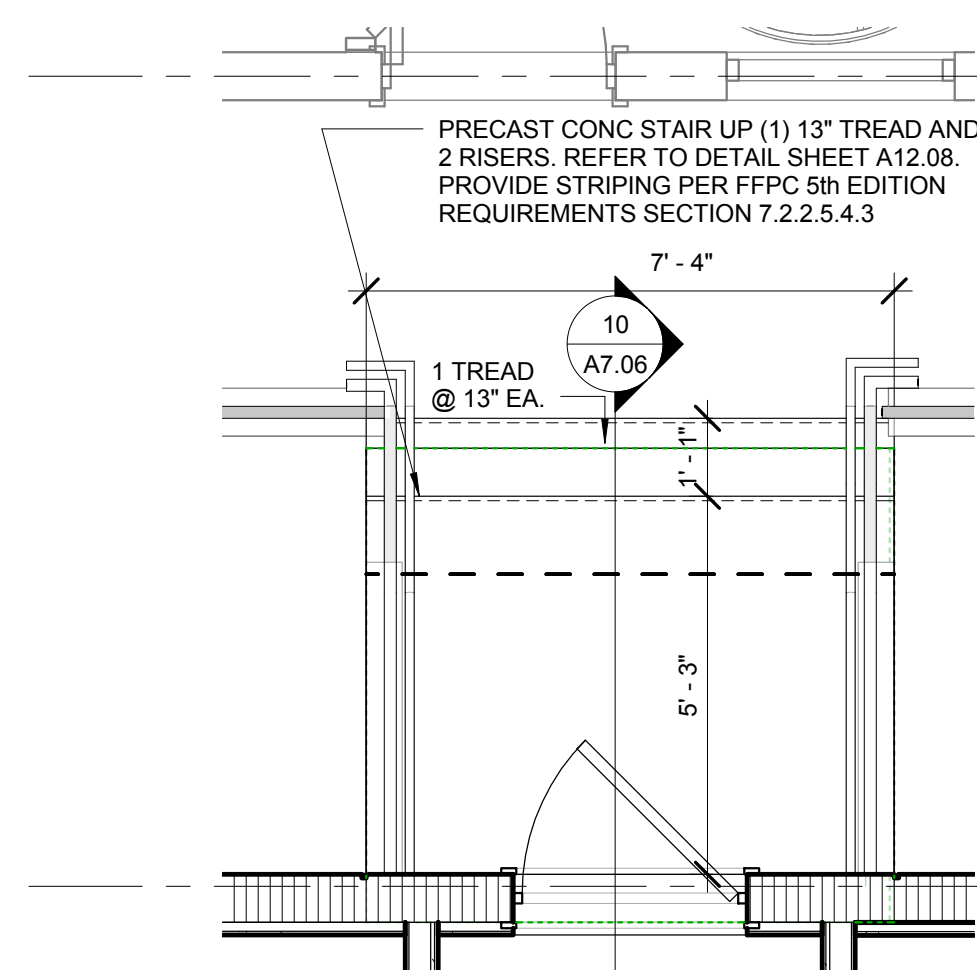
$$1/4'' = 1'-0''$$


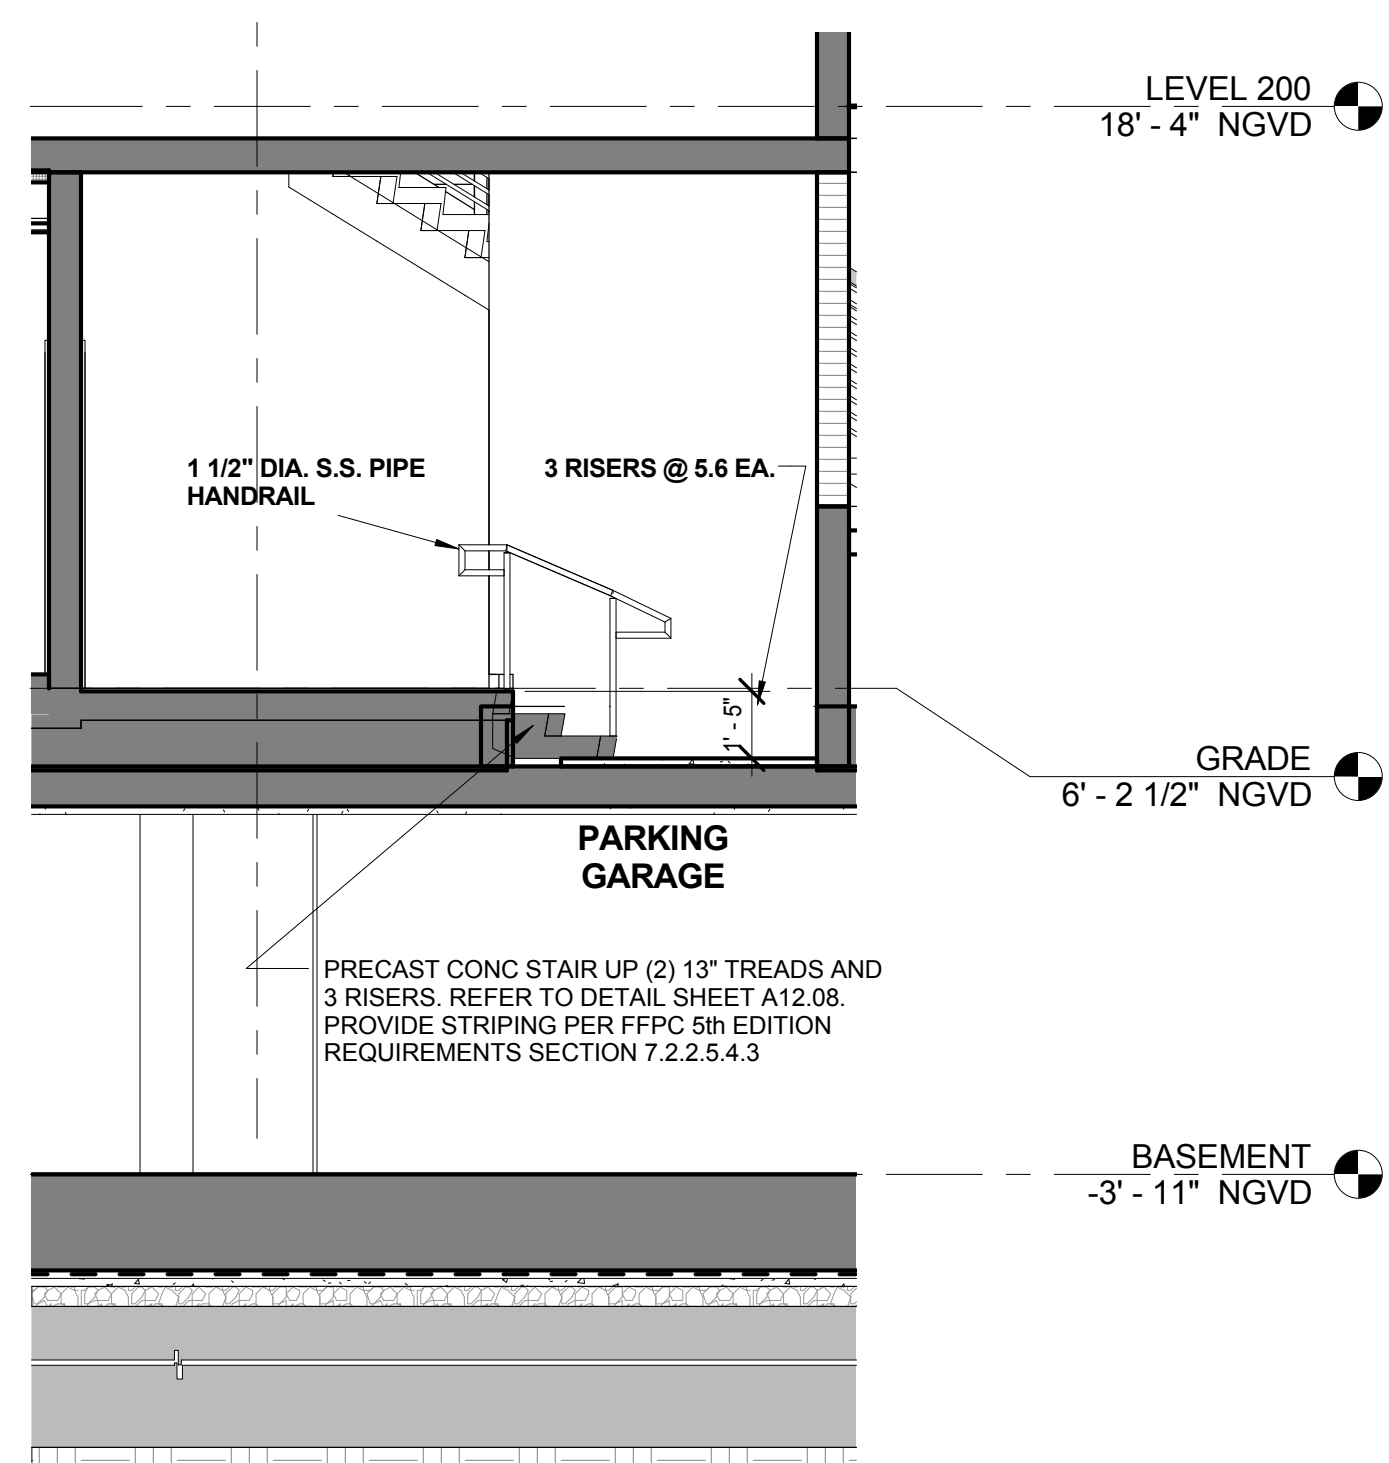
STAIR 11-LEVEL 300,400 AND 500
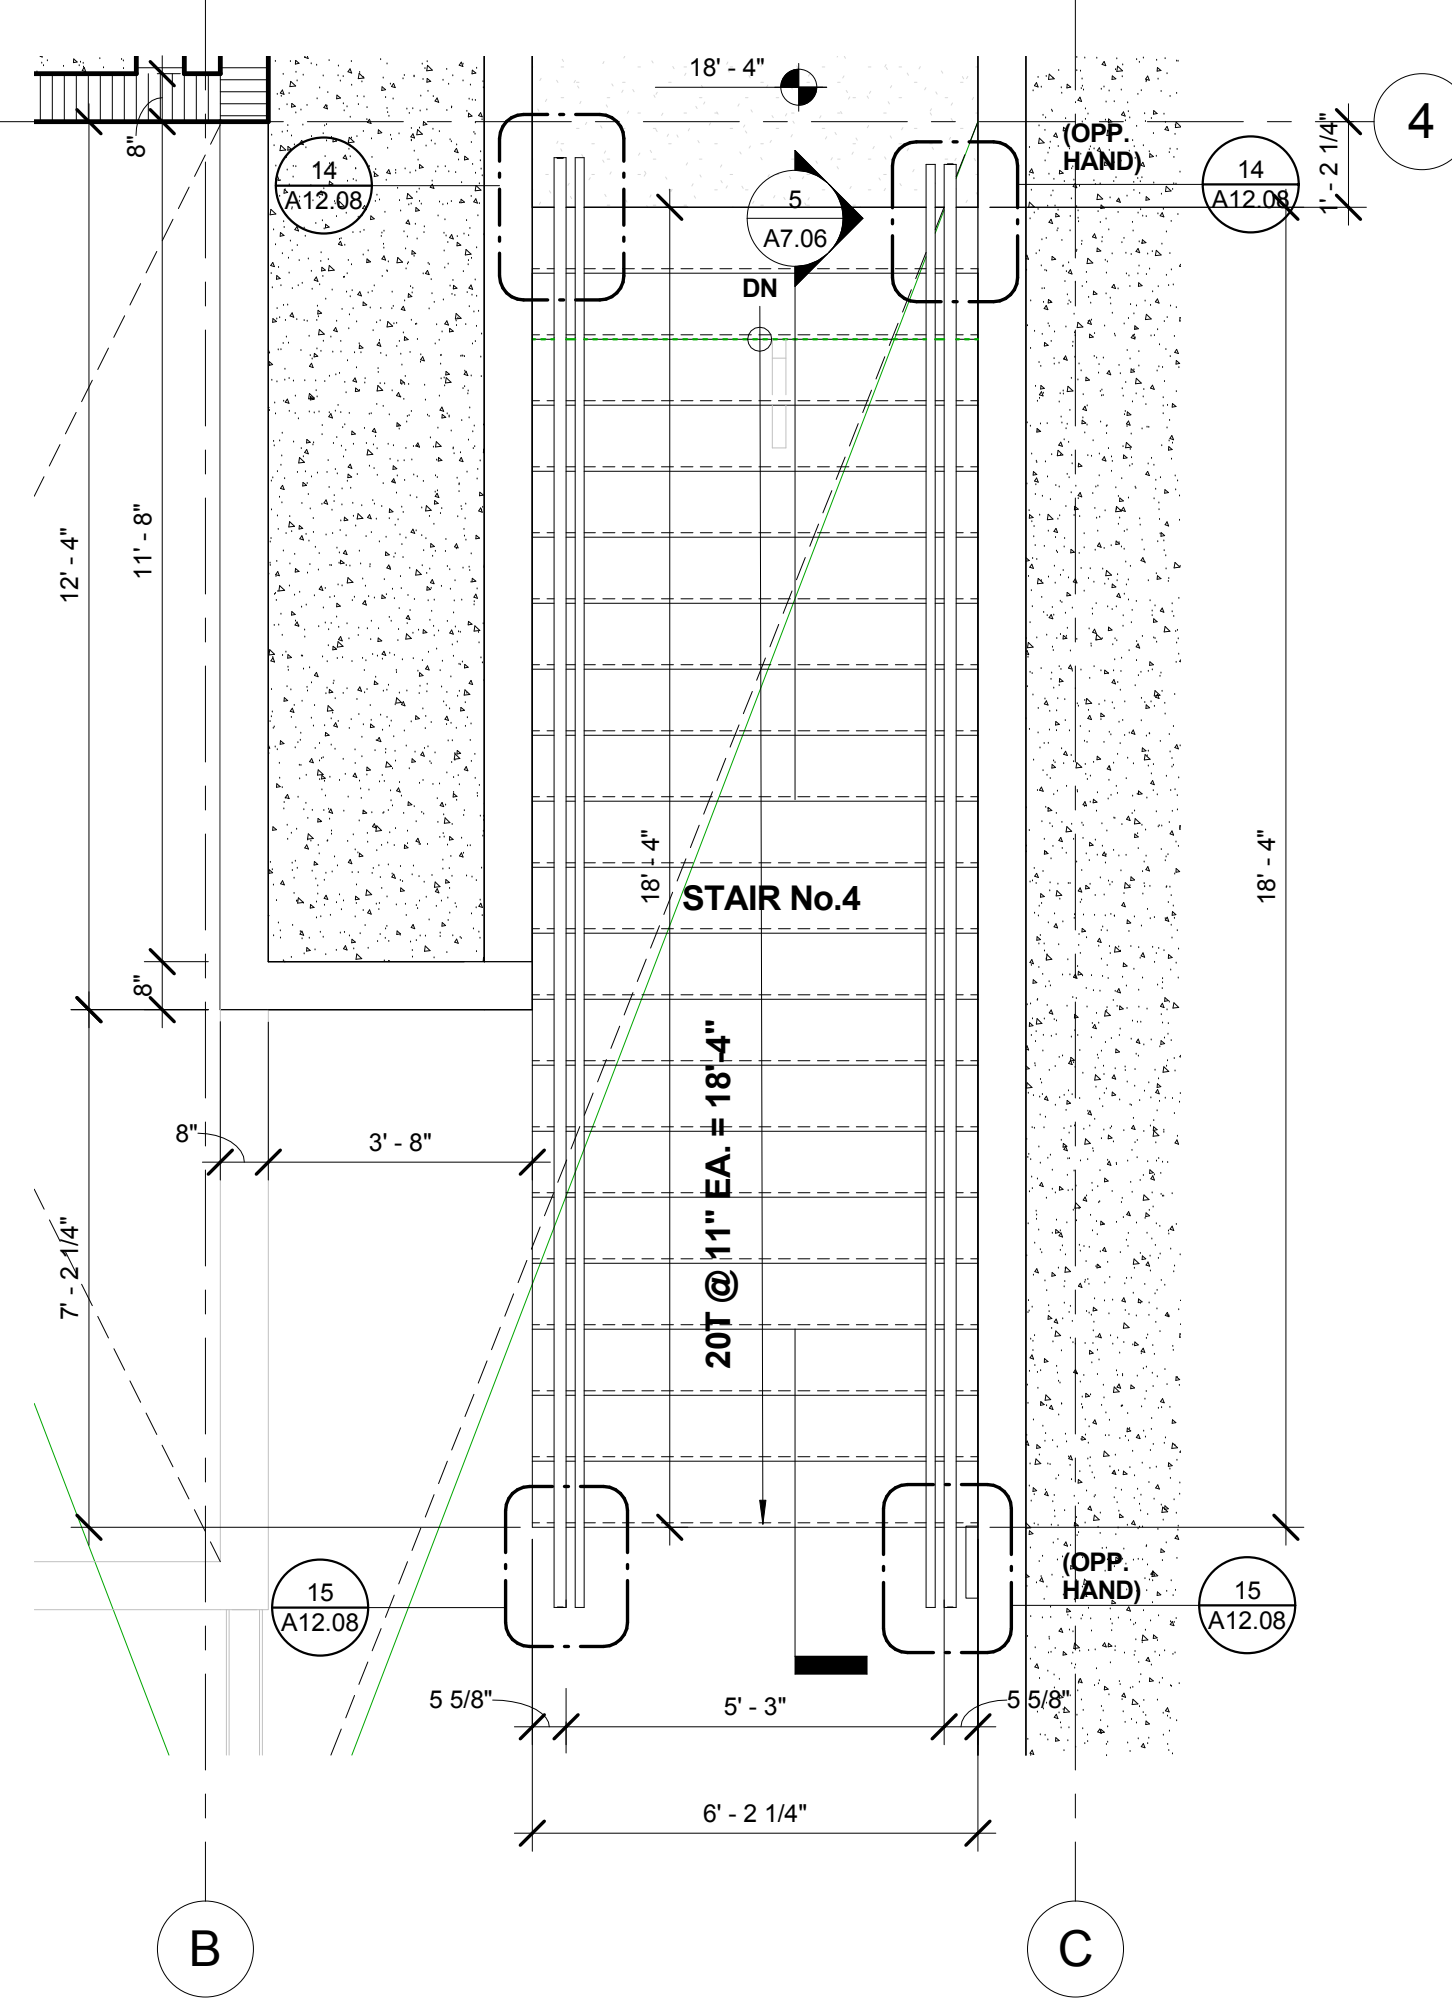
$$3/8'' = 1'-0''$$


STAIR 04 - LEVEL 200

$$\frac{3}{8}'' = 1'-0''$$


NEW BUILDING ELEVATIONS HAVE
CHANGED THEREFORE THE STAIRS
HAVE CHANGED IN HEIGHT




SECTION - STAIR 05

$$1/4'' = 1'-0''$$


- PRECAST CONC STAIR UP (1) 13" TREAD AND 2 RISERS. REFER TO DETAIL SHEET A12.08. PROVIDE STRIPING PER FFPC 5th EDITION REQUIREMENTS SECTION 7.2.2.5.4.3

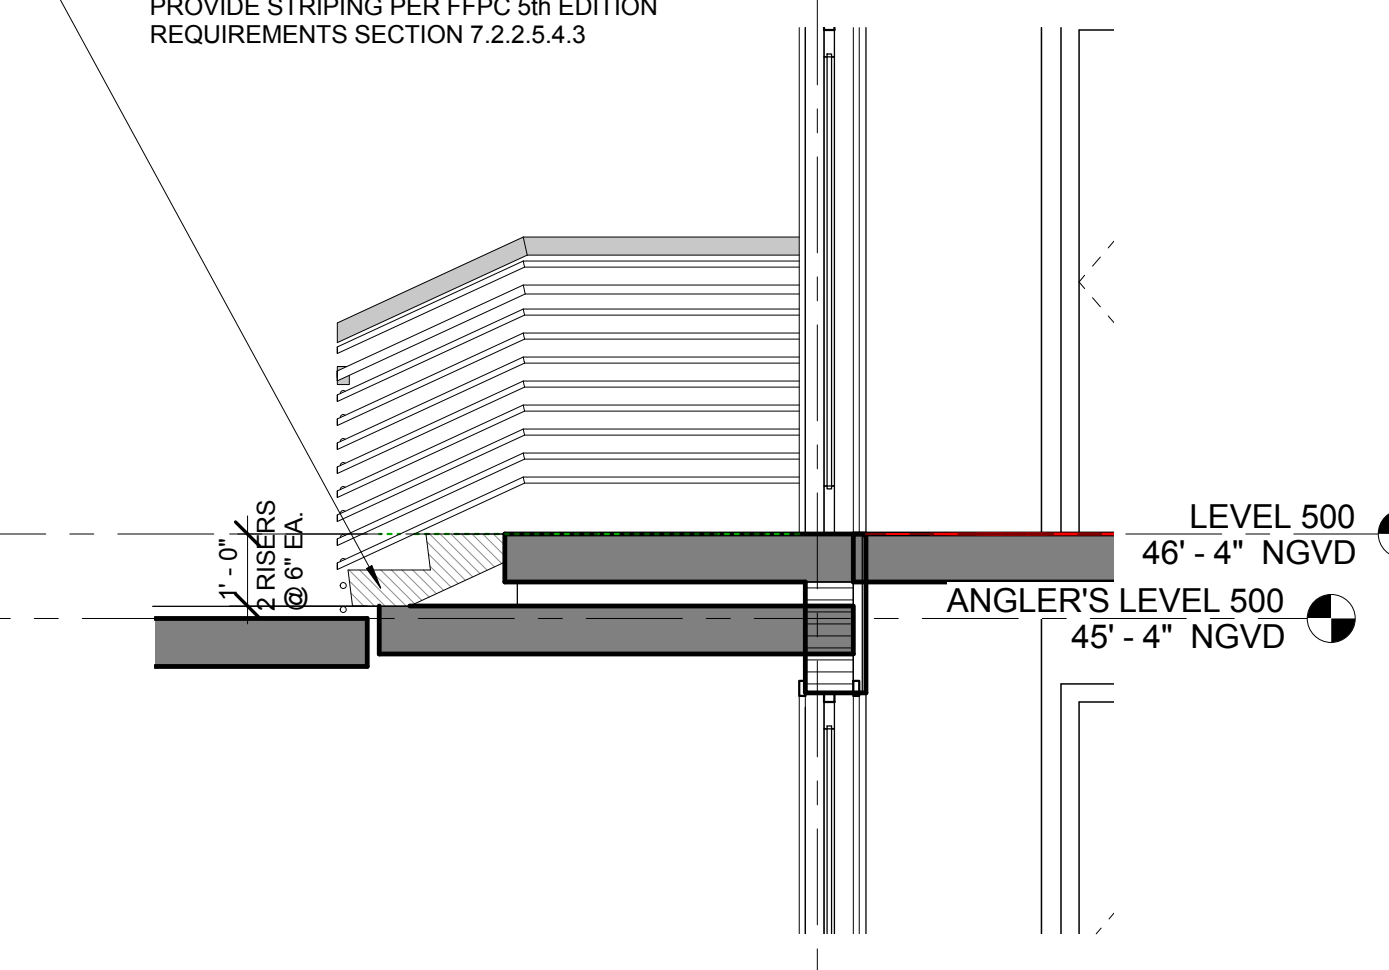


STAIR 11-SECTION
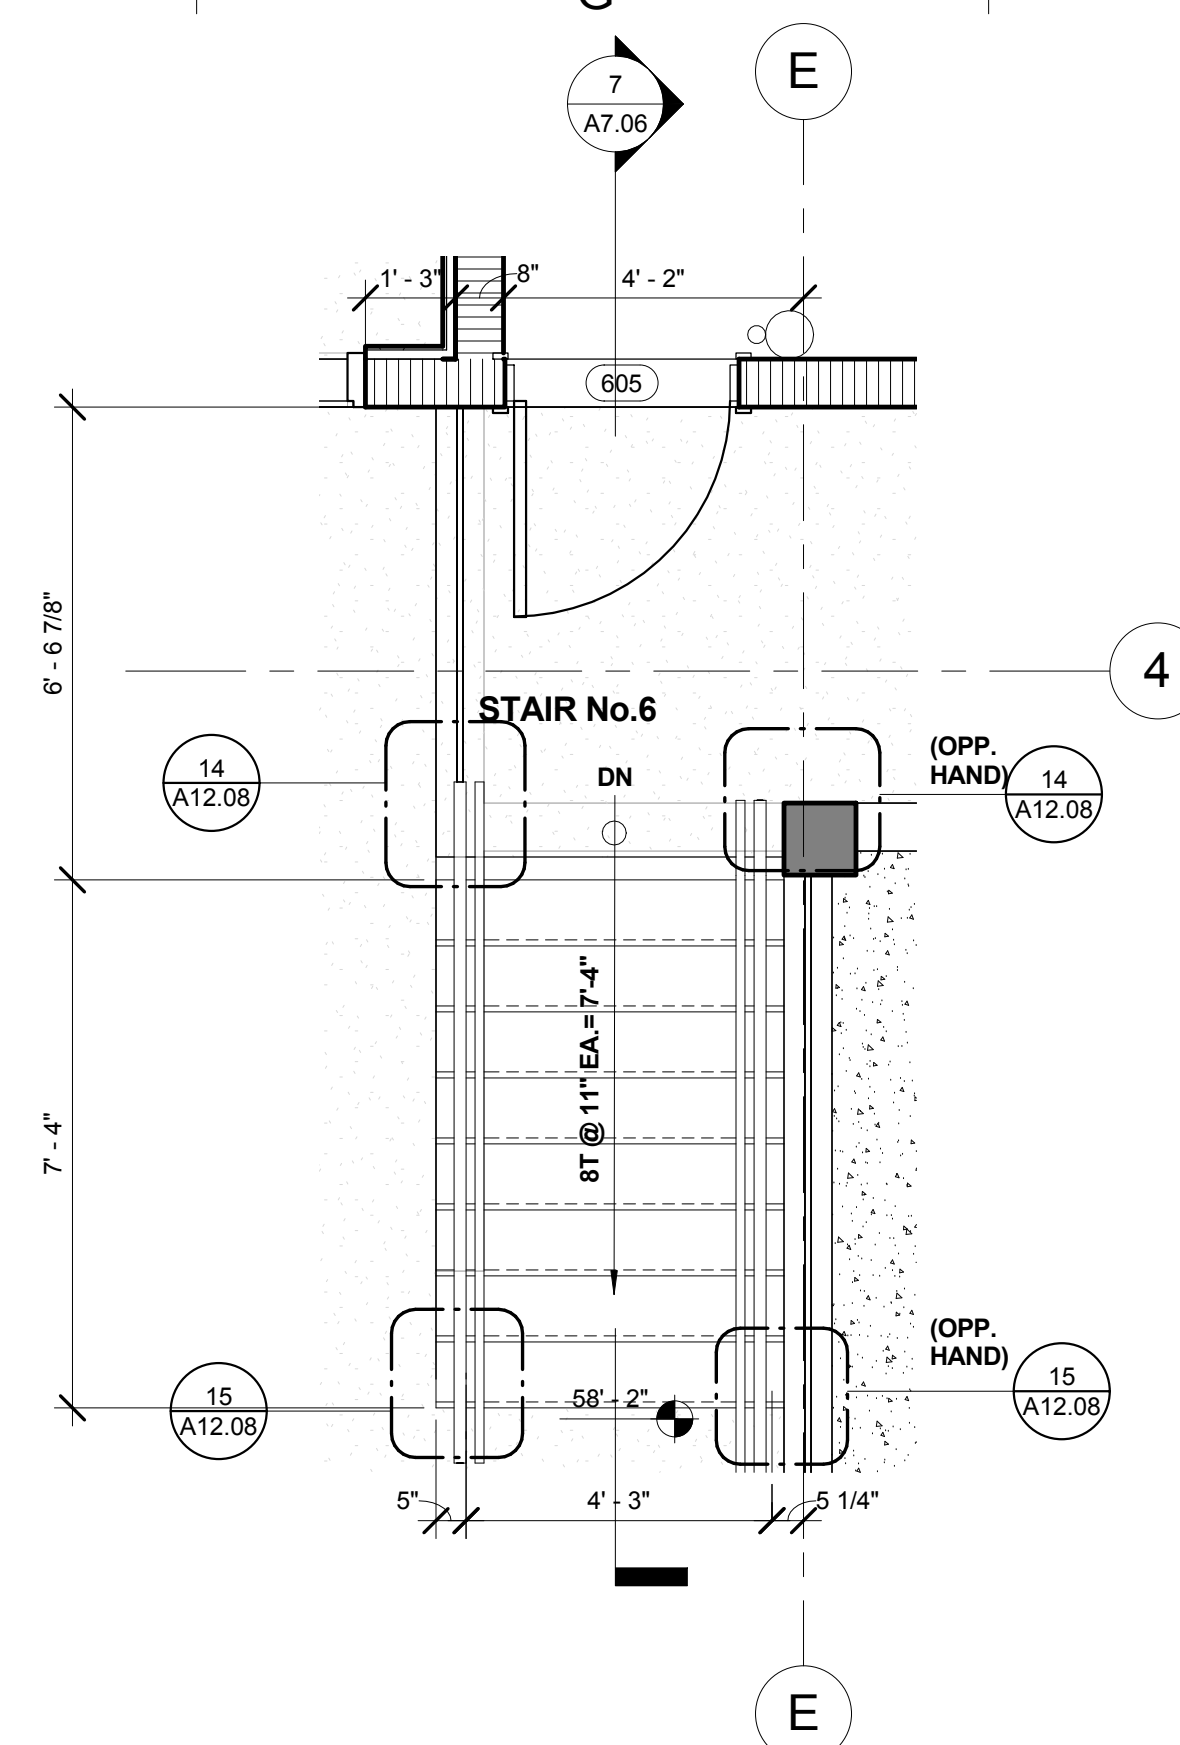
$$\frac{3}{8}'' = 1'-0''$$


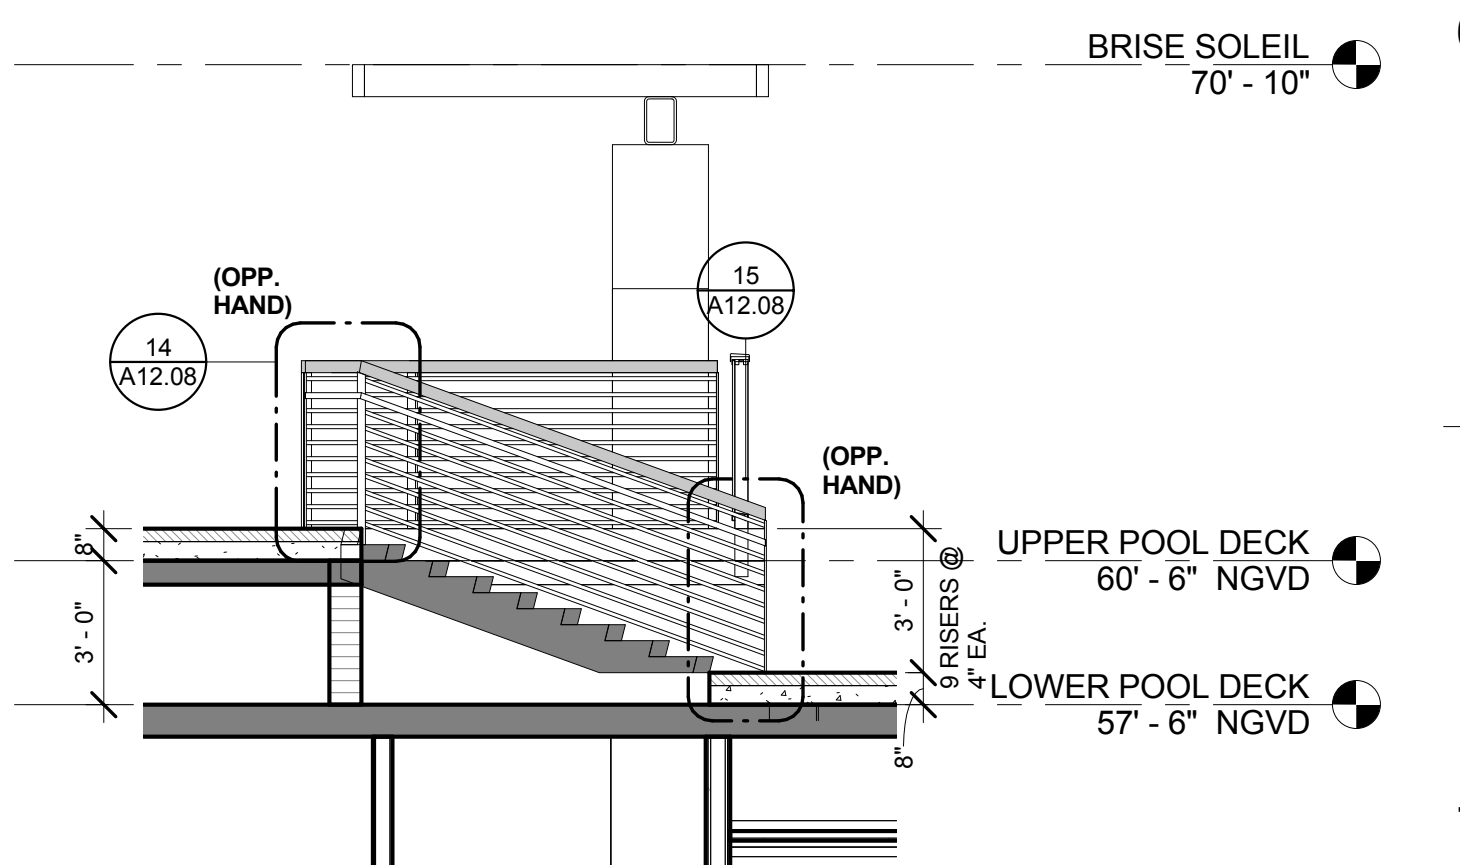
STAIR 06 - LEVEL POOL DECK
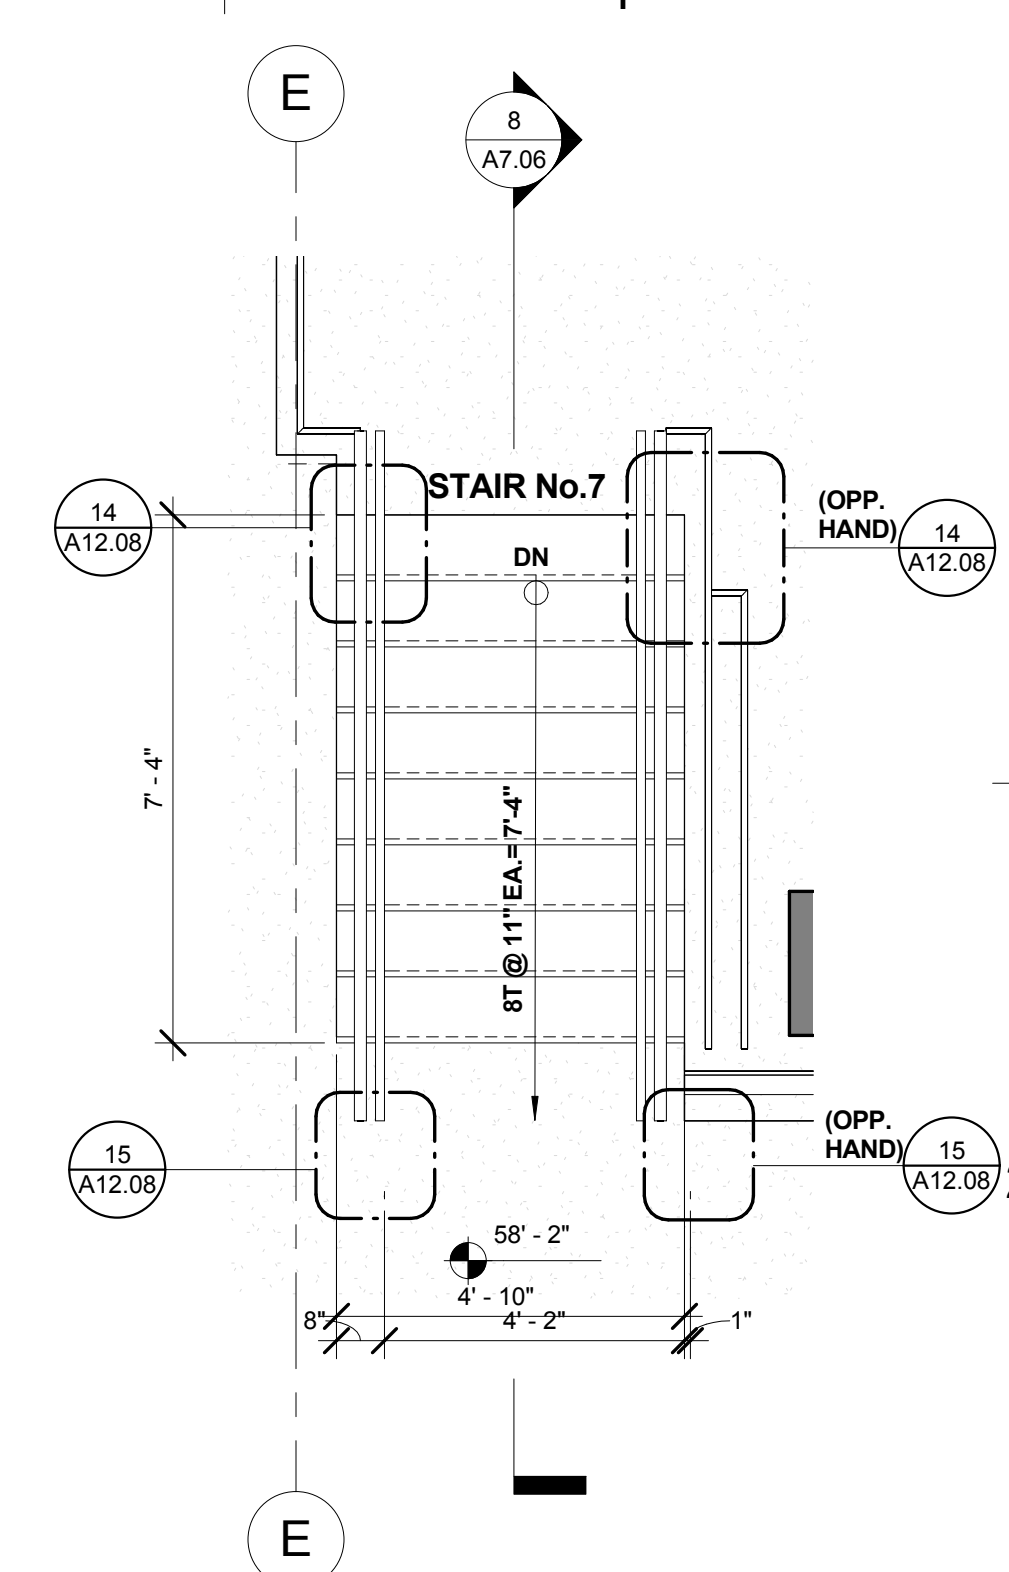
$$3/8" = 1'-0"$$


STAIR 07 - LEVEL POOL DECK

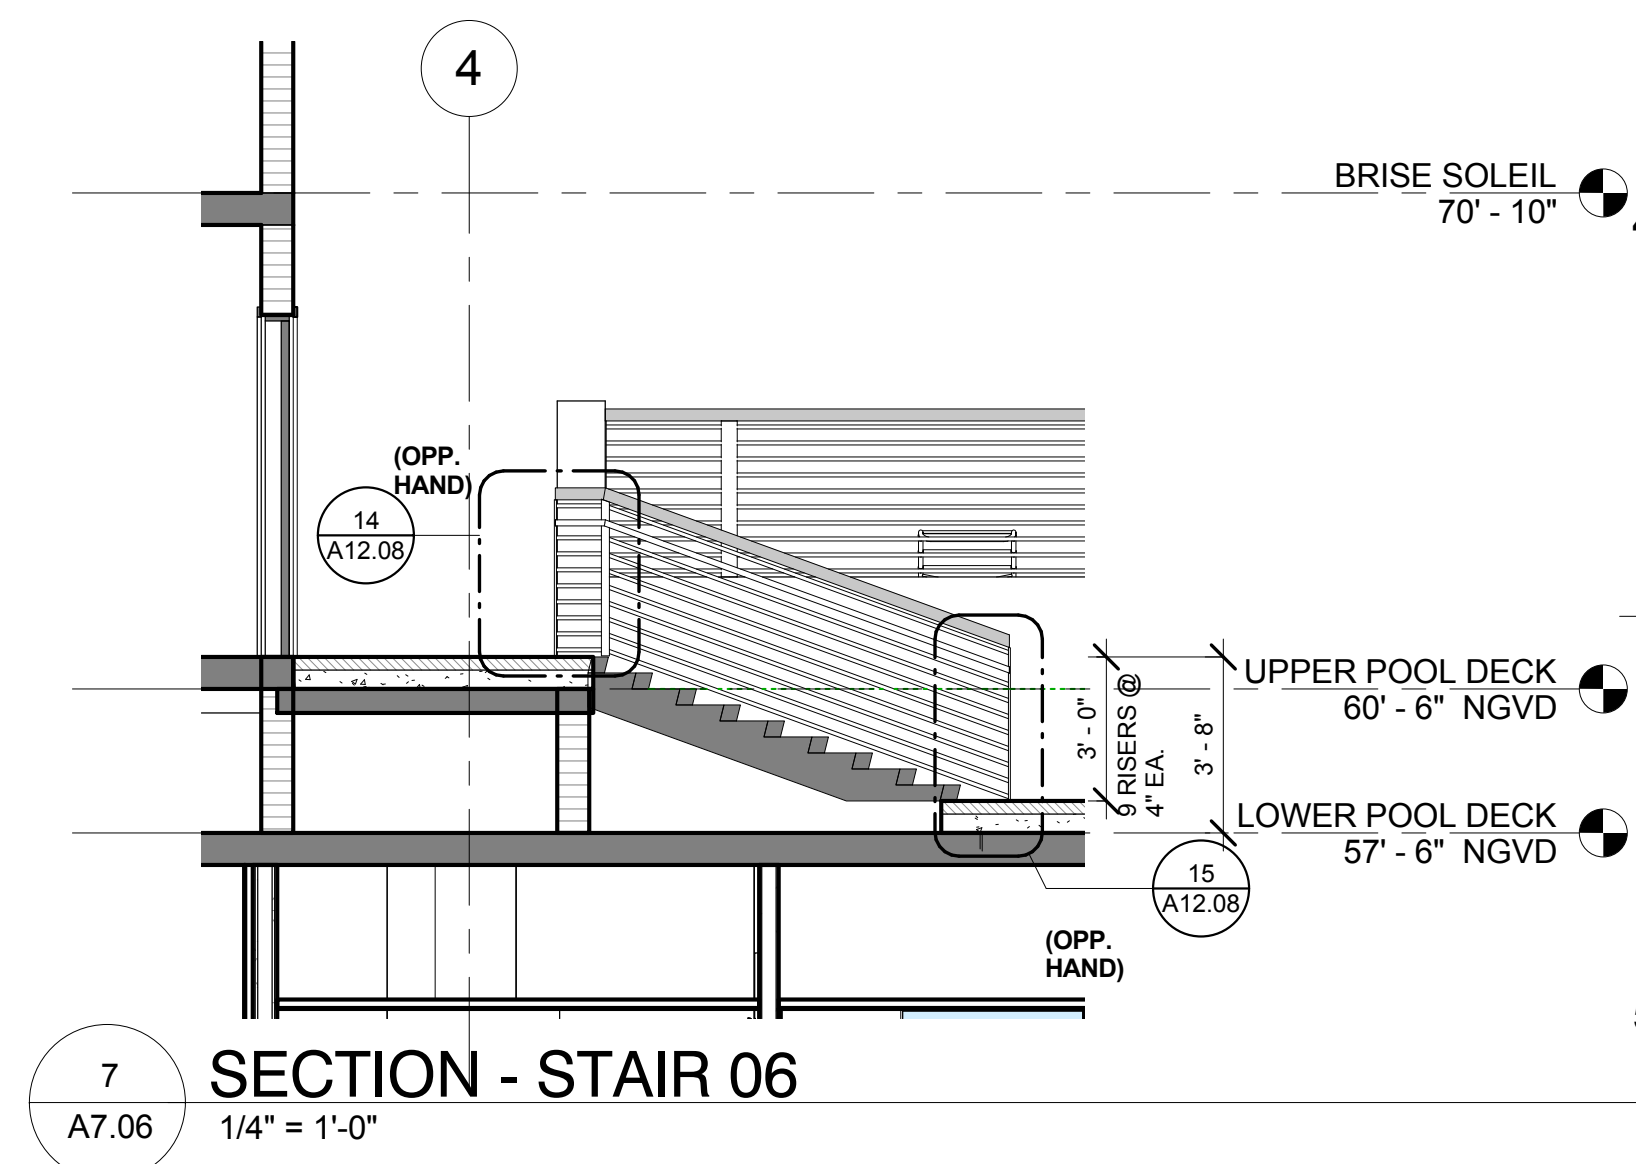
$$3/8'' = 1'-0''$$


SECTION - STAIR 06

$$1/4'' = 1'-0''$$


SECTION - STAIR 07

$$1/4'' = 1'-0''$$

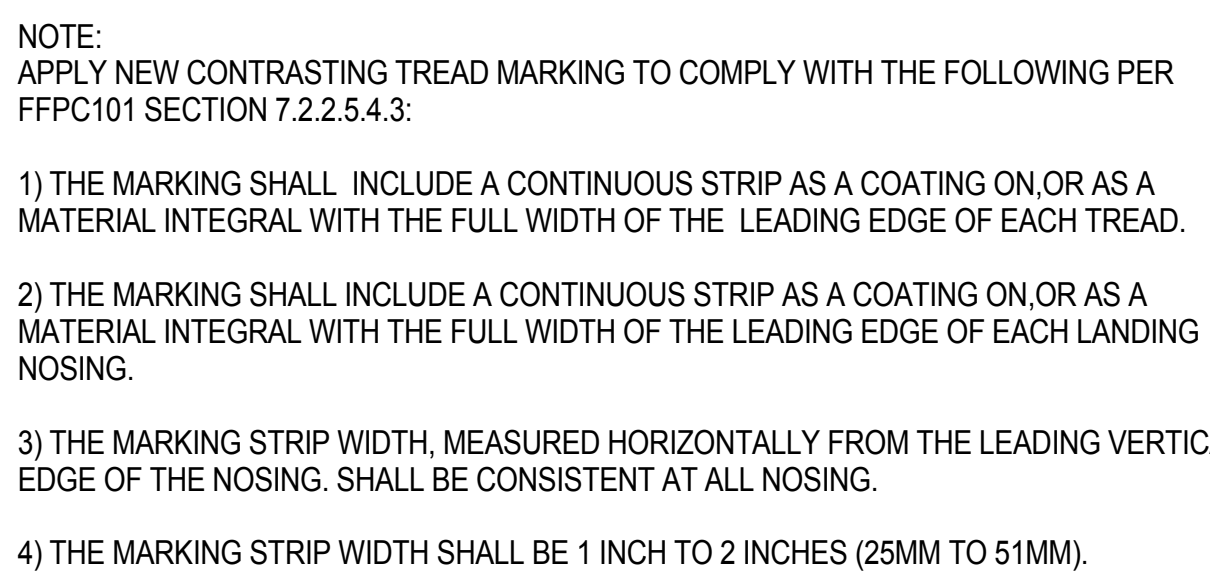



ANGLER'S HOTEL
600 WASHINGTON AVENUE, MIAMI BEACH, FLORIDA 33139
DEVELOPED BY: Angler's Boutique Resort LLC

ANGLER'S HOTEL

DEVELOPED BY: ANGEL'S BOUTIQUE RESUIT LLC

Permit Issue 10-13-14	
REVISIONS	
Description	Date
CMB Bldg. Dept. Comments	12/16/14
CMB Bldg. Dept. Comments	01/15/15
Revisions	06-12-15
HPB FILE #7582/ Bldg.Dept.comments	11-24-15

2064

A7.08

