


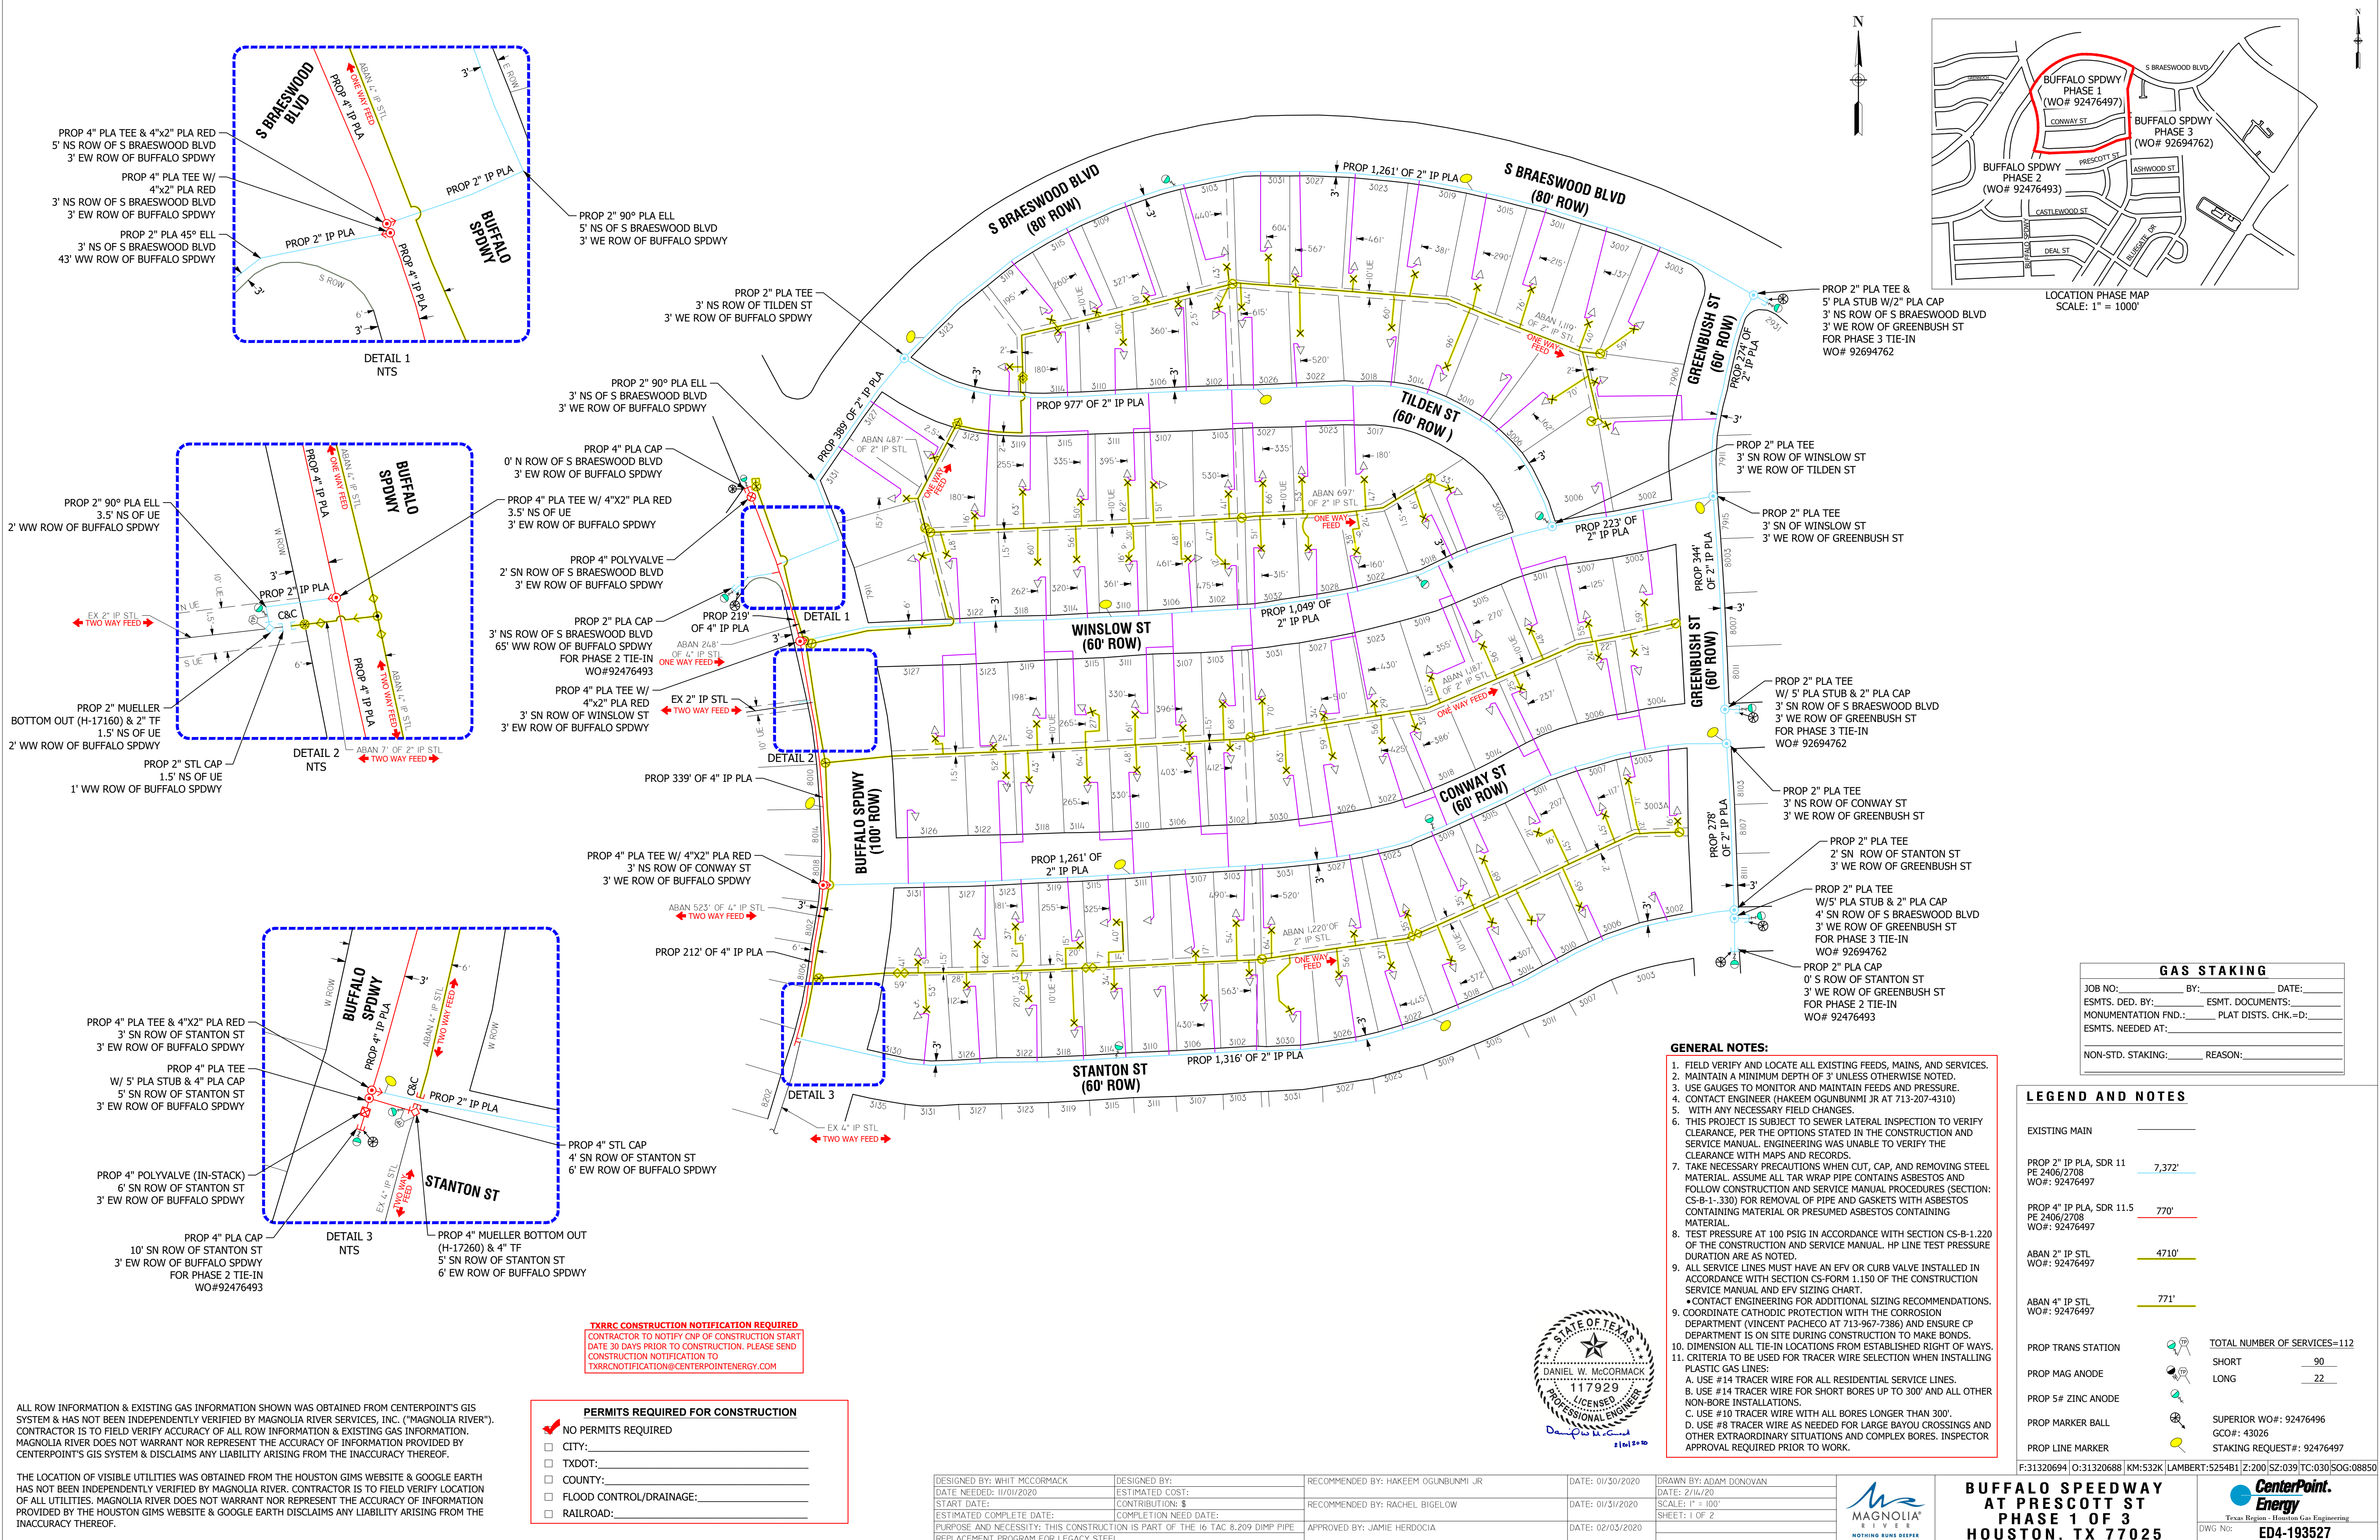

ALL ROW INFORMATION & EXISTING GAS INFORMATION SHOWN WAS OBTAINED FROM CENTERPOINT'S GIS SYSTEM & HAS NOT BEEN INDEPENDENTLY VERIFIED BY MAGNOLIA RIVER SERVICES, INC. ("MAGNOLIA RIVER"). CONTRACTOR IS TO FIELD VERIFY ACCURACY OF ALL ROW INFORMATION & EXISTING GAS INFORMATION. MAGNOLIA RIVER DOES NOT WARRANT NOR REPRESENT THE ACCURACY OF INFORMATION PROVIDED BY CENTERPOINT'S GIS SYSTEM & DISCLAIMS ANY LIABILITY ARISING FROM THE INACCURACY THEREOF.

THE LOCATION OF VISIBLE UTILITIES WAS OBTAINED FROM THE HOUSTON GIMS WEBSITE & GOOGLE EARTH HAS NOT BEEN INDEPENDENTLY VERIFIED BY MAGNOLIA RIVER. CONTRACTOR IS TO FIELD VERIFY LOCATION OF ALL UTILITIES. MAGNOLIA RIVER DOES NOT WARRANT NOR REPRESENT THE ACCURACY OF INFORMATION PROVIDED BY THE HOUSTON GIMS WEBSITE & GOOGLE EARTH DISCLAIMS ANY LIABILITY ARISING FROM THE INACCURACY THEREOF.

TXRRRC CONSTRUCTION NOTIFICATION REQUIRED
CONTRACTOR TO NOTIFY CNP OF CONSTRUCTION START
DATE 30 DAYS PRIOR TO CONSTRUCTION. PLEASE SEND
CONSTRUCTION NOTIFICATION TO
TXRRRCNOTIFICATION@CENTERPOINTENERGY.COM

PERMITS REQUIRED FOR CONSTRUCTION

☒ NO PERMITS REQUIRED

☐ CITY: _____


☐ TxDOT: _____

☐ COUNTY: _____

☐ FLOOD CONTROL/DRAINAGE: _____

☐ RAILROAD: _____

DESIGNED BY: WHIT MCCORMACK DATE NEEDED: 11/01/2020 START DATE: _____ ESTIMATED COMPLETE DATE: _____ PURPOSE AND NECESSITY: THIS CONSTRUCTION IS PART OF THE 16 TAC 8,209 DIMP PIPE REPLACEMENT PROGRAM FOR LEGACY STEEL	DESIGNED BY: _____ ESTIMATED COST: _____ CONTRIBUTION: \$ _____ COMPLETION NEED DATE: _____	RECOMMENDED BY: HAKEEM OGUNBUNMI JR RECOMMENDED BY: RACHEL BIGELOW APPROVED BY: JAMIE HERDOCIA	DATE: 01/30/2020 DATE: 01/31/2020 DATE: 02/03/2020	DRAWN BY: ADAM DONOVAN DATE: 2/14/2020 SCALE: 1" = 100' SHEET: 1 OF 2	BUFFALO SPEEDWAY AT PRESCOTT ST PHASE 1 OF 3 HOUSTON, TX 77025 CenterPoint Energy Texas Region - Houston Gas Engineering DWG NO: ED4-193527
--	--	--	--	--	---

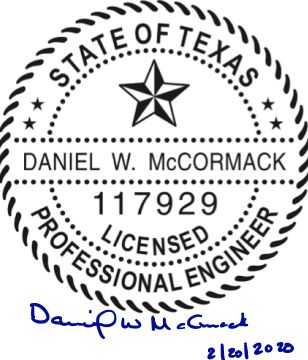

- GENERAL NOTES:**
- FIELD VERIFY AND LOCATE ALL EXISTING FEEDS, MAINS, AND SERVICES.
 - MAINTAIN A MINIMUM DEPTH OF 3' UNLESS OTHERWISE NOTED.
 - USE GAUGES TO MONITOR AND MAINTAIN FEEDS AND PRESSURE.
 - CONTACT ENGINEER (HAKEEM OGUNBUNMI JR AT 713-207-4310)
 - WITH ANY NECESSARY FIELD CHANGES.
 - THIS PROJECT IS SUBJECT TO SEWER LATERAL INSPECTION TO VERIFY CLEARANCE, PER THE OPTIONS STATED IN THE CONSTRUCTION AND SERVICE MANUAL. ENGINEERING WAS UNABLE TO VERIFY THE CLEARANCE WITH MAPS AND RECORDS.
 - TAKE NECESSARY PRECAUTIONS WHEN CUT, CAP, AND REMOVING STEEL MATERIAL. ASSUME ALL TAR WRAP PIPE CONTAINS ASBESTOS AND FOLLOW CONSTRUCTION AND SERVICE MANUAL PROCEDURES (SECTION: CS-B-1-.330) FOR REMOVAL OF PIPE AND GASKETS WITH ASBESTOS CONTAINING MATERIAL OR PRESUMED ASBESTOS CONTAINING MATERIAL.
 - TEST PRESSURE AT 100 PSIG IN ACCORDANCE WITH SECTION CS-B-1.220 OF THE CONSTRUCTION AND SERVICE MANUAL. HP LINE TEST PRESSURE DURATION ARE AS NOTED.
 - ALL SERVICE LINES MUST HAVE AN EFV OR CURB VALVE INSTALLED IN ACCORDANCE WITH SECTION CS-FORM 1.150 OF THE CONSTRUCTION SERVICE MANUAL AND EFV SIZING CHART.
 - CONTACT ENGINEERING FOR ADDITIONAL SIZING RECOMMENDATIONS.
 - COORDINATE CATHODIC PROTECTION WITH THE CORROSION DEPARTMENT (VINCENT PACHECO AT 713-967-7386) AND ENSURE CP DEPARTMENT IS ON SITE DURING CONSTRUCTION TO MAKE BONDS.
 - DIMENSION ALL TIE-IN LOCATIONS FROM ESTABLISHED RIGHT OF WAYS.
 - CRITERIA TO BE USED FOR TRACER WIRE SELECTION WHEN INSTALLING PLASTIC GAS LINES:
 - A. USE #14 TRACER WIRE FOR ALL RESIDENTIAL SERVICE LINES.
 - B. USE #14 TRACER WIRE FOR SHORT BORES UP TO 300' AND ALL OTHER NON-BORE INSTALLATIONS.
 - C. USE #10 TRACER WIRE WITH ALL BORES LONGER THAN 300'.
 - D. USE #8 TRACER WIRE AS NEEDED FOR LARGE BAYOU CROSSINGS AND OTHER EXTRAORDINARY SITUATIONS AND COMPLEX BORES. INSPECTOR APPROVAL REQUIRED PRIOR TO WORK.

GAS STAKING			
JOB NO: _____	BY: _____	DATE: _____	
ESMTS. DED. BY: _____	ESMT. DOCUMENTS: _____		
MONUMENTATION FND: _____	PLAT DISTS. CHK: =D: _____		
ESMTS. NEEDED AT: _____			
NON-STD. STAKING: _____	REASON: _____		

LEGEND AND NOTES			
EXISTING MAIN			
PROP 2" IP PLA, SDR 11 PE 2406/2708 WO#: 92476497	7,372'		
PROP 4" IP PLA, SDR 11.5 PE 2406/2708 WO#: 92476497	770'		
ABAN 2" IP STL WO#: 92476497	4710'		
ABAN 4" IP STL WO#: 92476497	771'		
PROP TRANS STATION		TOTAL NUMBER OF SERVICES=112	
PROP MAG ANODE		SHORT	90
PROP 5# ZINC ANODE		LONG	22
PROP MARKER BALL		SUPERIOR WO#: 92476496	
PROP LINE MARKER		GCO#: 43026	
		STAKING REQUEST#: 92476497	
F:31320694 O:31320688 KM:532K LAMBERT:5254B1 Z:200 SZ:039 TC:030 SOG:08850			

ALL ROW INFORMATION & EXISTING GAS INFORMATION SHOWN WAS OBTAINED FROM CENTERPOINT'S GIS SYSTEM & HAS NOT BEEN INDEPENDENTLY VERIFIED BY MAGNOLIA RIVER SERVICES, INC. ("MAGNOLIA RIVER"). CONTRACTOR IS TO FIELD VERIFY ACCURACY OF ALL ROW INFORMATION & EXISTING GAS INFORMATION. MAGNOLIA RIVER DOES NOT WARRANT NOR REPRESENT THE ACCURACY OF INFORMATION PROVIDED BY CENTERPOINT'S GIS SYSTEM & DISCLAIMS ANY LIABILITY ARISING FROM THE INACCURACY THEREOF.

THE LOCATION OF VISIBLE UTILITIES WAS OBTAINED FROM THE HOUSTON GIMS WEBSITE & GOOGLE EARTH HAS NOT BEEN INDEPENDENTLY VERIFIED BY MAGNOLIA RIVER. CONTRACTOR IS TO FIELD VERIFY LOCATION OF ALL UTILITIES. MAGNOLIA RIVER DOES NOT WARRANT NOR REPRESENT THE ACCURACY OF INFORMATION PROVIDED BY THE HOUSTON GIMS WEBSITE & GOOGLE EARTH DISCLAIMS ANY LIABILITY ARISING FROM THE INACCURACY THEREOF.

TXRRC CONSTRUCTION NOTIFICATION REQUIRED
CONTRACTOR TO NOTIFY CNP OF CONSTRUCTION START
DATE 30 DAYS PRIOR TO CONSTRUCTION. PLEASE SEND
CONSTRUCTION NOTIFICATION TO
TXRRCNOTIFICATION@CENTERPOINTENERGY.COM

PERMITS REQUIRED FOR CONSTRUCTION

- ☒ NO PERMITS REQUIRED
- ☐ CITY: _____
- ☐ TxDOT: _____
- ☐ COUNTY: _____
- ☐ FLOOD CONTROL/DRAINAGE: _____
- ☐ RAILROAD: _____

ADDRESS		WORK PERFORM	INSTALL				ABANDONED			WORK ORDER
NUMBER	STREET		FT	SIZE	MATERIAL	EFV	FT	SIZE	MATERIAL	
7911	BUFFALO SPEEDWAY	REPLACE	91	1"	CTS	775	6	1 1/4"	STL	92740126
3003	CONWAY ST	REPLACE	44	1"	CTS	775	86	1"	PLA	92740128
3004	CONWAY ST	REPLACE	128	1"	CTS	775	42	1"	PLA	92740172
3006	CONWAY ST	REPLACE	126	1"	CTS	775	20	1"	PLI	92740175
3007	CONWAY ST	REPLACE	82	1"	CTS	775	45	1 1/4"	STL	92740177
3010	CONWAY ST	REPLACE	143	1"	CTS	775	25	1 1/4"	STL	92740180
3011	CONWAY ST	REPLACE	126	1"	CTS	775	82	1 1/4"	STL	92740184
3014	CONWAY ST	REPLACE	117	1"	CTS	775	N/A	N/A	N/A	92740289
3015	CONWAY ST	REPLACE	66	1"	CTS	775	68	1"	PLA	92740294
3018	CONWAY ST	REPLACE	148	1"	CTS	775	32	1 1/4"	STL	92740297
3019	CONWAY ST	REPLACE	99	1"	CTS	775	35	1/2"	PLI	92740301
3022	CONWAY ST	REPLACE	127	1"	CTS	775	56	1/2"	PLI	92740304
3023	CONWAY ST	REPLACE	106	1"	CTS	775	35	1/2"	PLI	92740307
3026	CONWAY ST	REPLACE	145	1"	CTS	775	59	1/2"	PLI	92740453
3027	CONWAY ST	REPLACE	110	1"	CTS	775	24	1/2"	PLI	92740456
3030	CONWAY ST	REPLACE	132	1"	CTS	775	63	1 1/4"	STL	92740461
3031	CONWAY ST	REPLACE	79	1"	CTS	775	64	1/2"	PLI	92740463
3102	CONWAY ST	REPLACE	169	1"	CTS	775	4	1 1/4"	STL	92740466
3103	CONWAY ST	REPLACE	82	1"	CTS	775	54	1 1/4"	STL	92740549
3106	CONWAY ST	REPLACE	154	1"	CTS	775	4	1 1/4"	STL	92740550
3107	CONWAY ST	REPLACE	108	1"	CTS	775	17	1"	PLA	92740552
3110	CONWAY ST	REPLACE	155	1"	CTS	775	40	1 1/4"	STL	92740554
3111	CONWAY ST	REPLACE	63	1"	CTS	775	N/A	N/A	N/A	92740557
3114	CONWAY ST	REPLACE	188	1"	CTS	775	64	1 1/4"	STL	92740560
3115	CONWAY ST	REPLACE	63	1"	CTS	775	100	1 1/4"	STL	92740562
3118	CONWAY ST	REPLACE	125	1"	CTS	775	43	3/4"	PLA	92740565
3119	CONWAY ST	REPLACE	96	1"	CTS	775	60	1/2"	PLA	92740730
3122	CONWAY ST	REPLACE	143	1"	CTS	775	N/A	N/A	N/A	92740734
3123	CONWAY ST	REPLACE	68	1"	CTS	775	74	1 1/4"	STL	92740735
3126	CONWAY ST	REPLACE	115	1"	CTS	775	N/A	N/A	N/A	92740737
3127	CONWAY ST	REPLACE	88	1"	CTS	775	62	1/2"	PLI	92740739
3131	CONWAY ST	REPLACE	105	1"	CTS	775	5	1/2"	PLI	92740742
3003 A	CONWAY ST	REPLACE	107	1"	CTS	775	16	1"	PLA	92740746
7906	GREENBUSH ST	REPLACE	176	1"	CTS	775	2	1 1/4"	STL	92740853
3003	S BRAESWOOD BLVD	REPLACE	123	1"	CTS	775	59	1 1/4"	STL	92740857
3007	S BRAESWOOD BLVD	REPLACE	135	1"	CTS	775	40	1 1/4"	STL	92740860
3011	S BRAESWOOD BLVD	REPLACE	108	1"	CTS	775	76	1 1/4"	STL	92740863
3015	S BRAESWOOD BLVD	REPLACE	132	1"	CTS	775	39	1 1/4"	STL	92740864
3019	S BRAESWOOD BLVD	REPLACE	130	1"	CTS	775	30	1 1/4"	STL	92740867
3023	S BRAESWOOD BLVD	REPLACE	143	1"	CTS	775	25	1/2"	PLA	92740975
3027	S BRAESWOOD BLVD	REPLACE	150	1"	CTS	775	8	3/4"	STL	92740981
3031	S BRAESWOOD BLVD	REPLACE	118	1"	CTS	775	45	1 1/4"	STL	92740985
3103	S BRAESWOOD BLVD	REPLACE	117	1"	CTS	775	43	1 1/4"	STL	92741110
3109	S BRAESWOOD BLVD	REPLACE	145	1"	CTS	775	8	3/4"	STL	92741112
3115	S BRAESWOOD BLVD	REPLACE	125	1"	CTS	775	4	3/4"	STL	92741117
3119	S BRAESWOOD BLVD	REPLACE	97	1"	CTS	775	13	3/4"	STL	92741121
3123	S BRAESWOOD BLVD	REPLACE	148	1"	CTS	775	7	3/4"	STL	92741126
3127	S BRAESWOOD BLVD	REPLACE	126	1"	CTS	775	13	1 1/4"	STL	92741170
3131	S BRAESWOOD BLVD	REPLACE	116	1"	CTS	775	29	3/4"	STL	92741176
3002	STANTON ST	REPLACE	74	1"	CTS	775	N/A	N/A	N/A	92741180
3006	STANTON ST	REPLACE	61	1"	CTS	775	65	1"	PLA	92741183
3010	STANTON ST	REPLACE	66	1"	CTS	775	50	1"	STL	92741187
3014	STANTON ST	REPLACE	96	1"	CTS	775	30	1 1/4"	STL	92741292
3018	STANTON ST	REPLACE	66	1"	CTS	775	59	1 1/4"	STL	92741298
3022	STANTON ST	REPLACE	90	1"	CTS	775	37	1 1/4"	STL	92741302
3026	STANTON ST	REPLACE	86	1"	CTS	775	56	1/2"	PLI	92741305

ADDRESS		WORK PERFORM	INSTALL				ABANDONED			WORK ORDER
NUMBER	STREET		FT	SIZE	MATERIAL	EFV	FT	SIZE	MATERIAL	
3030	STANTON ST	REPLACE	61	1"	CTS	775	78	3/4"	STL	92741411
3102	STANTON ST	REPLACE	112	1"	CTS	775	5	1/2"	PLA	92741413
3106	STANTON ST	REPLACE	81	1"	CTS	775	50	1 1/4"	STL	92741419
3110	STANTON ST	REPLACE	104	1"	CTS	775	N/A	N/A	N/A	92741428
3114	STANTON ST	REPLACE	104	1"	CTS	775	34	1/2"	PLI	92741472
3118	STANTON ST	REPLACE	55	1"	CTS	775	79	1"	PLA	92741475
3122	STANTON ST	REPLACE	87	1"	CTS	775	39	1"	PLA	92741480
3126	STANTON ST	REPLACE	116	1"	CTS	775	5	1 1/4"	STL	92741484
3130	STANTON ST	REPLACE	78	1"	CTS	775	54	1/2"	PLI	92741488
3005	TILDEN ST	REPLACE	51	1"	CTS	775	33	1 1/4"	STL	92741594
3006	TILDEN ST	REPLACE	73	1"	CTS	775	65	1/2"	PLI	92741600
3010	TILDEN ST	REPLACE	84	1"	CTS	775	N/A	N/A	N/A	92741605
3014	TILDEN ST	REPLACE	58	1"	CTS	775	96	1"	PLA	92741608
3017	TILDEN ST	REPLACE	134	1"	CTS	775	47	1 1/4"	STL	92741655
3018	TILDEN ST	REPLACE	76	1"	CTS	775	55	1"	PLA	92741661
3022	TILDEN ST	REPLACE	70	1"	CTS	775	61	1 1/4"	STL	92741668
3023	TILDEN ST	REPLACE	154	1"	CTS	775	53	1 1/4"	STL	92741730
3026	TILDEN ST	REPLACE	112	1"	CTS	775	44	1 1/4"	STL	92741738
3027	TILDEN ST	REPLACE	102	1"	CTS	775	66	1 1/4"	STL	92741744
3102	TILDEN ST	REPLACE	117	1"	CTS	775	42	1/2"	PLA	92741747
3103	TILDEN ST	REPLACE	145	1"	CTS	775	41	1 1/4"	STL	92741893
3106	TILDEN ST	REPLACE	121	1"	CTS	775	5	1 1/4"	STL	92741900
3107	TILDEN ST	REPLACE	130	1"	CTS	775	61	1"	PLA	92741906
3110	TILDEN ST	REPLACE	76	1"	CTS	775	50	1/2"	PLA	92741931
3111	TILDEN ST	REPLACE	105	1"	CTS	775	62	1 1/4"	STL	92741937
3114	TILDEN ST	REPLACE	147	1"	CTS	775	5	1 1/4"	STL	92741943
3115	TILDEN ST	REPLACE	176	1"	CTS	775	50	1 1/4"	STL	92742009
3119	TILDEN ST	REPLACE	131	1"	CTS	775	63	1 1/4"	STL	92742017
3123	TILDEN ST	REPLACE	182	1"	CTS	775	16	1 1/4"	STL	92742028
3002	WINSLOW ST	REPLACE	152	1"	CTS	775	4	1 1/4"	STL	92742096
3003	WINSLOW ST	REPLACE	132	1"	CTS	775	59	1 1/4"	STL	92742151
3006	WINSLOW ST	REPLACE	73	1"	CTS	775	N/A	N/A	N/A	92742161
3007	WINSLOW ST	REPLACE	136	1"	CTS	775	55	1 1/4"	STL	92742191
3011	WINSLOW ST	REPLACE	156	1"	CTS	775	48	1/2"	PLA	92742199
3015	WINSLOW ST	REPLACE	129	1"	CTS	775	62	1"	PLA	92742206
3018	WINSLOW ST	REPLACE	66	1"	CTS	775	53	1 1/4"	STL	92742216
3019	WINSLOW ST	REPLACE	152	1"	CTS	775	45	1 1/4"	STL	92742225
3022	WINSLOW ST	REPLACE	56	1"	CTS	775	67	1/2"	PLA	92742294
3023	WINSLOW ST	REPLACE	159	1"	CTS	775	30	1/2"	PLI	92742302
3027	WINSLOW ST	REPLACE	154	1"	CTS	775	34	1 1/4"	STL	92742350
3028	WINSLOW ST	REPLACE	65	1"	CTS	775	60	1/2"	PLA	92742357
3031	WINSLOW ST	REPLACE	120	1"	CTS	775	70	1"	PLA	92742366
3032	WINSLOW ST	REPLACE	76	1"	CTS	775	51	1 1/4"	STL	92742392
3102	WINSLOW ST	REPLACE	68	1"	CTS	775	59	1 1/4"	STL	92742401
3103	WINSLOW ST	REPLACE	145	1"	CTS	775	68	1 1/4"	STL	92742470
3106	WINSLOW ST	REPLACE	73	1"	CTS	775	64	1 1/4"	STL	92742480
3107	WINSLOW ST	REPLACE	155	1"	CTS	775	64	1/2"	PLA	92742491
3110	WINSLOW ST	REPLACE	83	1"	CTS	775	60	1"	PLA	92742498
3111	WINSLOW ST	REPLACE	153	1"	CTS	775	61	1 1/4"	STL	92742507
3114	WINSLOW ST	REPLACE	79	1"	CTS	775	56	3/4"	STL	92742575
3115	WINSLOW ST	REPLACE	150	1"	CTS	775	85	1/2"	PLA	92742582
3118	WINSLOW ST	REPLACE	68	1"	CTS	775	60	1 1/4"	STL	92742610
3119	WINSLOW ST	REPLACE	151	1"	CTS	775	60	1 1/4"	STL	92742613
3122	WINSLOW ST	REPLACE	97	1"	CTS	775	37	1"	PLA	92742617
3123	WINSLOW ST	REPLACE	186	1"	CTS	775	8	1/2"	PLA	92742619
3127	WINSLOW ST	REPLACE	175	1"	CTS	775	10	1 1/4"	STL	92742621



GAS STAKING

JOB NO.: _____ BY: _____ DATE: _____
ESMTS, DED. BY: _____ ESMT, DOCUMENTS: _____
MONUMENTATION FND.: _____ PLAT DIST. CHK.=D: _____
ESMTS, NEEDED AT: _____
NON-STD. STAKING: _____ REASON: _____

GENERAL NOTES:

- FIELD VERIFY AND LOCATE ALL EXISTING FEEDS, MAINS, AND SERVICES.
- MAINTAIN A MINIMUM DEPTH OF 3' UNLESS OTHERWISE NOTED.
- USE GAUGES TO MONITOR AND MAINTAIN FEEDS AND PRESSURE.
- CONTACT ENGINEER (HAKEEM OGUNBUNMI JR AT 713-207-4310)
- WITH ANY NECESSARY FIELD CHANGES.
- THIS PROJECT IS SUBJECT TO SEWER LATERAL INSPECTION TO VERIFY CLEARANCE, PER THE OPTIONS STATED IN THE CONSTRUCTION AND SERVICE MANUAL. ENGINEERING WAS UNABLE TO VERIFY THE CLEARANCE WITH MAPS AND RECORDS.
- TAKE NECESSARY PRECAUTIONS WHEN CUT, CAP, AND REMOVING STEEL MATERIAL. ASSUME ALL TAR WRAP PIPE CONTAINS ASBESTOS AND FOLLOW CONSTRUCTION AND SERVICE MANUAL PROCEDURES (SECTION: CS-B-1-.330) FOR REMOVAL OF PIPE AND GASKETS WITH ASBESTOS CONTAINING MATERIAL OR PRESUMED ASBESTOS CONTAINING MATERIAL.
- TEST PRESSURE AT 100 PSIG IN ACCORDANCE WITH SECTION CS-B-1.220 OF THE CONSTRUCTION AND SERVICE MANUAL. HP LINE TEST PRESSURE DURATION ARE AS NOTED.
- ALL SERVICE LINES MUST HAVE AN EFV OR CURB VALVE INSTALLED IN ACCORDANCE WITH SECTION CS-FORM 1.150 OF THE CONSTRUCTION SERVICE MANUAL AND EFV SIZING CHART.
 - CONTACT ENGINEERING FOR ADDITIONAL SIZING RECOMMENDATIONS.
- COORDINATE CATHODIC PROTECTION WITH THE CORROSION DEPARTMENT (VINCENT PACHECO AT 713-967-7386) AND ENSURE CP DEPARTMENT IS ON SITE DURING CONSTRUCTION TO MAKE BONDS.
- DIMENSION ALL TIE-IN LOCATIONS FROM ESTABLISHED RIGHT OF WAYS.
- CRITERIA TO BE USED FOR TRACER WIRE SELECTION WHEN INSTALLING PLASTIC GAS LINES:
 - A. USE #14 TRACER WIRE FOR ALL RESIDENTIAL SERVICE LINES.
 - B. USE #14 TRACER WIRE FOR SHORT BORES UP TO 300' AND ALL OTHER NON-BORE INSTALLATIONS.
 - C. USE #10 TRACER WIRE WITH ALL BORES LONGER THAN 300'.
 - D. USE #8 TRACER WIRE AS NEEDED FOR LARGE BAYOU CROSSINGS AND OTHER EXTRAORDINARY SITUATIONS AND COMPLEX BORES. INSPECTOR APPROVAL REQUIRED PRIOR TO WORK.

F:31320694 | O:31320688 | KM:532K | LAMBERT:5254B1 | Z:200 | SZ:039 | TC:030 | SOG:08850



BUFFALO SPEEDWAY
AT PRESCOTT