




(a) Heating Optimisation

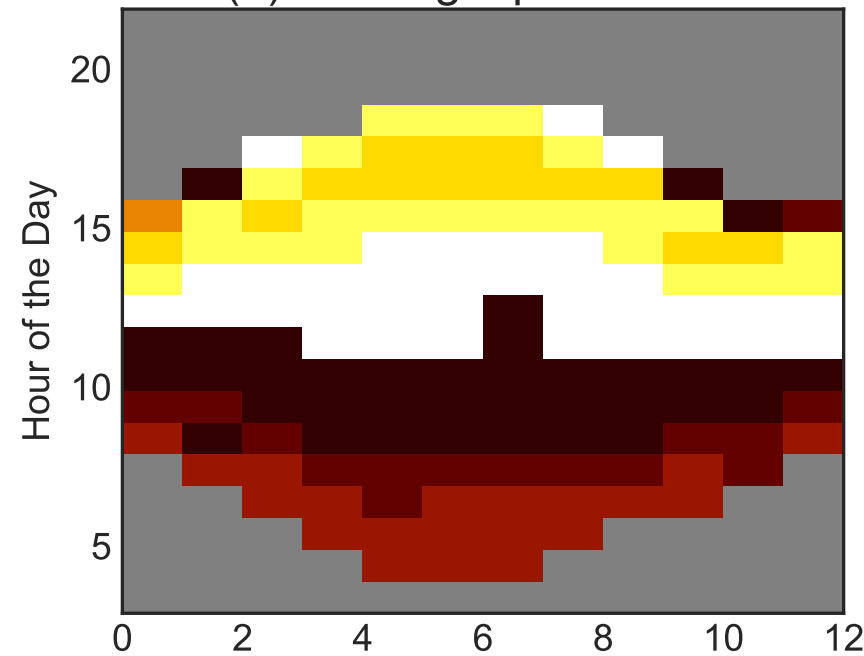

(b) Cooling Optimisation

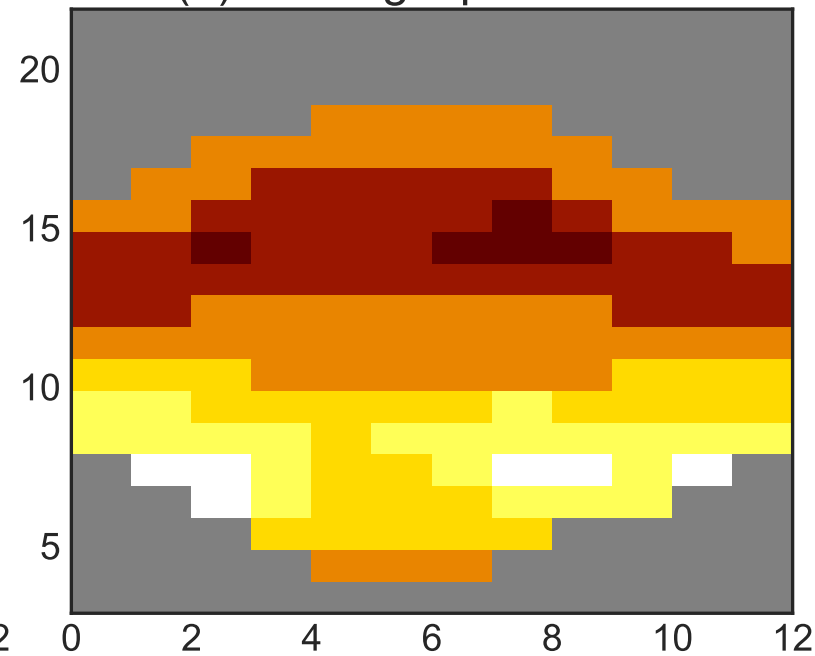

(c) Lighting Optimisation

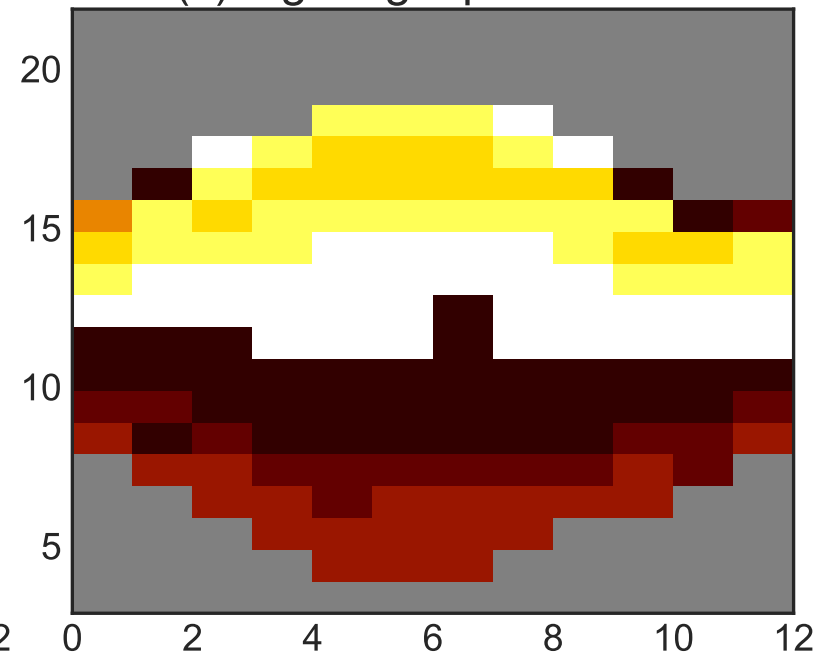

Azimuth Angle [deg]

45 (SE)

30

15


0 (S)

-15


-30

-45 (SW)

(d) PV Supply Optimisation

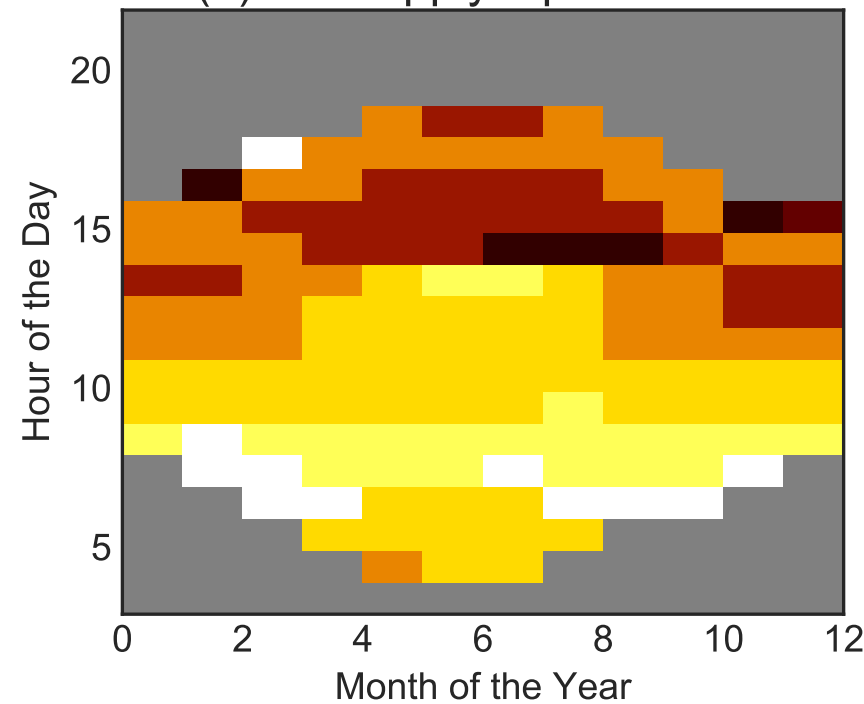

(e) Building Demand Optimisation

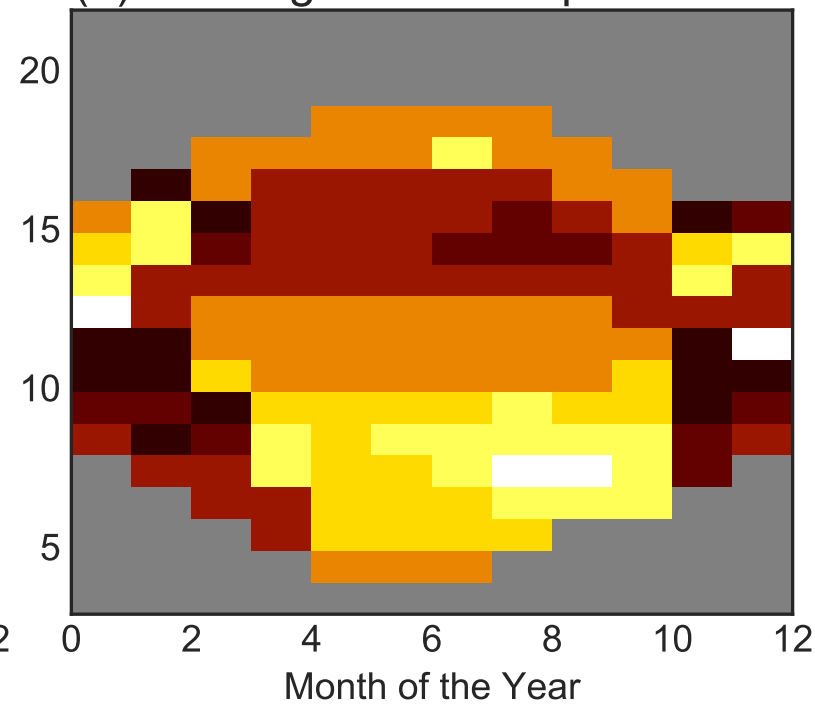

(f) Net Optimisation Including PV

