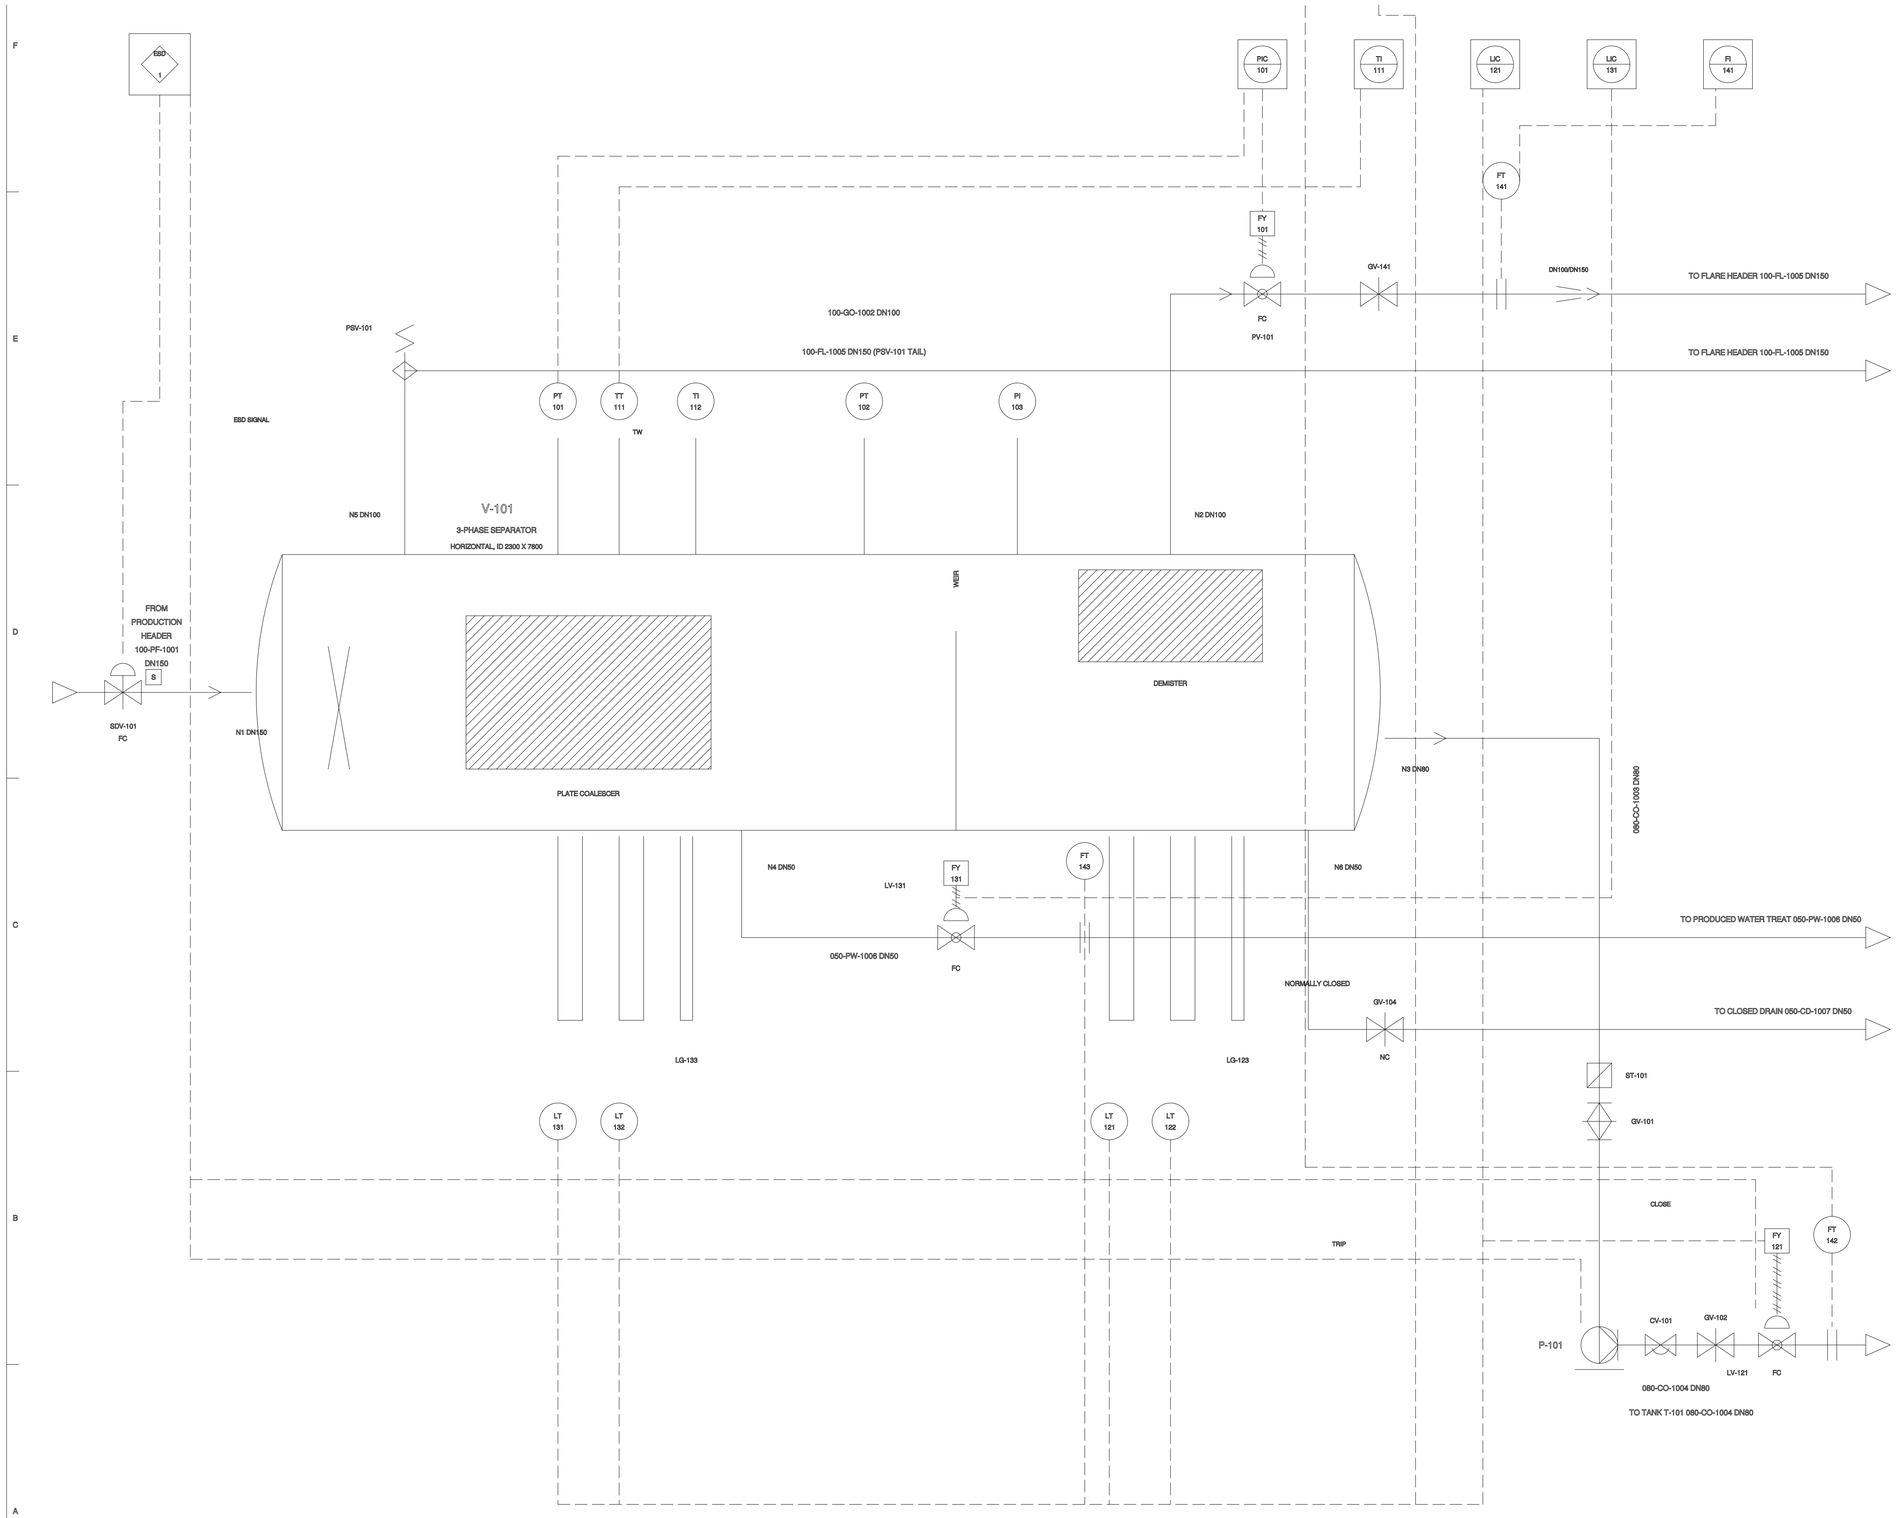


DIAGRAM CONTENT PER ISO 15519-2:2015.

4. ESD-1 (SIS) CAUSE & EFFECT: PT-102 PSHH/PSLL & LT-122 LSHH/LSLL → CLOSE SDV-101, CLOSE LV-121, TRIP P-101. LT-132 LSHH/LSLL → CLOSE LV-131. SEE C&E CHART.

5. PSV-101 SET PRESSURE = V-101 MAWP PER VESSEL DATASHEET. RELIEF SYSTEM PER API STD 521.

6. ALARMS PAH/PAL/LAH/LAL IMPLEMENTED IN DCS FROM PT-101, LT-121, LT-131.

7. FLARE HEADER 100-FL-1005 SLOPE 1:500 TO KO DRUM — NO POCKETS.

8. SIZES/DIMENSIONS FOR CLARITY ONLY — REFER TO LINE INDEX.

9. EQUIPMENT DESIGN: V-101 PER API RP 12J; T-101 PER API 650.

LEGEND

1. PROCESS LINE
2. ELECTRIC SIGNAL
3. PNEUMATIC SIGNAL
4. FIELD INSTRUMENT
5. DCS SHARED DISPLAY / CONTROL
6. SIS LOGIC SOLVER (ESD)

GATE GLOBE CHECK PSV

7. FC = FAIL CLOSED
8. ORIFICE FLANGE

REV	DESC
A0	ISSUED FOR REVIEW

GAS PRODUCTION FACILITY — ONSHOR

PIPING & INSTRUMENTATION DIAGRAM
3-PHASE PRODUCTION SEPARATOR V-1

DOC NO	GPF-00-PI-PID-0001
REV: A0 (ISSUED FOR REVIEW)	SCALE
DATE: 09 OCT 2028	SHEET
DRAWN: GLM-5.3-FLASH	UNITS
CHECKED: PM (AI)	APPROVED