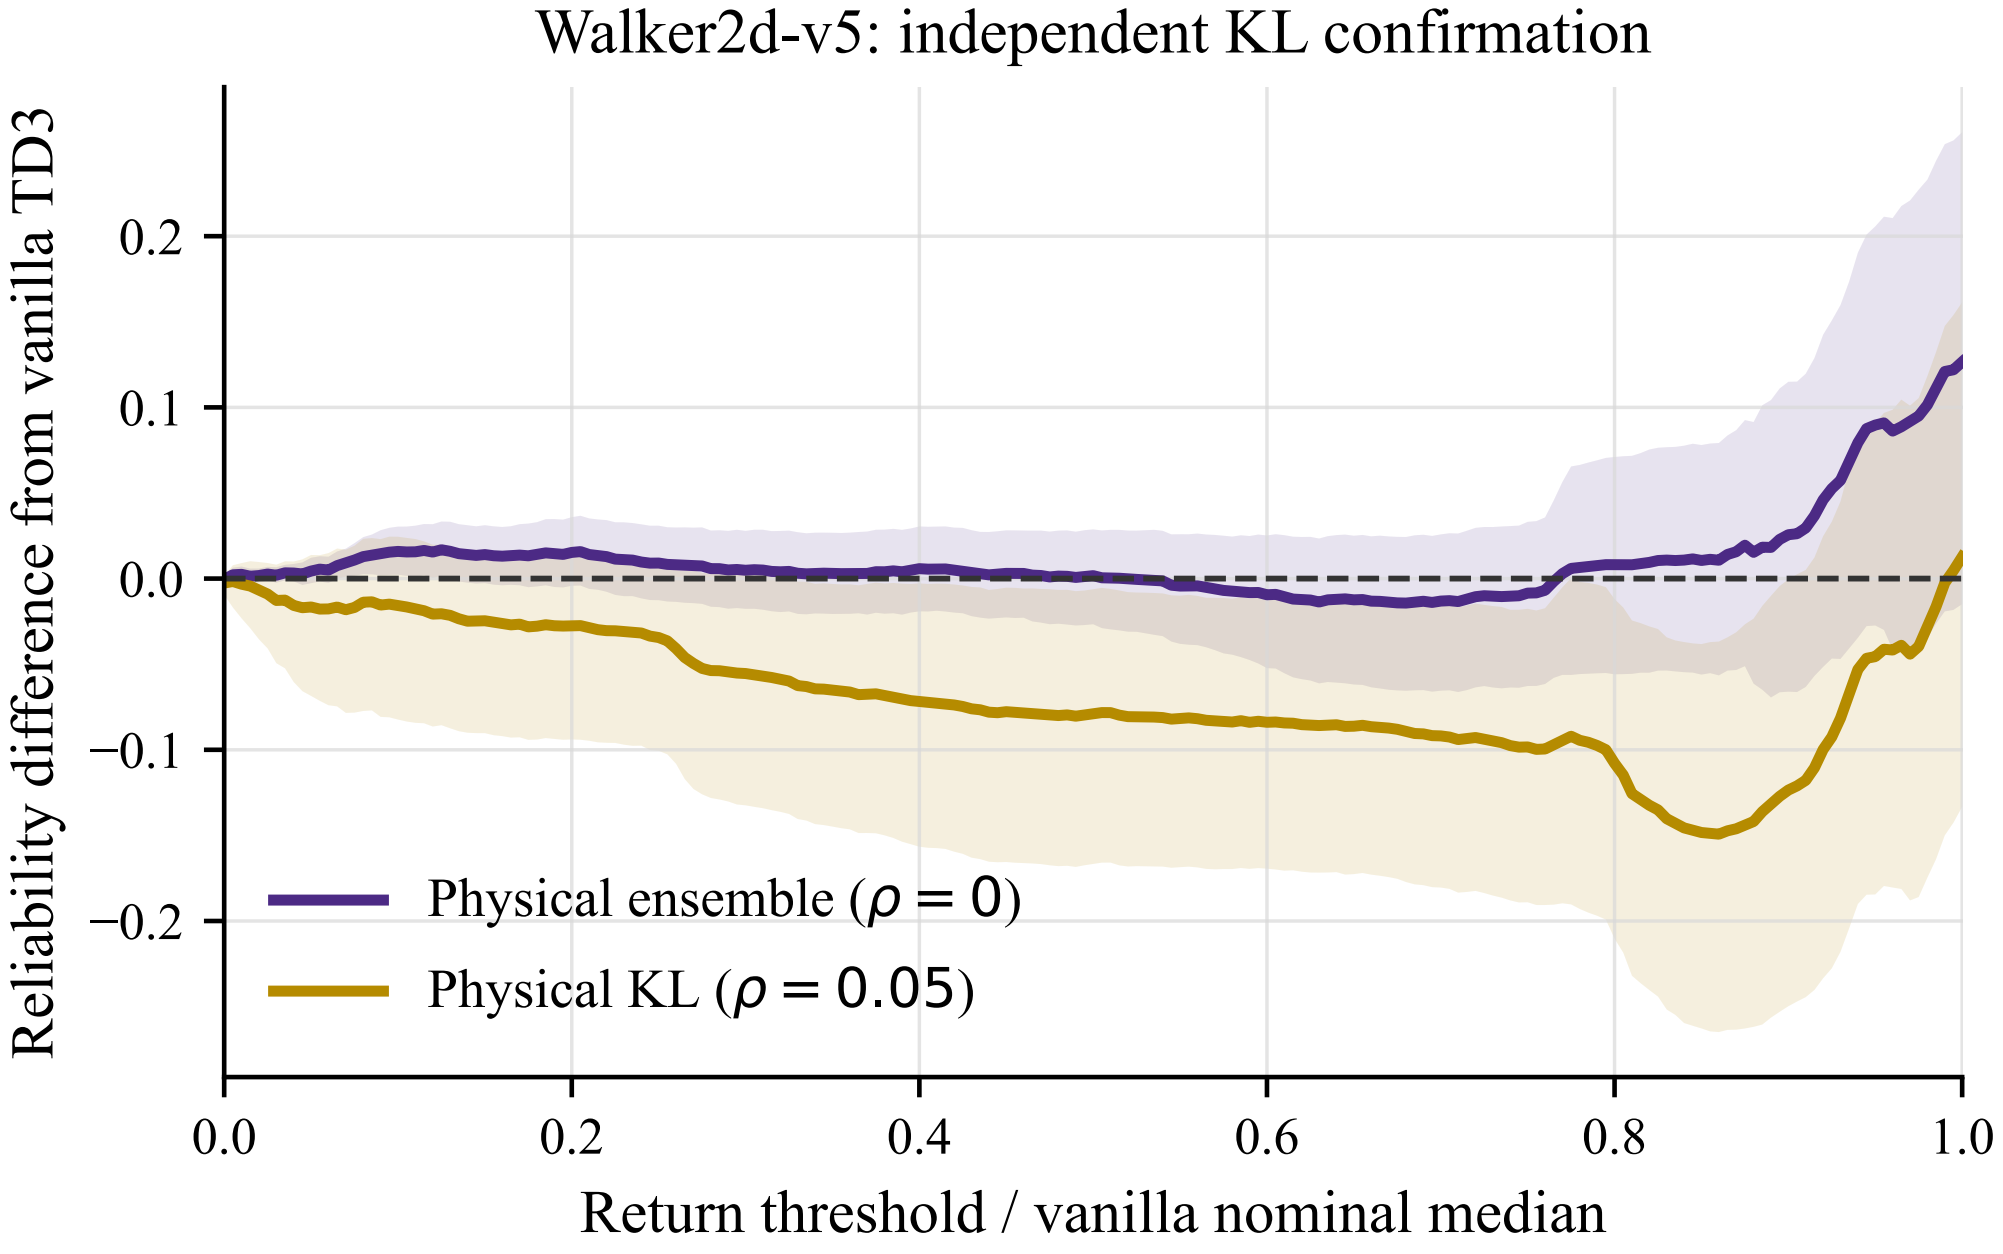
Walker2d-v5: independent KL confirmation
Reliability difference from vanilla TD3
0.2
0.1
0.0
−0.1
−0.2
Physical ensemble ($\rho = 0$)
Physical KL ($\rho = 0.05$)
0.0
0.2
0.4
0.6
0.8
1.0
Return threshold / vanilla nominal median