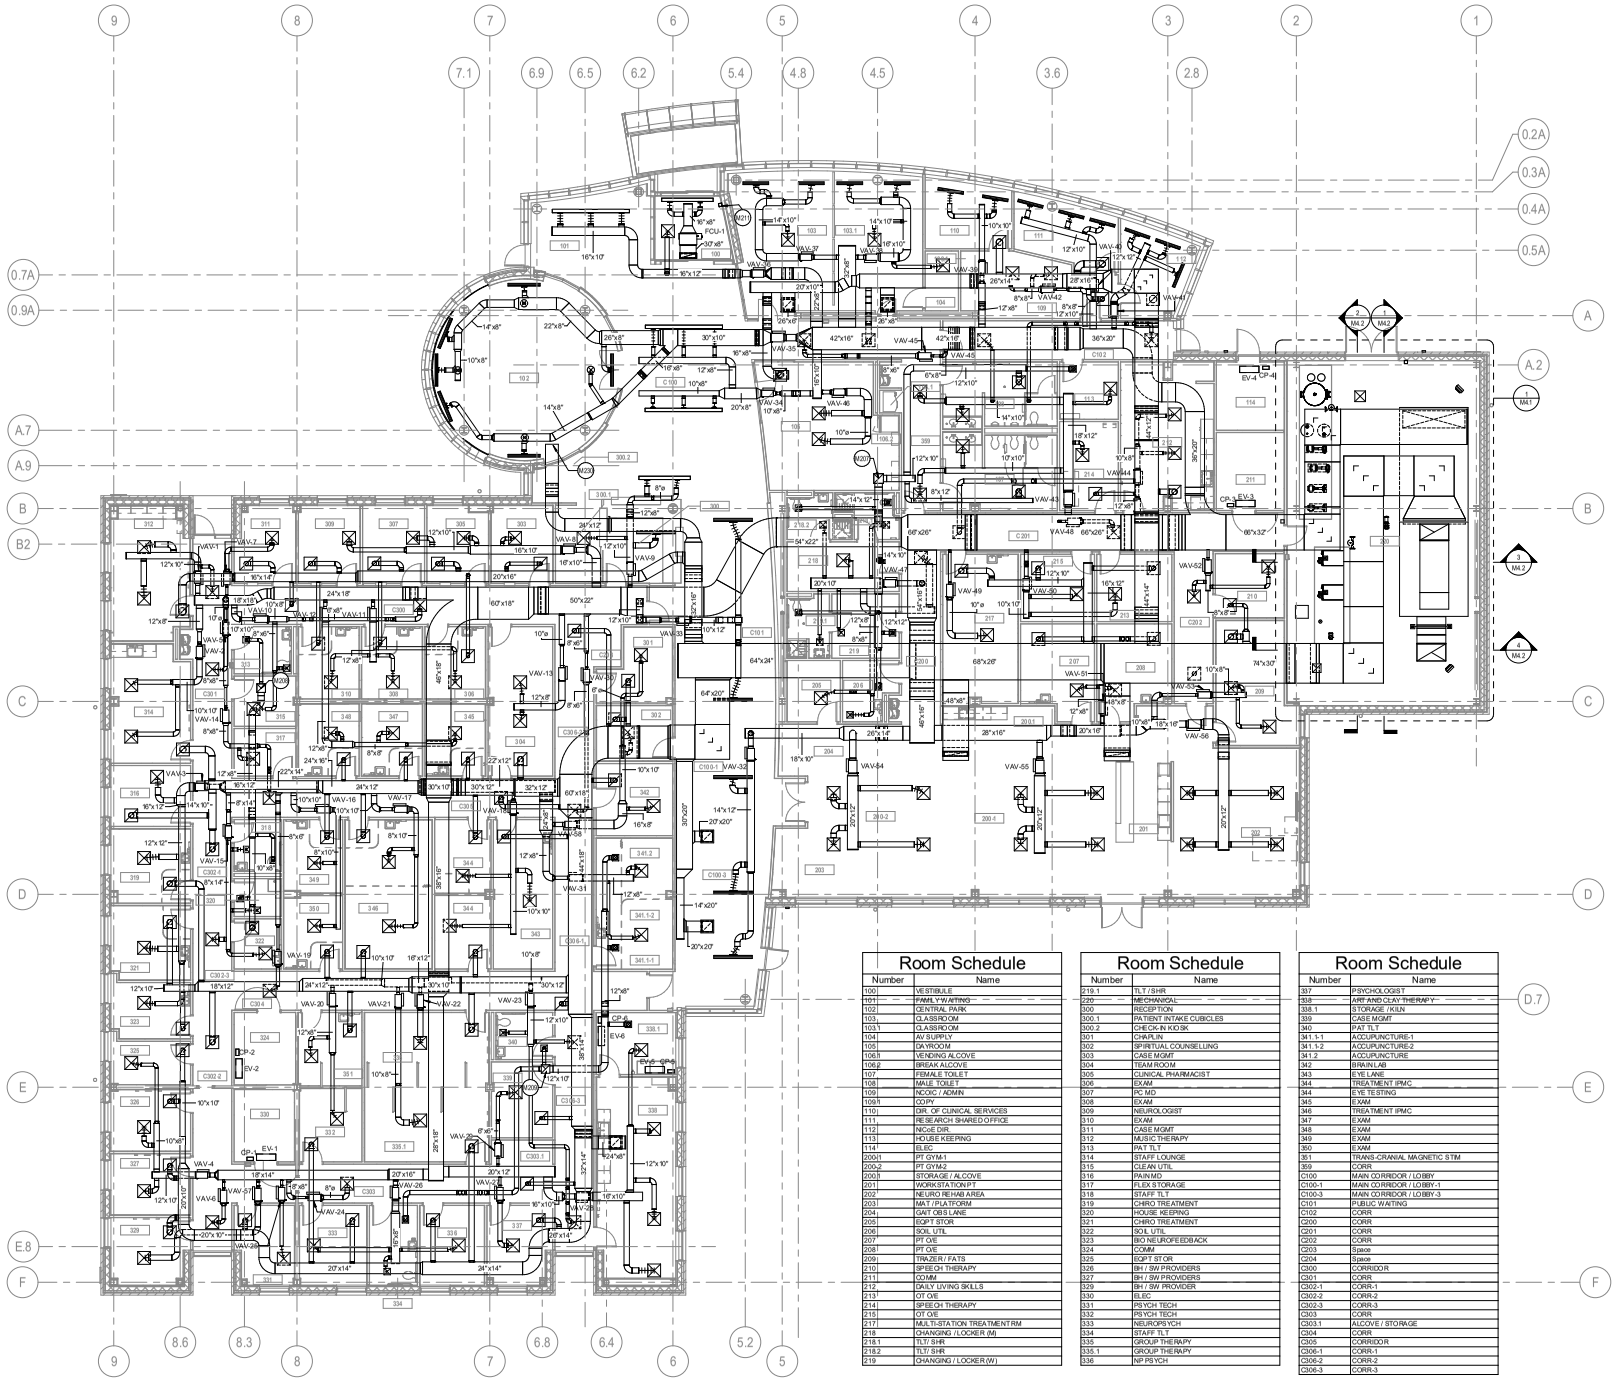


SHEET NOTES

1. PROVIDE VOLUME DAMPERS ON ALL DUCT TAKEOFFS SERVING SUPPLY, EXHAUST AND RETURN AIR TERMINALS. TYPICAL THROUGHOUT.
2. PROVIDE REMOTE DAMPER OPERATORS FOR ALL AIR TERMINALS LOCATED IN THE HVID LID AND WOOD CEILING.
3. PROVIDE ALL RECTANGULAR MITERED ELBOWS WITH TURNING VANES.
4. PROVIDE DUCT PRESSURE READING PORTS BEFORE AND AFTER DUCT SILENCERS. TYPICAL FOR ALL DUCT SILENCERS.
5. PROVIDE DUCT DP SENSOR LOCATED IN COMPLIANCE WITH ASHRAE 90.1. STATIC PRESSURE SENSORS SHALL BE PLACED IN A POSITION SUCH THAT THE CONTROLLER SETPOINT IS NO GREATER THAN ONE-THIRD THE TOTAL STATIC PRESSURE, IF THIS RESULTS IN THE SENSOR BEING LOCATED DOWNSTREAM OF MAJOR DUCT SPLITS, MULTIPLE SENSORS SHALL BE INSTALLED IN EACH MAJOR BRANCH TO ENSURE THAT STATIC PRESSURE CAN BE MAINTAINED IN EACH.
6. IN ADDITION TO HANGERS AND SUPPORTS FOR DUCTWORK, PIPING AND EQUIPMENT, PROVIDE SEISMIC RESTRAINTS IN CONFORMANCE WITH ASCE/SEI 07 – 10. FOR ADDITIONAL INFORMATION, SEE SPECIFICATIONS, STRUCTURAL DRAWINGS AND CHAPTER 13 OF ASCE/SEI 07-10.
7. DO NOT PROVIDE VAV BOXES WITH AN 120V INTEGRAL ELECTRICAL TRANSFORMER. COORDINATE WITH THE ELECTRICAL TRADE.

KEYED NOTES

M207	18"X18" EXHAUST DUCT UP TO EF-3 ON ROOF.
M208	16"X16" EXHAUST DUCT UP TO EF-2 ON ROOF.
M209	16"X16" EXHAUST DUCT UP TO EF-1 ON ROOF.
M211	PROVIDE EMERGENCY SHUTOFF SWITCH FOR ENTIRE HVAC SYSTEM. INSTALL 48" ABOVE FINISHED FLOOR. SEE SHEET M0.8 FOR MORE INFORMATION.
M230	PROVIDE OPEN END DUCT WITH VOLUME DAMPER FOR RETURN FROM CENTRAL PARK.

Room Schedule

Number	Name
100	VESTIBULE
101	FAMILY WAITING
102	CENTRAL PARK
103	CLASSROOM
103.1	CLASSROOM
104	AV SUPPLY
105	DAYROOM
106.1	VENDING ALCOVE
106.2	BREAK ALCOVE
107	FEMALE TOILET
108	MALE TOILET
109	NCOIC / ADMIN
109.1	COPY
110	DIR. OF CLINICAL SERVICES
111	RESEARCH SHARED OFFICE
112	NCoE DIR.
113	HOUSE KEEPING
114	ELEC
200.1	PT GYM-1
200.2	PT GYM-2
200.3	STORAGE / ALCOVE
201	WORKSTATION PT
202	NEURO REHAB AREA
203	MAT / PLATFORM
204	GAIT OBS LANE
205	EQPT STOR
206	SOIL UTIL
207	PT CVE
208	PT CVE
209	TRAZER / FATS
210	SPEECH THERAPY
211	COMM
212	DAILY LIVING SKILLS
213	OT CVE
214	SPEECH THERAPY
215	OT CVE
217	MULTI-STATION TREATMENT RM
218	CHANGING / LOCKER (M)
218.1	TLT/ SHR
218.2	TLT/ SHR
219	CHANGING / LOCKER (W)

Room Schedule

Number	Name
219.1	TLT / SHR
220	MECHANICAL
300	RECEPTION
300.1	PATIENT INTAKE CUBICLES
300.2	CHECK-IN KIOSK
301	CWA/LIN
302	SPIRTUAL COUNSELLING
303	CASE MGMT
304	TEAM ROOM
305	CLINICAL PHARMACIST
306	EXAM
307	PC MD
308	EXAM
309	NEUROLOGIST
310	EXAM
311	CASE MGMT
312	MUSIC THERAPY
313	PAT TLT
314	STAFF LOUNGE
315	CUEAN UTIL
316	PA/NM D
317	FLEX STORAGE
318	STAFF TLT
319	CHIRO TREATMENT
320	HOUSE KEEPING
321	CHIRO TREATMENT
322	SOIL UTIL
323	BIO NEUROFEEDBACK
324	COMM
325	EQPT STOR
326	BH / SW PROVIDERS
327	BH / SW PROVIDERS
329	BH / SW PROVIDER
330	ELEC
331	PSYCH TECH
332	PSYCH TECH
333	NEUROPSYCH
334	STAFF TLT
335	GROUP THERAPY
335.1	GROUP THERAPY
336	NP PSYCH

Room Schedule

Number	Name
337	PSYCHOLOGIST
338	AIR* AND CLAY THERAPY
338.1	STORAGE / KILN
339	CASE MGMT
340	PAT TLT
341.1-1	ACCUPUNCTURE-1
341.1-2	ACCUPUNCTURE-2
341.2	ACCUPUNCTURE
342	BRAIN LAB
343	EYE LANE
344	TREATMENT IPMC
344	EYE TESTING
345	EXAM
346	TREATMENT IPMC
347	EXAM
348	EXAM
349	EXAM
350	EXAM
351	TRANS-CRANIAL MAGNETIC STIM
359	CORR
C100	MAIN CORRIDOR / LOBBY
C100-1	MAIN CORRIDOR / LOBBY-1
C100-3	MAIN CORRIDOR / LOBBY-3
C101	PUBLIC WAITING
C102	CORR
C200	CORR
C201	CORR
C202	CORR
C203	Space
C204	Space
C300	CORRIDOR
C301	CORR
C302-1	CORR-1
C302-2	CORR-2
C302-3	CORR-3
C303	CORR
C303.1	ALCOVE / STORAGE
C304	CORR
C305	CORRIDOR
C306-1	CORR-1
C306-2	CORR-2
C306-3	CORR-3

1 GROUND FLOOR DUCT PLAN
SCALE: 1/8" = 1'-0"

Plot Date: 1/4/2019 10:23:09 AM

NICoE
National Intrepid Center of Excellence

EGLIN AIR FORCE BASE

BUILDING XX
ASH DR, EGLIN AIR FORCE BASE
FLORIDA
32542

SMITHGROUP

1700 NEW YORK AVE, NW
SUITE 100
WASHINGTON, DC 20006
202.842.2100
www.smithgroup.com

SmithGroup
MEP-FP ENGINEERING
1700 New York Ave, Suite 100
Washington, D.C. 20006
202.842.2100

Baskerville-Donovan, Inc.
CIVIL ENGINEERING
449 W Main Street
Pensacola, Florida 32502
850.438.9661
Engineering Business: EB-0000340

Cagley & Associates
STRUCTURAL ENGINEERING
6141 Executive Boulevard
Rockville, Maryland 20852
301.881.9050

IMEG Corporation
ELECTRONIC SECURITY / TELECOMMUNICATIONS
2802 106th Street
Suite 100
Des Moines, Iowa 50322
515.334.9906

ISSUED FOR	REV	DATE
CONTRACT DOCUMENTS		01.04.2019
DESIGN DEVELOPMENT		11.05.2018
SCHEMATIC DESIGN		8.17.2018

SEALS AND SIGNATURES

COMMONWEALTH OF VIRGINIA
JOHN K. HERRMAN
Lic. No. 019325
PROFESSIONAL ENGINEER

KEYPLAN

PLAN NORTH

DRAWING TITLE
GROUND FLOOR DUCT PLAN

SCALE
1/8" = 1'-0"

PROJECT NUMBER
10822.000

DRAWING NUMBER
M2.3