


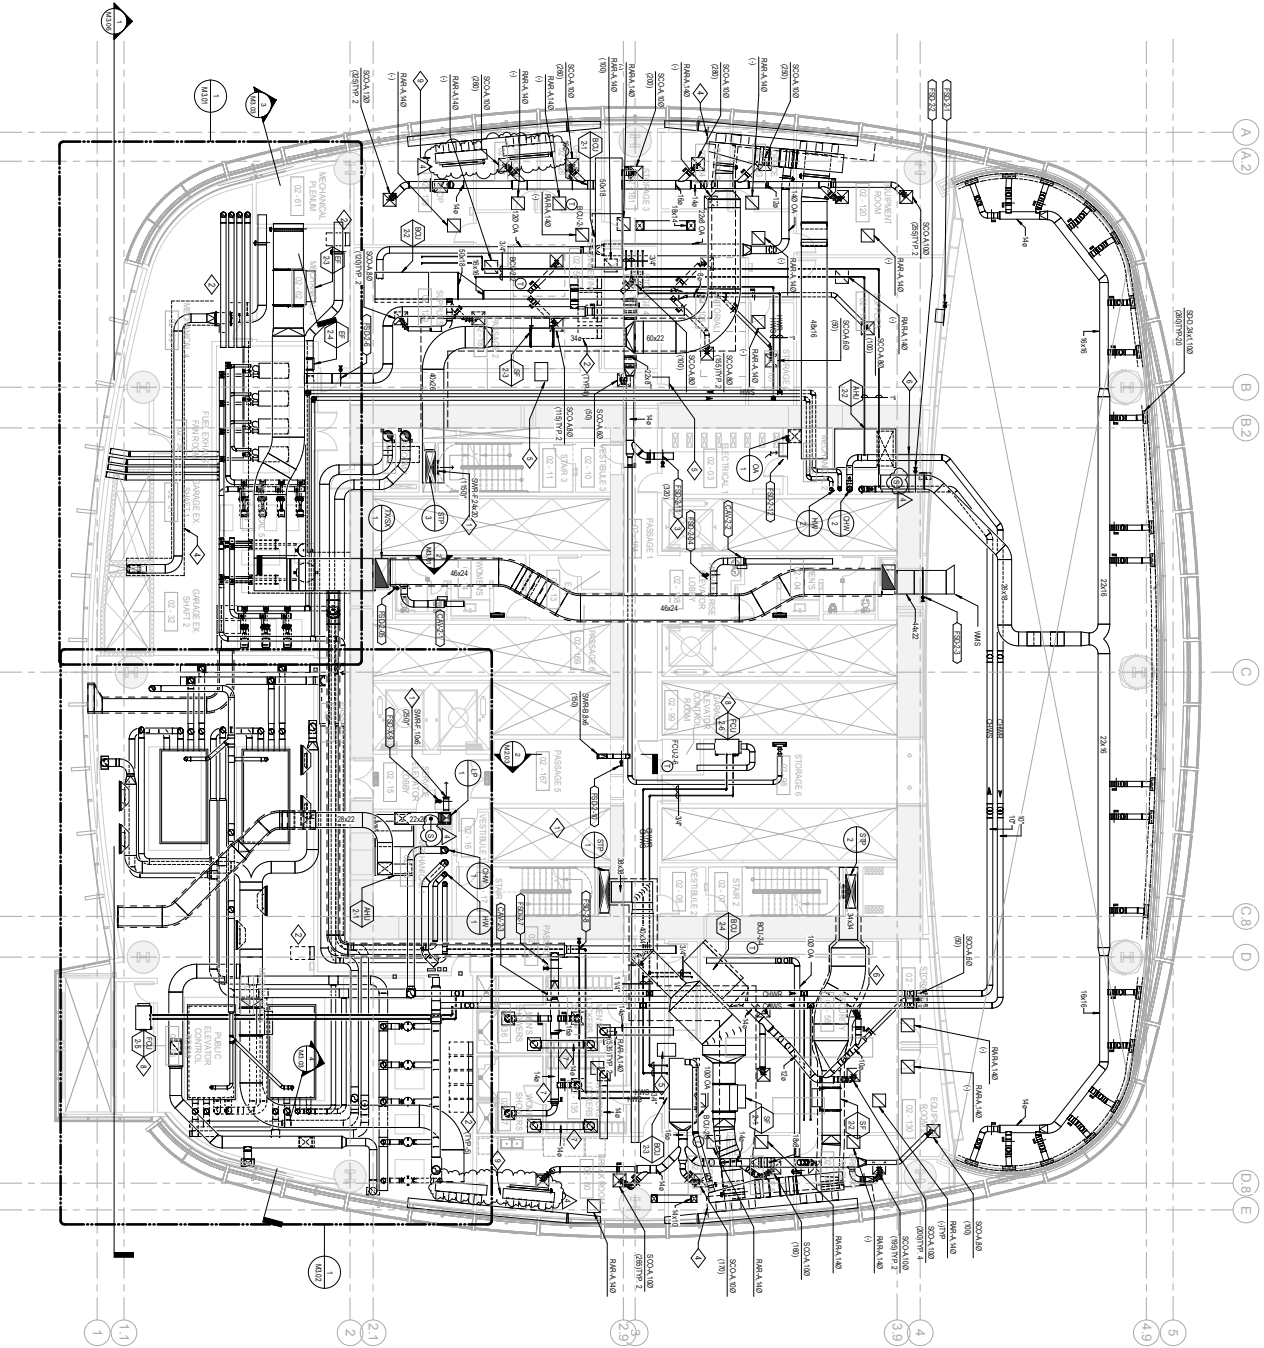

SHEET NOTES

REFER TO DETAILS ON 105 FOR W/VE AND R/VE PLAN/ CONNECTION DETAILS.

NUMBERED NOTES

- NOT USED
- FAN ROOM WITH ELECTRICAL CLEARANCE
- PROVIDE WITH W/VE R/VE SCREEN AT EACH OPEN BLD.
- ARCHITECTURAL RATED ENCLOSURE
- 3404 TRAVEL AIR DUCT
- RATED SEPARATION
- ALL STEEL STRUCTURE DUCT DOWNSTREAM OF CAN BOX, SLOPED
- PROVIDE WITH R/VE R/VE SCREEN AT EACH OPEN BLD.
- CONNECTIONS TO BE MADE IN ACCORDANCE WITH APPROVED DETAILS
- SEE COMMENTS ON 105 FOR W/VE

Transbay Tower
San Francisco, CA



BOSTON ARCHITECTS' NAMES
Owner
PELL CLARKE PELLI ARCHITECTS
Design Architect
REGULATORY ASSOCIATES, INC.
Architect of Record
MOHNSON ASSOCIATES, ASSOCIATES
Architect of Record
WSP
Mechanical Engineer
PWP LINDSAY ARCHITECTURE
MEP ENGINEERS
PERSONNEL ASSOCIATES, INC.
MEP ENGINEERS
ACI FIRE PROTECTION ENGINEERING
MEP ENGINEERS
HMM ENGINEERING
MEP ENGINEERS
AMP
MEP ENGINEERS
HILL LIGHTING DESIGN, INC.
Lighting Architect
OSHA AND ASSOCIATES, INC.
MEP ENGINEERS
KORSON VERIFIED
MEP ENGINEERS
ENVIRONMENTAL BUILDING STRATEGIES
LEED CONSULTING
HAI CONSULTING
MEP ENGINEERS
C.S. CALLAN CO., INC.
MEP ENGINEERS
ENGINEERING SPECIALISTS GROUP
MEP ENGINEERS
DEBRA NICOLA DESIGN
MEP ENGINEERS
ROYCE HANCOCK ARCHITECT & INTERIOR
MEP ENGINEERS

MECHANICAL LEVEL 2 PLAN

M2.02

1/8" = 1'-0"