OpenStudio Results

Model Summary

Building Summary

Data	Value
Building Name	My Office Building
Total Site Energy	137,561 kWh
Total Building Area	1,048 m^2
Total Site EUI	131.20 kWh/m^2
OpenStudio Standards Building Type	n/a

Weather Summary

	Value
Weather File	LONDON/GATWICK - GBR IWEC Data WMO#=037760
Latitude	51.15
Longitude	-0.2
Elevation	62 m
Time Zone	0.00
North Axis Angle	0.00
ASHRAE Climate Zone	

Sizing Period Design Days

	Maximum Dry Bulb (C)	Daily Temperature Range (K)	Humidity Value	Humidity Type	Wind Speed (m/s)	Wind Direction
LONDON/GATWICK ANN CLG .4% CONDNS DB=>MWB	27.2	9.7	18.7	Wetbulb [C]	3.5	90.0
LONDON/GATWICK ANN CLG .4% CONDNS DP=>MDB	21.9	9.7	17.8	Dewpoint [C]	3.5	90.0
LONDON/GATWICK ANN CLG .4% CONDNS ENTH=>MDB	25.7	9.7	56300.0	Enthalpy [J/kg]	3.5	90.0
LONDON/GATWICK ANN CLG .4% CONDNS WB=>MDB	25.4	9.7	19.7	Wetbulb [C]	3.5	90.0
LONDON/GATWICK ANN CLG 1% CONDNS DB=>MWB	25.2	9.7	17.8	Wetbulb [C]	3.5	90.0
LONDON/GATWICK ANN CLG 1% CONDNS DP=>MDB	20.5	9.7	16.9	Dewpoint [C]	3.5	90.0
LONDON/GATWICK ANN CLG 1% CONDNS ENTH=>MDB	23.9	9.7	53200.0	Enthalpy [J/kg]	3.5	90.0
LONDON/GATWICK ANN CLG 1% CONDNS WB=>MDB	23.8	9.7	18.7	Wetbulb [C]	3.5	90.0
LONDON/GATWICK ANN CLG 2% CONDNS DB=>MWB	23.8	9.7	17.2	Wetbulb [C]	3.5	90.0
LONDON/GATWICK ANN CLG 2% CONDNS DP=>MDB	19.6	9.7	16.1	Dewpoint [C]	3.5	90.0

LONDON/GATWICK ANN CLG 2% CONDNS ENTH=>MDB	22.2	9.7	50400.0	Enthalpy [J/kg]	3.5	90.0
LONDON/GATWICK ANN CLG 2% CONDNS WB=>MDB	22.1	9.7	17.8	Wetbulb [C]	3.5	90.0
LONDON/GATWICK ANN HTG 99% CONDNS DB	-3.0	0.0	-3.0	Wetbulb [C]	1.5	80.0
LONDON/GATWICK ANN HTG 99.6% CONDNS DB	-4.6	0.0	-4.6	Wetbulb [C]	1.5	80.0
LONDON/GATWICK ANN HTG WIND 99% CONDNS WS=>MCDB	6.9	0.0	6.9	Wetbulb [C]	11.3	80.0
LONDON/GATWICK ANN HTG WIND 99.6% CONDNS WS=>MCDB	7.9	0.0	7.9	Wetbulb [C]	12.6	80.0
LONDON/GATWICK ANN HUM_N 99% CONDNS DP=>MCDB	-0.7	0.0	-6.0	Dewpoint [C]	1.5	80.0
LONDON/GATWICK ANN HUM_N 99.6% CONDNS DP=>MCDB	-2.1	0.0	-7.6	Dewpoint [C]	1.5	80.0

Unmet Hours Summary

Time Setpoint Not Met	Time (hr)
During Heating	0.0
During Cooling	0.0
During Occupied Heating	0.0
During Occupied Cooling	0.0

Unmet Hours Tolerance

Tolerance for Time Setpoint Not Met	Temperature (C)
Heating	0.2
Cooling	0.2

Annual Overview

End Use - view table

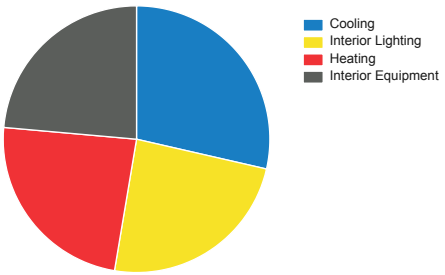

Energy Use - view table

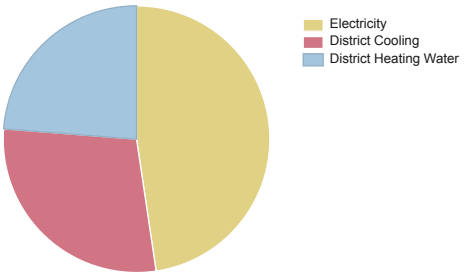

EUI - Electricity - view table

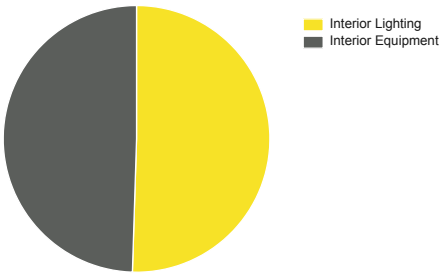

EUI - Gas - view table

Monthly Overview

Electricity Consumption (kWh) - view table

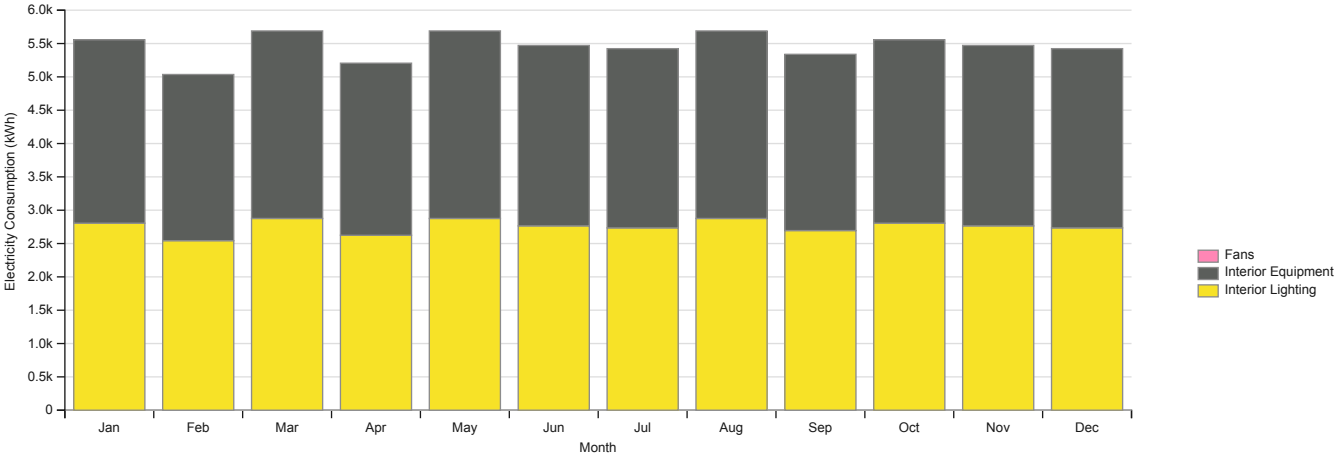

District Cooling Consumption (kWh) - view table

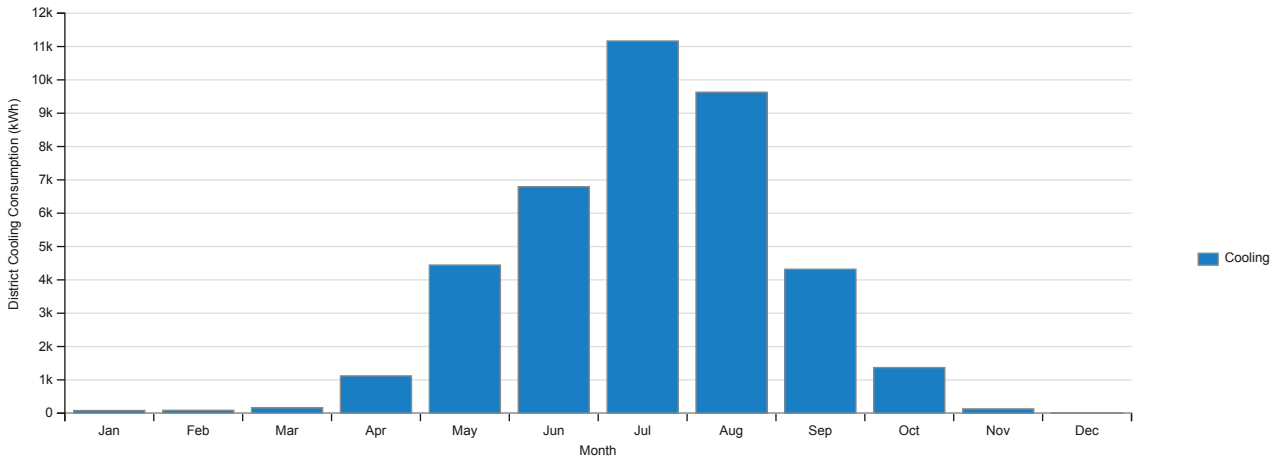

District Heating Water Consumption (kWh) - view table

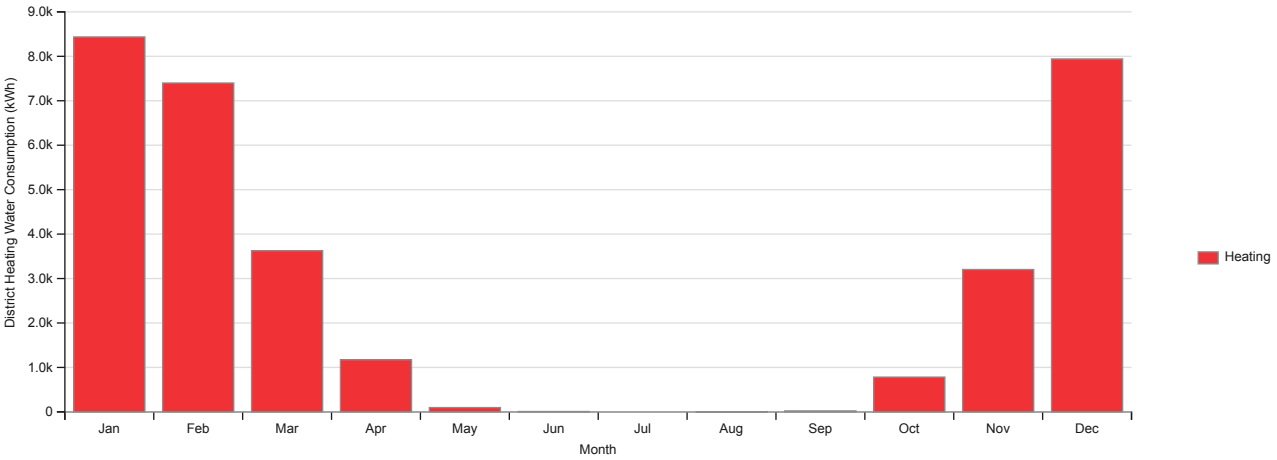

Electricity Peak Demand (kW) - view table

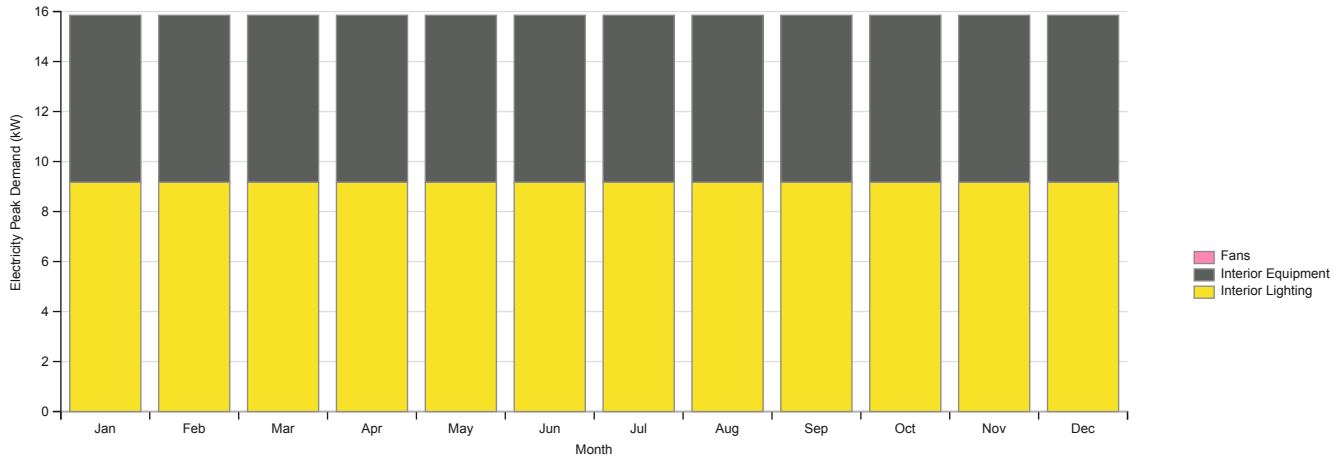

District Cooling Peak Demand (W) - view table

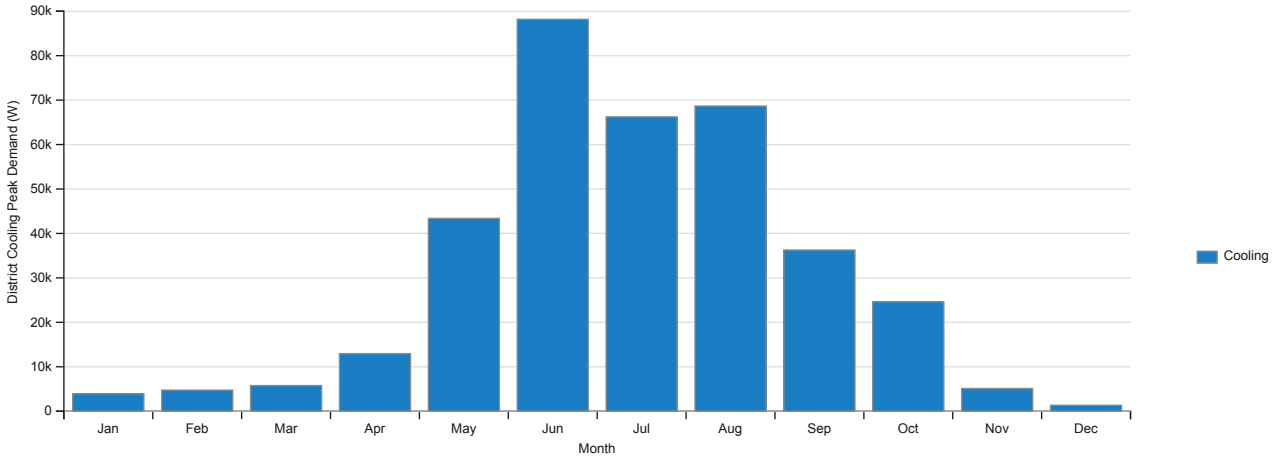

District Heating Water Peak Demand (W) - view table

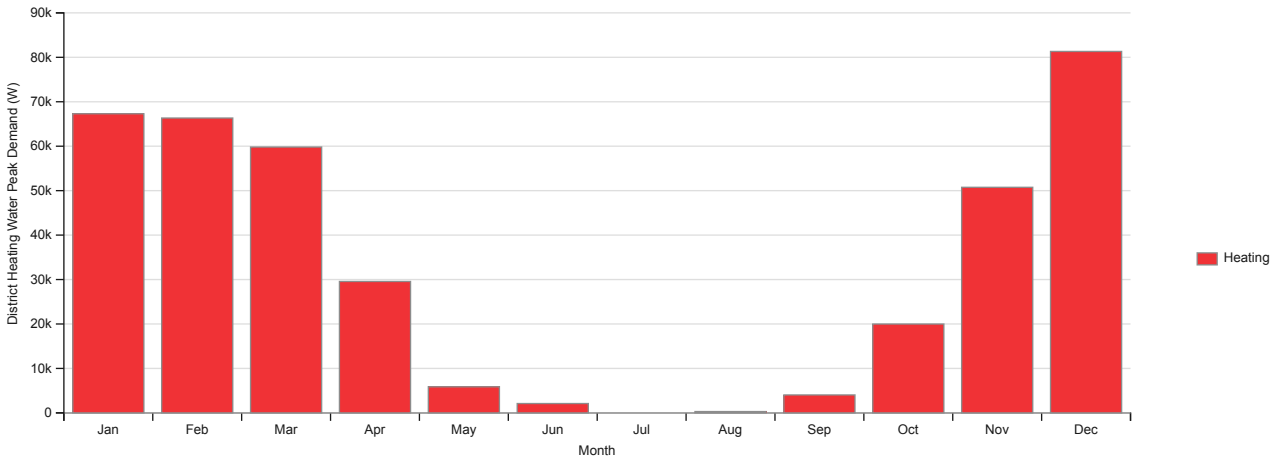

Utility Bills/Rates

No Data to Show for Utility Bills/Rates

Envelope Summary

Base Surface Constructions

Construction	Net Area (m^2)	Surface Count	R Value (m^2*K/W)
My Office Building Ext Wall	747.7	61	2.72
My Office Building Roof	354.8	17	8.30

Sub Surface Constructions

Construction	Net Area (m^2)	Surface Count	U-factor (W/m^2*K)	SHGC	VLT

Double Glazed Window	188.3	46	0.02	0.70	0.81
Exterior Door	15.3	5		n/a	n/a

Sub Surface Construction Details (Material Layers)

Material Name
(Material Layers in Construction 'Double Glazed Window':)
Clear 6mm
16mm Air Gap
Clear 6mm
(Material Layers in Construction 'Exterior Door':)
F08 Metal surface
I01 25mm insulation board

Window-to-Wall and Skylight-to-Roof area Ratios

Description	Total (%)	North (%)	East (%)	South (%)	West (%)
Gross Window-Wall Ratio	19.8	24.17	13.52	26.16	12.71
Gross Window-Wall Ratio (Conditioned)	19.8	24.17	13.52	26.16	12.71
Skylight-Roof Ratio	0.0				

Space Type Breakdown

Space Type Breakdown - view table

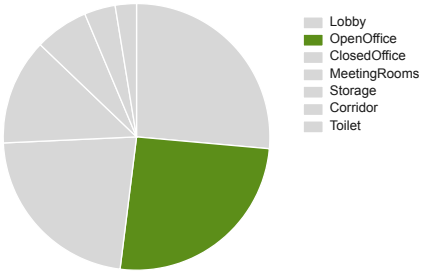

Space Type Summary

ClosedOffice
(9 spaces and 9 thermal zones)

Definition	Value	Unit	Inst. Multiplier
Internal Mass Definition (ClosedOffice)	1	m^2/floor area m^2	1.0
People Definition (ClosedOffice)	0.0500	people/m^2	1.0
Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0000	W/m^2	1.0
Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	9.0000	W/m^2	1.0
ClosedOffice Infiltration	0.2000	ach	

OpenOffice Ventilation Rate (outdoor air method Sum)	54.0000	m^3/h/person	

Corridor
(3 spaces and 3 thermal zones)

Definition	Value	Unit	Inst. Multiplier
People Definition (Corridor)	0.0300	people/m^2	1.0
Lights Definition (Corridors, Toilets, Storage, PlantRooms)	5.0000	W/m^2	1.0
Corridor Infiltration	0.2000	ach	
Storage Ventilation (outdoor air method Sum)	18.0000	m^3/h/person	

Lobby
(4 spaces and 3 thermal zones)

Definition	Value	Unit	Inst. Multiplier
Internal Mass Definition (Lobby)	1	m^2/floor area m^2	1.0
People Definition (Lobby)	0.2000	people/m^2	1.0
Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0000	W/m^2	1.0
Lights Definition (Lobby)	10.0000	W/m^2	1.0
Lobby Infiltration	0.3000	ach	
Lobby Ventilation (outdoor air method Sum)	36.0000	m^3/h/person	

MeetingRooms
(8 spaces and 8 thermal zones)

Definition	Value	Unit	Inst. Multiplier
Internal Mass Definition (OpenOffice, MeetingRooms, Storage)	2	m^2/floor area m^2	1.0
People Definition (MeetingRooms)	0.5000	people/m^2	1.0
Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0000	W/m^2	1.0
Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	9.0000	W/m^2	1.0
ClosedOffice Infiltration 1	0.2000	ach	
OpenOffice Ventilation Rate (outdoor air method Sum)	54.0000	m^3/h/person	

OpenOffice
(5 spaces and 5 thermal zones)

Definition	Value	Unit	Inst. Multiplier
Internal Mass Definition (OpenOffice, MeetingRooms, Storage)	2	m^2/floor area m^2	1.0
People Definition (OpenOffice)	0.1000	people/m^2	1.0
Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0000	W/m^2	1.0
Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	9.0000	W/m^2	1.0
My Office Building Infiltration Rate	0.2000	ach	
OpenOffice Ventilation Rate (outdoor air method Sum)	54.0000	m^3/h/person	

Storage
(10 spaces and 4 thermal zones)

Definition	Value	Unit	Inst. Multiplier
Internal Mass Definition (OpenOffice, MeetingRooms, Storage)	2	m^2/floor area m^2	1.0
People Definition (PlantRooms, ITrooms, Storage)	0.0100	people/m^2	1.0
Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0000	W/m^2	1.0
Lights Definition (Corridors, Toilets, Storage, PlantRooms)	5.0000	W/m^2	1.0
Storage Infiltration	0.1000	ach	
Storage Ventilation (outdoor air method Sum)	18.0000	m^3/h/person	

Toilet
(6 spaces and 3 thermal zones)

Definition	Value	Unit	Inst. Multiplier
People Definition (Toilets)	0.0200	people/m^2	1.0
Lights Definition (Corridors, Toilets, Storage, PlantRooms)	5.0000	W/m^2	1.0
Toilet Infiltration	0.1000	ach	
Storage Ventilation (outdoor air method Sum)	18.0000	m^3/h/person	

Interior Lighting Summary

Zone Lighting

Lights	Zone	Lighting Power Density (W/m^2)	Total Power (W)	Schedule Name	Scheduled Hours/Week (hr)	Actual Load Hours/Week (hr)	Return Air Fraction	Annual Consumption (kWh)
SPACE 3 - 1 LIGHTS (OPENOFFICE)		9.0	1041.13	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	3755.56
SPACE 2 - 4 LIGHTS (OPENOFFICE)		9.0	109.78	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	397.22
SPACE 4 - 1 LIGHTS (OPENOFFICE)		9.0	1041.13	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	3755.56
SPACE 3 - 2 LIGHTS (OPENOFFICE)		9.0	109.78	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	397.22
SPACE 4 - 2 LIGHTS (OPENOFFICE)		9.0	109.78	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	397.22
SPACE 3 - 13 LIGHTS 2		9.0	121.64	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	438.89
SPACE 3 - 11 LIGHTS 2		9.0	166.53	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	600.0
SPACE 4 - 10 LIGHTS 2		9.0	141.63	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	511.11
SPACE 2 - 2 LIGHTS 2		9.0	162.94	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	588.89

SPACE 2 - 9 LIGHTS 2		9.0	192.57	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	694.44
SPACE 3 - 10 LIGHTS 2		9.0	141.63	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	511.11
SPACE 4 - 15 LIGHTS 2		9.0	121.64	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	438.89
SPACE 4 - 11 LIGHTS 2		9.0	166.53	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	600.0
SPACE 4 - 3 LIGHTS 7		5.0	66.43	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	238.89
SPACE 2 - 5 LIGHTS 7		5.0	64.28	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	230.56
SPACE 3 - 3 LIGHTS 7		5.0	66.43	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	238.89
SPACE 2 - 10 LIGHTS 4		10.0	1088.08	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	3925.0
SPACE 3 - 17 LIGHTS 4		10.0	570.32	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	2058.33
SPACE 2 - 11 LIGHTS 4		10.0	541.26	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	1952.78
SPACE 4 - 17 LIGHTS 4		10.0	570.32	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	2058.33
SPACE 4 - 7 LIGHTS 3		5.0	22.61	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	80.56
SPACE 3 - 15 LIGHTS 3		5.0	49.7	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	180.56
SPACE 4 - 16 LIGHTS 3		5.0	35.34	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	127.78
SPACE 3 - 16 LIGHTS 3		5.0	35.34	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	127.78
SPACE 3 - 6 LIGHTS 3		5.0	22.42	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	80.56
SPACE 3 - 7 LIGHTS 3		5.0	22.61	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	80.56
SPACE 3 - 9 LIGHTS 3		5.0	40.59	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	147.22
SPACE 4 - 6 LIGHTS 3		5.0	22.42	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	80.56
SPACE 4 - 14 LIGHTS 3		5.0	49.7	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	180.56
SPACE 4 - 9 LIGHTS 3		5.0	40.59	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	147.22

SPACE 2 - 8 LIGHTS 1		9.0	81.05	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	291.67
SPACE 3 - 8 LIGHTS 1		9.0	192.28	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	694.44
SPACE 2 - 1 LIGHTS 1		9.0	505.63	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	1825.0
SPACE 2 - 3 LIGHTS 1		9.0	335.27	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	1208.33
SPACE 3 - 12 LIGHTS 1		9.0	142.29	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	513.89
SPACE 4 - 12 LIGHTS 1		9.0	142.29	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	513.89
SPACE 3 - 14 LIGHTS 1		9.0	256.47	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	925.0
SPACE 4 - 13 LIGHTS 1		9.0	256.47	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	925.0
SPACE 4 - 8 LIGHTS 1		9.0	192.28	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	694.44
SPACE 2 - 6 LIGHTS 6		5.0	22.42	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	80.56
SPACE 4 - 5 LIGHTS 6		5.0	22.42	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	80.56
SPACE 3 - 4 LIGHTS 6		5.0	22.61	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	80.56
SPACE 3 - 5 LIGHTS 6		5.0	22.42	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	80.56
SPACE 2 - 7 LIGHTS 6		5.0	22.61	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	80.56
SPACE 4 - 4 LIGHTS 6		5.0	22.61	MY OFFICE BUILDING LIGHTS	69.34	69.19	0.0000	80.56

Space Lighting Details

Load Name	Definition Name	Load Type	Load (units)	Multiplier	Total Load (W)
(Space Name: 'Space 2 - 10', Area: 109 m^2, Total LPD: 10.0 W/m^2)					
Lights 4	Lights Definition (Lobby)	Spacetype	10.0 (W/m^2)	1	1088
(Space Name: 'Space 2 - 8', Area: 9 m^2, Total LPD: 9.0 W/m^2)					
Lights 1	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	81
(Space Name: 'Space 2 - 6', Area: 4 m^2, Total LPD:					

5.0 W/m^2)					
Lights 6	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	22
(Space Name: 'Space 3 - 13', Area: 14 m^2, Total LPD: 9.0 W/m^2)					
Lights 2	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	122
(Space Name: 'Space 3 - 11', Area: 19 m^2, Total LPD: 9.0 W/m^2)					
Lights 2	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	167
(Space Name: 'Space 3 - 17', Area: 57 m^2, Total LPD: 10.0 W/m^2)					
Lights 4	Lights Definition (Lobby)	Spacetype	10.0 (W/m^2)	1	570
(Space Name: 'Space 4 - 10', Area: 16 m^2, Total LPD: 9.0 W/m^2)					
Lights 2	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	142
(Space Name: 'Space 4 - 5', Area: 4 m^2, Total LPD: 5.0 W/m^2)					
Lights 6	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	22
(Space Name: 'Space 3 - 4', Area: 5 m^2, Total LPD: 5.0 W/m^2)					
Lights 6	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	23
(Space Name: 'Space 3 - 8', Area: 21 m^2, Total LPD: 9.0 W/m^2)					
Lights 1	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	192
(Space Name: 'Space 3 - 1', Area: 116 m^2, Total LPD: 9.0 W/m^2)					
Lights (OpenOffice)	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	1041
(Space Name: 'Space 2 - 11', Area: 54 m^2, Total LPD: 10.0 W/m^2)					
Lights 4	Lights Definition (Lobby)	Spacetype	10.0 (W/m^2)	1	541
(Space Name: 'Space 4 - 3', Area: 13 m^2, Total LPD: 5.0 W/m^2)					
Lights 7	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	66
(Space Name: 'Space 2 - 1', Area: 56 m^2, Total LPD: 9.0 W/m^2)					
Lights 1	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	506
(Space Name: 'Space 4 - 7', Area: 5 m^2, Total LPD: 5.0 W/m^2)					
Lights 3	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	23
(Space Name: 'Space 2 - 2', Area: 18 m^2, Total LPD: 9.0 W/m^2)					

Lights 2	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	163
(Space Name: 'Space 3 - 5', Area: 4 m^2, Total LPD: 5.0 W/m^2)					
Lights 6	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	22
(Space Name: 'Space 2 - 5', Area: 13 m^2, Total LPD: 5.0 W/m^2)					
Lights 7	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	64
(Space Name: 'Space 2 - 3', Area: 37 m^2, Total LPD: 9.0 W/m^2)					
Lights 1	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	335
(Space Name: 'Space 2 - 4', Area: 12 m^2, Total LPD: 9.0 W/m^2)					
Lights (OpenOffice)	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	110
(Space Name: 'Space 2 - 7', Area: 5 m^2, Total LPD: 5.0 W/m^2)					
Lights 6	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	23
(Space Name: 'Space 2 - 9', Area: 21 m^2, Total LPD: 9.0 W/m^2)					
Lights 2	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	193
(Space Name: 'Space 3 - 3', Area: 13 m^2, Total LPD: 5.0 W/m^2)					
Lights 7	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	66
(Space Name: 'Space 3 - 10', Area: 16 m^2, Total LPD: 9.0 W/m^2)					
Lights 2	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	142
(Space Name: 'Space 3 - 12', Area: 16 m^2, Total LPD: 9.0 W/m^2)					
Lights 1	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	142
(Space Name: 'Space 4 - 12', Area: 16 m^2, Total LPD: 9.0 W/m^2)					
Lights 1	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	142
(Space Name: 'Space 3 - 14', Area: 28 m^2, Total LPD: 9.0 W/m^2)					
Lights 1	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	256
(Space Name: 'Space 4 - 15', Area: 14 m^2, Total LPD: 9.0 W/m^2)					
Lights 2	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	122
(Space Name: 'Space 3 - 15', Area: 10 m^2, Total LPD: 5.0 W/m^2)					
Lights 3	Lights Definition (Corridors, Toilets, Storage,	Spacetype	5.0 (W/m^2)	1	50

	PlantRooms)				
(Space Name: 'Space 4 - 16', Area: 7 m^2, Total LPD: 5.0 W/m^2)					
Lights 3	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	35
(Space Name: 'Space 3 - 16', Area: 7 m^2, Total LPD: 5.0 W/m^2)					
Lights 3	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	35
(Space Name: 'Space 4 - 4', Area: 5 m^2, Total LPD: 5.0 W/m^2)					
Lights 6	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	23
(Space Name: 'Space 4 - 11', Area: 19 m^2, Total LPD: 9.0 W/m^2)					
Lights 2	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	167
(Space Name: 'Space 3 - 6', Area: 4 m^2, Total LPD: 5.0 W/m^2)					
Lights 3	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	22
(Space Name: 'Space 3 - 7', Area: 5 m^2, Total LPD: 5.0 W/m^2)					
Lights 3	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	23
(Space Name: 'Space 3 - 9', Area: 8 m^2, Total LPD: 5.0 W/m^2)					
Lights 3	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	41
(Space Name: 'Space 4 - 17', Area: 57 m^2, Total LPD: 10.0 W/m^2)					
Lights 4	Lights Definition (Lobby)	Spacetype	10.0 (W/m^2)	1	570
(Space Name: 'Space 4 - 13', Area: 28 m^2, Total LPD: 9.0 W/m^2)					
Lights 1	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	256
(Space Name: 'Space 4 - 6', Area: 4 m^2, Total LPD: 5.0 W/m^2)					
Lights 3	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	22
(Space Name: 'Space 4 - 8', Area: 21 m^2, Total LPD: 9.0 W/m^2)					
Lights 1	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	192
(Space Name: 'Space 4 - 1', Area: 116 m^2, Total LPD: 9.0 W/m^2)					
Lights (OpenOffice)	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	1041
(Space Name: 'Space 4 - 14', Area: 10 m^2, Total LPD: 5.0 W/m^2)					
Lights 3	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	50

(Space Name: 'Space 4 - 9', Area: 8 m^2, Total LPD: 5.0 W/m^2)					
Lights 3	Lights Definition (Corridors, Toilets, Storage, PlantRooms)	Spacetype	5.0 (W/m^2)	1	41
(Space Name: 'Space 3 - 2', Area: 12 m^2, Total LPD: 9.0 W/m^2)					
Lights (OpenOffice)	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	110
(Space Name: 'Space 4 - 2', Area: 12 m^2, Total LPD: 9.0 W/m^2)					
Lights (OpenOffice)	Lights Definition (OpenOffice, ClosedOffice, MeetingRooms)	Spacetype	9.0 (W/m^2)	1	110

Lighting Controls Details

Space Name	Control Name	Zone Controlled (type, fraction)	Illuminance Setpoint (lux)

Plug Loads Summary

Electric Plug Load Consumption

	Electricity Annual Value (kWh)
InteriorEquipment:Electricity:Zone:FLOOR1-OPENOFFICE	5658.33
General:InteriorEquipment:Electricity:Zone:FLOOR1-OPENOFFICE	5658.33
InteriorEquipment:Electricity:Zone:GROUND-BREAKROOM	597.22
General:InteriorEquipment:Electricity:Zone:GROUND-BREAKROOM	597.22
InteriorEquipment:Electricity:Zone:FLOOR2-OPENOFFICE	5658.33
General:InteriorEquipment:Electricity:Zone:FLOOR2-OPENOFFICE	5658.33
InteriorEquipment:Electricity:Zone:FLOOR1-BREAKROOM	597.22
General:InteriorEquipment:Electricity:Zone:FLOOR1-BREAKROOM	597.22
InteriorEquipment:Electricity:Zone:FLOOR2-BREAKROOM	597.22
General:InteriorEquipment:Electricity:Zone:FLOOR2-BREAKROOM	597.22
InteriorEquipment:Electricity:Zone:FLOOR1-CENTRAL-MEETINGROOM	330.56
General:InteriorEquipment:Electricity:Zone:FLOOR1-CENTRAL-MEETINGROOM	330.56
InteriorEquipment:Electricity:Zone:FLOOR1-NORTH-MEETINGROOM2	452.78
General:InteriorEquipment:Electricity:Zone:FLOOR1-NORTH-MEETINGROOM2	452.78
InteriorEquipment:Electricity:Zone:FLOOR2-NORTH-MEETINGROOM1	386.11
General:InteriorEquipment:Electricity:Zone:FLOOR2-NORTH-MEETINGROOM1	386.11
InteriorEquipment:Electricity:Zone:GROUND-SOUTH-MEETINGROOM	441.67
General:InteriorEquipment:Electricity:Zone:GROUND-SOUTH-MEETINGROOM	441.67
InteriorEquipment:Electricity:Zone:GROUND-NORTH-MEETINGROOMS	522.22
General:InteriorEquipment:Electricity:Zone:GROUND-NORTH-MEETINGROOMS	522.22
InteriorEquipment:Electricity:Zone:FLOOR1-NORTH-MEETINGROOM1	386.11
General:InteriorEquipment:Electricity:Zone:FLOOR1-NORTH-MEETINGROOM1	386.11
InteriorEquipment:Electricity:Zone:FLOOR2-CENTRAL-MEETINGROOM	330.56
General:InteriorEquipment:Electricity:Zone:FLOOR2-CENTRAL-MEETINGROOM	330.56
InteriorEquipment:Electricity:Zone:FLOOR2-NORTH-MEETINGROOM2	452.78
General:InteriorEquipment:Electricity:Zone:FLOOR2-NORTH-MEETINGROOM2	452.78

InteriorEquipment:Electricity:Zone:GROUNDFLOOR-LOBBY/CORRIDOR	3986.11
General:InteriorEquipment:Electricity:Zone:GROUNDFLOOR-LOBBY/CORRIDOR	3986.11
InteriorEquipment:Electricity:Zone:FLOOR1-LOBBY	1394.44
General:InteriorEquipment:Electricity:Zone:FLOOR1-LOBBY	1394.44
InteriorEquipment:Electricity:Zone:FLOOR2-LOBBY	1394.44
General:InteriorEquipment:Electricity:Zone:FLOOR2-LOBBY	1394.44
InteriorEquipment:Electricity:Zone:FLOOR2-NORHTWEST-STORAGEROOMS	419.44
General:InteriorEquipment:Electricity:Zone:FLOOR2-NORHTWEST-STORAGEROOMS	419.44
InteriorEquipment:Electricity:Zone:FLOOR1-SOUTHEAST-STORAGEROOMS	416.67
General:InteriorEquipment:Electricity:Zone:FLOOR1-SOUTHEAST-STORAGEROOMS	416.67
InteriorEquipment:Electricity:Zone:FLOOR2-SOUTHEAST-STORAGEROOMS	416.67
General:InteriorEquipment:Electricity:Zone:FLOOR2-SOUTHEAST-STORAGEROOMS	416.67
InteriorEquipment:Electricity:Zone:FLOOR1-NORHTWEST-STORAGEROOMS	419.44
General:InteriorEquipment:Electricity:Zone:FLOOR1-NORHTWEST-STORAGEROOMS	419.44
InteriorEquipment:Electricity:Zone:GROUND-LOUNGE	441.67
General:InteriorEquipment:Electricity:Zone:GROUND-LOUNGE	441.67
InteriorEquipment:Electricity:Zone:FLOOR1-NORTH-CLOSEDOFFICE	1044.44
General:InteriorEquipment:Electricity:Zone:FLOOR1-NORTH-CLOSEDOFFICE	1044.44
InteriorEquipment:Electricity:Zone:GROUND-SOUTH-OFFICE	2747.22
General:InteriorEquipment:Electricity:Zone:GROUND-SOUTH-OFFICE	2747.22
InteriorEquipment:Electricity:Zone:GROUND-SOUTHEAST-CORNEROFFICE	1822.22
General:InteriorEquipment:Electricity:Zone:GROUND-SOUTHEAST-CORNEROFFICE	1822.22
InteriorEquipment:Electricity:Zone:FLOOR1-SOUTH-CLOSEDOFFICE	772.22
General:InteriorEquipment:Electricity:Zone:FLOOR1-SOUTH-CLOSEDOFFICE	772.22
InteriorEquipment:Electricity:Zone:FLOOR2-SOUTH-CLOSEDOFFICE	772.22
General:InteriorEquipment:Electricity:Zone:FLOOR2-SOUTH-CLOSEDOFFICE	772.22
InteriorEquipment:Electricity:Zone:FLOOR1-SOUTHEAST-CORNEROFFICE	1394.44
General:InteriorEquipment:Electricity:Zone:FLOOR1-SOUTHEAST-CORNEROFFICE	1394.44
InteriorEquipment:Electricity:Zone:FLOOR2-SOUTHEAST-CORNEROFFICE	1394.44
General:InteriorEquipment:Electricity:Zone:FLOOR2-SOUTHEAST-CORNEROFFICE	1394.44
InteriorEquipment:Electricity:Zone:FLOOR2-NORTH-CLOSEDOFFICE	1044.44
General:InteriorEquipment:Electricity:Zone:FLOOR2-NORTH-CLOSEDOFFICE	1044.44

Space-level Electric Plug Loads

Equipment Name	Definition	Load (units)	Inheritance Level	Multiplier	Total Load (W)
(Space Name: Space 2 - 1, Area: 56 m^2)					
Electric Equipment 1	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	562
(Space Name: Space 2 - 10, Area: 109 m^2)					
Electric Equipment 4	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	544
(Space Name: Space 2 - 11, Area: 54 m^2)					
Electric Equipment 4	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	271

(Space Name: Space 2 - 2, Area: 18 m^2)					
Electric Equipment 2	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	91
(Space Name: Space 2 - 3, Area: 37 m^2)					
Electric Equipment 1	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	373
(Space Name: Space 2 - 4, Area: 12 m^2)					
Electric Equipment (OpenOffice)	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	122
(Space Name: Space 2 - 8, Area: 9 m^2)					
Electric Equipment 1	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	90
(Space Name: Space 2 - 9, Area: 21 m^2)					
Electric Equipment 2	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	107
(Space Name: Space 3 - 1, Area: 116 m^2)					
Electric Equipment (OpenOffice)	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	1157
(Space Name: Space 3 - 10, Area: 16 m^2)					
Electric Equipment 2	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	79
(Space Name: Space 3 - 11, Area: 19 m^2)					
Electric Equipment 2	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	93
(Space Name: Space 3 - 12, Area: 16 m^2)					
Electric Equipment 1	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	158
(Space Name: Space 3 - 13, Area: 14 m^2)					
Electric Equipment 2	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	68
(Space Name: Space 3 - 14, Area: 28 m^2)					
Electric Equipment 1	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	285
(Space Name: Space 3 - 15, Area: 10 m^2)					
Electric Equipment 3	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	50
(Space Name: Space 3 - 16, Area: 7 m^2)					
Electric Equipment 3	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	35

(Space Name: Space 3 - 17, Area: 57 m^2)					
Electric Equipment 4	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	285
(Space Name: Space 3 - 2, Area: 12 m^2)					
Electric Equipment (OpenOffice)	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	122
(Space Name: Space 3 - 6, Area: 4 m^2)					
Electric Equipment 3	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	22
(Space Name: Space 3 - 7, Area: 5 m^2)					
Electric Equipment 3	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	23
(Space Name: Space 3 - 8, Area: 21 m^2)					
Electric Equipment 1	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	214
(Space Name: Space 3 - 9, Area: 8 m^2)					
Electric Equipment 3	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	41
(Space Name: Space 4 - 1, Area: 116 m^2)					
Electric Equipment (OpenOffice)	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	1157
(Space Name: Space 4 - 10, Area: 16 m^2)					
Electric Equipment 2	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	79
(Space Name: Space 4 - 11, Area: 19 m^2)					
Electric Equipment 2	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	93
(Space Name: Space 4 - 12, Area: 16 m^2)					
Electric Equipment 1	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	158
(Space Name: Space 4 - 13, Area: 28 m^2)					
Electric Equipment 1	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	285
(Space Name: Space 4 - 14, Area: 10 m^2)					
Electric Equipment 3	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	50
(Space Name: Space 4 - 15, Area: 14 m^2)					
Electric Equipment 2	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	68

(Space Name: Space 4 - 16, Area: 7 m^2)					
Electric Equipment 3	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	35
(Space Name: Space 4 - 17, Area: 57 m^2)					
Electric Equipment 4	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	285
(Space Name: Space 4 - 2, Area: 12 m^2)					
Electric Equipment (OpenOffice)	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	122
(Space Name: Space 4 - 6, Area: 4 m^2)					
Electric Equipment 3	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	22
(Space Name: Space 4 - 7, Area: 5 m^2)					
Electric Equipment 3	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	23
(Space Name: Space 4 - 8, Area: 21 m^2)					
Electric Equipment 1	Electric Equipment Definition (OpenOffice, ClosedOffice, BreakRoom)	10.0 (W/m^2)	spacetype	1.0	214
(Space Name: Space 4 - 9, Area: 8 m^2)					
Electric Equipment 3	Electric Equipment Definition (MeetingRooms, PlantRooms, Lobby)	5.0 (W/m^2)	spacetype	1.0	41

Exterior Lighting

No Data to Show for Exterior Lighting

Water Use Equipment

No Data to Show for Water Use Equipment

HVAC Load Profiles

Monthly Load Profiles - view table

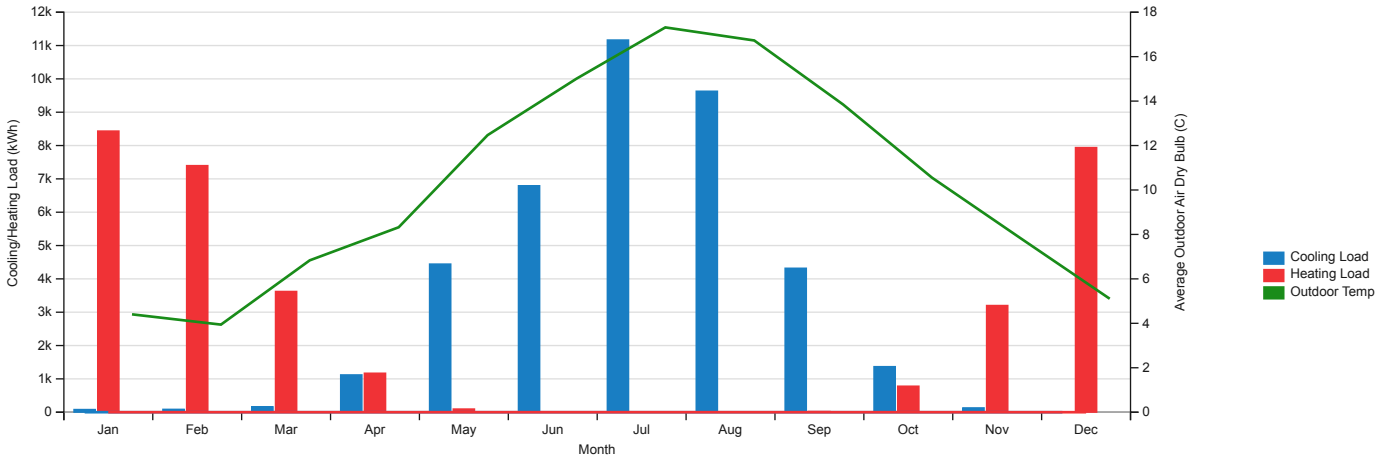

Zone Conditions

Temperature (Table values represent hours spent in each temperature range)

Zone	Unmet Htg (hr)	Unmet Htg - Occ (hr)	< 13 (C)	13-16 (C)	16-18 (C)	18-20 (C)	20-21 (C)	21-22 (C)	22-23 (C)	23-24 (C)	24-26 (C)	26-28 (C)	28-30 (C)	>= 30 (C)	Unmet Clg (hr)	Unmet Clg - Occ (hr)	Mean Temp (C)
FLOOR1-BREAKROOM	0	0	0	0	496	1306	324	2337	497	1083	2185	527	5	0	0	0	22.1 (C)
FLOOR1-CENTRAL-MEETINGROOM	0	0	0	0	7	1226	3372	1231	1469	822	633	0	0	0	0	0	21.2 (C)
FLOOR1-CORRIDOR	0	0	0	0	1051	2821	474	539	508	665	1740	962	0	0	0	0	21.5 (C)
FLOOR1-LOBBY	0	0	0	0	1381	2989	394	410	678	630	1589	689	0	0	0	0	21.0 (C)
FLOOR1-NORHTWEST-STORAGEROOMS	0	0	0	0	1766	2714	362	409	436	660	1604	809	0	0	0	0	20.9 (C)
FLOOR1-NORTH-CLOSEDOFFICE	0	0	0	0	812	1357	2374	882	2117	712	506	0	0	0	0	0	20.9 (C)
FLOOR1-NORTH-MEETINGROOM1	0	0	0	0	712	1597	2933	1111	1480	813	114	0	0	0	0	0	20.6 (C)
FLOOR1-NORTH-MEETINGROOM2	0	0	0	0	645	1690	2993	1062	1409	790	171	0	0	0	0	0	20.6 (C)
FLOOR1-OPENOFFICE	0	0	0	0	0	635	771	2372	663	1319	2750	250	0	0	0	0	22.7 (C)
FLOOR1-SOUTH-CLOSEDOFFICE	0	0	0	0	101	856	1610	1497	2930	695	1058	13	0	0	0	0	21.8 (C)
FLOOR1-SOUTHEAST-CORNEROFFICE	0	0	0	0	851	926	1900	1149	2349	484	986	115	0	0	0	0	21.2 (C)
FLOOR1-SOUTHEAST-STORAGEROOMS	0	0	0	0	173	2550	839	489	794	856	2206	853	0	0	0	0	22.2 (C)
FLOOR1-TOILETS	0	0	0	1	1791	2485	319	342	400	381	954	848	1035	204	0	0	21.7 (C)
FLOOR2-BREAKROOM	0	0	0	0	558	1285	336	2360	460	1037	2205	515	4	0	0	0	22.1 (C)
FLOOR2-CENTRAL-MEETINGROOM	0	0	0	0	5	1296	3396	1275	1498	973	317	0	0	0	0	0	21.2 (C)
FLOOR2-CORRIDOR	0	0	0	0	1193	2779	456	465	579	608	1721	959	0	0	0	0	21.4 (C)
FLOOR2-LOBBY	0	0	0	2	1587	2899	370	423	667	572	1557	683	0	0	0	0	20.8 (C)
FLOOR2-NORHTWEST-STORAGEROOMS	0	0	0	0	1957	2682	297	435	379	605	1511	894	0	0	0	0	20.7 (C)
FLOOR2-NORTH-CLOSEDOFFICE	0	0	0	0	928	1267	2392	891	2130	758	394	0	0	0	0	0	20.8 (C)
FLOOR2-NORTH-MEETINGROOM1	0	0	0	0	767	1563	3014	1103	1472	773	68	0	0	0	0	0	20.6 (C)
FLOOR2-NORTH-MEETINGROOM2	0	0	0	0	731	1648	3018	1103	1376	786	98	0	0	0	0	0	20.5 (C)
FLOOR2-OPENOFFICE	0	0	0	0	0	672	825	2307	626	1243	2870	217	0	0	0	0	22.7 (C)
FLOOR2-SOUTH-CLOSEDOFFICE	0	0	0	0	155	915	1777	1387	2879	656	989	2	0	0	0	0	21.7 (C)
FLOOR2-SOUTHEAST-CORNEROFFICE	0	0	0	2	1024	816	2023	1114	2276	461	977	67	0	0	0	0	21.1 (C)
FLOOR2-SOUTHEAST-STORAGEROOMS	0	0	0	0	258	2625	783	520	769	857	2323	625	0	0	0	0	22.1 (C)

FLOOR2-TOILETS	0	0	0	1	1834	2565	324	283	423	373	970	874	997	116	0	0	21.5 (C)
GROUND-BREAKROOM	0	0	0	0	927	1053	2214	1007	2132	524	811	92	0	0	0	0	21.0 (C)
GROUND-LOUNGE	0	0	0	0	1581	698	2405	890	1974	450	729	33	0	0	0	0	20.6 (C)
GROUND-NORTH-MEETINGROOMS	0	0	0	0	1565	940	3013	1070	1392	663	117	0	0	0	0	0	20.2 (C)
GROUND-SOUTH-MEETINGROOM	0	0	0	0	296	1229	2708	1539	1743	690	555	0	0	0	0	0	21.1 (C)
GROUND-SOUTH-OFFICE	0	0	0	0	134	944	1675	1533	2770	647	1048	9	0	0	0	0	21.7 (C)
GROUND-SOUTHEAST-CORNEROFFICE	0	0	0	0	847	962	1916	1238	2379	549	849	20	0	0	0	0	21.1 (C)
GROUND-TOILETS	0	0	0	3	1804	2479	298	386	392	459	948	896	844	251	0	0	21.7 (C)
GROUNDFLOOR-LOBBY/CORRIDOR	0	0	0	0	837	3122	631	467	704	765	1844	390	0	0	0	0	21.2 (C)

Humidity (Table values represent hours spent in each Humidity range)

Zone	< 30 (%)	30-35 (%)	35-40 (%)	40-45 (%)	45-50 (%)	50-55 (%)	55-60 (%)	60-65 (%)	65-70 (%)	70-75 (%)	75-80 (%)	>= 80 (%)	Mean Relative Humidity (%)
FLOOR1-BREAKROOM	279	516	1132	2007	2023	1200	787	455	254	80	27	0	46.7 (%)
FLOOR1-CENTRAL-MEETINGROOM	616	825	1168	1529	1610	1460	938	435	151	25	3	0	45.5 (%)
FLOOR1-CORRIDOR	625	972	1670	2211	1533	868	613	227	41	0	0	0	42.8 (%)
FLOOR1-LOBBY	233	435	1025	1656	1829	1631	953	653	297	47	1	0	48.0 (%)
FLOOR1-NORHTWEST-STORAGEROOMS	0	0	136	556	924	1017	1680	1484	1166	824	493	480	60.7 (%)
FLOOR1-NORTH-CLOSEDOFFICE	82	254	540	1141	2383	2092	1082	589	413	154	25	5	50.6 (%)
FLOOR1-NORTH-MEETINGROOM1	453	672	1079	1307	1698	1607	1038	622	222	53	9	0	47.1 (%)
FLOOR1-NORTH-MEETINGROOM2	456	670	1082	1308	1699	1593	1032	615	238	58	9	0	47.1 (%)
FLOOR1-OPENOFFICE	323	611	1327	1902	2120	1401	687	338	51	0	0	0	45.3 (%)
FLOOR1-SOUTH-CLOSEDOFFICE	154	464	843	1568	2812	1600	753	431	134	1	0	0	47.4 (%)
FLOOR1-SOUTHEAST-CORNEROFFICE	107	321	785	1386	2814	1527	726	573	327	171	23	0	49.1 (%)
FLOOR1-SOUTHEAST-STORAGEROOMS	0	0	79	469	1436	2087	1888	1282	889	482	148	0	56.6 (%)
FLOOR1-TOILETS	335	769	1687	2213	1552	976	632	382	182	32	0	0	44.7 (%)
FLOOR2-BREAKROOM	271	504	1111	2038	2046	1198	766	457	252	88	29	0	46.8 (%)
FLOOR2-CENTRAL-MEETINGROOM	614	815	1147	1461	1605	1438	996	470	181	28	5	0	45.8 (%)
FLOOR2-CORRIDOR	592	932	1658	2226	1551	875	591	286	49	0	0	0	43.1 (%)
FLOOR2-LOBBY	213	399	1011	1616	1807	1683	954	645	358	71	3	0	48.4 (%)
FLOOR2-NORHTWEST-STORAGEROOMS	0	0	166	588	874	1003	1600	1381	1230	768	539	611	61.2 (%)
FLOOR2-NORTH-CLOSEDOFFICE	82	243	527	1090	2307	2140	1122	596	440	165	41	7	50.9 (%)
FLOOR2-NORTH-MEETINGROOM1	454	660	1069	1288	1677	1613	1033	636	253	66	11	0	47.3 (%)

FLOOR2-NORTH-MEETINGROOM2	454	671	1058	1279	1670	1595	1043	635	268	74	13	0	47.4 (%)
FLOOR2-OPENOFFICE	311	610	1318	1945	2135	1383	673	336	49	0	0	0	45.3 (%)
FLOOR2-SOUTH-CLOSEDOFFICE	143	435	792	1503	2838	1627	803	450	161	8	0	0	47.7 (%)
FLOOR2-SOUTHEAST-CORNEROFFICE	102	299	708	1295	2849	1588	738	578	350	206	47	0	49.5 (%)
FLOOR2-SOUTHEAST-STORAGEROOMS	0	0	47	295	1228	2076	2097	1337	982	524	170	4	57.5 (%)
FLOOR2-TOILETS	302	720	1546	2266	1638	1022	622	398	201	45	0	0	45.1 (%)
GROUND-BREAKROOM	200	425	801	1357	2318	1705	939	530	315	138	32	0	48.8 (%)
GROUND-LOUNGE	86	251	541	1167	2500	1699	942	668	409	335	119	43	51.3 (%)
GROUND-NORTH-MEETINGROOMS	421	537	1009	1259	1630	1652	1164	638	326	102	22	0	48.2 (%)
GROUND-SOUTH-MEETINGROOM	597	807	1171	1338	1729	1559	943	413	170	29	4	0	45.7 (%)
GROUND-SOUTH-OFFICE	147	438	778	1553	2689	1741	822	432	158	2	0	0	47.7 (%)
GROUND-SOUTHEAST-CORNEROFFICE	107	328	669	1285	2719	1696	830	571	351	174	30	0	49.6 (%)
GROUND-TOILETS	344	758	1585	2086	1754	974	659	383	180	37	0	0	44.9 (%)
GROUNDFLOOR-LOBBY/CORRIDOR	271	537	1048	1604	1853	1613	1035	629	147	22	1	0	47.4 (%)

Zone Overview

Zone Summary

	Area (m^2)	Conditioned (Y/N)	Part of Total Floor Area (Y/N)	Volume (m^3)	Multiplier	Above Ground Gross Wall Area (m^2)	Underground Gross Wall Area (m^2)	Window Glass Area (m^2)	Lighting (W/m^2)	People (m^2/person)	Plug and Process (W/m^2)
FLOOR1-BREAKROOM	12.2	Yes	Yes	48.79	1.00	28.08	0.0	4.78	9.0	10.0	10.0
FLOOR1-CENTRAL-MEETINGROOM	13.52	Yes	Yes	54.06	1.00	0.0	0.0	0.0	9.0	2.0	5.0
FLOOR1-CORRIDOR	13.29	Yes	Yes	53.14	1.00	6.64	0.0	0.0	5.0	33.33	0.0
FLOOR1-LOBBY	57.03	Yes	Yes	228.13	1.00	54.48	0.0	6.73	10.0	5.0	5.0
FLOOR1-NORHTWEST-STORAGEROOMS	17.12	Yes	Yes	68.5	1.00	36.0	0.0	3.06	5.0	100.0	5.0
FLOOR1-NORTH-CLOSEDOFFICE	21.36	Yes	Yes	85.46	1.00	15.44	0.0	6.73	9.0	20.0	10.0
FLOOR1-NORTH-MEETINGROOM1	15.74	Yes	Yes	62.95	1.00	13.28	0.0	4.78	9.0	2.0	5.0
FLOOR1-NORTH-MEETINGROOM2	18.5	Yes	Yes	74.01	1.00	17.76	0.0	3.96	9.0	2.0	5.0
FLOOR1-OPENOFFICE	115.68	Yes	Yes	462.72	1.00	46.4	0.0	13.45	9.0	10.0	10.0
FLOOR1-SOUTH-CLOSEDOFFICE	15.81	Yes	Yes	63.24	1.00	20.4	0.0	4.78	9.0	20.0	10.0
FLOOR1-SOUTHEAST-CORNEROFFICE	28.5	Yes	Yes	113.99	1.00	45.12	0.0	14.33	9.0	20.0	10.0
FLOOR1-SOUTHEAST-	17.01	Yes	Yes	68.04	1.00	9.12	0.0	0.0	5.0	100.0	5.0

STORAGEROOMS											
FLOOR1-TOILETS	9.01	Yes	Yes	36.02	1.00	18.96	0.0	2.16	5.0	50.0	0.0
FLOOR2-BREAKROOM	12.2	Yes	Yes	48.79	1.00	28.08	0.0	4.78	9.0	10.0	10.0
FLOOR2-CENTRAL-MEETINGROOM	13.52	Yes	Yes	54.06	1.00	0.0	0.0	0.0	9.0	2.0	5.0
FLOOR2-CORRIDOR	13.29	Yes	Yes	53.14	1.00	6.64	0.0	0.0	5.0	33.33	0.0
FLOOR2-LOBBY	57.03	Yes	Yes	228.13	1.00	54.48	0.0	6.73	10.0	5.0	5.0
FLOOR2-NORHTWEST-STORAGEROOMS	17.12	Yes	Yes	68.5	1.00	36.0	0.0	3.06	5.0	100.0	5.0
FLOOR2-NORTH-CLOSEDOFFICE	21.36	Yes	Yes	85.46	1.00	15.44	0.0	6.73	9.0	20.0	10.0
FLOOR2-NORTH-MEETINGROOM1	15.74	Yes	Yes	62.95	1.00	13.28	0.0	4.78	9.0	2.0	5.0
FLOOR2-NORTH-MEETINGROOM2	18.5	Yes	Yes	74.01	1.00	17.76	0.0	3.96	9.0	2.0	5.0
FLOOR2-OPENOFFICE	115.68	Yes	Yes	462.72	1.00	46.4	0.0	13.45	9.0	10.0	10.0
FLOOR2-SOUTH-CLOSEDOFFICE	15.81	Yes	Yes	63.24	1.00	20.4	0.0	4.78	9.0	20.0	10.0
FLOOR2-SOUTHEAST-CORNEROFFICE	28.5	Yes	Yes	113.99	1.00	45.12	0.0	14.33	9.0	20.0	10.0
FLOOR2-SOUTHEAST-STORAGEROOMS	17.01	Yes	Yes	68.04	1.00	9.12	0.0	0.0	5.0	100.0	5.0
FLOOR2-TOILETS	9.01	Yes	Yes	36.02	1.00	18.96	0.0	2.16	5.0	50.0	0.0
GROUND-BREAKROOM	12.2	Yes	Yes	48.79	1.00	28.08	0.0	4.78	9.0	10.0	10.0
GROUND-LOUNGE	9.01	Yes	Yes	36.02	1.00	26.56	0.0	3.96	9.0	20.0	10.0
GROUND-NORTH-MEETINGROOMS	21.4	Yes	Yes	85.59	1.00	33.04	0.0	8.71	9.0	2.0	5.0
GROUND-SOUTH-MEETINGROOM	18.1	Yes	Yes	72.42	1.00	20.4	0.0	4.78	9.0	2.0	5.0
GROUND-SOUTH-OFFICE	56.18	Yes	Yes	224.72	1.00	46.4	0.0	13.45	9.0	20.0	10.0
GROUND-SOUTHEAST-CORNEROFFICE	37.25	Yes	Yes	149.01	1.00	54.24	0.0	14.33	9.0	20.0	10.0
GROUND-TOILETS	9.01	Yes	Yes	36.02	1.00	18.96	0.0	2.16	5.0	50.0	0.0
GROUNDFLOOR-LOBBY/CORRIDOR	175.79	Yes	Yes	703.16	1.00	100.32	0.0	6.73	9.63	5.33	4.63
Total	1048.46			4193.84		951.36	0.0	188.34	8.75	6.4	7.08
Conditioned Total	1048.46			4193.84		951.36	0.0	188.34	8.75	6.4	7.08
Unconditioned Total	0.0			0.0		0.0	0.0	0.0	0.0	0.0	0.0
Not Part of Total	0.0			0.0		0.0	0.0	0.0	0.0	0.0	0.0

Zone Sensible Cooling and Heating Sensible Sizing

	Heating/Cooling	Calculated Design Load	Design Load With Sizing Factor	Calculated Design Air Flow (m^3/h)	Design Air Flow With Sizing Factor (m^3/h)	Date/Time Of Peak	Outdoor Temperature at Peak Load (C)	Outdoor Humidity Ratio at Peak Load (kgWater/kgAir)
FLOOR1-BREAKROOM	Cooling	1540.66 (W)	1771.76 (W)	453.6	522.0	7/21 17:00:00	25.84	0.01

FLOOR1-BREAKROOM	Heating	1285.0 (W)	1606.26 (W)	194.4	244.8	2/21 08:00:00	-4.6	0.0
FLOOR1-CENTRAL-MEETINGROOM	Cooling	1560.65 (W)	1794.75 (W)	576.0	662.4	7/21 14:50:00	27.2	0.01
FLOOR1-CENTRAL-MEETINGROOM	Heating	2938.15 (W)	3672.69 (W)	432.0	540.0	2/21 11:00:00	-4.6	0.0
FLOOR1-CORRIDOR	Cooling	302.02 (W)	347.33 (W)	75.6	86.4	7/21 16:00:00	26.62	0.01
FLOOR1-CORRIDOR	Heating	306.2 (W)	382.75 (W)	39.6	50.4	2/21 08:00:00	-4.6	0.0
FLOOR1-LOBBY	Cooling	1826.02 (W)	2099.92 (W)	450.0	514.8	7/21 15:00:00	27.2	0.01
FLOOR1-LOBBY	Heating	3495.6 (W)	4369.51 (W)	468.0	586.8	2/21 11:00:00	-4.6	0.0
FLOOR1-NORHTWEST-STORAGEROOMS	Cooling	522.01 (W)	600.31 (W)	129.6	147.6	7/21 17:00:00	25.84	0.01
FLOOR1-NORHTWEST-STORAGEROOMS	Heating	732.9 (W)	916.12 (W)	97.2	122.4	2/21 08:00:00	-4.6	0.0
FLOOR1-NORTH-CLOSEDOFFICE	Cooling	1320.33 (W)	1518.38 (W)	486.0	561.6	7/21 14:20:00	27.2	0.01
FLOOR1-NORTH-CLOSEDOFFICE	Heating	1307.25 (W)	1634.07 (W)	187.2	234.0	2/21 08:00:00	-4.6	0.0
FLOOR1-NORTH-MEETINGROOM1	Cooling	2004.72 (W)	2305.43 (W)	741.6	849.6	7/21 14:50:00	27.2	0.01
FLOOR1-NORTH-MEETINGROOM1	Heating	3772.66 (W)	4715.83 (W)	558.0	694.8	2/21 11:00:00	-4.6	0.0
FLOOR1-NORTH-MEETINGROOM2	Cooling	2278.11 (W)	2619.83 (W)	842.4	968.4	7/21 14:50:00	27.2	0.01
FLOOR1-NORTH-MEETINGROOM2	Heating	4402.21 (W)	5502.77 (W)	648.0	810.0	2/21 11:00:00	-4.6	0.0
FLOOR1-OPENOFFICE	Cooling	6226.65 (W)	7160.65 (W)	1836.0	2113.2	7/21 14:10:00	27.2	0.01
FLOOR1-OPENOFFICE	Heating	7027.88 (W)	8784.85 (W)	1090.8	1364.4	2/21 11:00:00	-4.6	0.0
FLOOR1-SOUTH-CLOSEDOFFICE	Cooling	1548.55 (W)	1780.84 (W)	572.4	655.2	7/21 14:00:00	27.2	0.01
FLOOR1-SOUTH-CLOSEDOFFICE	Heating	977.37 (W)	1221.72 (W)	140.4	176.4	2/21 08:00:00	-4.6	0.0
FLOOR1-SOUTHEAST-CORNEROFFICE	Cooling	3615.63 (W)	4157.98 (W)	1332.0	1533.6	7/21 10:20:00	24.0	0.01
FLOOR1-SOUTHEAST-CORNEROFFICE	Heating	2106.57 (W)	2633.21 (W)	302.4	378.0	2/21 08:00:00	-4.6	0.0
FLOOR1-SOUTHEAST-STORAGEROOMS	Cooling	226.14 (W)	260.06 (W)	54.0	64.8	7/21 15:10:00	27.1	0.01
FLOOR1-SOUTHEAST-STORAGEROOMS	Heating	232.63 (W)	290.78 (W)	32.4	39.6	2/21 08:00:00	-4.6	0.0
FLOOR1-TOILETS	Cooling	0.0 (W)	0.0 (W)	0.0	3.6	7/21 17:40:00	25.2	0.01
FLOOR1-TOILETS	Heating	417.64 (W)	522.06 (W)	54.0	68.4	2/21 08:00:00	-4.6	0.0
FLOOR2-BREAKROOM	Cooling	1560.25 (W)	1794.29 (W)	460.8	529.2	7/21 17:00:00	25.84	0.01
FLOOR2-BREAKROOM	Heating	1308.36 (W)	1635.45 (W)	198.0	248.4	2/21 08:00:00	-4.6	0.0

FLOOR2-CENTRAL-MEETINGROOM	Cooling	1504.54 (W)	1730.22 (W)	554.4	637.2	7/21 14:50:00	27.2	0.01
FLOOR2-CENTRAL-MEETINGROOM	Heating	2946.88 (W)	3683.6 (W)	435.6	543.6	2/21 11:00:00	-4.6	0.0
FLOOR2-CORRIDOR	Cooling	296.73 (W)	341.24 (W)	72.0	82.8	7/21 16:00:00	26.62	0.01
FLOOR2-CORRIDOR	Heating	360.61 (W)	450.76 (W)	46.8	61.2	2/21 08:00:00	-4.6	0.0
FLOOR2-LOBBY	Cooling	1856.84 (W)	2135.36 (W)	457.2	525.6	7/21 15:00:00	27.2	0.01
FLOOR2-LOBBY	Heating	3640.73 (W)	4550.91 (W)	489.6	612.0	2/21 11:00:00	-4.6	0.0
FLOOR2-NORHTWEST-STORAGEROOMS	Cooling	540.79 (W)	621.91 (W)	133.2	151.2	7/21 17:00:00	25.84	0.01
FLOOR2-NORHTWEST-STORAGEROOMS	Heating	815.0 (W)	1018.75 (W)	108.0	136.8	2/21 08:00:00	-4.6	0.0
FLOOR2-NORTH-CLOSEDOFFICE	Cooling	1296.24 (W)	1490.68 (W)	478.8	550.8	7/21 14:20:00	27.2	0.01
FLOOR2-NORTH-CLOSEDOFFICE	Heating	1355.29 (W)	1694.11 (W)	194.4	244.8	2/21 08:00:00	-4.6	0.0
FLOOR2-NORTH-MEETINGROOM1	Cooling	1990.77 (W)	2289.39 (W)	734.4	846.0	7/21 14:50:00	27.2	0.01
FLOOR2-NORTH-MEETINGROOM1	Heating	3829.33 (W)	4786.66 (W)	565.2	705.6	2/21 11:00:00	-4.6	0.0
FLOOR2-NORTH-MEETINGROOM2	Cooling	2266.94 (W)	2606.98 (W)	835.2	961.2	7/21 14:50:00	27.2	0.01
FLOOR2-NORTH-MEETINGROOM2	Heating	4472.21 (W)	5590.26 (W)	658.8	824.4	2/21 11:00:00	-4.6	0.0
FLOOR2-OPENOFFICE	Cooling	6297.5 (W)	7242.12 (W)	1857.6	2138.4	7/21 14:10:00	27.2	0.01
FLOOR2-OPENOFFICE	Heating	7090.74 (W)	8863.42 (W)	1101.6	1378.8	2/21 11:00:00	-4.6	0.0
FLOOR2-SOUTH-CLOSEDOFFICE	Cooling	1539.22 (W)	1770.11 (W)	568.8	651.6	7/21 14:00:00	27.2	0.01
FLOOR2-SOUTH-CLOSEDOFFICE	Heating	1025.79 (W)	1282.23 (W)	147.6	183.6	2/21 08:00:00	-4.6	0.0
FLOOR2-SOUTHEAST-CORNEROFFICE	Cooling	3596.34 (W)	4135.79 (W)	1328.4	1526.4	7/21 10:20:00	24.0	0.01
FLOOR2-SOUTHEAST-CORNEROFFICE	Heating	2213.68 (W)	2767.1 (W)	320.4	399.6	2/21 08:00:00	-4.6	0.0
FLOOR2-SOUTHEAST-STORAGEROOMS	Cooling	189.6 (W)	218.05 (W)	46.8	54.0	7/21 14:50:00	27.2	0.01
FLOOR2-SOUTHEAST-STORAGEROOMS	Heating	285.01 (W)	356.26 (W)	39.6	46.8	2/21 08:00:00	-4.6	0.0
FLOOR2-TOILETS	Cooling	0.0 (W)	0.0 (W)	0.0	3.6	7/21 17:40:00	25.2	0.01
FLOOR2-TOILETS	Heating	448.22 (W)	560.27 (W)	61.2	75.6	2/21 08:00:00	-4.6	0.0
GROUND-BREAKROOM	Cooling	2040.64 (W)	2346.73 (W)	752.4	864.0	7/21 17:00:00	25.84	0.01
GROUND-BREAKROOM	Heating	1131.9 (W)	1414.88 (W)	165.6	205.2	2/21 08:00:00	-4.6	0.0
GROUND-LOUNGE	Cooling	1556.68 (W)	1790.18 (W)	576.0	658.8	7/21 17:00:00	25.84	0.01

GROUND-LOUNGE	Heating	877.05 (W)	1096.32 (W)	126.0	158.4	2/21 08:00:00	-4.6	0.0
GROUND-NORTH-MEETINGROOMS	Cooling	2843.69 (W)	3270.24 (W)	1051.2	1206.0	7/21 14:50:00	27.2	0.01
GROUND-NORTH-MEETINGROOMS	Heating	5344.38 (W)	6680.48 (W)	788.4	986.4	2/21 11:00:00	-4.6	0.0
GROUND-SOUTH-MEETINGROOM	Cooling	3049.45 (W)	3506.86 (W)	1126.8	1296.0	7/21 14:00:00	27.2	0.01
GROUND-SOUTH-MEETINGROOM	Heating	4348.52 (W)	5435.65 (W)	640.8	802.8	2/21 11:00:00	-4.6	0.0
GROUND-SOUTH-OFFICE	Cooling	4930.25 (W)	5669.79 (W)	1818.0	2091.6	7/21 13:40:00	27.04	0.01
GROUND-SOUTH-OFFICE	Heating	2710.3 (W)	3387.88 (W)	385.2	482.4	2/21 08:00:00	-4.6	0.0
GROUND-SOUTHEAST-CORNEROFFICE	Cooling	4433.18 (W)	5098.16 (W)	1634.4	1879.2	7/21 09:40:00	22.96	0.01
GROUND-SOUTHEAST-CORNEROFFICE	Heating	2539.68 (W)	3174.6 (W)	363.6	457.2	2/21 08:00:00	-4.6	0.0
GROUND-TOILETS	Cooling	0.0 (W)	0.0 (W)	0.0	3.6	7/21 17:30:00	25.36	0.01
GROUND-TOILETS	Heating	422.76 (W)	528.45 (W)	57.6	72.0	2/21 08:00:00	-4.6	0.0
GROUNDFLOOR-LOBBY/CORRIDOR	Cooling	4585.12 (W)	5272.89 (W)	1126.8	1296.0	7/21 15:00:00	27.2	0.01
GROUNDFLOOR-LOBBY/CORRIDOR	Heating	9032.74 (W)	11290.92 (W)	1213.2	1515.6	2/21 11:00:00	-4.6	0.0

Zone Equipment Detail

No Data to Show for Zone Equipment Detail

Air Loops Detail

No Data to Show for Air Loops Detail

Plant Loops Detail

No Data to Show for Plant Loops Detail

Outdoor Air

Average and Minimum Outdoor Air During Occupied Hours

	Average Number of Occupants	Nominal Number of Occupants	Zone Volume (m^3)	Avg. Mechanical Ventilation (ach)	Min. Mechanical Ventilation (ach)	Avg. Infiltration (ach)	Min. Infiltration (ach)	Avg. Simple Ventilation (ach)	Min. Simple Ventilation (ach)
FLOOR1-BREAKROOM	0.61	1.22	49	0.0	0.0	0.155	0.001	0.681	0.001
FLOOR1-CENTRAL-MEETINGROOM	3.37	6.76	54	0.0	0.0	0.154	0.001	3.387	0.005
FLOOR1-CORRIDOR	0.2	0.4	53	0.0	0.0	0.154	0.001	0.068	0.0
FLOOR1-LOBBY	5.69	11.41	228	0.0	0.0	0.232	0.002	0.905	0.001
FLOOR1-NORHTWEST-STORAGEROOMS	0.03	0.17	69	0.0	0.0	0.077	0.001	0.023	0.0
FLOOR1-NORTH-CLOSEDOFFICE	0.53	1.07	85	0.0	0.0	0.154	0.001	0.339	0.001

FLOOR1-NORTH-MEETINGROOM1	3.93	7.87	63	0.0	0.0	0.154	0.001	3.386	0.005
FLOOR1-NORTH-MEETINGROOM2	4.62	9.25	74	0.0	0.0	0.154	0.001	3.386	0.005
FLOOR1-OPENOFFICE	5.78	11.57	463	0.0	0.0	0.155	0.001	0.682	0.001
FLOOR1-SOUTH-CLOSEDOFFICE	0.39	0.79	63	0.0	0.0	0.155	0.001	0.339	0.001
FLOOR1-SOUTHEAST-CORNEROFFICE	0.71	1.42	114	0.0	0.0	0.154	0.001	0.339	0.001
FLOOR1-SOUTHEAST-STORAGEROOMS	0.04	0.17	68	0.0	0.0	0.078	0.001	0.023	0.0
FLOOR1-TOILETS	0.04	0.18	36	0.0	0.0	0.078	0.001	0.045	0.0
FLOOR2-BREAKROOM	0.61	1.22	49	0.0	0.0	0.155	0.001	0.681	0.001
FLOOR2-CENTRAL-MEETINGROOM	3.37	6.76	54	0.0	0.0	0.154	0.001	3.387	0.005
FLOOR2-CORRIDOR	0.2	0.4	53	0.0	0.0	0.154	0.001	0.068	0.0
FLOOR2-LOBBY	5.69	11.41	228	0.0	0.0	0.232	0.002	0.905	0.001
FLOOR2-NORHTWEST-STORAGEROOMS	0.03	0.17	69	0.0	0.0	0.077	0.001	0.023	0.0
FLOOR2-NORTH-CLOSEDOFFICE	0.53	1.07	85	0.0	0.0	0.154	0.001	0.339	0.001
FLOOR2-NORTH-MEETINGROOM1	3.93	7.87	63	0.0	0.0	0.154	0.001	3.386	0.005
FLOOR2-NORTH-MEETINGROOM2	4.62	9.25	74	0.0	0.0	0.154	0.001	3.386	0.005
FLOOR2-OPENOFFICE	5.78	11.57	463	0.0	0.0	0.155	0.001	0.682	0.001
FLOOR2-SOUTH-CLOSEDOFFICE	0.39	0.79	63	0.0	0.0	0.155	0.001	0.339	0.001
FLOOR2-SOUTHEAST-CORNEROFFICE	0.71	1.42	114	0.0	0.0	0.154	0.001	0.339	0.001
FLOOR2-SOUTHEAST-STORAGEROOMS	0.04	0.17	68	0.0	0.0	0.078	0.001	0.023	0.0
FLOOR2-TOILETS	0.04	0.18	36	0.0	0.0	0.078	0.001	0.045	0.0
GROUND-BREAKROOM	0.61	1.22	49	0.0	0.0	0.154	0.001	0.678	0.001
GROUND-LOUNGE	0.22	0.45	36	0.0	0.0	0.154	0.001	0.339	0.001
GROUND-NORTH-MEETINGROOMS	5.34	10.7	86	0.0	0.0	0.154	0.001	3.386	0.005
GROUND-SOUTH-MEETINGROOM	4.52	9.05	72	0.0	0.0	0.154	0.001	3.388	0.005
GROUND-SOUTH-OFFICE	1.4	2.81	225	0.0	0.0	0.155	0.001	0.339	0.001
GROUND-SOUTHEAST-CORNEROFFICE	0.93	1.86	149	0.0	0.0	0.154	0.001	0.339	0.001
GROUND-TOILETS	0.04	0.18	36	0.0	0.0	0.078	0.001	0.045	0.0
GROUNDFLOOR-LOBBY/CORRIDOR	5.49	32.97	703	0.0	0.0	0.226	0.001	0.845	0.001

Cash Flow

No Data to Show for Cash Flow

Site and Source Summary

Site and Source Energy

	Total Energy (kWh)	Energy Per Total Building Area (kWh/m^2)	Energy Per Conditioned Building Area (kWh/m^2)
Total Site Energy	137561.1	131.2	131.2
Net Site Energy	137561.1	131.2	131.2
Total Source Energy	367216.7	350.2	350.2
Net Source Energy	367216.7	350.2	350.2

Site to Source Energy Conversion Factors

	Site=>Source Conversion Factor
Electricity	3.167
Natural Gas	1.084
District Cooling	1.056
District Heating	0.0

Schedule Overview

Schedule Overview - view table

Cooling Setpoint (CloseOffice/MeetingRooms)

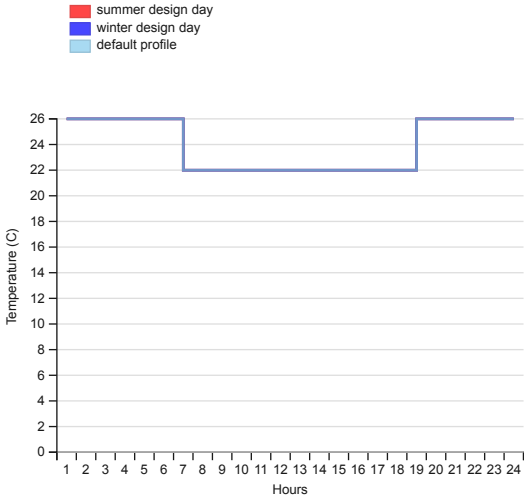

Cooling Setpoint (Lobby/Storage)

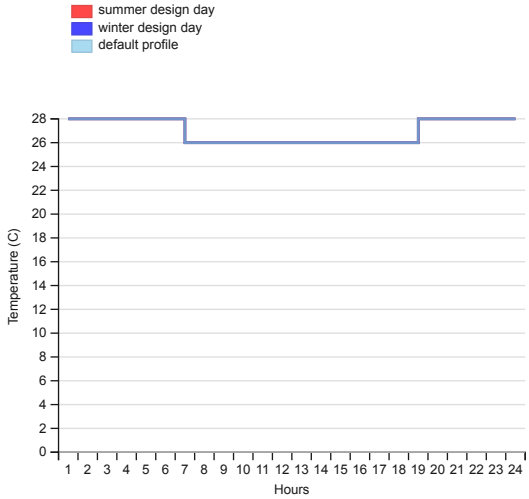

Cooling Setpoint (OpenOffice)

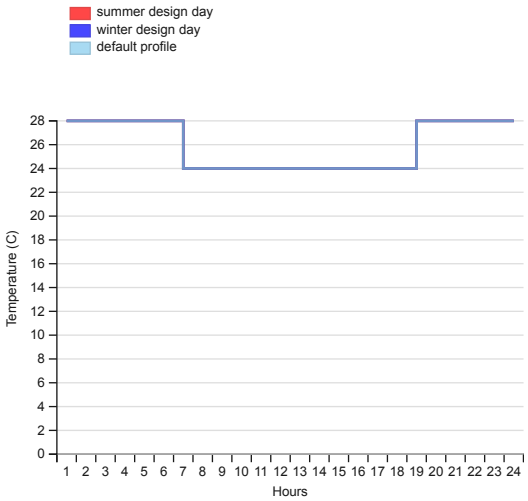

Cooling Setpoint (PlantRooms)

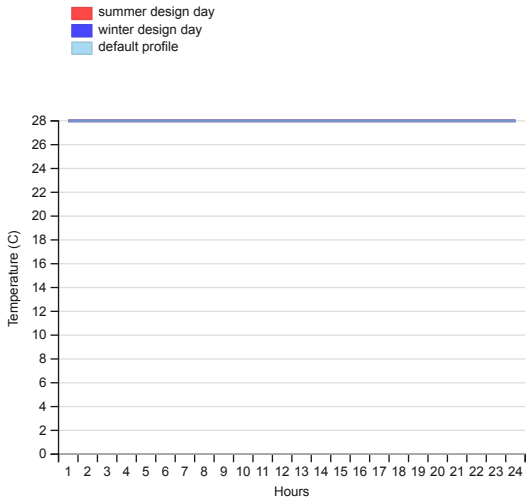

Heating Setpoint (CloseOffice/MeetingRooms)

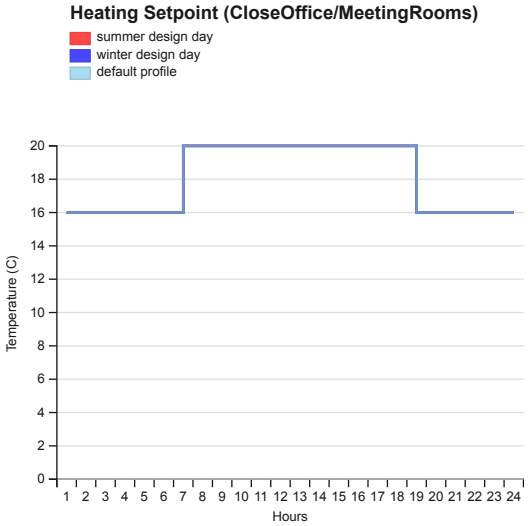

Heating Setpoint (OpenOffice)

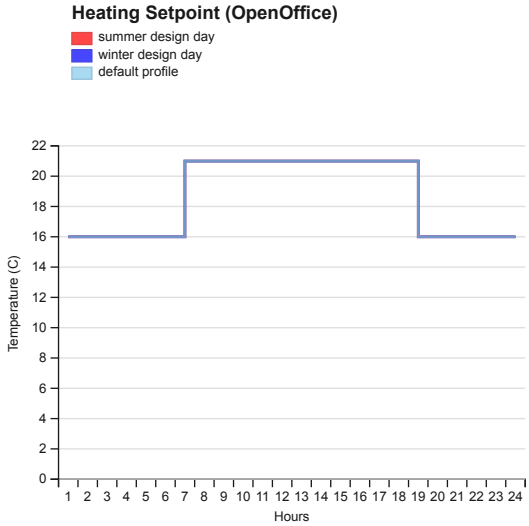

Heating Setpoint (PlantRooms)

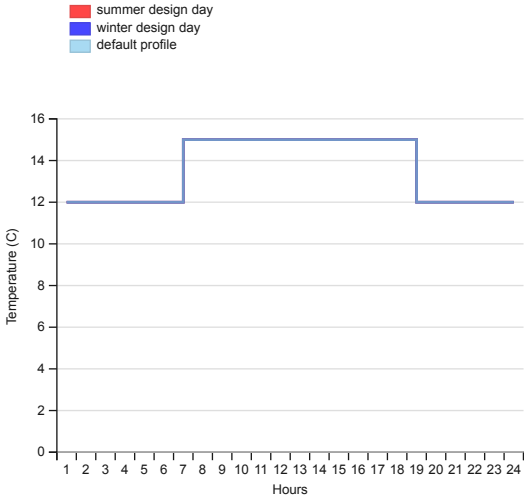

Heating Setpoint (Toilets/Storage/Lobby)

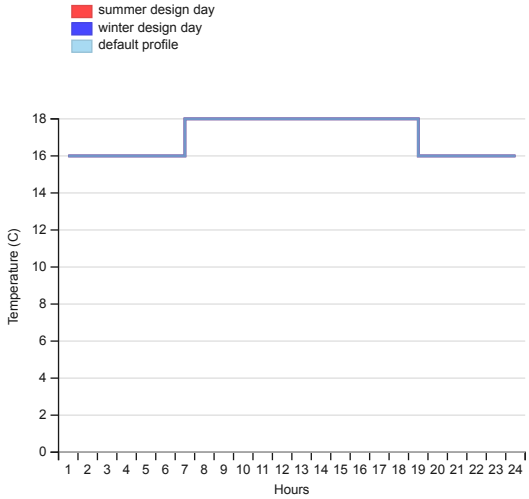

My Office Building Occupancy

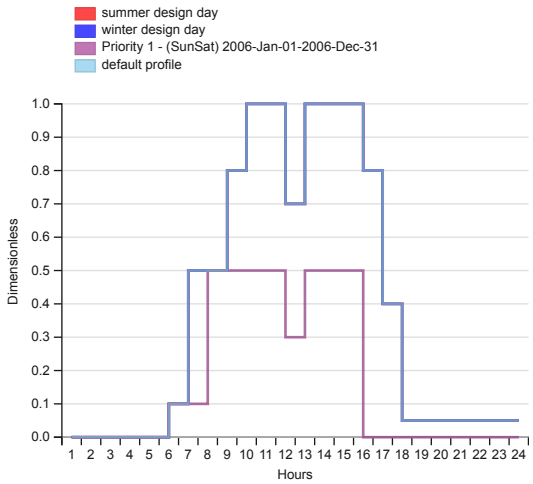

My Office Building Electrical

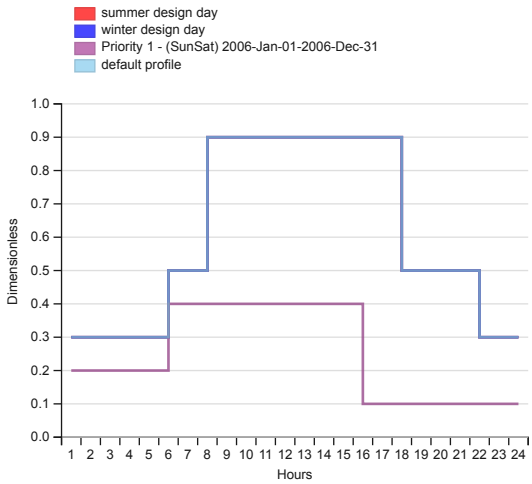

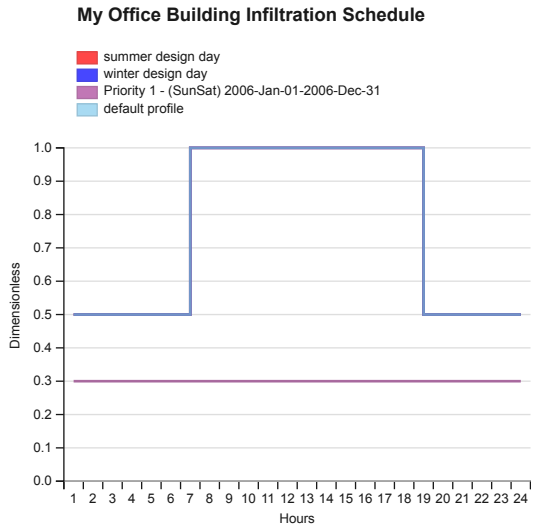

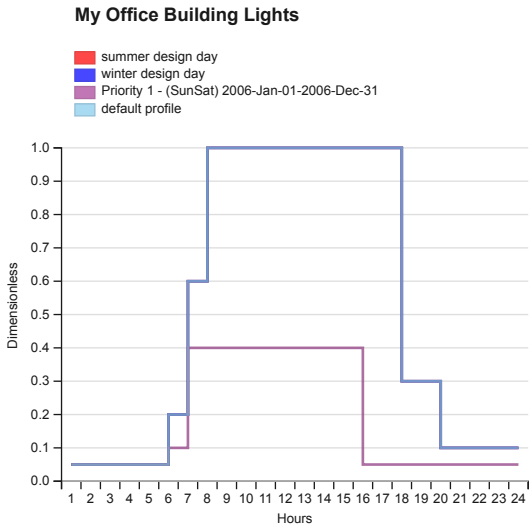

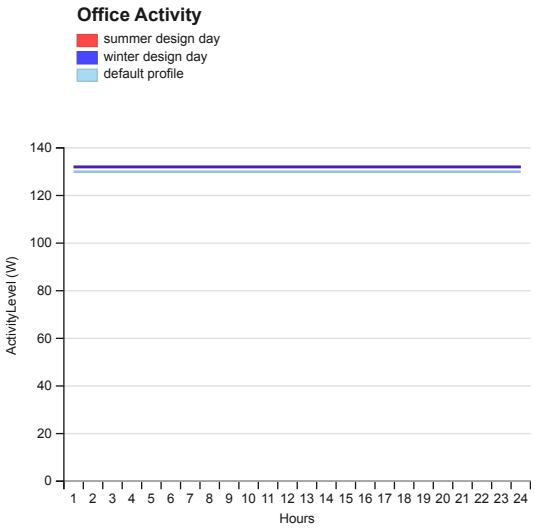

Measure Warnings

Measure Warning Summary

Description	Count
Number of measures in workflow	1
Number of measures with warnings	0
Total number of warnings	0