



① تم التصميم باستخدام الكودات التالية في التصميم الكود السعودي للحماية من الحرائق SBC 801

② المكتب لا يتحمل مسؤولية تعديلات في المخططات او التعديل في النشاط المستخدم للمنشاء



نوع السحرة

☐ مصري

☐ اثنائي

☐ كمين

☐ صي

☒ فاعل

☐ تفكيك مركب

☐ شبكات



بابل للاستشارات الهندسية

مرحلة العمل

☐ دراسة


☒ ابتدائي

☐ نهائي

FIRE ALARM SYSTEM		اسم اللوحة /
GROUND FLOOR		

التقرير الفني للمشروع (قاسم / جديد)	
تصنيف خطورة الموقع	خفيفة / متوسطة / عالية
تصنيف المبني	A , B , E , F , S
من ناحية الاستخدام	H , I , M , R , U
عدد الأشخاص بالدور الأرضي	10
عدد الأشخاص بالدور المتكرر	
عدد الأشخاص بالدور الملحق	

المتطلبات		
المرجع	مطلب غير متطلب	مطلب
903.2.8		المرشحات الثقافية
905.3.1		خراطيم الحريق
906.1		الطفايات اليدوية
907.2.8		الكواشف الثقافية عن الحريق
907.2.8		السايرين الضوئية الصوتية
907.2.8		نقطة النداء اليدوية
1008.2		أشواء الطوارئ

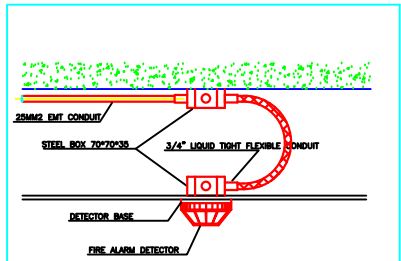

	SMOKE DETECTOR WITH BASE
	HEAT DETECTOR WITH BASE
	MULTI SENSOR (SMOKE AND HEAT) WITH BASE
	SOUNDER AND FLASHER OUTDOOR, LOOP POWERED
	SOUNDER INDOOR, LOOP POWERED
	MANUAL PULL STATION DOUBLE ACTION
	MANUAL PULL STATION DOUBLE ACTION, WEATHERPROOF TYPE
	MAIN FIRE ALARM CONTROL PANEL
	EXIT SIGN
	EMERGENCY LIGHT WITH BATTERY WORKING FOR 3 HOURS
	FIRE RATED DOOR WITH LATCH SELF CLOSING
	Exhaust fan

