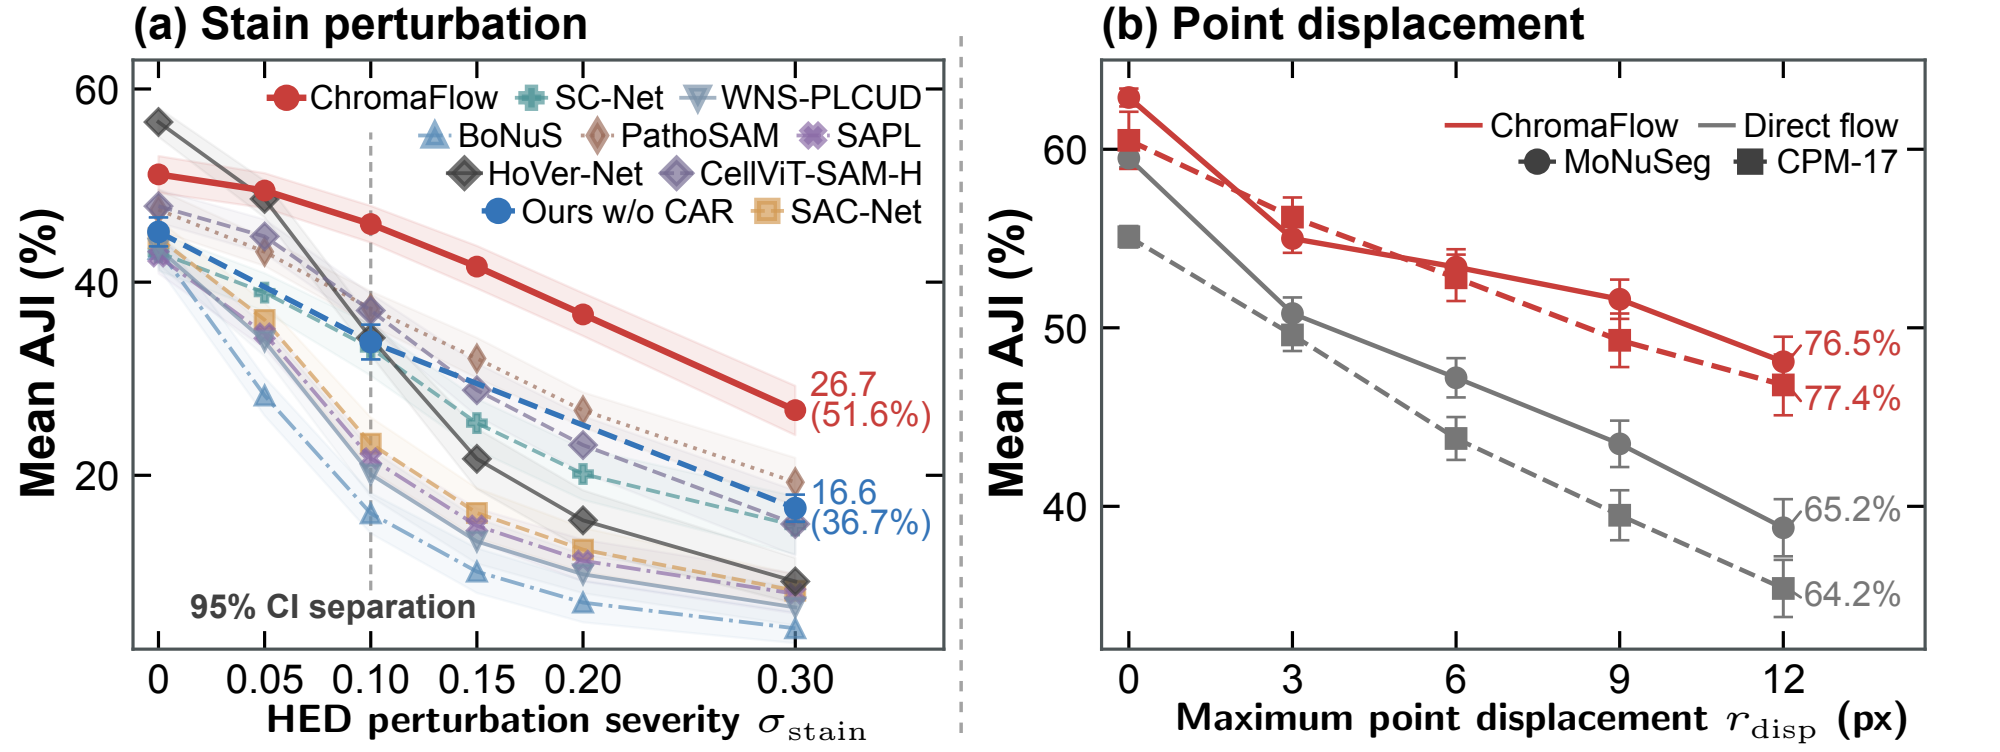

(a) Stain perturbation
ChromaFlow
SC-Net
WNS-PLCUD
BoNuS
PathoSAM
SAPL
HoVer-Net
CellViT-SAM-H
Ours w/o CAR
SAC-Net
Mean AJI (%)
60
40
20
26.7
(51.6%)
16.6
(36.7%)
95% CI separation
0
0.05
0.10
0.15
0.20
0.30
HED perturbation severity σ_{stain}
(b) Point displacement
ChromaFlow
Direct flow
MoNuSeg
CPM-17
Mean AJI (%)
60
50
40
76.5%
77.4%
65.2%
64.2%
0
3
6
9
12
Maximum point displacement r_{disp} (px)