

TEST REPORT N°: CXBL-ESH-P25091384-1

SUMMARY TEST REPORT

TO:	Envision Energy Co., Ltd.	FAX:	--
ATTN:	--	E-MAIL:	--
FROM:	BUREAU VERITAS LCIE CHINA COMPANY LIMITED	E-MAIL:	--
THIS DOCUMENT INCLUDES: 10 PAGES			
NUMBER OF SAMPLES	1		

APPLICANT NAME AND LOCATION:	Envision Energy Co., Ltd. No. 3, Shengzhuang Road, Shengang Street Jiangyin City, 214443 Jiangsu P.R. China	 Energy Power Conversion System
STANDARDS USED (DATE):	IEC 60529: 1989+A1: 1999+A2: 2013	
SECTIONS EXAMINED:	Section 13 and section 14	
TESTS REALISED:	IP65	
DATE OF TEST	2025-12-15 to 2025-12-17	
REMARK / NOTE:	Test was conducted on model: ENPCS-2520, all holes and assemble connectors were covered according to instruction manual	
CONCLUSION:	The samples satisfy the sections examined.	
Test done by,  Damon Qian, 2025-12-19		Approved by,  Robin Wu, 2025-12-19
This report is governed by, and incorporates by reference, the Conditions of Testing as posted at the date of issuance of this report at http://www.bureauveritas.com/home/about-us/our-business/cps/about-us/terms-conditions/ and is intended for your exclusive use. Any copying or replication of this report to or for any other person or entity, or use of our name or trademark, is permitted only with our prior written permission. This report sets forth our findings solely with respect to the test samples identified herein. The results set forth in this report are not indicative or representative of the quality or characteristics of the lot from which a test sample was taken or any similar or identical product unless specifically and expressly noted. Our report includes all of the tests requested by you and the results thereof based upon the information that you provided to us. Measurement uncertainty is only provided upon request for accredited tests. Statements of conformity are based on simple acceptance criteria without taking measurement uncertainty into account, unless otherwise requested in writing. You have 60 days from date of issuance of this report to notify us of any material error or omission caused by our negligence or if you require measurement uncertainty; provided, however, that such notice shall be in writing and shall specifically address the issue you wish to raise. A failure to raise such issue within the prescribed time shall constitute your unqualified acceptance of the completeness of this report, the tests conducted and the correctness of the report contents.		

BUREAU VERITAS LCIE CHINA COMPANY
LIMITED

Building 4, No. 518, Xin Zhuan Road,
CaoHejing Songjiang High-Tech
Park, Shanghai P.R.C (201612)

Tel: +86 21 6195 7000
Fax: +86 21 6195 7001
Email: BVLCIEMKT@bureauveritas.com

The Accreditation only attests the technical capability of the testing laboratory for the tests covered by the accreditation

TEST REPORT N°: CXBL-ESH-P25091384-1

Before IPX5 test




TEST REPORT N°: CXBL-ESH-P25091384-1

During IPX5 Test



TEST REPORT N°: CXBL-ESH-P25091384-1

After IPX5

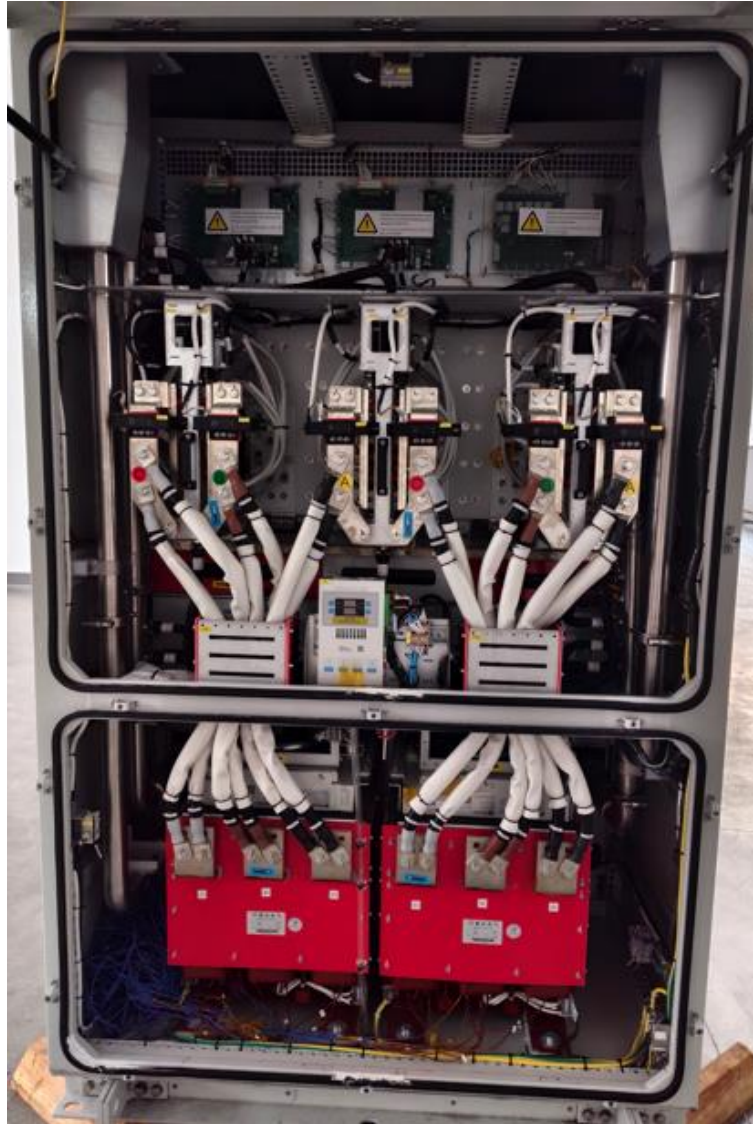

TEST REPORT N°: CXBL-ESH-P25091384-1

Before IP6X Test



TEST REPORT N°: CXBL-ESH-P25091384-1

After IP6X Test





TEST REPORT N°: CXBL-ESH-P25091384-1

TECHNICAL DATA:		Remarks
Type of test sample	ENPCS-2520	—
Class:	Class ☒ I ☐ II ☐ III	—
IP:	IP65	—

TABLE OF RESULTS

SECTIONS	TITLE	REMARK	NOTE	PASS	FAIL	N.A	N.D
13	Tests for protection against solid foreign objects indicated by the first characteristic numeral	IP6X		X			
13.1	Test means			X			
13.2	Test conditions for first characteristic numerals 1,2,3,4					X	
13.3	Acceptance conditions for first characteristic numerals 1,2,3,4					X	
13.4	Dust test for first characteristic numerals 5 and 6			X			
13.5	Special conditions for first characteristic numeral 5					X	
13.5.1	Test conditions for first characteristic numeral 5					X	
13.5.2	Acceptance conditions for first characteristic numeral 5					X	
13.6	Special conditions for first characteristic numeral 6			X			
13.6.1	Test conditions for first characteristic numeral 6			X			
13.6.2	Acceptance conditions for first characteristic numeral 6			X			
14	Test for protection against water indicated by the second characteristic numeral	IPX5		X			
14.1	Test means			X			
14.2	Test conditions			X			
14.2.1	Test for second characteristic numeral 1 with the drip box					X	
14.2.2	Test for second characteristic numeral 2 with the drip box					X	
14.2.3	Test for second characteristic numeral 3 with oscillation tube or spray nozzle					X	
14.2.4	Test for second characteristic numeral 4 with oscillation tube or spray nozzle					X	



TEST REPORT N°: CXBL-ESH-P25091384-1

14.2.5	Test for second characteristic numeral 5 with the 6.3 mm nozzle			X			
14.2.6	Test for second characteristic numeral 6 with the 12.5 mm nozzle					X	
14.2.7	Test for second characteristic numeral 7:temporary immersion between 0.15 m and 1 m					X	
14.2.8	Test for second characteristic numeral 8:continuous immersion subject to agreement					X	
14.2.9	Test for second characteristic numeral 9 by high pressure and temperature water jetting					X	
N.A: Not applicable – N.D: Not demanded							

Notes:

None



TEST REPORT N°: CXBL-ESH-P25091384-1

Test equipment list:

No.	Equipment	Internal No.	Type	Manufacturer	Last Calibration	Due Date
1	Power Analyzer	9957CA24A	DEWE3-M4	DEWETRON	11/Aug/25	10/Aug/26
2	Current probe	7005-1DA24A	AIT6000-D160	Hangzhi	27/Oct/25	26/Oct/26
3	Current probe	7005-2DA24A	AIT6000-D160	Hangzhi	27/Oct/25	26/Oct/26
4	Current probe	7005-3DA24A	AIT6000-D160	Hangzhi	27/Oct/25	26/Oct/26
5	Current probe	7005-4DA24A	AIT6000-D160	Hangzhi	27/Oct/25	26/Oct/26
6	Barometer	9684CB23B	testo 622	testo	12/Feb/25	07/Jan/26
7	Temperature & humidity meter	9694CB23B	DSR-THP	ZOGLAB	12/Feb/25	07/Jan/26
8	Second chronograph	7187CB25B	XL-009	/	28/Sep/25	27/Sep/26
9	AC power supply	/	4WM	Xi'an Actionpower Electric Co., Ltd.	/	/
10	DC power supply	/	4WM	Xi'an Actionpower Electric Co., Ltd.	/	/
11	thermometer	7189CB25B	/	/	10/Oct/25	09/Oct/26
12	roll ruler	7188CB25B	/	DELI	28/Sep/25	27/Sep/26
13	IPX5	9869DA24A	/	/	11/Mar/25	10/Mar/26
14	Dust Chamber	9540DA23A	/	SHANGHAIJINGTIAN	06/Jan/25	25/Jan/26



TEST REPORT N°: CXBL-ESH-P25091384-1

End of Test Report