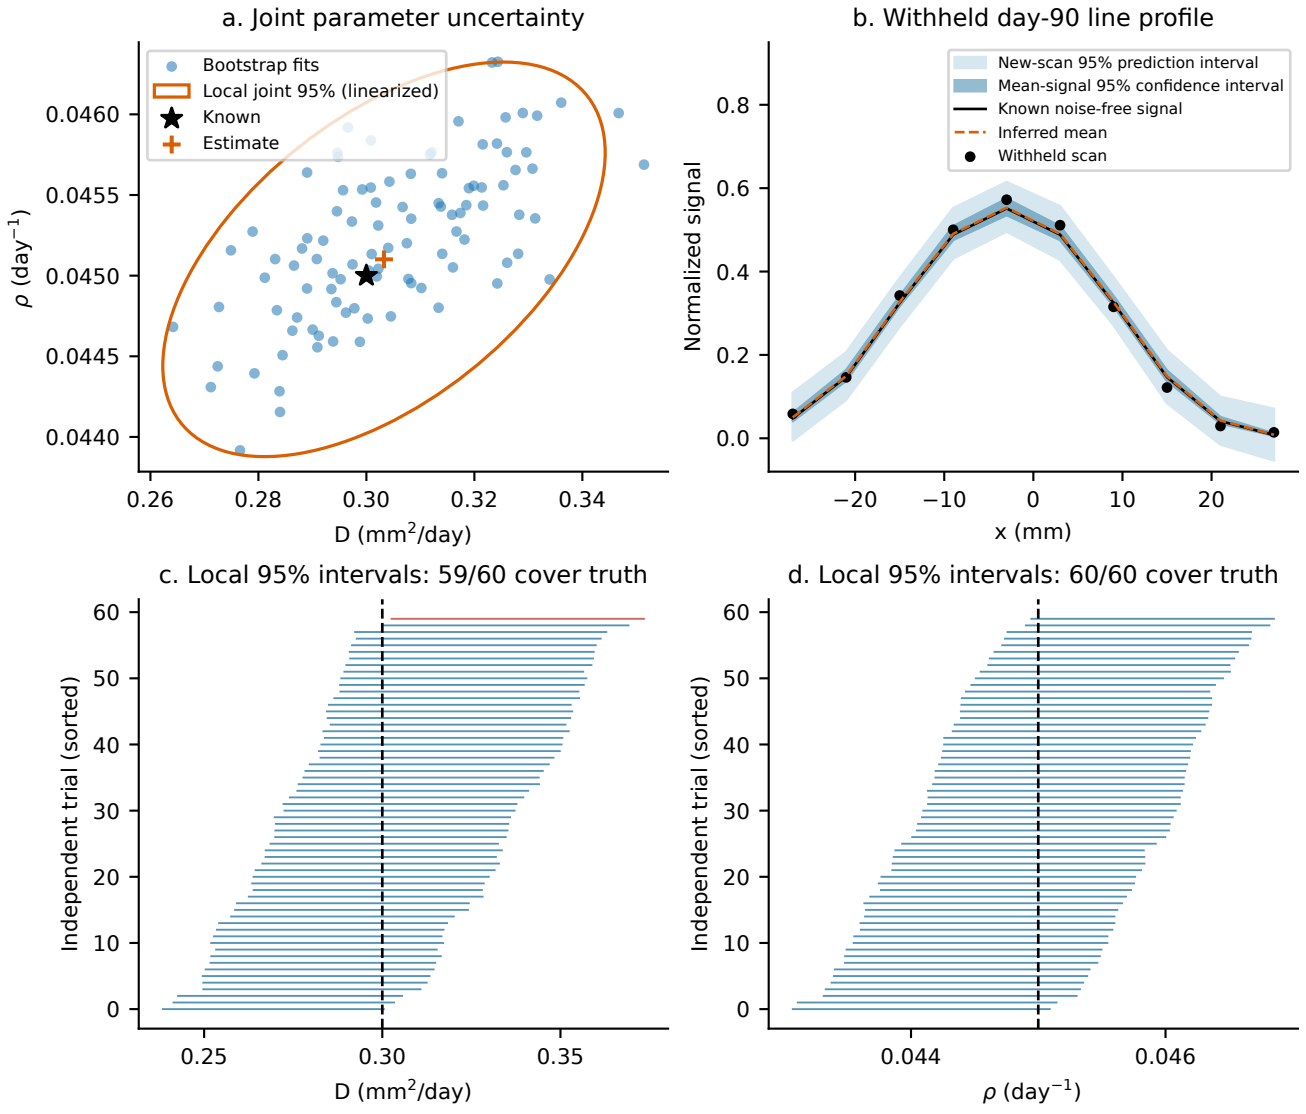
a. Joint parameter uncertainty
Bootstrap fits
Local joint 95% (linearized)
Known
Estimate
ρ (day⁻¹)
D (mm²/day)
b. Withheld day-90 line profile
New-scan 95% prediction interval
Mean-signal 95% confidence interval
Known noise-free signal
Inferred mean
Withheld scan
Normalized signal
x (mm)
c. Local 95% intervals: 59/60 cover truth
Independent trial (sorted)
D (mm²/day)
d. Local 95% intervals: 60/60 cover truth
Independent trial (sorted)
ρ (day⁻¹)