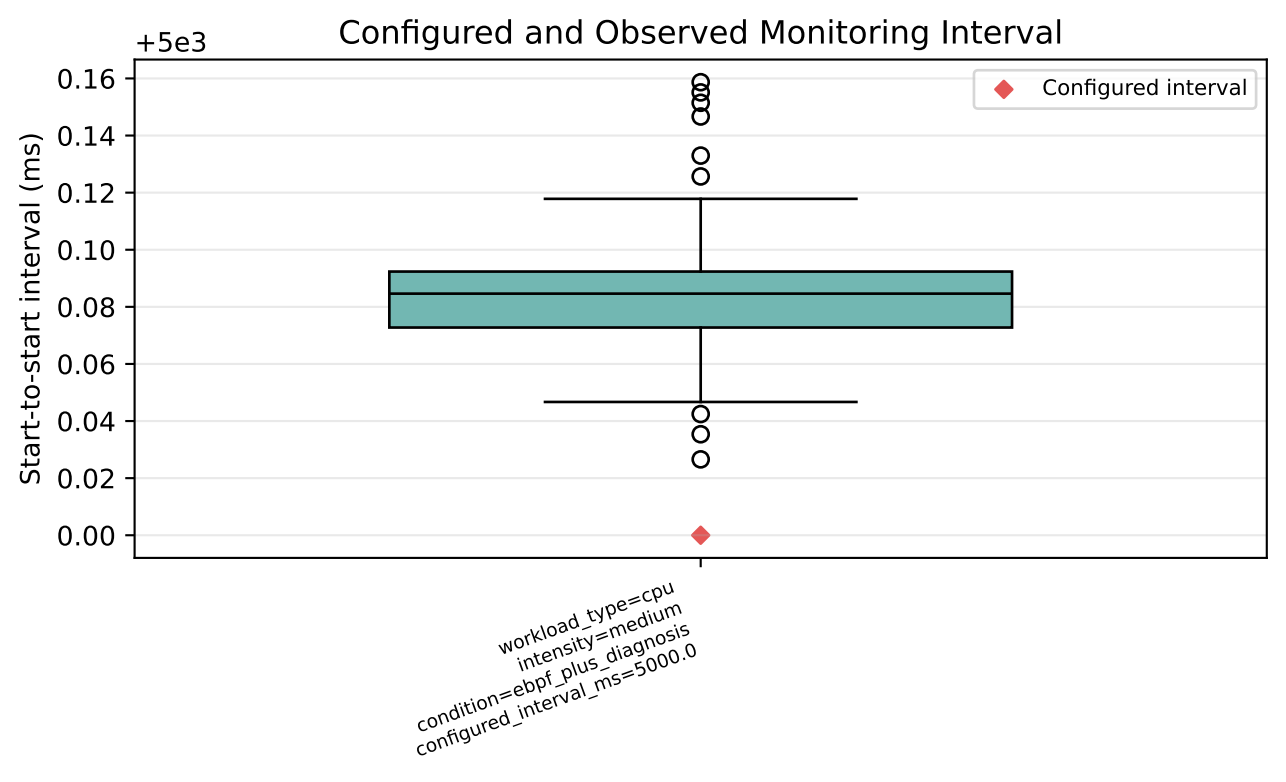
Configured and Observed Monitoring Interval
+5e3
Start-to-start interval (ms)
0.16
0.14
0.12
0.10
0.08
0.06
0.04
0.02
0.00
Configured interval
workload_type=cpu
intensity=medium
condition=ebpf_plus_diagnosis
configured_interval_ms=5000.0