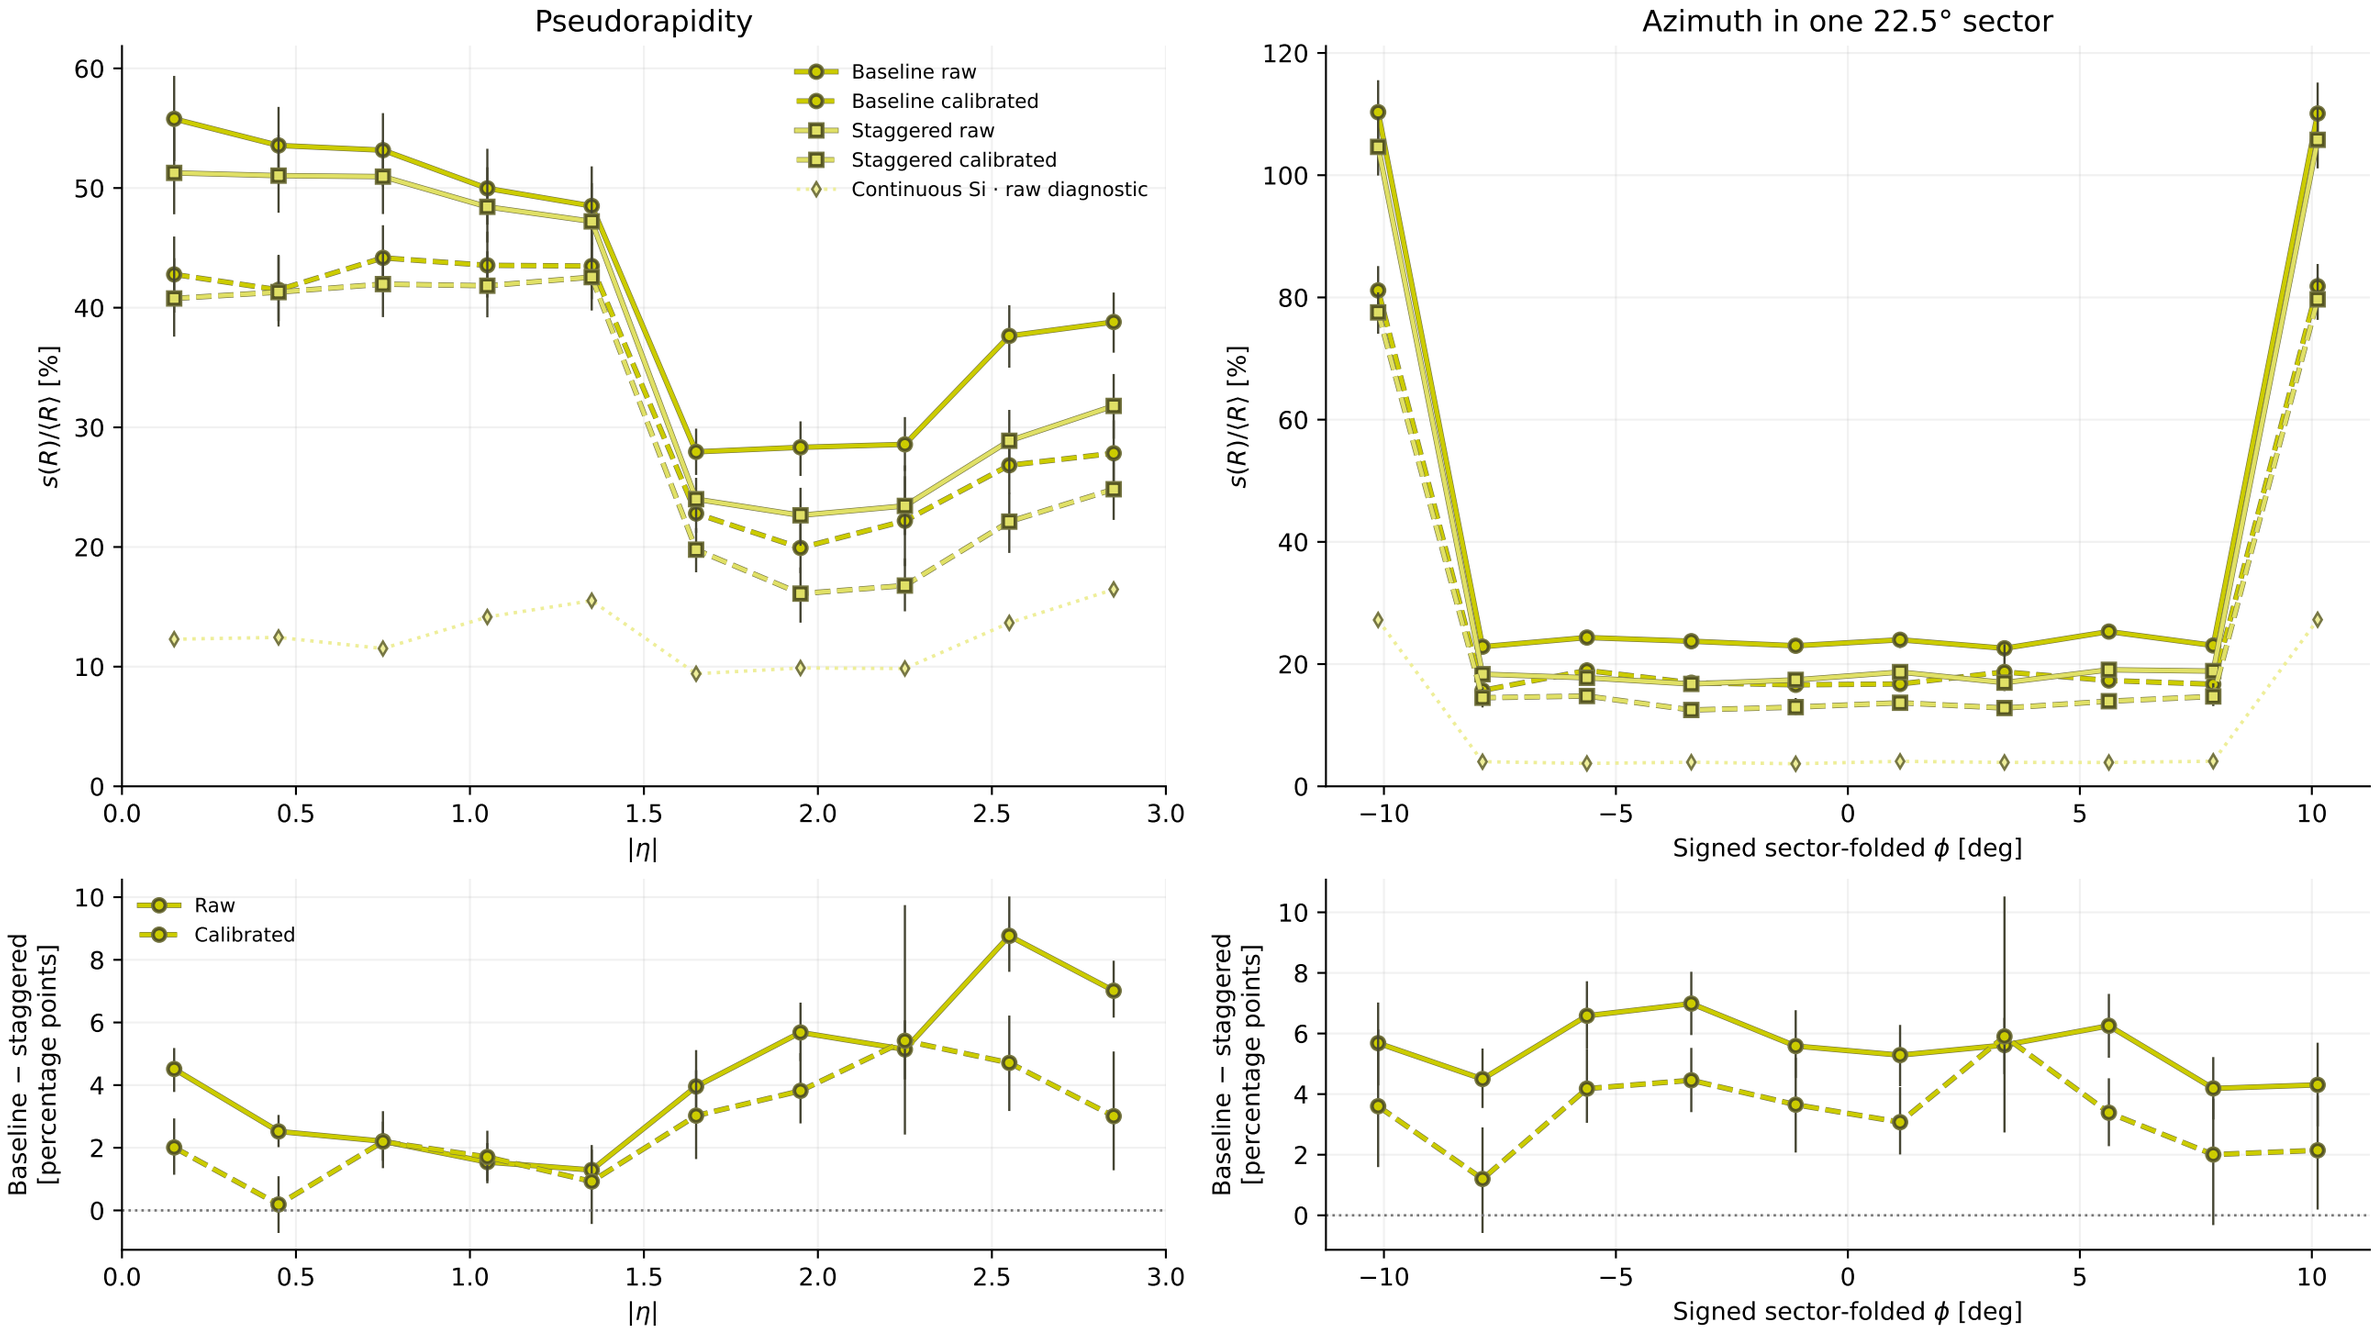
nODD ECAL · physical board staggering and held-out calibration
10,000 identical electron inputs · flat 10–80 GeV · 12 DDSim workers
Pseudorapidity
Azimuth in one 22.5° sector
Baseline raw
Baseline calibrated
Staggered raw
Staggered calibrated
Continuous Si · raw diagnostic
s(R)/⟨R⟩ [%]
|η|
Signed sector-folded φ [deg]
Raw
Calibrated
Baseline − staggered [percentage points]
Raw R=S/Etrue; calibrated R=Ecal/Etrue · All events retained · Approximate 95% paired bootstrap
Calibration preprocessing, tuning and outer-fold models refitted in every replica; continuous Si is a separate diagnostic