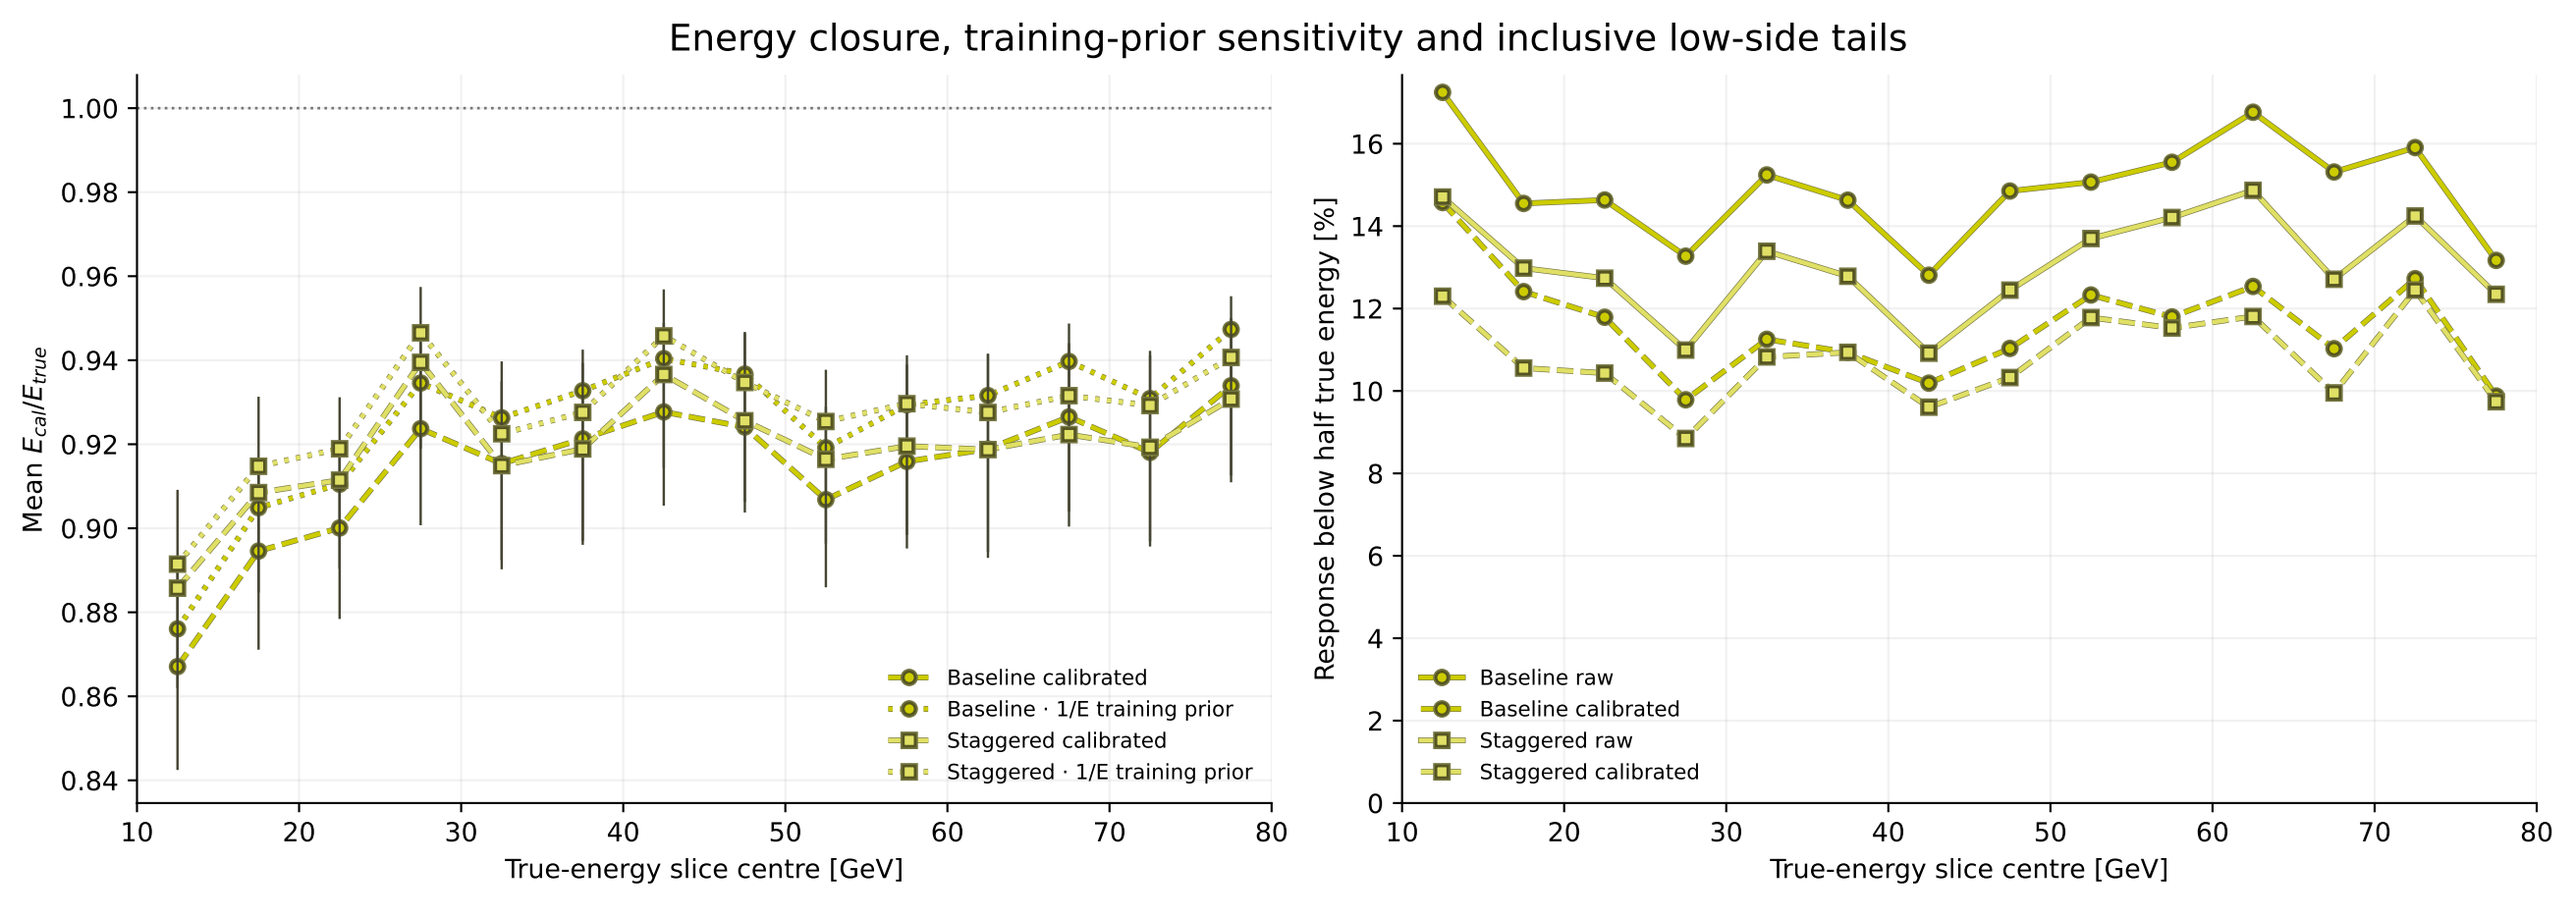
Energy closure, training-prior sensitivity and inclusive low-side tails
Mean E_{cal}/E_{true}
1.00
0.98
0.96
0.94
0.92
0.90
0.88
0.86
0.84
10
20
30
40
50
60
70
80
True-energy slice centre [GeV]
Baseline calibrated
Baseline · 1/E training prior
Staggered calibrated
Staggered · 1/E training prior
Response below half true energy [%]
16
14
12
10
8
6
4
2
0
True-energy slice centre [GeV]
Baseline raw
Baseline calibrated
Staggered raw
Staggered calibrated
14 fixed 5 GeV slices; finite-energy-slice checks, not fixed-energy certification
Raw tail comparator uses cross-fit training-only scale S/R0; prior variants are secondary sensitivity only