Strixel pitch: channels, power and service-space sensitivity

Unqualified load/cable redesign hypotheses; fixed fibres, cooling pipes, local buses and trays.

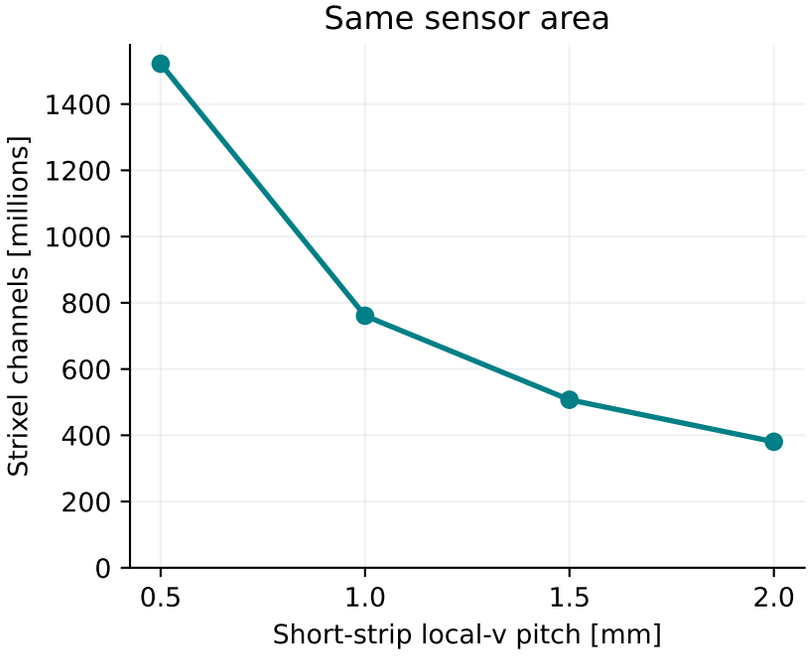

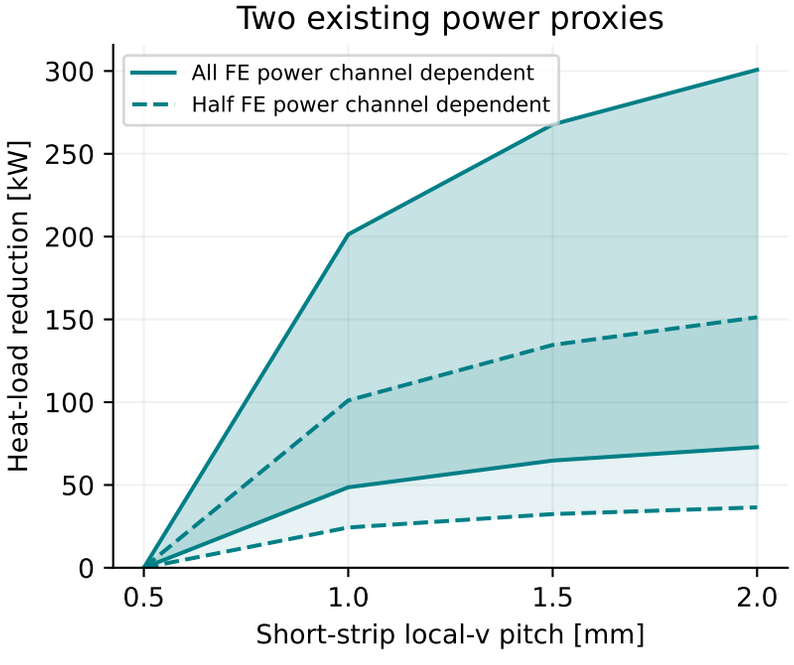

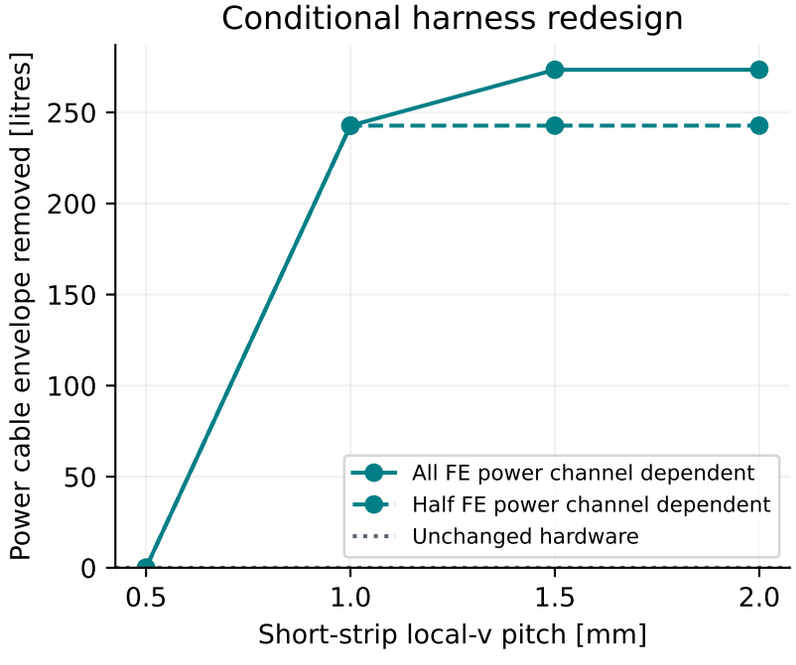

Power bands span comparator normalizations, not confidence bounds. Cable litres include internal void; LV/HV fanout is unqualified.

PROTOTYPE · unchanged DES020/021 routes · analytical power and cable-space sensitivities