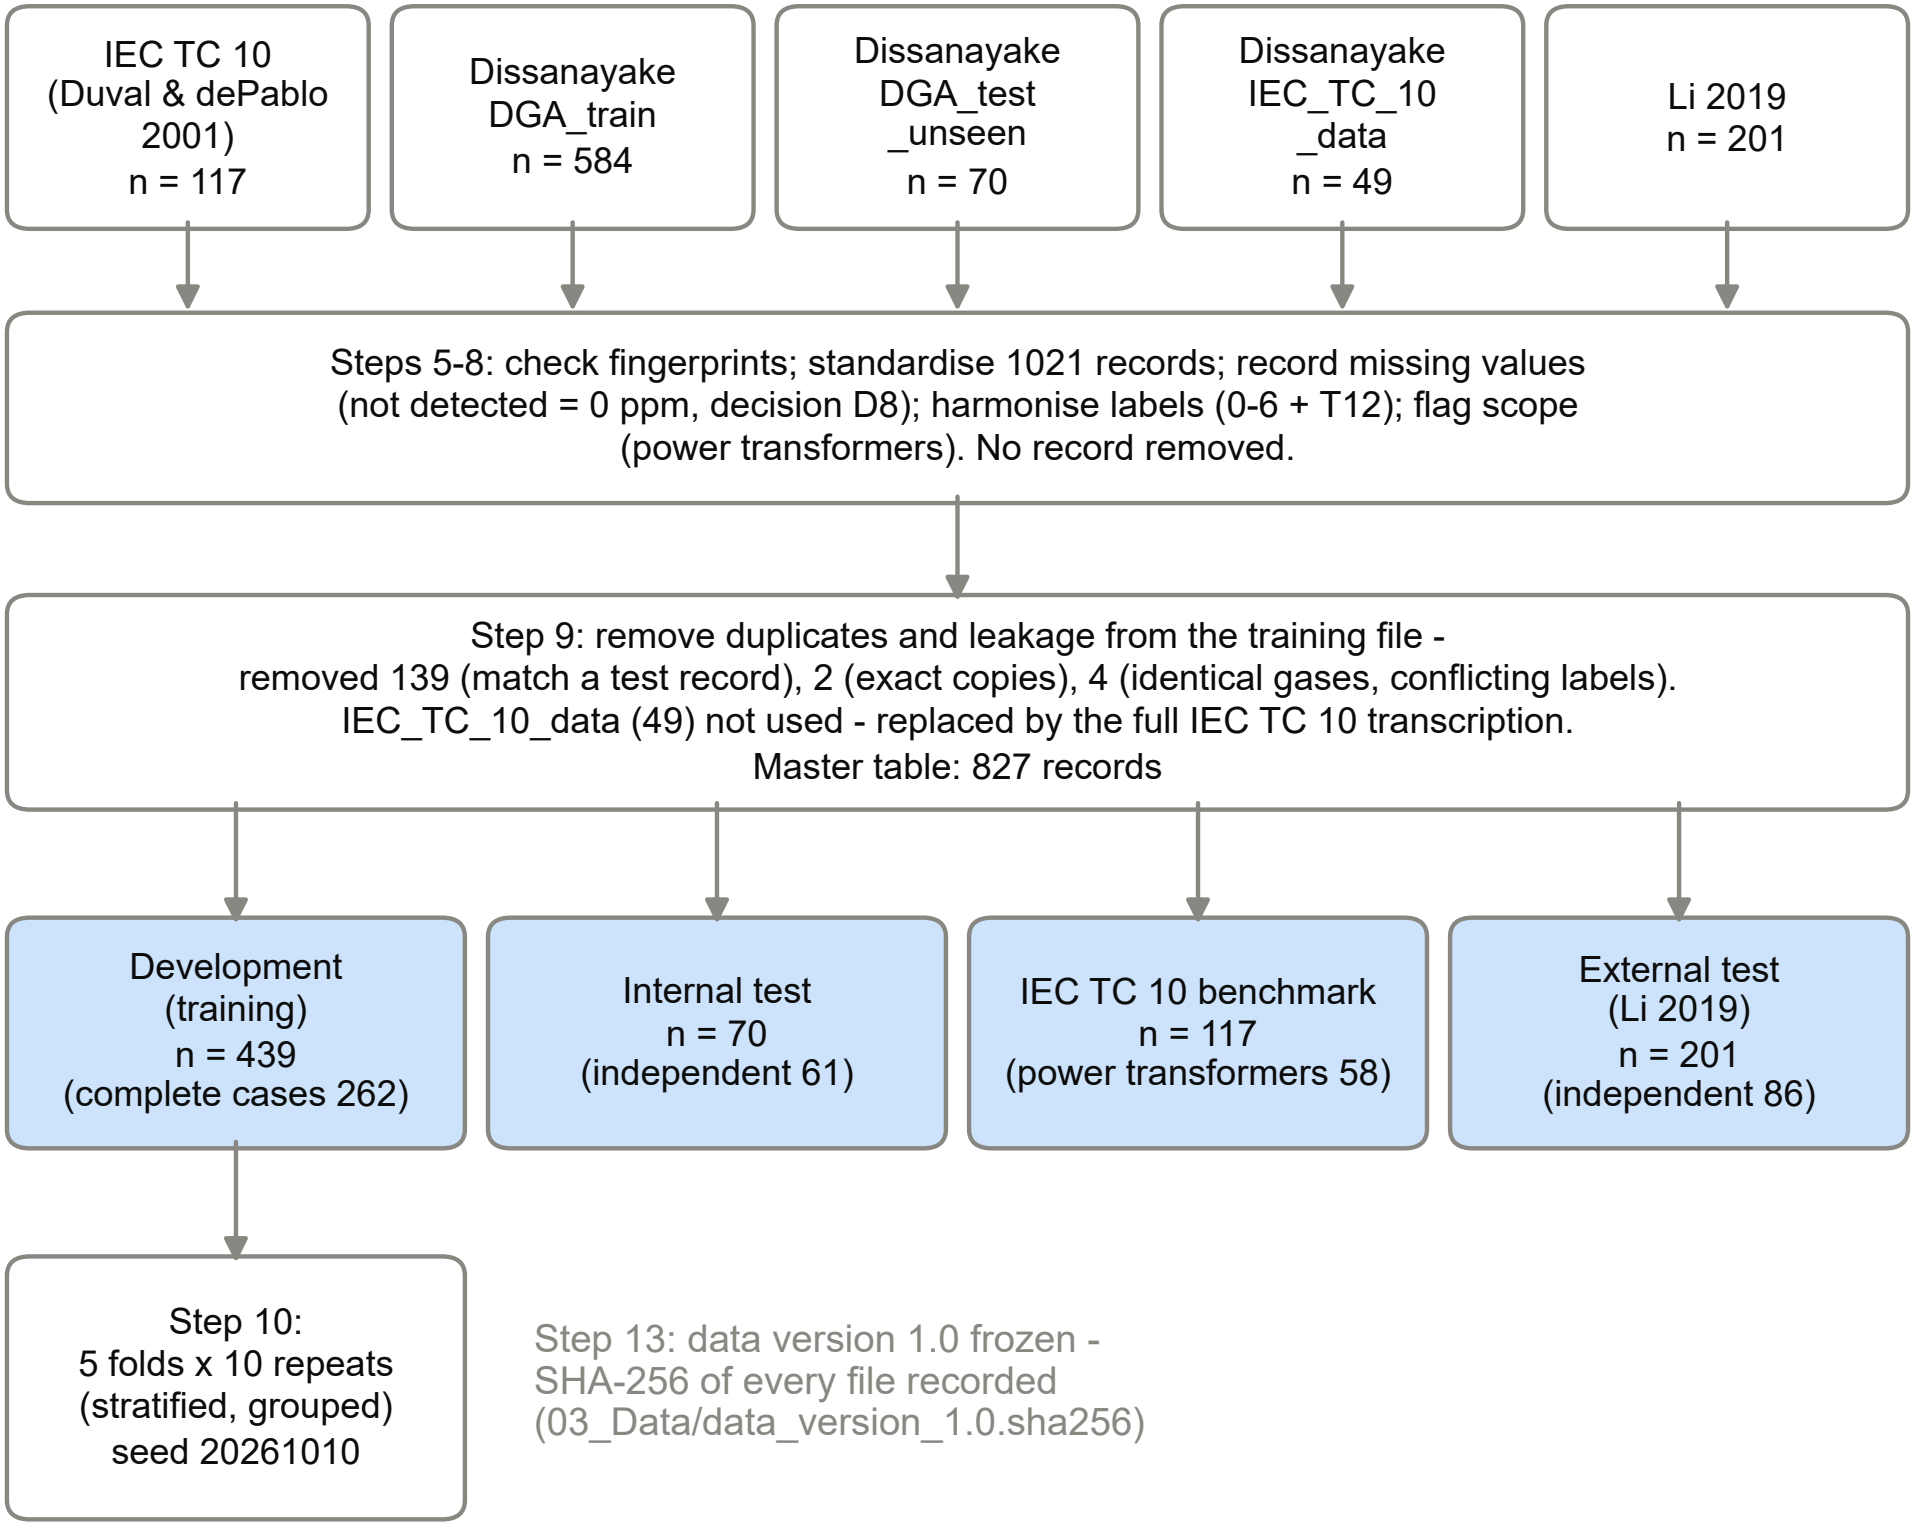
IEC TC 10
(Duval & dePablo
2001)
n = 117
Dissanayake
DGA_train
n = 584
Dissanayake
DGA_test
_unseen
n = 70
Dissanayake
IEC_TC_10
_data
n = 49
Li 2019
n = 201
Steps 5-8: check fingerprints; standardise 1021 records; record missing values
(not detected = 0 ppm, decision D8); harmonise labels (0-6 + T12); flag scope
(power transformers). No record removed.
Step 9: remove duplicates and leakage from the training file -
removed 139 (match a test record), 2 (exact copies), 4 (identical gases, conflicting labels).
IEC_TC_10_data (49) not used - replaced by the full IEC TC 10 transcription.
Master table: 827 records
Development
(training)
n = 439
(complete cases 262)
Internal test
n = 70
(independent 61)
IEC TC 10 benchmark
n = 117
(power transformers 58)
External test
(Li 2019)
n = 201
(independent 86)
Step 10:
5 folds x 10 repeats
(stratified, grouped)
seed 20261010
Step 13: data version 1.0 frozen -
SHA-256 of every file recorded
(03_Data/data_version_1.0.sha256)