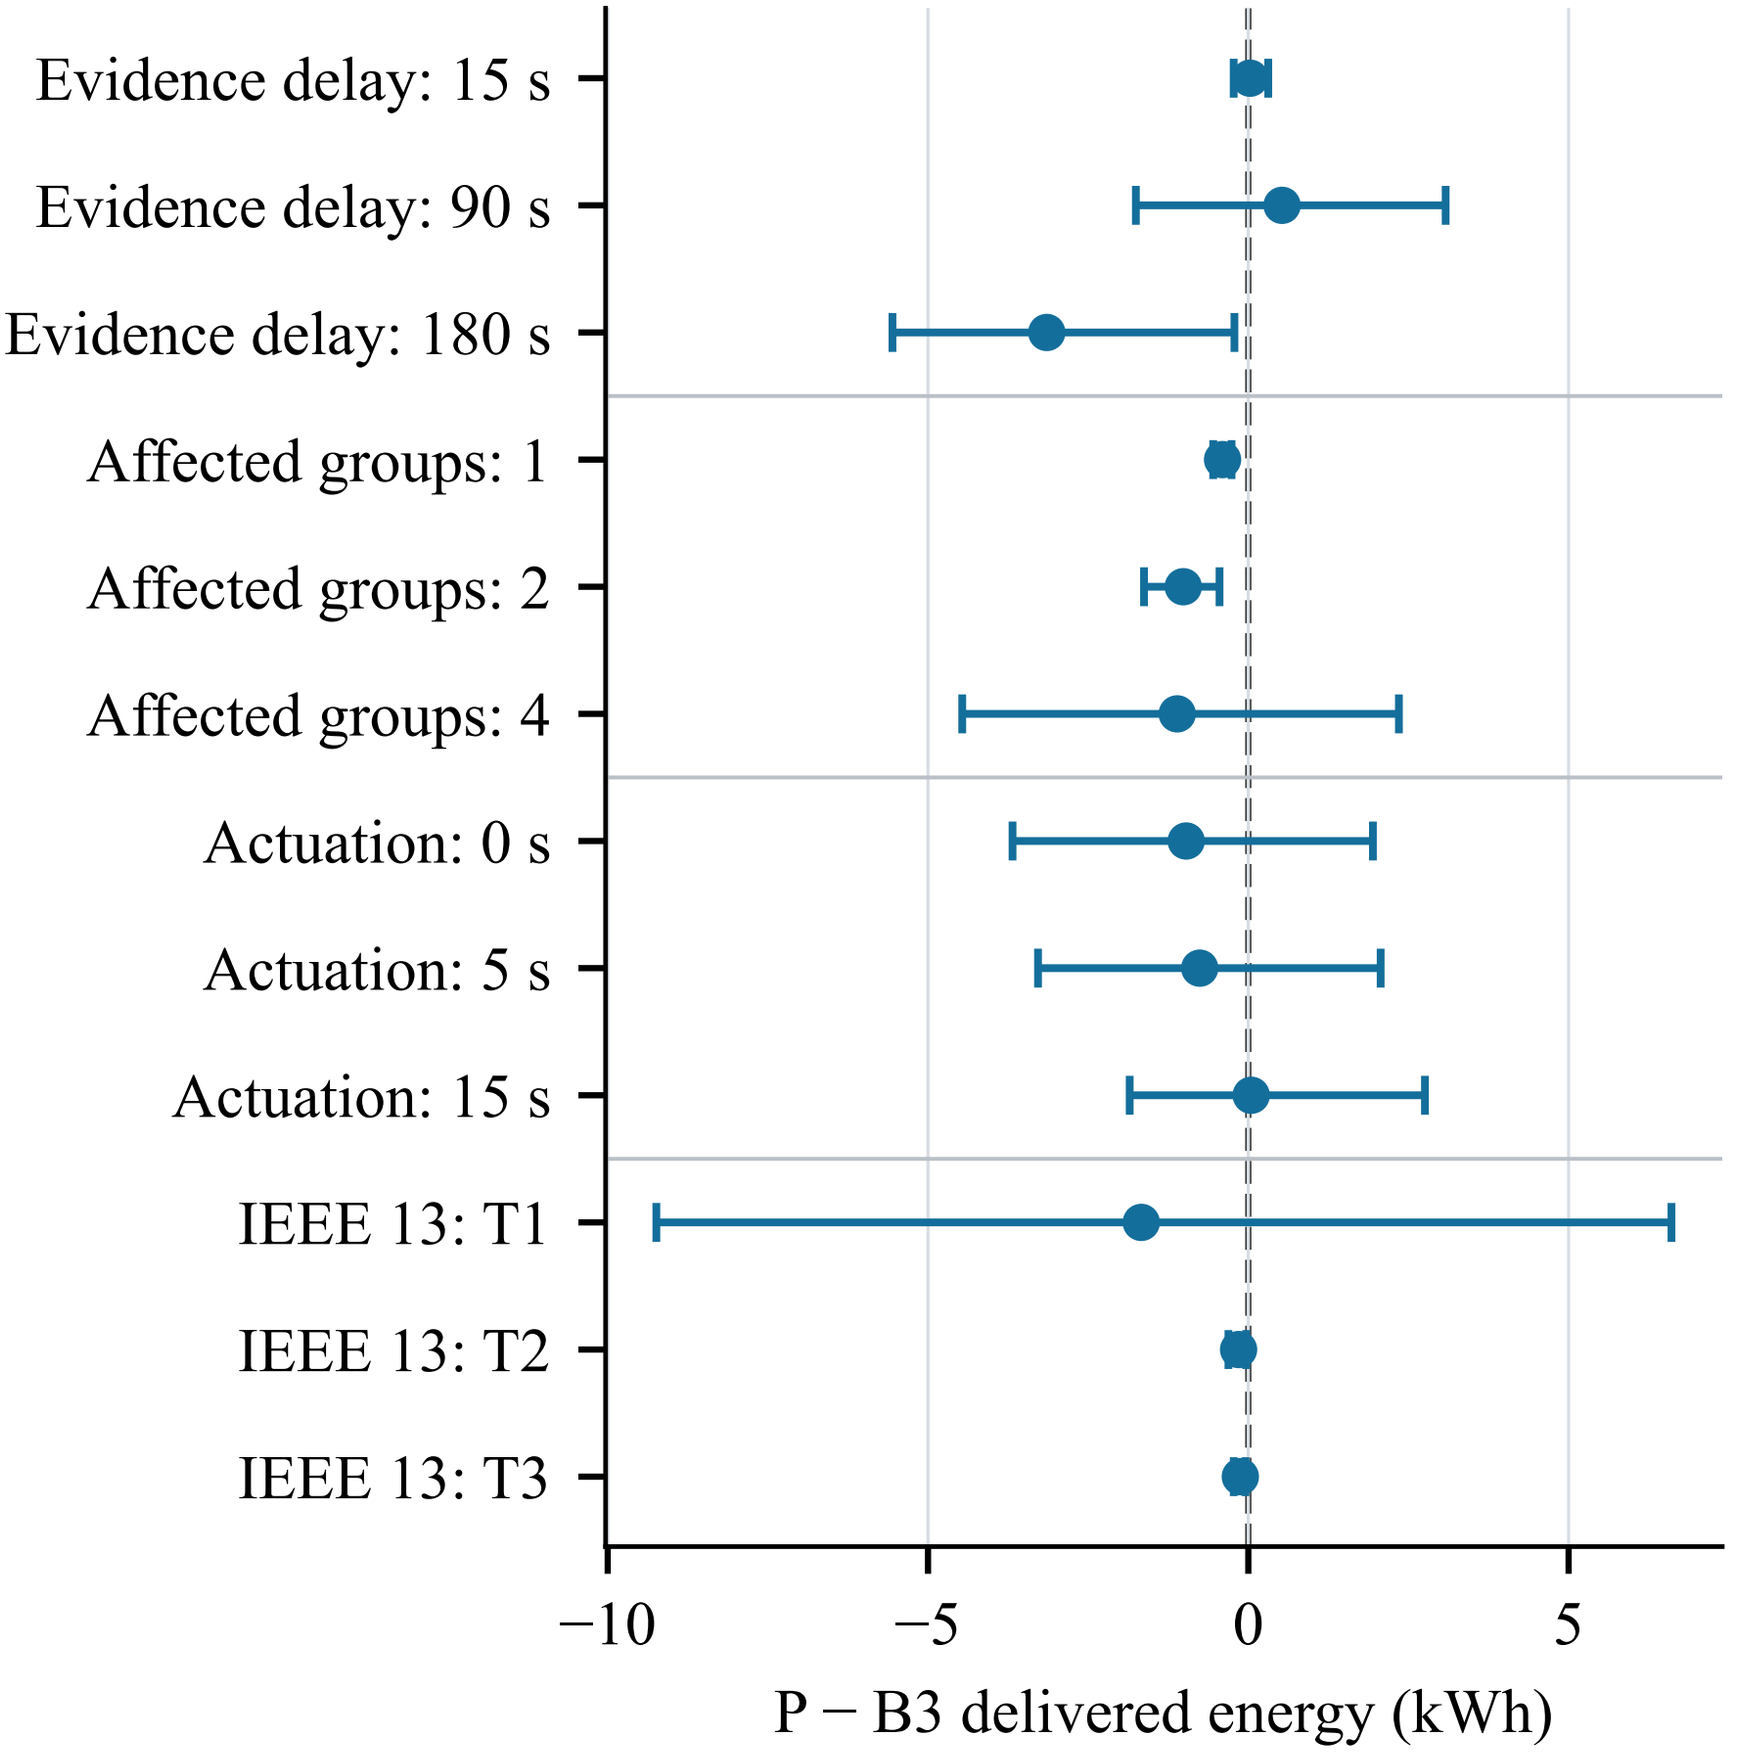
Evidence delay: 15 s
Evidence delay: 90 s
Evidence delay: 180 s
Affected groups: 1
Affected groups: 2
Affected groups: 4
Actuation: 0 s
Actuation: 5 s
Actuation: 15 s
IEEE 13: T1
IEEE 13: T2
IEEE 13: T3
−10
−5
0
5
P − B3 delivered energy (kWh)