
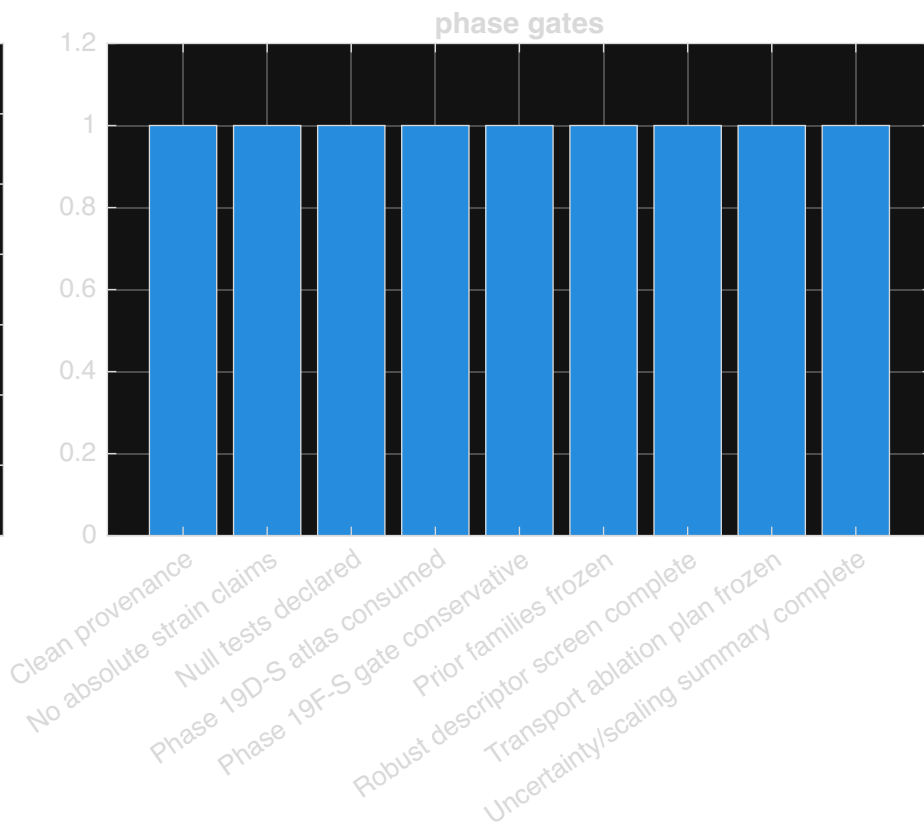
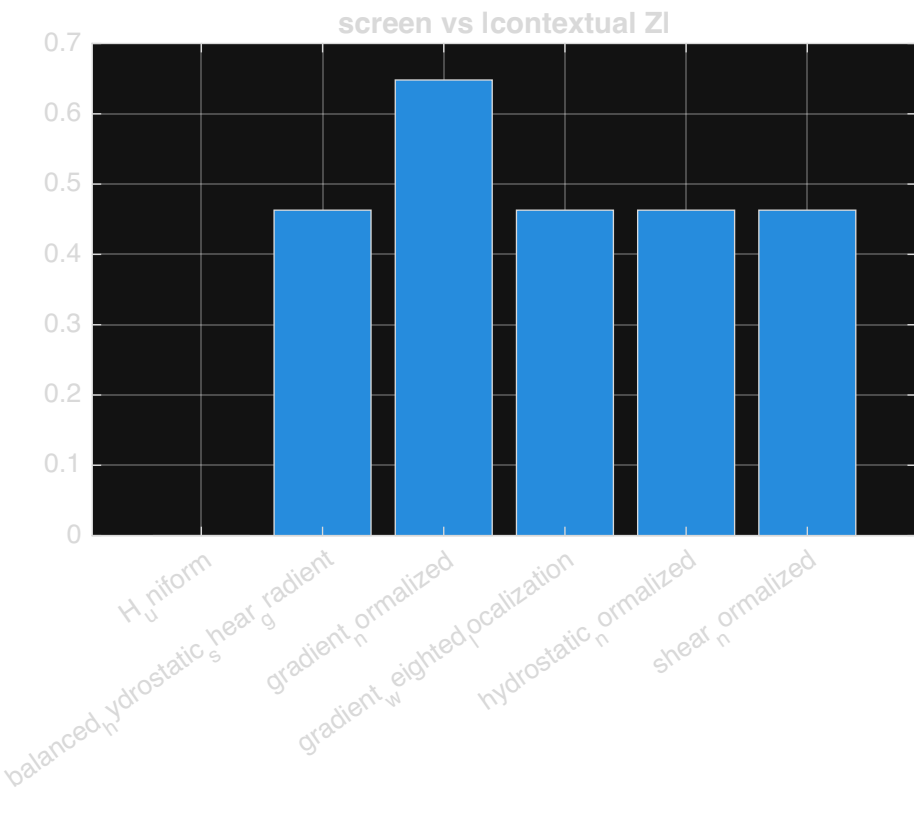
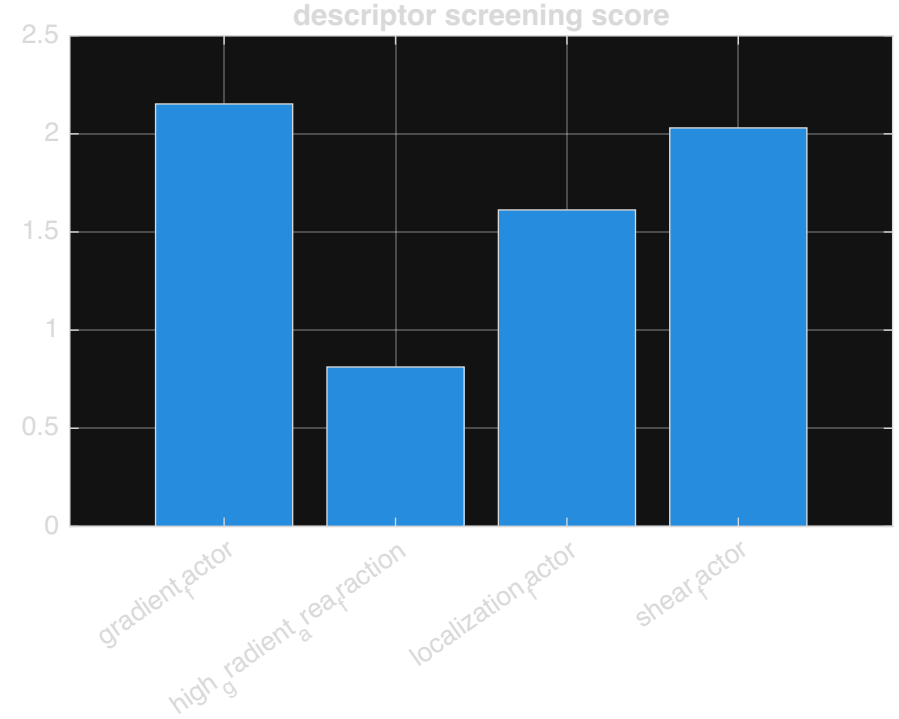
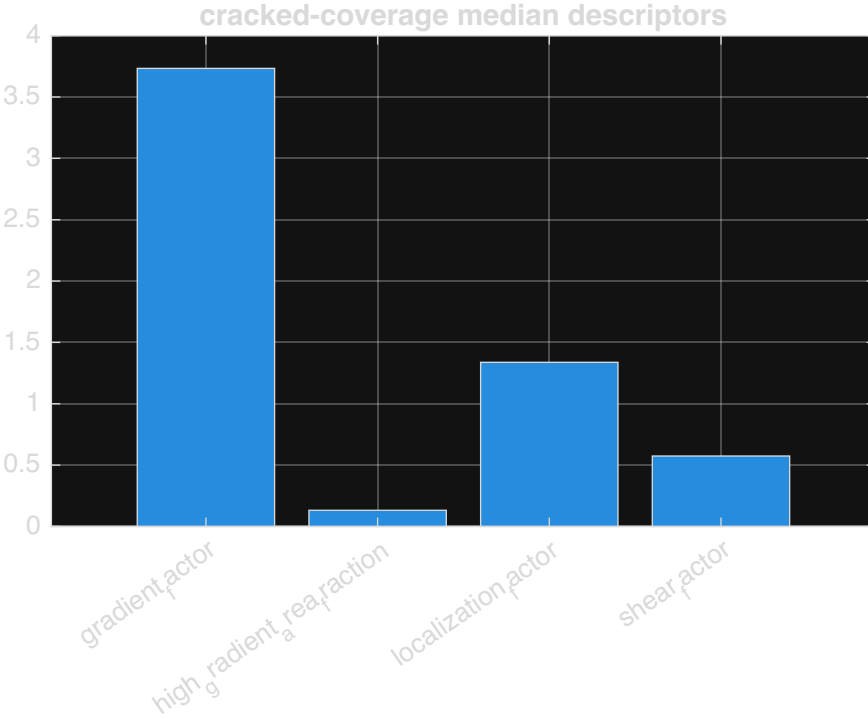


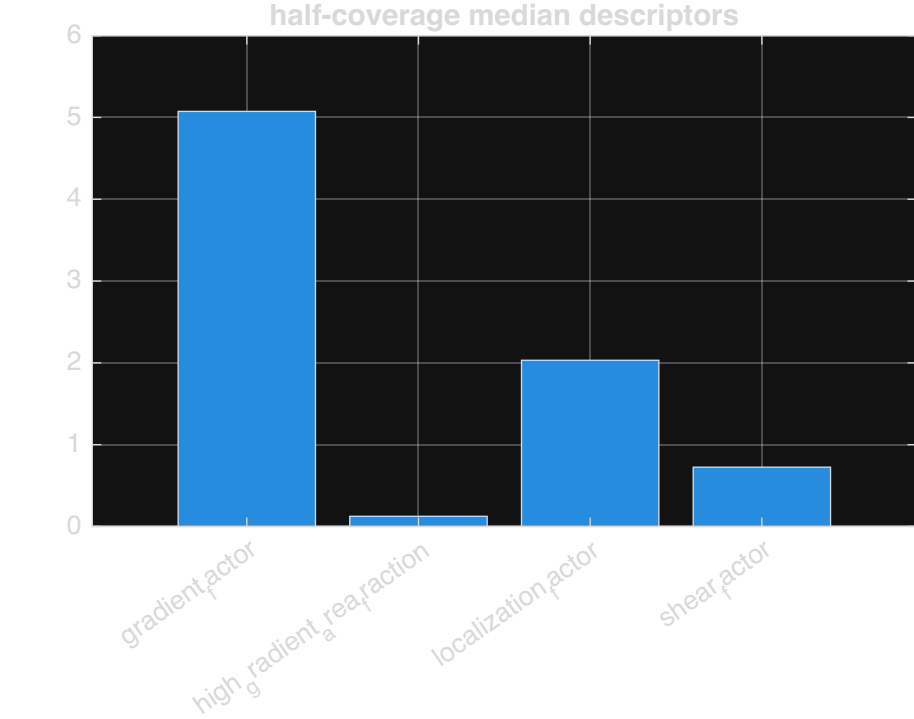

19E-S decision

supported_screen_only_pending_solver_ablation

top descriptor: gradient_factor

no absolute strain claims; no transport refit