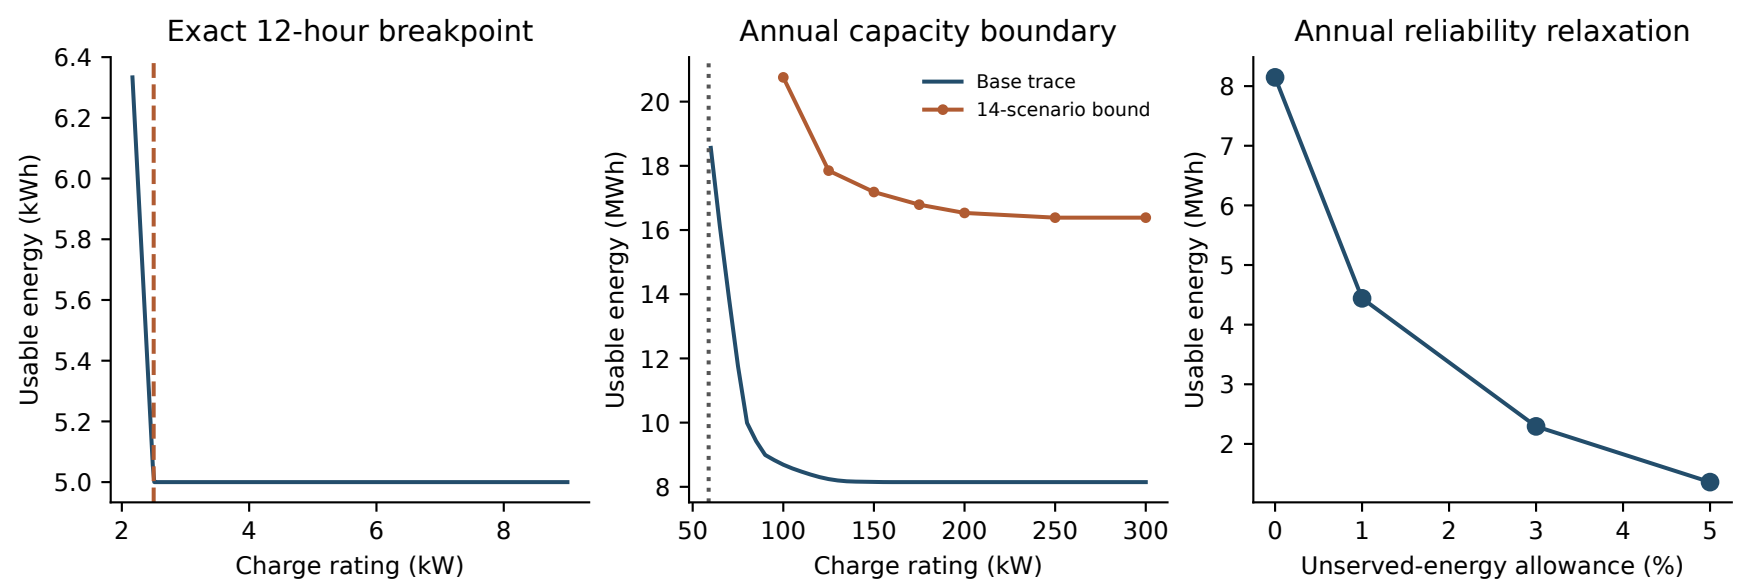
Exact 12-hour breakpoint
Usable energy (kWh)
6.4
6.2
6.0
5.8
5.6
5.4
5.2
5.0
2
4
6
8
Charge rating (kW)
Annual capacity boundary
Usable energy (MWh)
20
18
16
14
12
10
8
Base trace
14-scenario bound
50
100
150
200
250
300
Charge rating (kW)
Annual reliability relaxation
Usable energy (MWh)
8
7
6
5
4
3
2
0
1
2
3
4
5
Unserved-energy allowance (%)