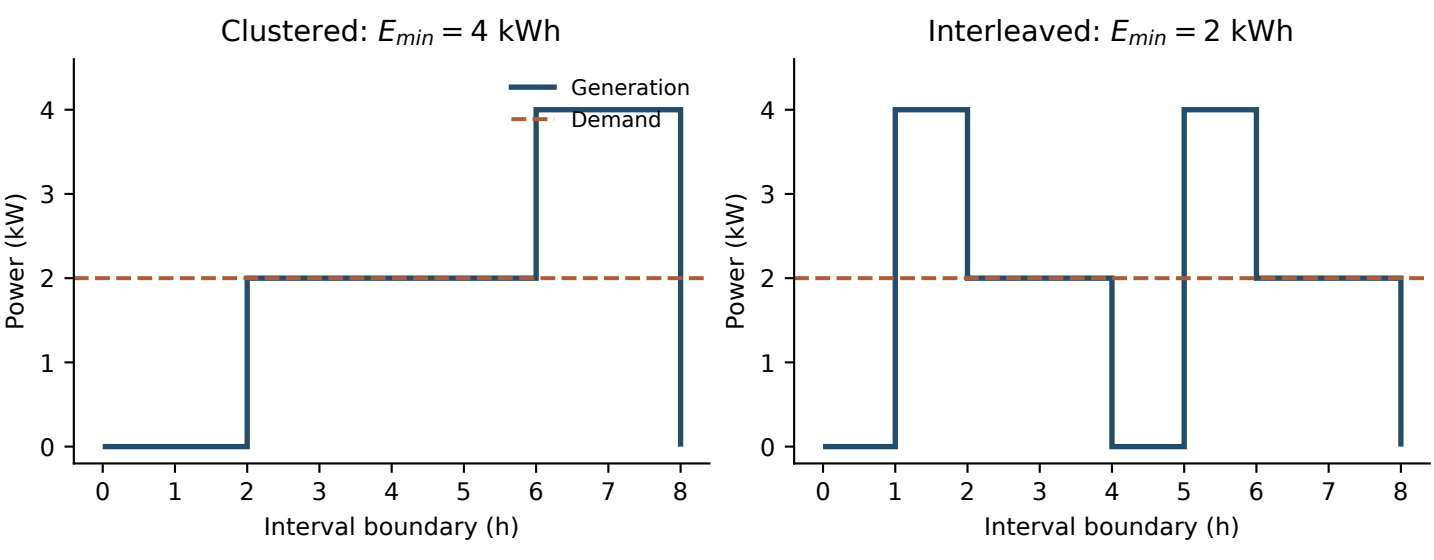
Clustered: $E_{min} = 4$ kWh
Interleaved: $E_{min} = 2$ kWh
Generation
Demand
Power (kW)
Interval boundary (h)
0
1
2
3
4
5
6
7
8