



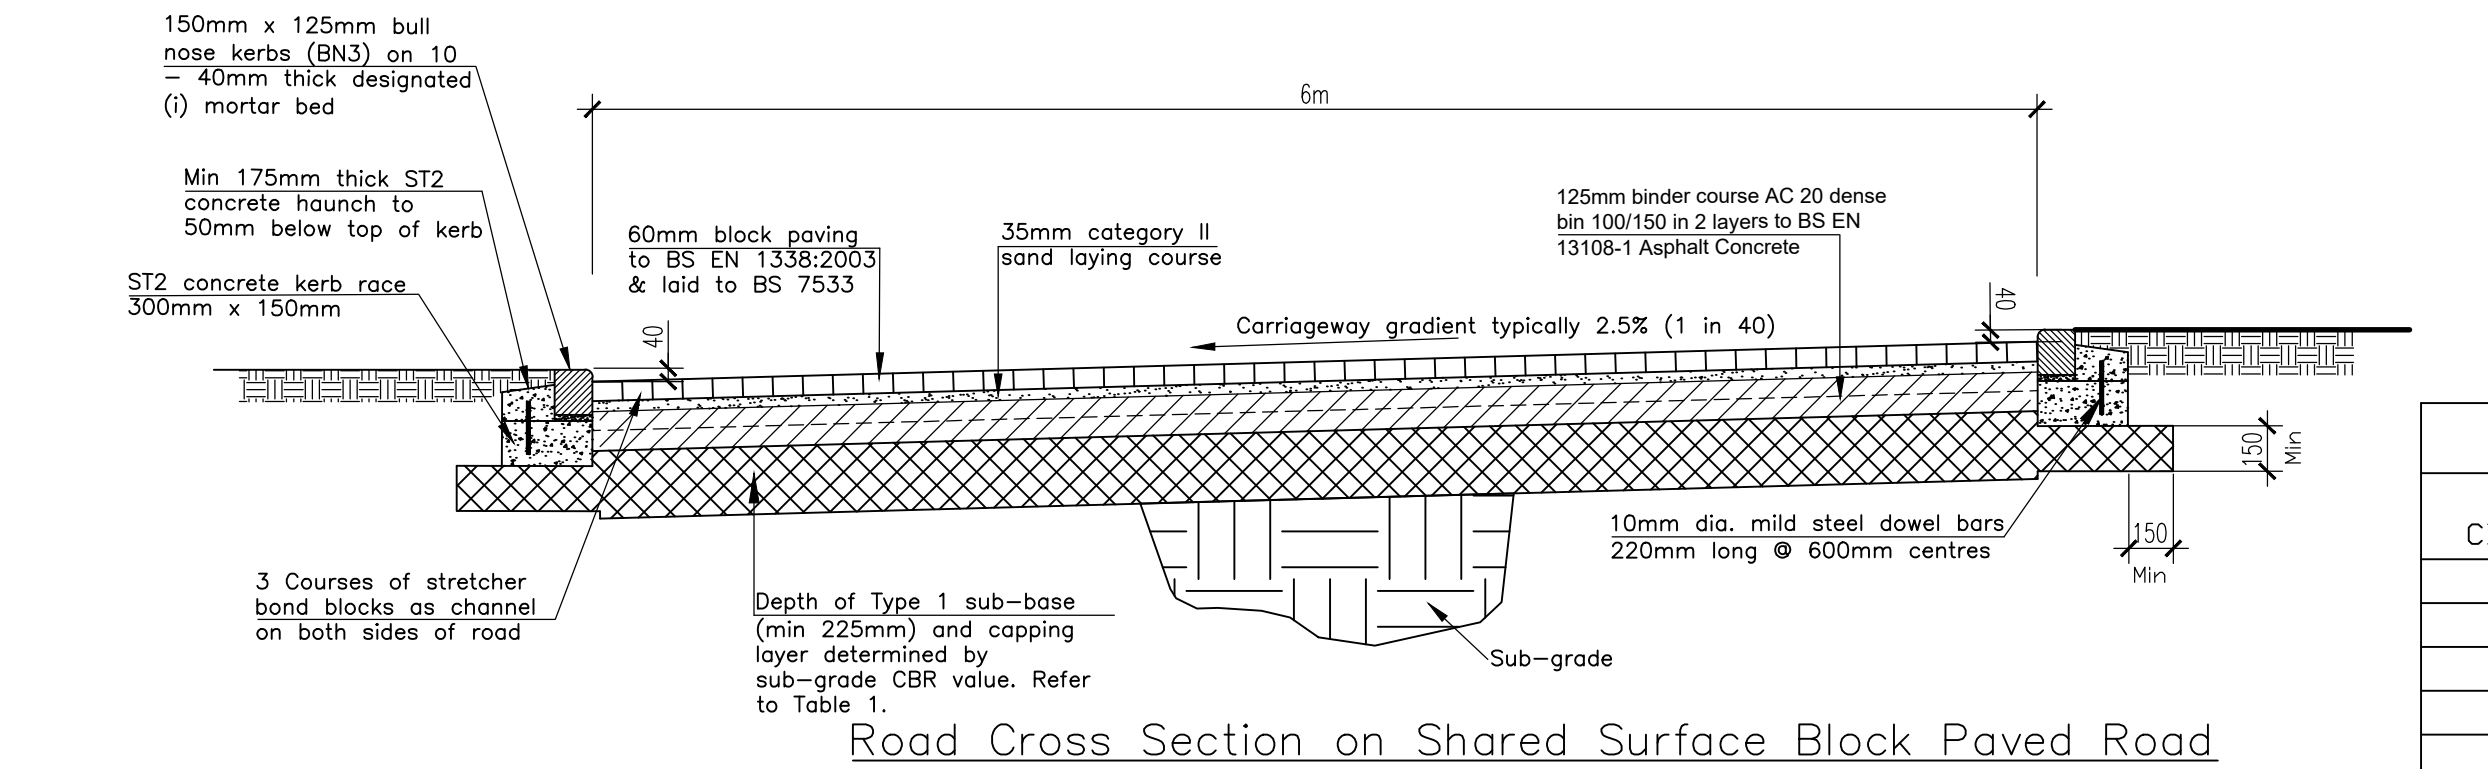



TABLE 1: MINIMUM SUB-BASE AND CAPPING LAYER THICKNESSES		
SUB-GRADE CBR VALUE %	SUB BASE THICKNESS	CAPPING LAYER
> 30	-	-
15+ - 30	150mm	-
5+ - 15	225mm	-
2.5 - 5	150mm	350mm
< 2.5	150mm	600mm

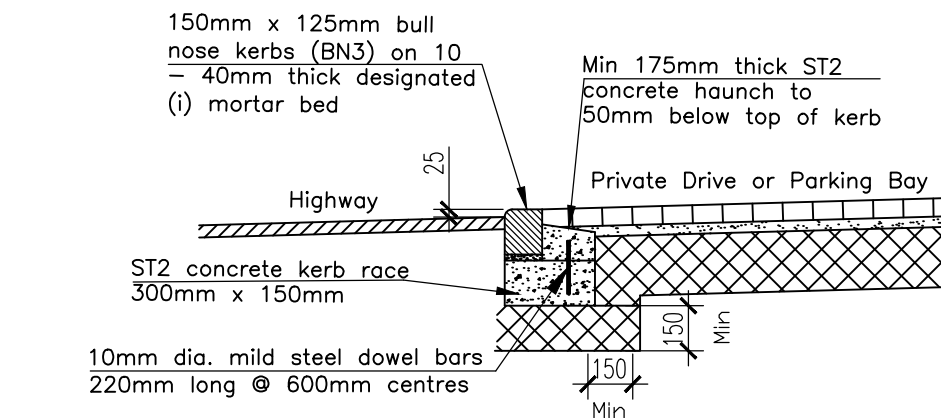

Upstand on Bull Nose Kerbs to be 25mm between Adoptable Road and Private Drive or Parking Bay

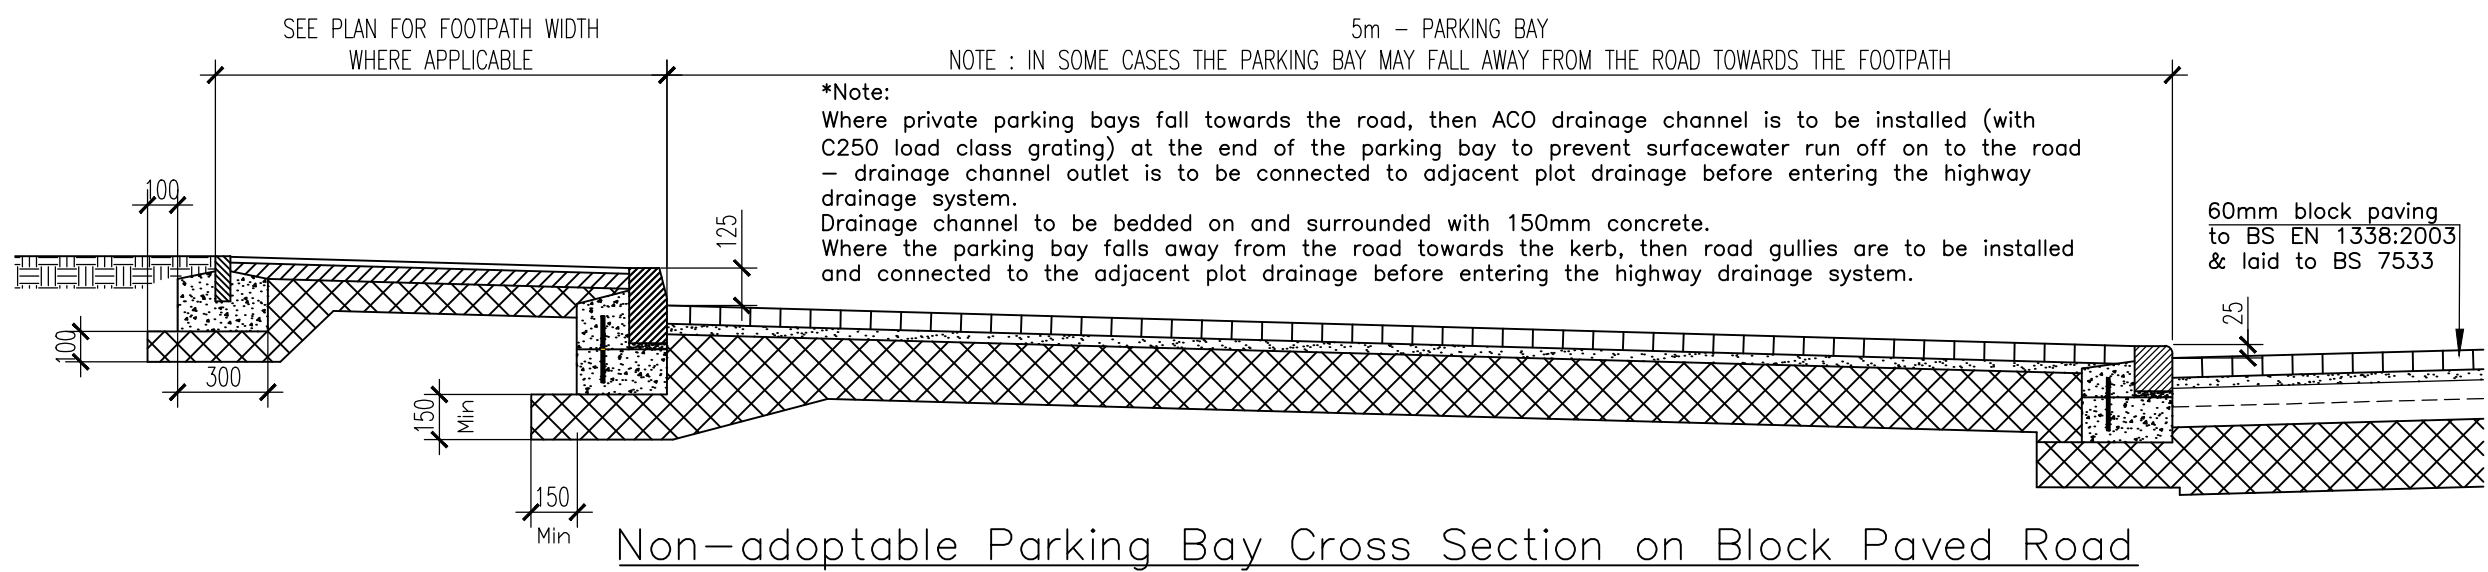

CBR TEST RESULTS FROM GROUND INVESTIGATION INDICATE A CBR VALUE OF 6% SHOULD BE USED FOR ROAD DESIGN - 6No. CBR TESTS TO BE CARRIED OUT AT MAXIMUM 30m CTRS. AT LOCATIONS SHOWN ON THE ROAD LAYOUT DRAWING.

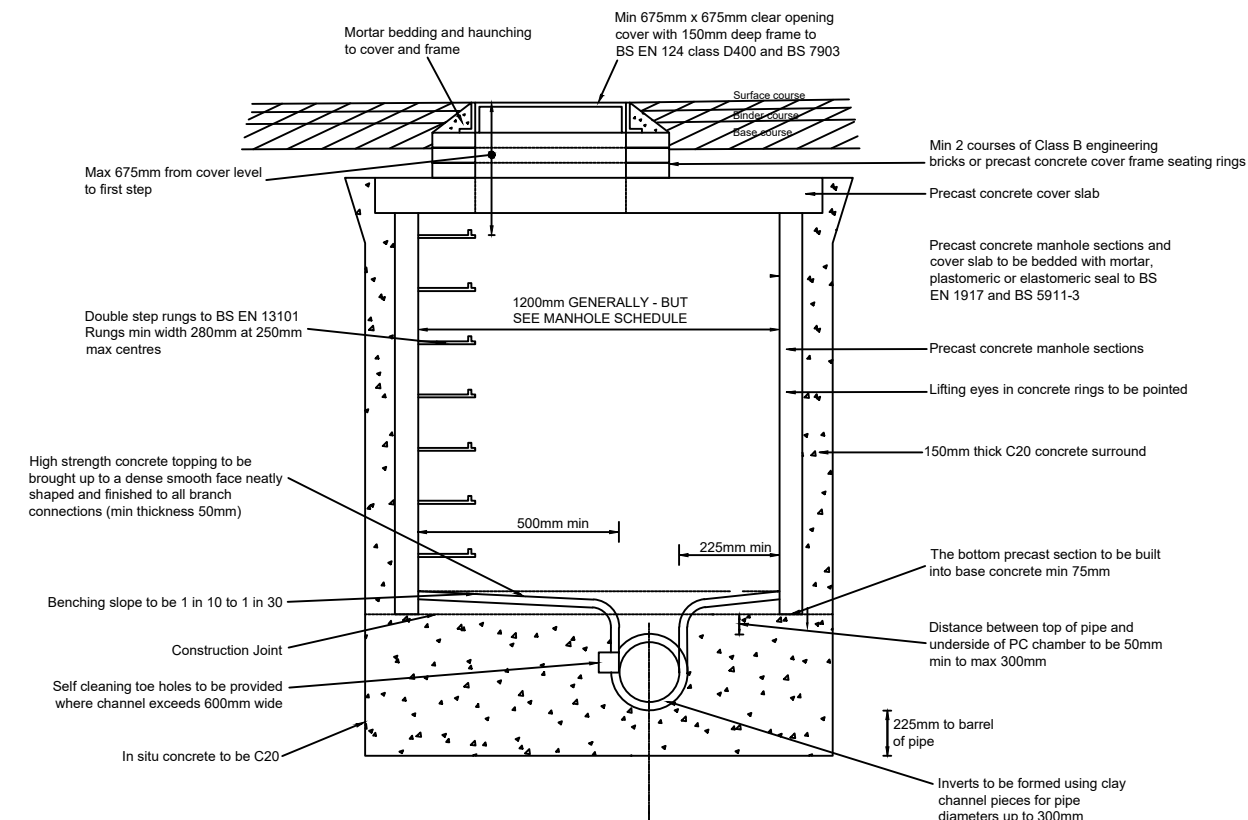

TYPICAL MANHOLE DETAIL

HIGHWAY ADOPTABLE DRAINAGE:
160mm dia. to 300mm dia. TO BE WAVIN ULTRARIB PIPEWORK.
450mm dia. TO BE POLYPIPE RIDGISEWER


DIMENSION a

IN MACHINE SLAG UNIFORM SOLS
Sieve graded pipes, min 50mm.
Sieve graded pipes 16 Bc or 100mm, whichever is the greater under barrels but not less than 50mm under sockets (400mm max)

IN ROCK OR MIXED SOLS
Sieve graded pipes, min 150mm.
Sieve graded pipes 14 Bc or 200mm, whichever is the greater under barrels and 150mm min under sockets (400mm max)

WITH CONCRETE BEDDING
100mm min for all types of pipe
CLASS A1, A2 AND A3
Precast concrete setting blocks as shown for adoption to be used for pipe support.


For Class A reinforcement concrete cast-in-situ, the bedding shall be 0.4% min of concrete cross sectional area. If the shell is increased up to 1%, the bedding factor may increase up to 4.8.

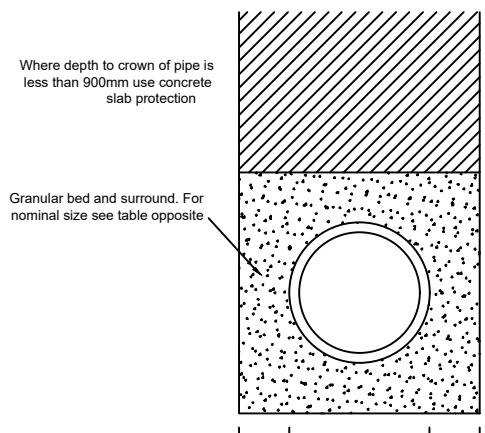

CLASS S PIPE BED AND SURROUND


CONCRETE SLAB PIPE PROTECTION

Where depth to crown of pipe in roadway is less than 1200mm (NOT TO SCALE)

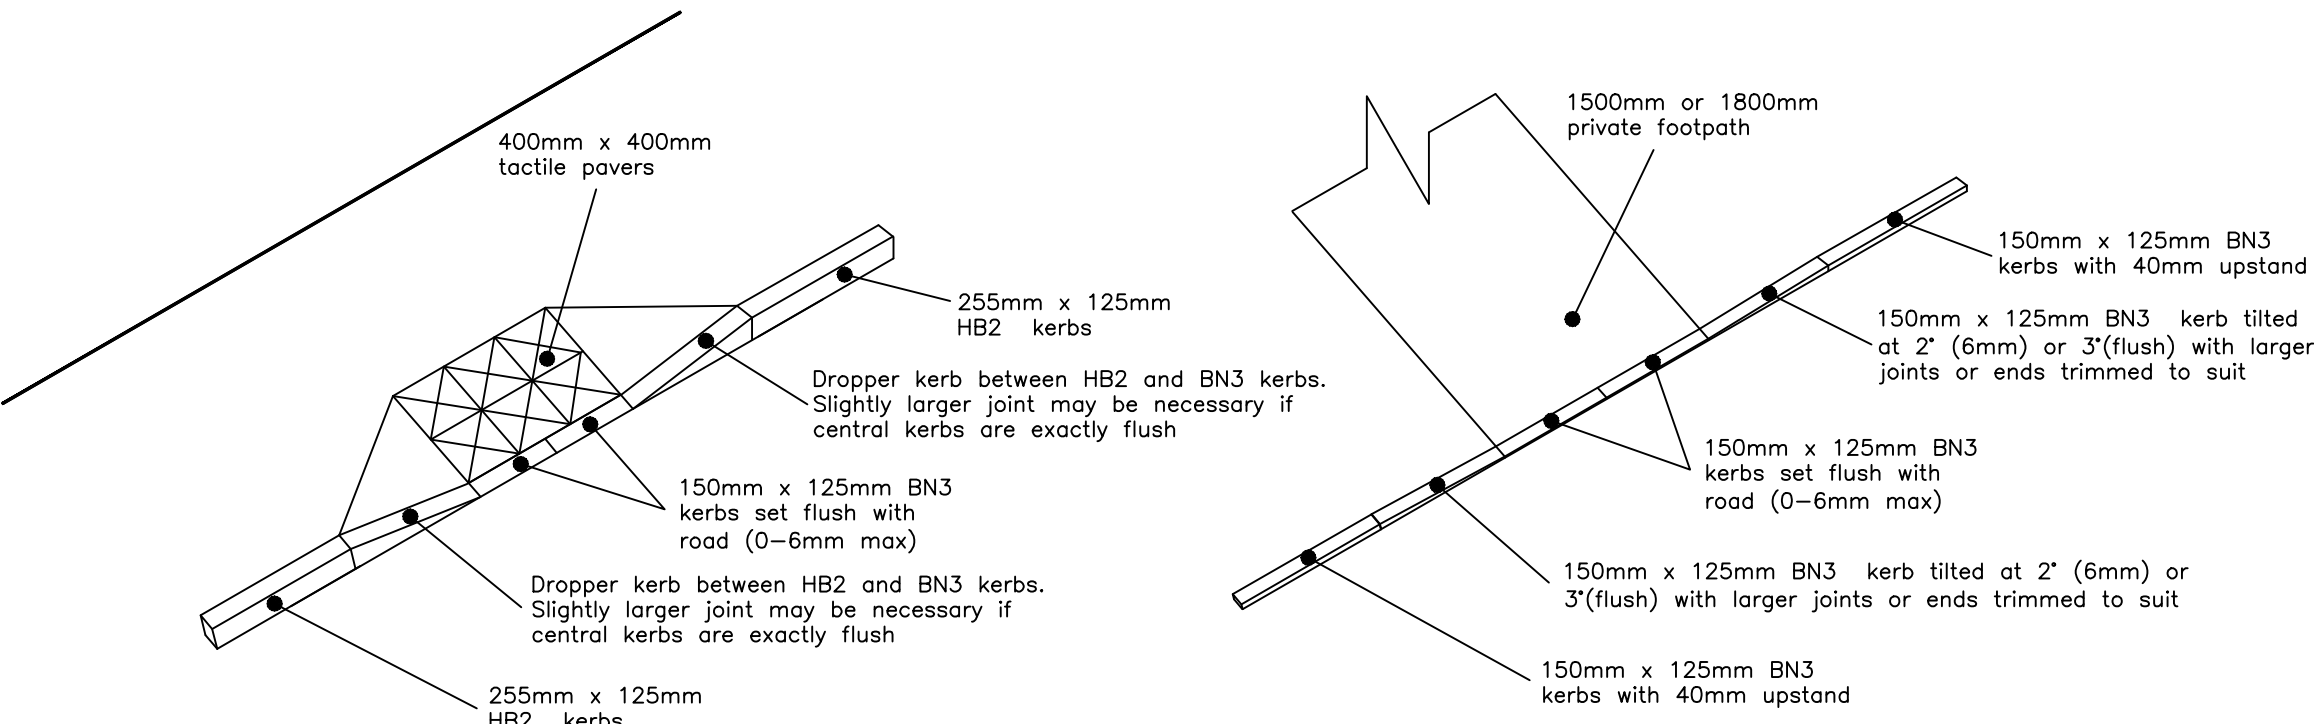


Typical Dropped Kerb Detail for Tactile Paving N.T.S.


Typical Dropped Kerb Detail where Private Footpath meets Adoptable Highway N.T.S.

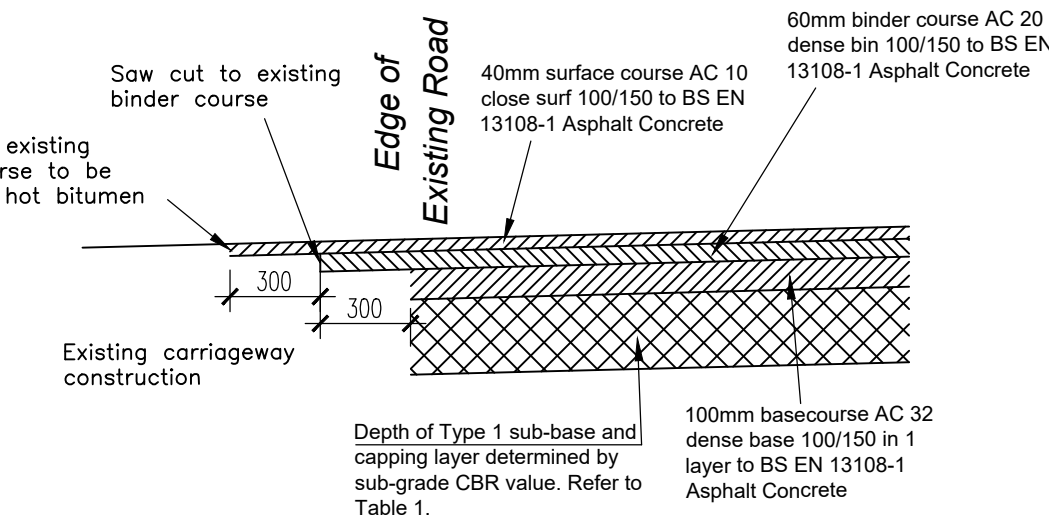

New Estate Road Tie-in to Existing Road

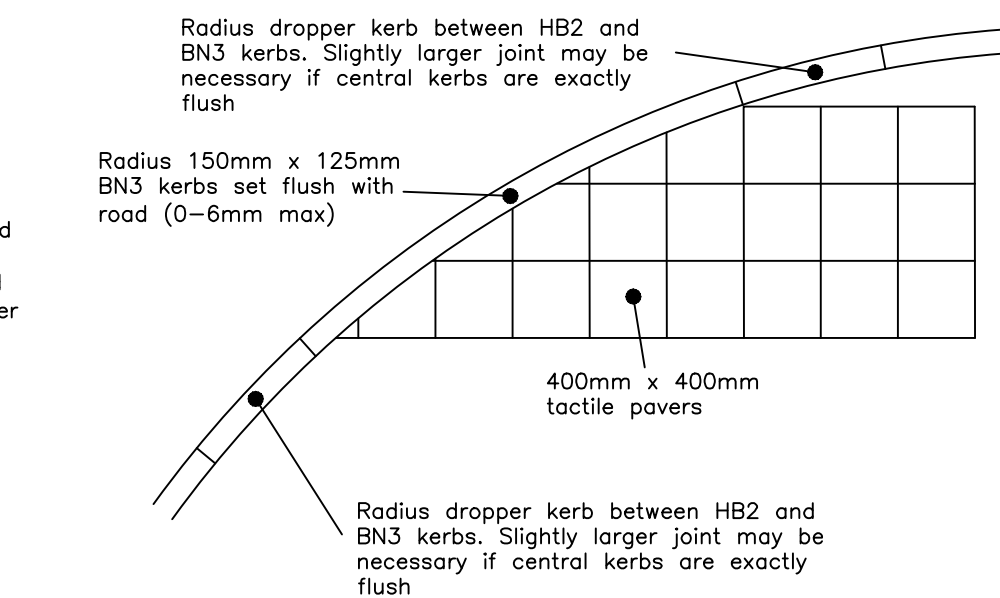

Typical Dropped Kerb Detail for Tactile Paving N.T.S.

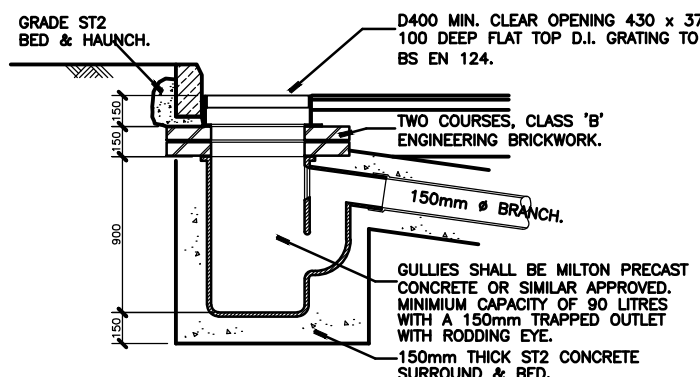

ROAD GULLY DETAIL.

NOTES.

This drawing and the copyright remain the property of Dandara Homes Limited.
It may not be copied or altered without their written permission and must be returned to the Housing Department when work is completed.
All dimensions must be checked on site. Any discrepancies should be notified to the Architects. Only written dimensions shall be followed.

This drawing MUST be read with other Architectural and Engineers drawings and the specification.

ALL ADOPTABLE HIGHWAY AND FOOTPATHS TO BE CONSTRUCTED IN ACCORDANCE WITH MANUAL FOR MANX ROADS.

THE TYPE 1 SUB-BASE FOR BLOCK PAVED ROADS TO BE A MINIMUM OF 225mm THICK.

P01	Issued for Section 4 & Section 8 Agreement	09.12.2025	MS
REV.	AMENDMENT	DATE	BY

dandara

Dandara Group Head Office
Isle of Man Business Park
Cool Road, Braddan
Isle of Man
IM2 2SA

Tel: 01624 693300 Email: isleofman@dandara.com Web: www.dandara.com

CLIENT:
Dandara Homes Ltd

PROJECT:
Parkfield
Ballahick Lane
Ballasalla

DRAWING:
Road and Drainage Construction Details

STATUS:
Approval

SCALE: 1:25 Unless Shown DATE: December 2025

JOB No.: 2333 NAME: MS

DRAWING No.: 2333-DAN-BA4-DR-D-C-90005

Rev: P01