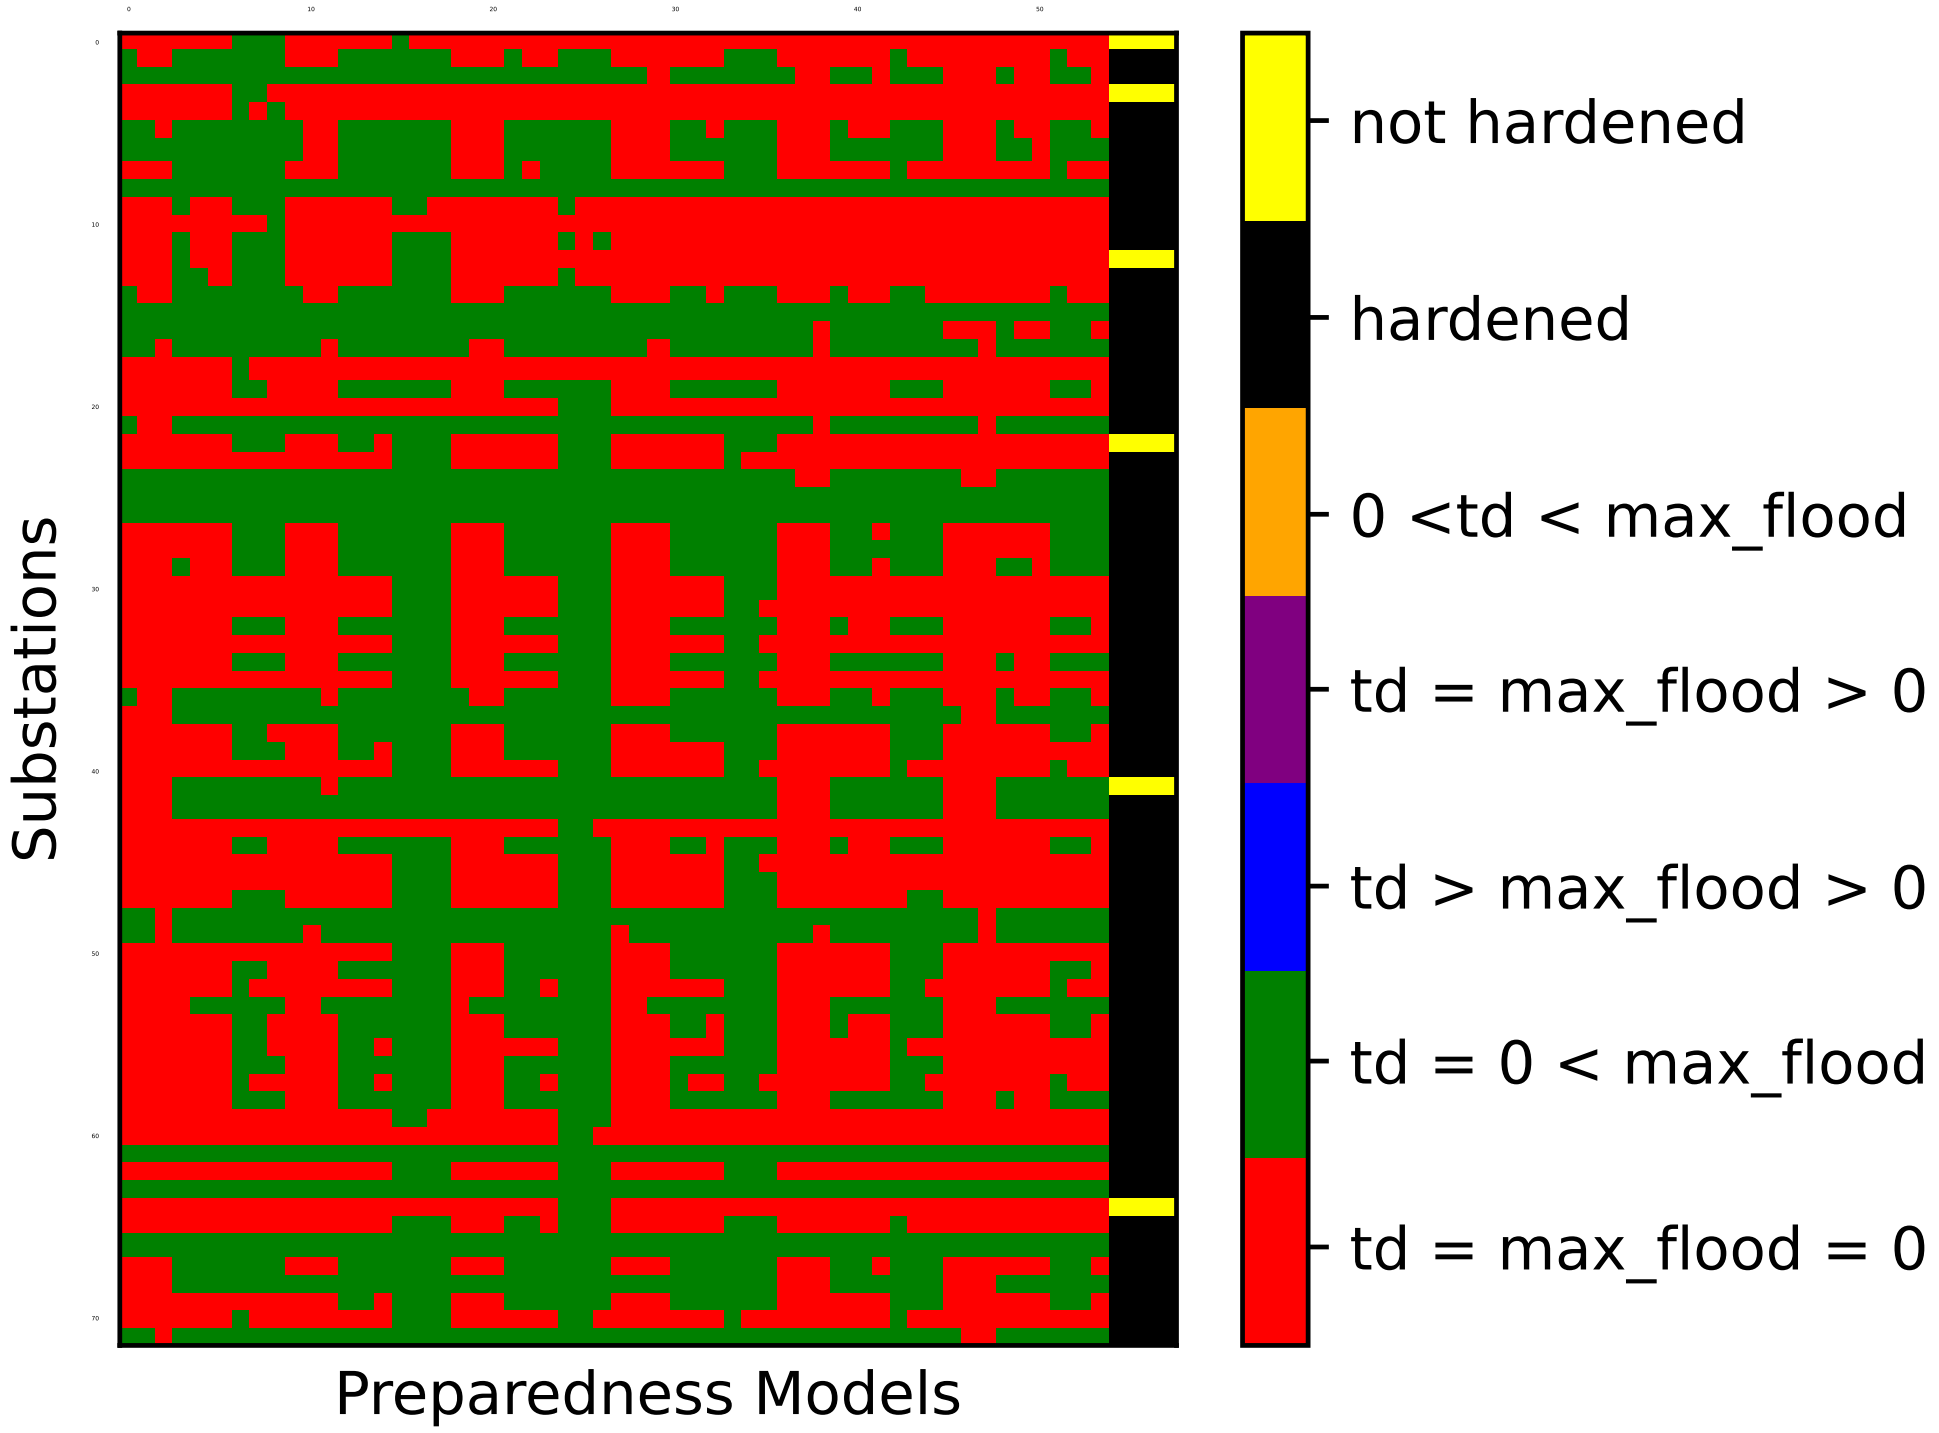
Substations
Preparedness Models
not hardened
hardened
0 <td < max_flood
td = max_flood > 0
td > max_flood > 0
td = 0 < max_flood
td = max_flood = 0