


Robot UVC electrical architecture — two separate 48 VDC to 120 VAC branches

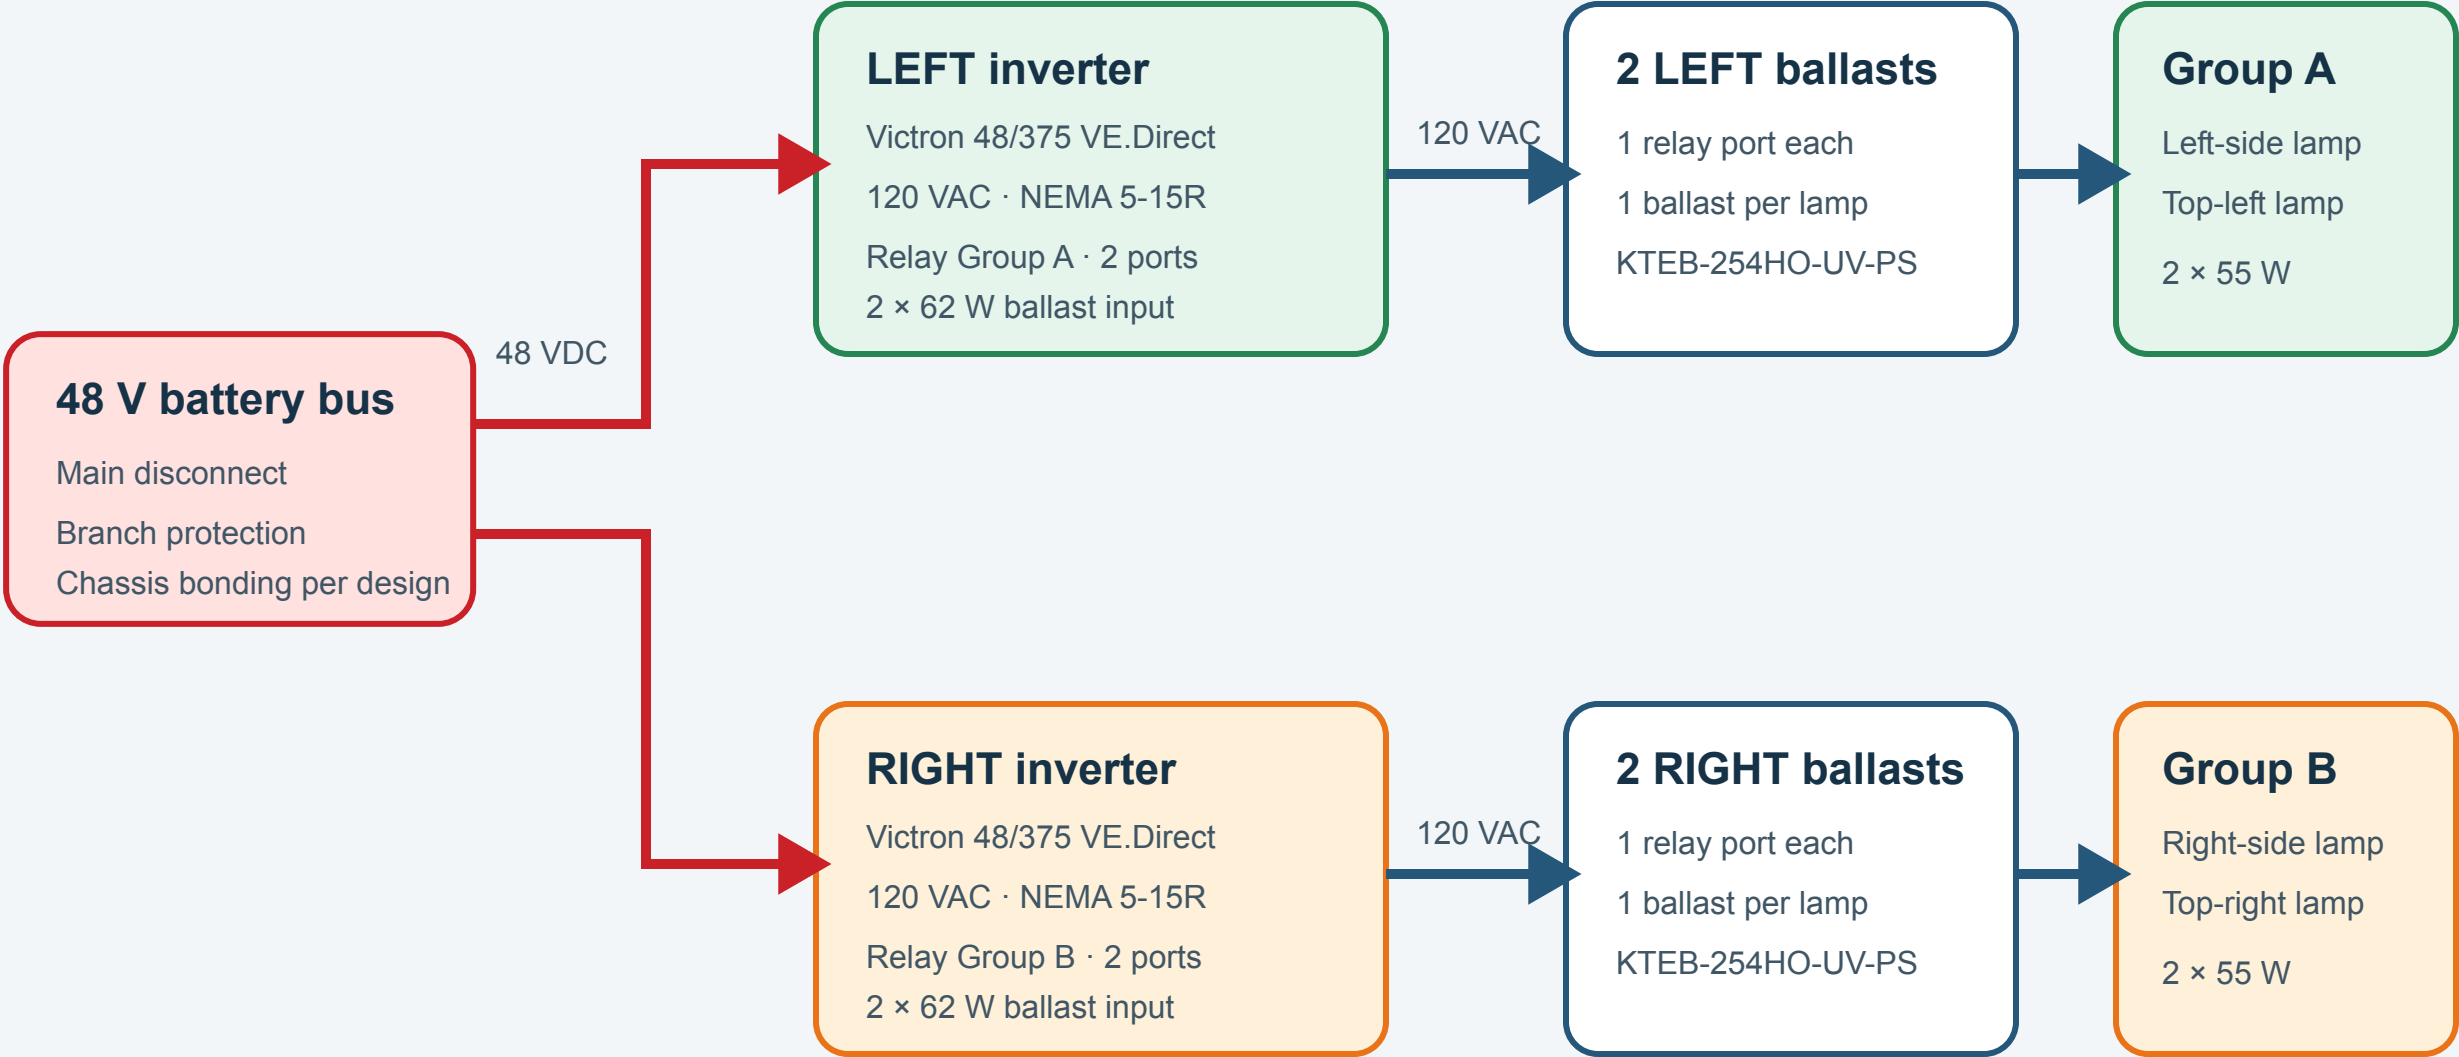

Confirmed topology: each relay port switches the 120 VAC input of one dedicated ballast. Relay contacts, wiring, protection, and enclosure must be AC- and ballast-inrush-rated.