Three labware objects, one continuous recorded trial

125,100 steps · 208.5 s trial-relative clock · positive trial only · local adaptation

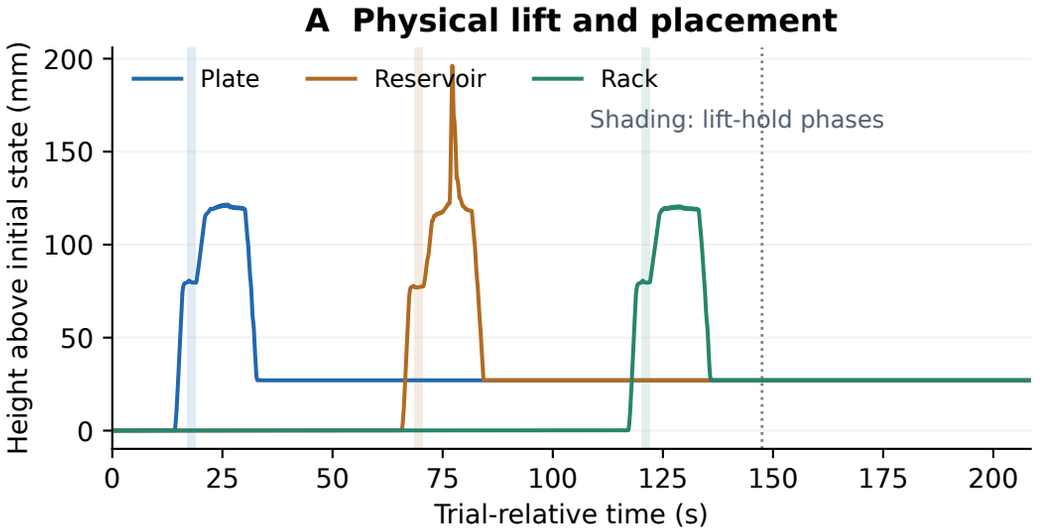

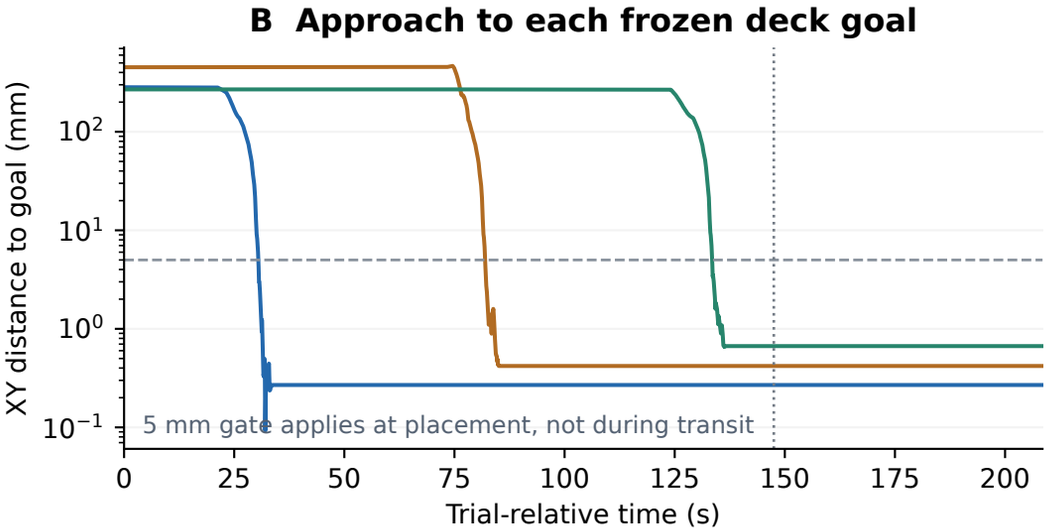

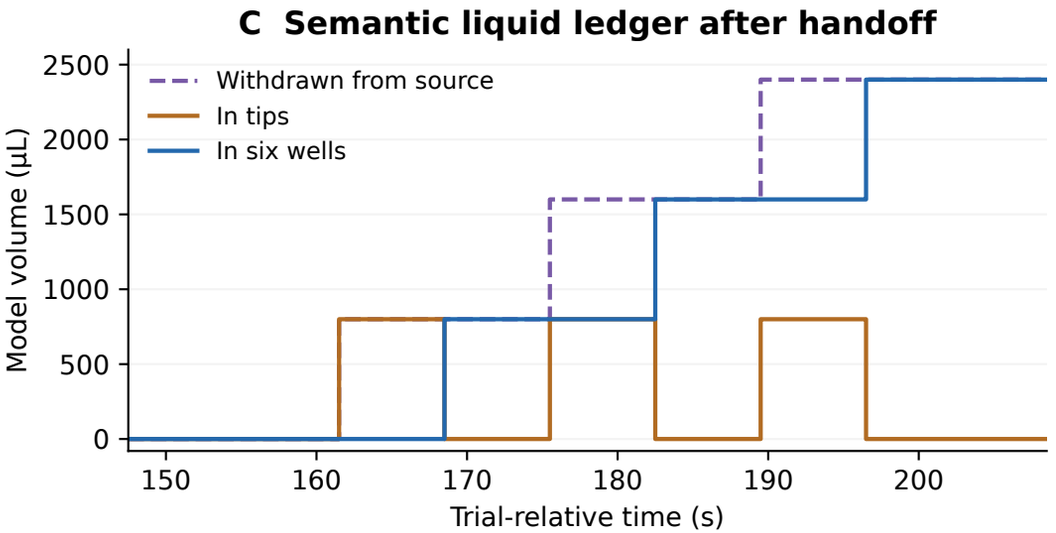

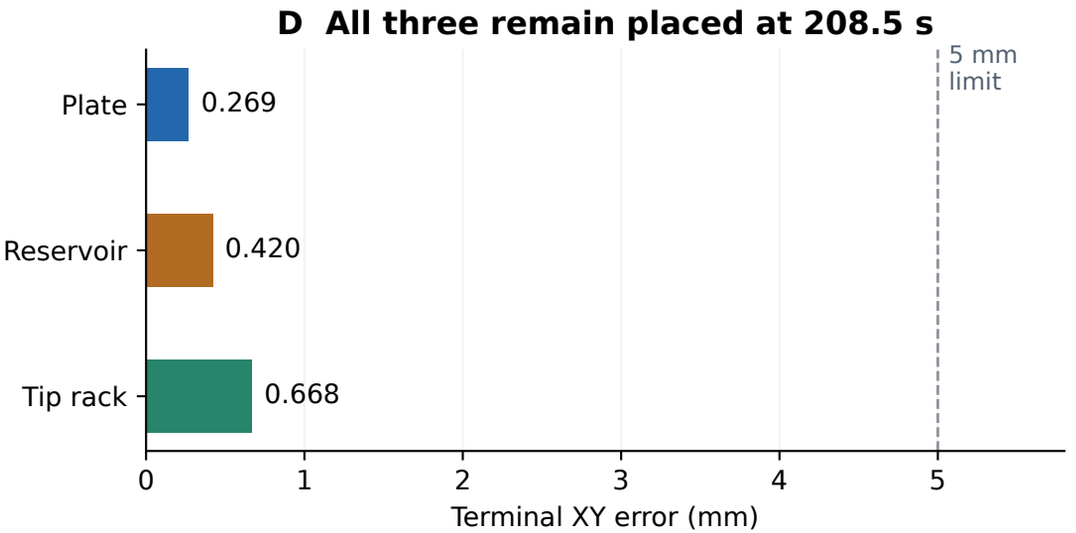

Local supports, grip overlay and control adaptations. Liquid ledger has no fluid-force feedback.
All recorded steps are plotted; initialization warmup is excluded. No independent native callback counter in this frozen trial.
One positive trial is not a success-rate estimate; full paper reproduction remains open.