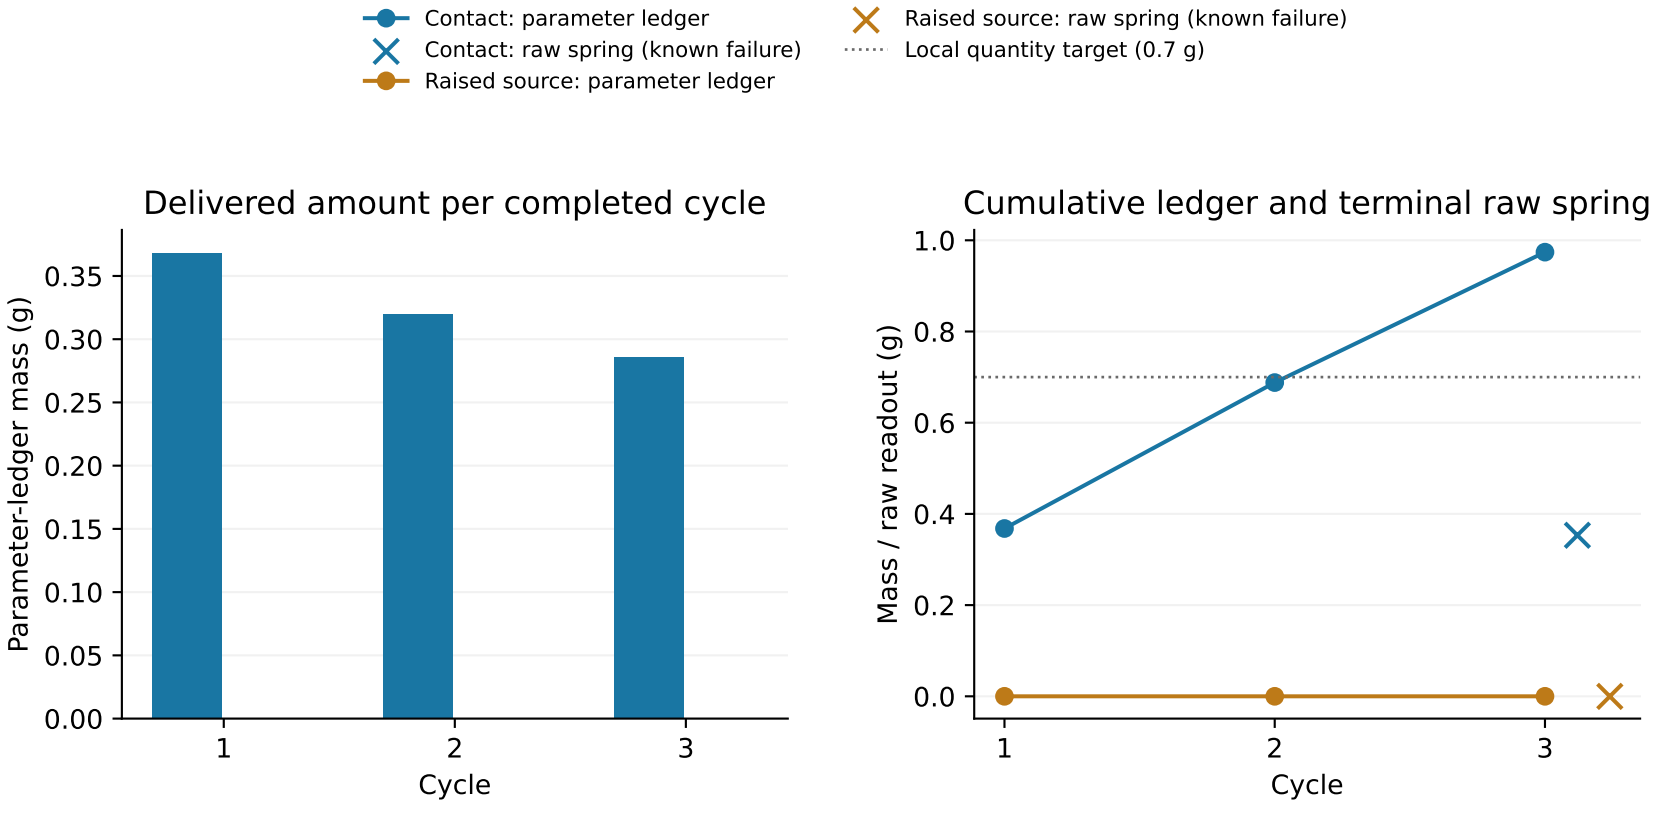

One positive trial and its paired physical intervention; cycles are dependent, not independent repeats.

Parameter ledger is not a scale measurement. Frozen spring readout remains unqualified; N10 F acceptance is false.