The release command still grips the reservoir

Complete-scene R4 fails at 96 s · original 600 Hz trajectory and contacts · no new simulation

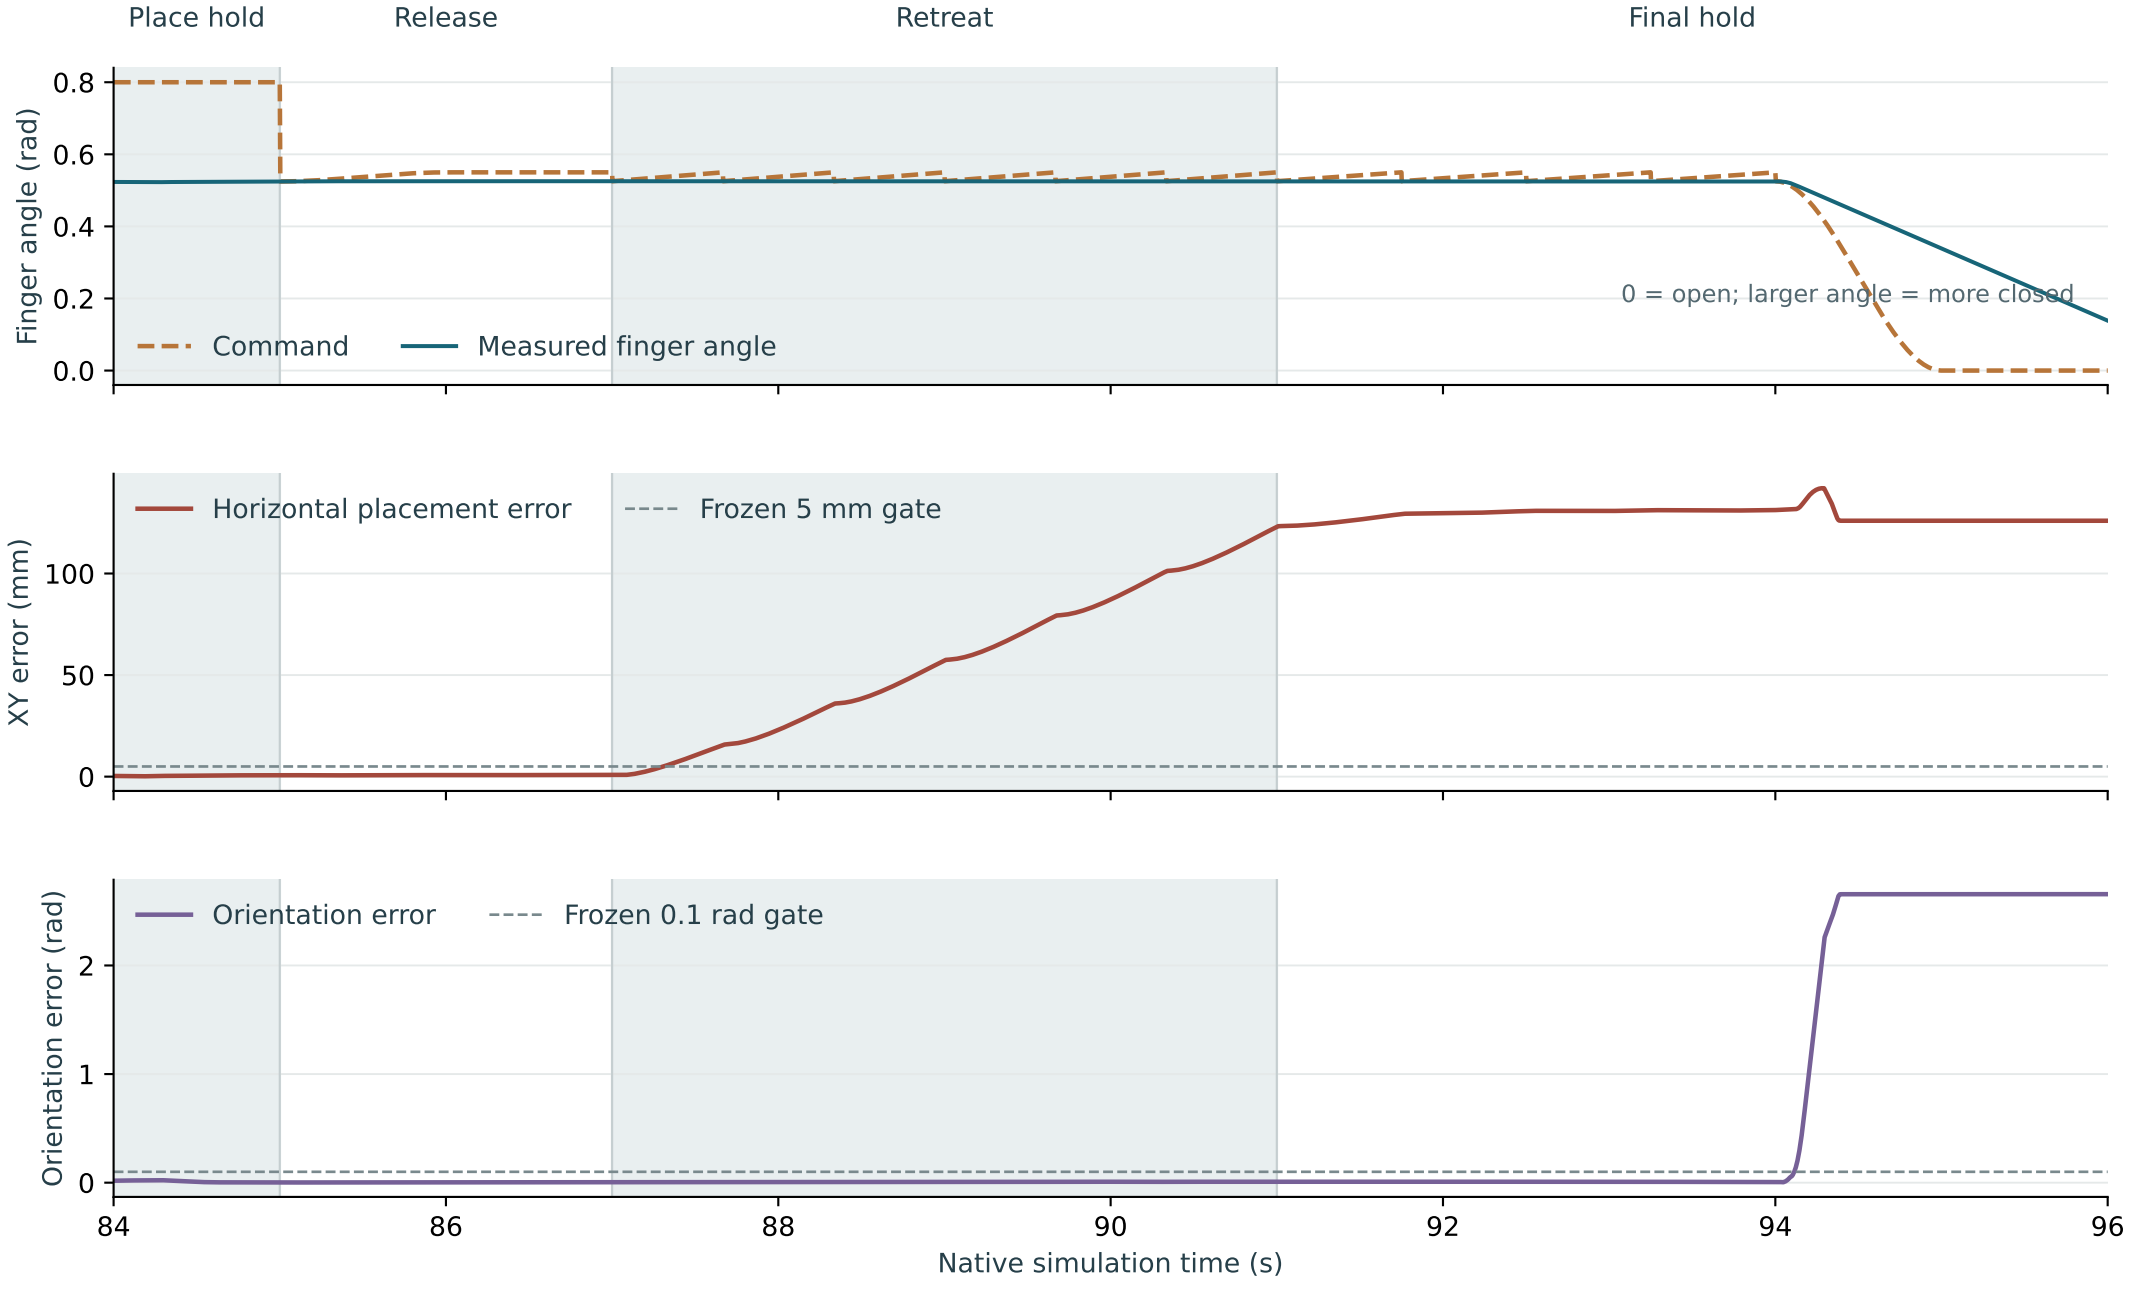

Both fingers remain in contact during all 1,200 release steps and 2,400 retreat steps.
Opening begins during final hold, after 94 s; the displaced vessel tips and the full trial fails.