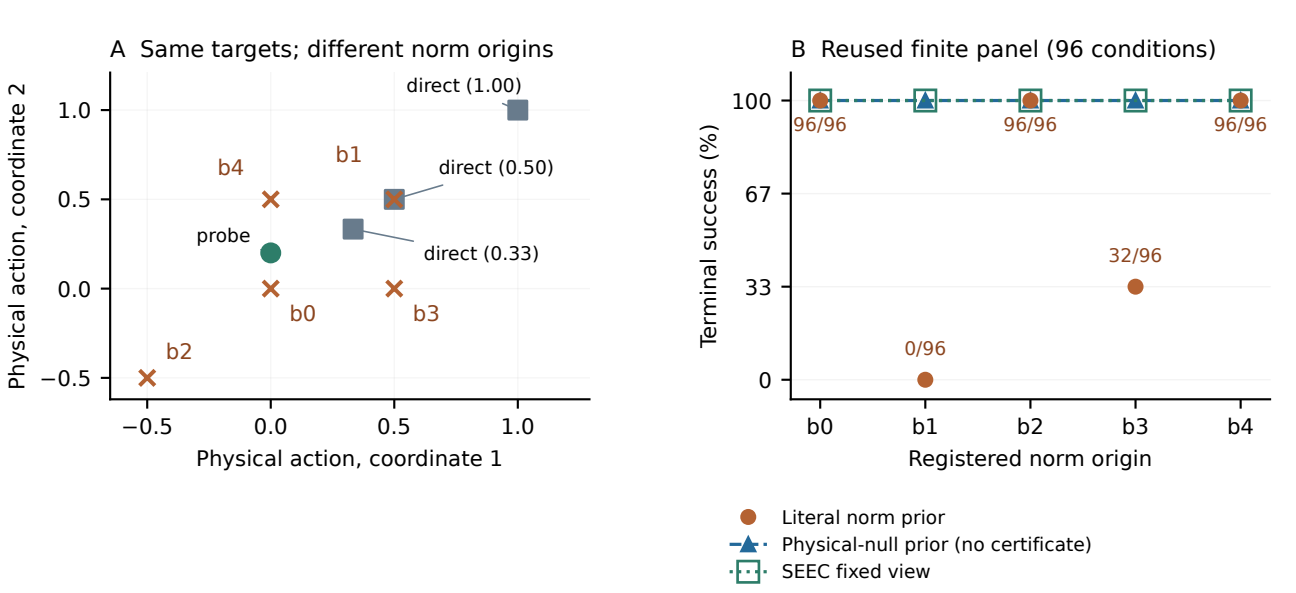
A Same targets; different norm origins
direct (1.00)
b4
b1
direct (0.50)
probe
direct (0.33)
b0
b3
b2
Physical action, coordinate 2
Physical action, coordinate 1
1.0
0.5
0.0
−0.5
−0.5
0.0
0.5
1.0
B Reused finite panel (96 conditions)
Terminal success (%)
100
67
33
0
96/96
96/96
96/96
32/96
0/96
b0
b1
b2
b3
b4
Registered norm origin
Literal norm prior
Physical-null prior (no certificate)
SEEC fixed view