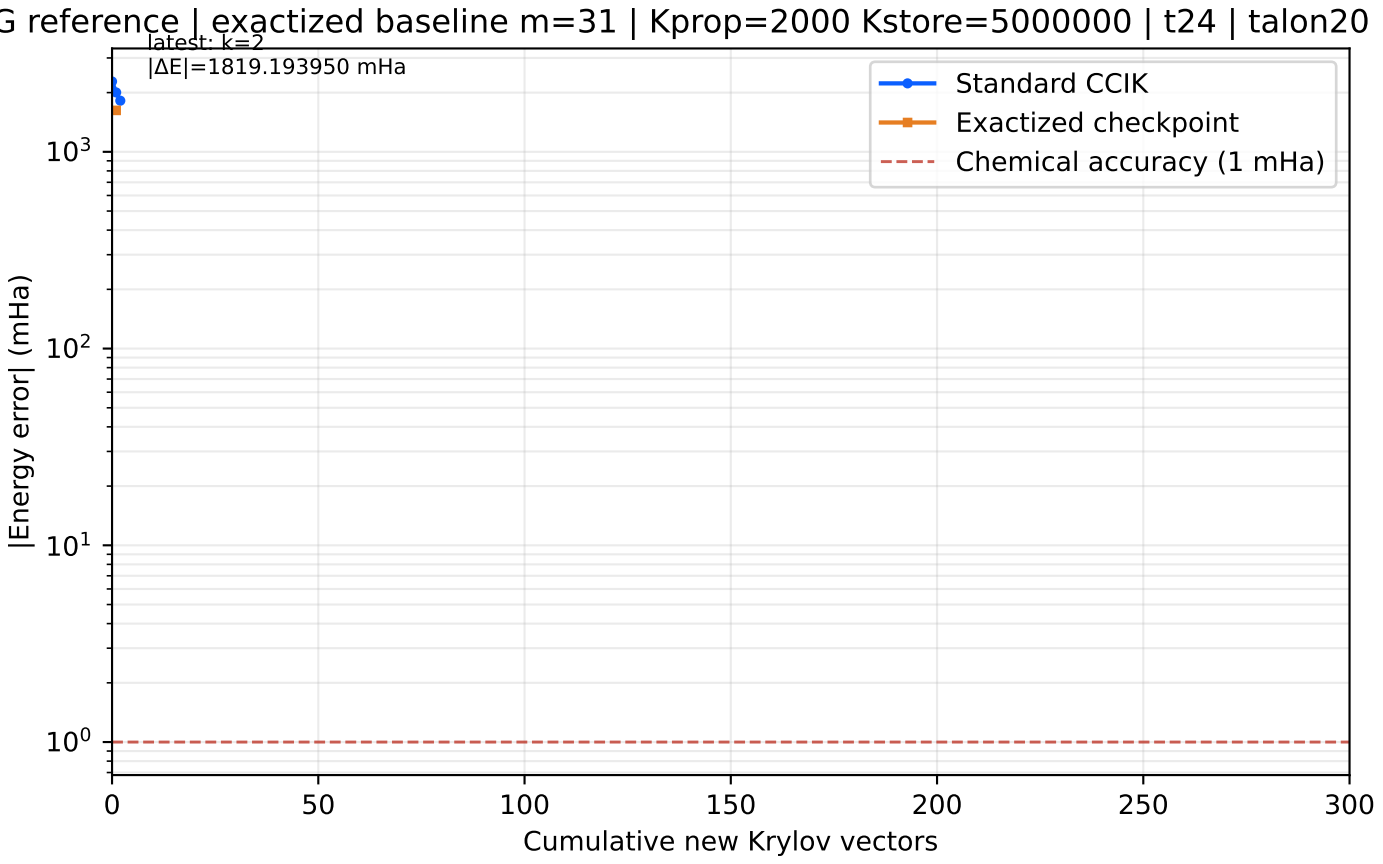
G reference | exactized baseline m=31 | Kprop=2000 Kstore=5000000 | t24 | talon20
latest: k=2
|ΔE|=1819.193950 mHa
Standard CCIK
Exactized checkpoint
Chemical accuracy (1 mHa)
|Energy error| (mHa)
10^3
10^2
10^1
10^0
0
50
100
150
200
250
300
Cumulative new Krylov vectors